

AT MICROFICHE REFERENCE LIBRARY

A project of Volunteers in Asia

The Passive Solar Energy Book

by: Edward Mazria

Published by:

Rodale Press, Inc.
33 East Minor Street
Emmaus, PA 18049 USA

Paper copies are \$12.95.


Available from:

Rodale Press, Inc.
33 East Minor Street
Emmaus, PA 18049 USA

Reproduced by permission of the Rodale Press.

Reproduction of this microfiche document in any form is subject to the same restrictions as those of the original document.

THE PASSIVE SOLAR ENERGY BOOK



A complete guide to passive solar home,
greenhouse and building design

BY EDWARD MAZRIA

\$12.95
In Canada \$14.95

This book contains all of the information necessary to successfully design an effective passive solar heated building.

It is:

- A Primer — in the fundamental concepts of solar energy, heat theory and thermal comfort.
- A Source Book — with descriptions, photographs, illustrations and performance data of many passive solar heated buildings.
- A Workbook — containing a step-by-step process for designing and sizing passive solar heating systems; methods for calculating building heat loss, heat gain, system performance and cost effectiveness; and sun charts and graphic tools for designing shading devices, determining the extent of solar obstructions and calculating solar radiation values.

Edward Mazria is an architect, a member of the American Institute of Architects and president of Edward Mazria and Associates, Inc., in Albuquerque, New Mexico. The author of many solar publications, he has taught courses in architectural design in solar energy and has conducted many passive solar workshops throughout the country for architects, builders and owner-builders.

Passive solar energy systems collect and transport heat by natural means. In essence, the building structure or some element of it is the system. There are no separate collectors, storage units or mechanical equipment. Passive systems are simple in concept and use, have few moving parts and are built using common construction materials. The most striking difference between passive and active systems is that one operates on the energy available in its immediate environment and the other imports energy to make the system work.

Now we're getting serious. Passive techniques are beyond the experimental stage. We know they work, and in different climates. But we have not known with confidence how to calibrate them for individual applications, site by site, house by house. But the rigors of modern computer analysis are now giving us real answers; and Ed Mazria's book gives a wonderfully clear presentation of both the soul of passive architecture, and the numbers that can make it work for you.

Fred Nelson, *Sunset*

The best book we have seen on passive solar buildings because it makes the fundamental reasons why such buildings are highly desirable so crystal clear. And, once you really understand the fundamentals of any subject, the rest is easy.

William B. Edmondson, Editor, *Solar Energy Digest*

Reverses the recent, unfortunate trend toward high-priced passive solar books full of prettified, egotistical architectural eyewash, yet devoid of the needed revelation of technical secrets that keep any designer employed. Ed tells all and does it without oppressive jargon establishing a new and higher standard of excellence for future writers in this overcrowded field.

Lee Johnson, Editor, *RAIN: Journal of Appropriate Technology*

cover design and illustrations by Russel Ball

0-87857-237-6

THE PASSIVE SOLAR ENERGY BOOK

A complete guide to passive solar home,
greenhouse and building design.

BY EDWARD MAZRIA



Rodale Press, Emmaus, Pa.

Copyright © 1979 by Edward Mazria

All rights reserved. No part of this publication may be reproduced or transmitted in any form or by any means, electronic or mechanical, including photocopy, recording, or any information storage and retrieval system without the written permission of the publisher.

Book Design by T. A. Lepley

Printed in the United States of America on recycled paper, containing a high percentage of de-inked fiber.

Library of Congress Cataloging in Publication Data

Mazria, Edward.

The passive solar energy book.

Bibliography: p.

Includes index.

1. Solar energy. 2. Solar heating. I. Title.

TJ810.M32 1979b 696 78-21656

ISBN 0-87857-260-0 (Hardcover)

ISBN 0-87857-237-6 (Paperback)

8 10 9 hardcover
12 14 16 18 20 19 17 15 13 11 paperback

For JOSEPH and SARA

Table of Contents

ACKNOWLEDGMENTS		x
ABOUT THE ILLUSTRATOR		xii
USING THE BOOK	I. What the Book Is About	1
	The Contents	3
	The Format	4
NATURAL PROCESSES	II. The Sun and Earth—<i>the origin of the sun, solar radiation, radiation and the earth's atmosphere</i>	5
	Radiation and Matter— <i>solar intensity on a surface, reflection, transmission and absorption</i>	13
	Characteristics of Heat— <i>heat transfer, heat storage</i>	20
PASSIVE SOLAR SYSTEMS	III. Approaches to Solar Heating	28
	Direct Gain	29
	Indirect Gain— <i>masonry thermal storage wall, water thermal storage wall, attached greenhouse, roof ponds</i>	43
	Isolated Gain	59
	Advantages and Disadvantages of Passive Solar Systems	62
DESIGN PATTERNS	IV. Using the Patterns	66
	The Patterns	
	1. BUILDING LOCATION	72
	2. BUILDING SHAPE AND ORIENTATION	78
	3. NORTH SIDE	85
	4. LOCATION OF INDOOR SPACES	90
	5. PROTECTED ENTRANCE	93
		vii

The Passive Solar Energy Book

	6. WINDOW LOCATION	100
	7. CHOOSING THE SYSTEM	105
	8. APPROPRIATE MATERIALS	115
	Direct Gain Systems	
	9. SOLAR WINDOWS	118
	10. CLERESTORIES AND SKYLIGHTS	124
	11. MASONRY HEAT STORAGE	133
	12. INTERIOR WATER WALL	144
	Thermal Storage Wall Systems	
	13. SIZING THE WALL	152
	14. WALL DETAILS	158
	Attached Greenhouse Systems	
	15. SIZING THE GREENHOUSE	172
	16. GREENHOUSE CONNECTION	180
	Roof Pond Systems	
	by Kenneth L. Haggard and Polly Cooper	
	17. SIZING THE ROOF POND	186
	18. ROOF POND DETAILS	193
	Greenhouse	
	19. SOUTH-FACING GREENHOUSE	200
	20. GREENHOUSE DETAILS	208
	21. COMBINING SYSTEMS	219
	22. CLOUDY DAY STORAGE	225
	23. MOVABLE INSULATION	230
	24. REFLECTORS	240
	25. SHADING DEVICES	249
	26. INSULATION ON THE OUTSIDE	258
	27. SUMMER COOLING	262
V.	THE TOOLS	
	The Sun Charts— <i>how the sun works, the cylindrical sun chart, sun charts, sun time, plotting the skyline</i>	267
	The Solar Radiation Calculator— <i>hourly radiation, totals, daily radiation totals, solar intensity masks</i>	293
	The Shading Calculator— <i>plotting the shading mask</i>	301

Table of Contents

APPENDICES	1. Performance Calculations	309
	2. Percentage of Solar Radiation Absorbed by Various Surfaces	345
	3. Average Daily Solar Radiation	346
	4. Average Daily Temperatures (°F) in North America	360
	5. Degree-Days	372
	6. Clear-Day Solar Heat Gain	402
	7. Percentage of Enhancement of Solar Heat Gain with Specular Reflectors	406
	8. Conversion Tables	408
GLOSSARY		411
BIBLIOGRAPHY		418
PHOTOGRAPH ACKNOWLEDGMENTS		422
PHOTOGRAPH CREDITS		426
INDEX		427

Acknowledgments

Four years ago, when I began writing this book, information concerning passive solar heating was virtually nonexistent. During this time many friends have worked with me to generate portions of the information contained in the text. Their work and assistance made the scope of this book possible. I want to especially thank:

Steve Baker who worked closely with me for two years to generate data for the formulation of the patterns and calculation procedures. His insight and knowledge of the subject add a dimension to the book that would otherwise be absent. I am grateful not only for his contribution to the book, but for his support and friendship during its production.

Robert Young who spent numerous hours assembling the Appendix, producing the technical drawings and photographing many of the buildings presented in the book.

Raymond Harrigan who gave generously of his time, at the conception of the book, to answer my seemingly endless questions about solar energy and heat transfer.

Russ Ball for his stunning illustrations and friendship.

Marcia Mazria for her loving support, humor and endless patience.

David Winitsky for brilliantly conceiving the explanation of the sun charts and radiation calculators.

Francis Wessling for generating the computer model that led to the formulation of the patterns and calculation procedures.

Carol Glasheim for coming in out of the sun long enough to edit the text.

Acknowledgments

Ken Haggard and **Polly Cooper** for their patterns on roof ponds.

Tom Gettings for his beautiful photographs.

Carol Stoner for her early and continuing encouragement.

Loretta Harrison for being there when the going was rough.

And to **MATRIX** for providing a supportive environment.

The continuing support of many friends, their confidence in me and patience made it all possible: Joyce Brown, Bonnie Katz, Aaron Mazria, Gary Goldberg, Dianna Meehan, David Tawil, Jim Greenan, Larry Keller, Charlene Cerny, Robert Strell, Min Kantrowitz, Barbara Levy, J. Douglass and Sara Balcomb, Wayne and Susan Nichols, Rosalie Harris, Carol Bickleman, Boyd Babbit, John Reynolds, Tim Zanes, Peter Calthorpe, Jim Van Duyn, Eric Hoff and Richard Nordhaus.

The use of patterns in the text is modeled after "The Pattern Language" developed by Christopher Alexander, Center for Environmental Structure, Berkeley, California.

About the Illustrator

Russel Ball is well known for his commercial design, illustrations and fine art. He has been art director of three major advertising agencies and his prints and paintings are shown in galleries throughout the United States. Since the illustrations for this book had to present technical information clearly and precisely, as well as be visually appealing, the illustrator and author have worked closely together throughout the four years of the book's development.

I Using the Book

What the Book Is About

This book supports a new attitude towards architecture. It describes a way of building that is strongly related to site, climate, local building materials and the sun. It implies a special relationship to natural processes that offers the potential for an inexhaustible supply of vital energy. This attitude is obviously not entirely new, since much vernacular architecture has always reflected a strong relationship to daily and seasonal climatic and solar variations. In recent years, however, relying on the misconception of an infinite and inexpensive energy supply, people have chosen to abandon these long-standing considerations.

Architecture in the twentieth century has been characterized by an emphasis on technology to the exclusion of other values. In the built environment this concern manifests itself in the materials we build with, such as plastics and synthetics. There is an existing dependence on mechanical control of the indoor environment rather than exploitation of climatic and other natural processes to satisfy our comfort requirements. In a sense, we have become prisoners of complicated mechanical systems, since windows must be inoperable and sealed in order for these systems to work. A minor power or equipment failure can make these buildings uninhabitable. Today, little attention is paid to the unique character and variation of local climate and building materials. One can now see essentially the same type building from coast to coast.

Today, there is a strong, new interest in passive solar heating and cooling systems because they simplify rather than complicate life. Passive systems are simple in concept and use, have few moving parts and require little or no maintenance. Also, these systems do not generate thermal pollution, since they

The Passive Solar Energy Book

require no external energy input and produce no physical by-products or waste. Since solar energy is conveniently distributed to all parts of the globe, expensive transportation and distribution networks of energy are also eliminated.

Since a building or some element of it is the passive system, the application of passive solar energy must be included in every step of a building's design. Whereas conventional or active solar-heating systems can be somewhat independent of the conceptual organization of a building, it is extremely difficult to add a passive system to a building once it has been designed.

To date, architects, builders and owner-builders have made little use of the information available concerning passive systems because it is too technical, cumbersome and time-consuming in application. To be useful, information must lead to the necessary degree of accuracy at each stage of a building's design. The degree of accuracy increases as the design moves from the schematic stage through detailed drawings and models and finally to construction documents. In the early stages, it makes no sense to perform extensive heat loss and gain calculations since the building will change many times before a design is complete.

The basic purpose of this book is to make technical information accessible to all people. The text is written in such a way as to facilitate this. The various elements that make up a passively heated building are explained separately and ordered in a sequence that makes them easy to apply to a building's design. The illustrations that accompany the text are intended to convey very technical information in a simple and clear format.

This book deliberately does not use professional architectural and engineering graphic symbols to represent various materials and concepts, but instead, illustrates them with a degree of realism. The photographs show existing applications of both entire systems as well as specific details.

To allow for change resulting from new experiments and observation, the book is structured in a way that permits the reader to improve and add information as more is learned about passive systems. Since each element of a passive system is treated separately in the text, the retrieval of specific pieces of information is made easy.

The information in this book can be used at all locations between 28° and 56° north latitude. Also, this information can be adapted to the same latitudes in the Southern Hemisphere by simply reversing the seasons and reversing true

south with true north. Thus, for example, June 21 becomes the shortest day of the year and December 21 the longest. Winter is in June, July and August, and the sun is low in the northern sky rather than in the southern sky.

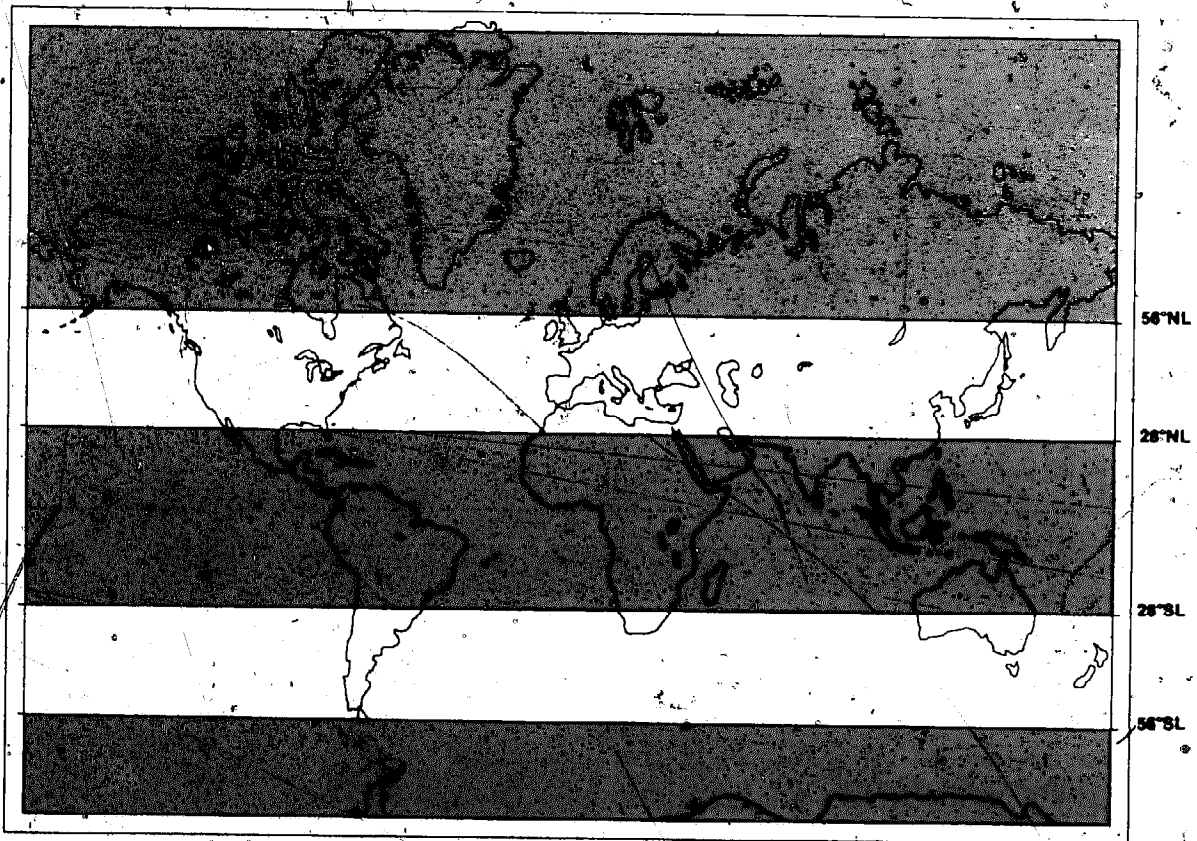


Fig. I-1: Geographical regions covered in this book.

The Contents

The Passive Solar Energy Book contains most of the information you will need to successfully design a passive solar building. Its contents are ordered in sequence from general solar theory and applications to system design and performance calculations. Chapter 2 contains the fundamental concepts of solar energy, heat theory and thermal comfort. It provides the foundation for

The Passive Solar Energy Book

understanding the information given in the following chapters. Chapter 3 presents the various types of passive systems. Existing architectural examples of each system are included, along with performance data, to give you an indication of their applicability to a wide range of climates and locations. In the chapter on design patterns, chapter 4, a method for designing a passive solar heated building is provided. The intent here is to lead you through a process that allows you to choose and size a system suited to your particular needs. Once a building and system has been designed, its performance can be calculated and then adjusted, if necessary. The graphic tools that follow in chapter 5 concern the sun's position and movement across the skydome, solar intensity for different orientations, obstructions to solar collection and the design of fixed or movable shading devices. And finally, in the Appendices, data necessary to accurately design and calculate a passive system is presented. Before you begin reading this book, however, keep in mind that good design is the integration of many concerns of which solar energy is but one.

The Format

The *Passive Solar Energy Book* covers a wide range of passive solar concepts and information. In order to understand the details of a particular passive system, it is important to first understand the fundamental principles behind all the systems. To help you grasp these fundamentals, chapters 2 through 4 are written in such a way that the sentences in bold type summarize the text that follows. By themselves, these sentences, when read in sequence, form a continuous text. To read the book, first read only the bold type, consulting the text to clarify and embellish particular points of information. This will take you only an hour or so. Once you have read the book in this way, you can go back and read the entire text to acquire a full understanding of the details.

II

Natural Processes

The Sun and Earth

The Origin of the Sun

At present, the most widely accepted theory for the origin of the sun is that it was formed from a cloud of gas composed chiefly of hydrogen.

The first stage in the sun's development was the gravitational contraction of hydrogen particles. At some point, when the gravitational contraction of the cloud caused violent collisions between hydrogen particles, enough heat was generated to fuse the hydrogen nuclei and release energy. The fusion or union of hydrogen nuclei produced helium. The mass of this new helium atom was less than that of the original hydrogen atoms, since mass was converted into energy in the fusion process. The resulting release of energy opposed any further gravitational contraction of hydrogen. The first fusion reaction in the cloud was the birth of the sun.

The energy output of the sun requires the burning or conversion of mass into energy at the rate of 4.2 million tons per second. Assuming that the sun has been in the hydrogen-burning stage for 6 billion years, this seems at first glance like a great loss. A closer look shows that the total mass of the sun is 2,200,000,000,000,000,000,000,000 tons, so that the sun loses only 0.000000000000000002% of its mass each second. At this rate, the sun can be expected to continue radiating energy for billions of years to come.

Solar Radiation

The thermonuclear fusions at the core of the sun release energy in the form of high-frequency electromagnetic radiation. The theory which currently is most

The Passive Solar Energy Book

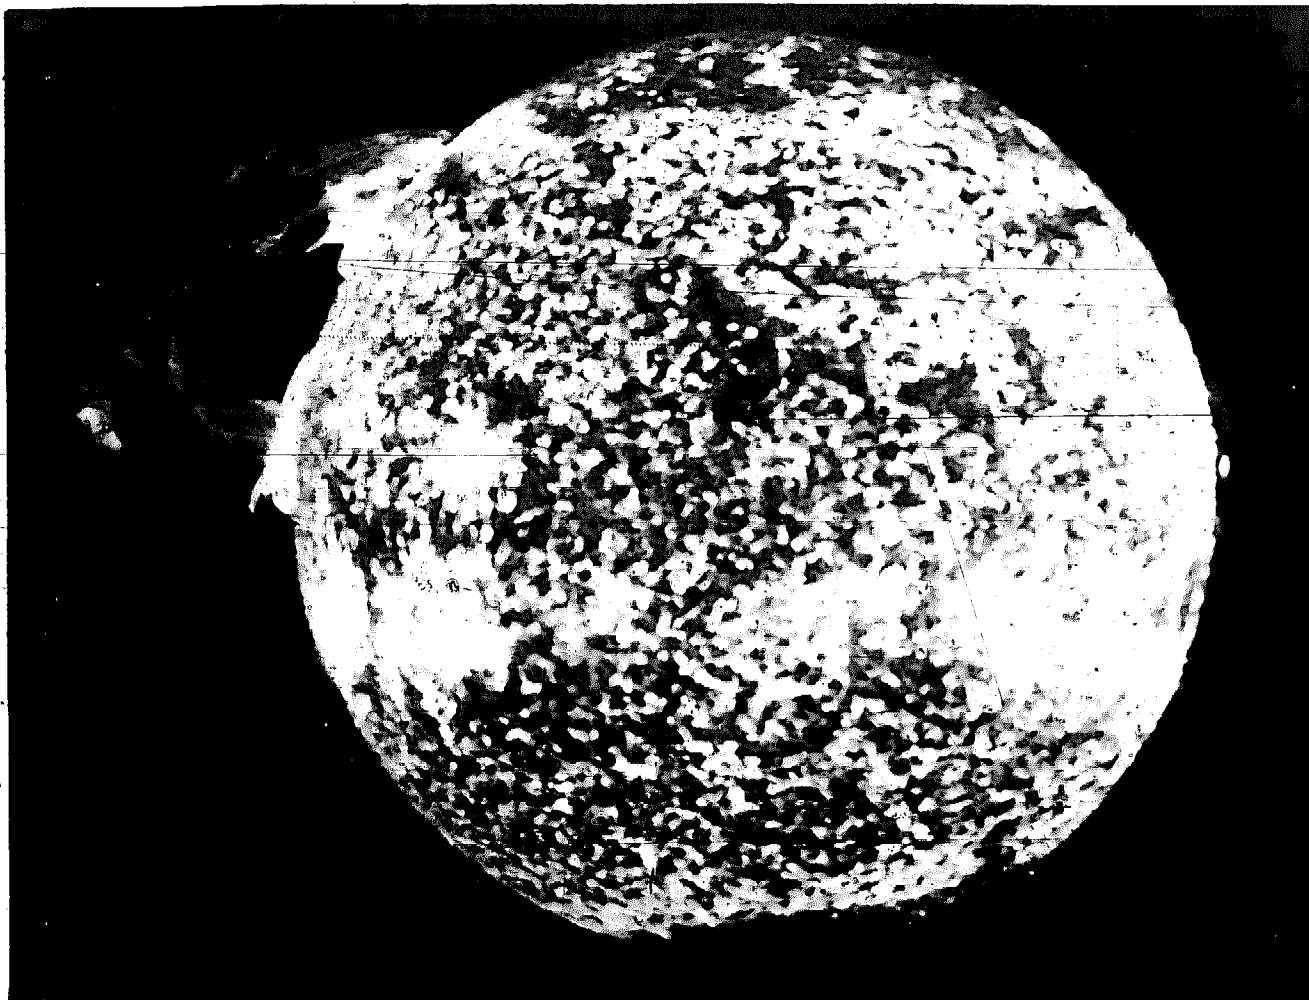


Photo II-1: The sun.

accepted states that electromagnetic radiation can be represented as either a combination of rapidly alternating electric and magnetic fields (or waves) or energy particles called photons. This definition of radiation is difficult to understand and visualize, but the theory behind it allows us to describe and predict how radiation will act. Radiant energy is produced at the solar core at temperatures estimated between 18,000,000° to 25,000,000° Fahrenheit (10,000,000° to 14,000,000° Celsius). The average temperature at the surface of the sun is only 10,000°F (5,500°C).

Natural Processes

The energy traveling through space is made up of radiation in different wavelengths. Electromagnetic radiation is classified according to its wavelength—the more energetic the radiation, the shorter its wavelength. Radiation is emitted from the surface of the sun in all wavelengths, from long wavelength radio waves to very short X rays and gamma rays.

Although the sun radiates energy in many wavelengths, it radiates proportionally more energy in certain wavelengths.

At an average temperature of 10,000°F, the sun radiates most of its energy at very high frequencies (short wavelengths). Visible light makes up 46% of the total energy emitted from the sun. Visible light, or the wavelength to which the human eye is sensitive, extends from 0.35 to 0.75 microns (the unit used to measure wavelength is the micron or micrometer which is equal to a millionth of a meter or .00004 of an inch). It is made up of all the familiar colors from the shorter wavelength violet (0.35 microns) to blue, green, yellow, orange and the longer wavelength red (0.75 microns). Forty-nine percent of the radiation emitted from the sun is in the infrared (below red) band. Infrared radiation, which we experience as heat, is radiation at wavelengths longer than the red end of the visible spectrum (greater than 0.75 microns). The remaining portion of the sun's radiation is emitted in the ultra-violet band at wavelengths shorter than the violet end of the visible spectrum (smaller than 0.35 microns). All electromagnetic radiation leaving the sun travels through space at a uniform rate, in the form of diverging rays, traveling at the speed of light which is 186,280 miles a second (300,000 kilometers a second). The earth a small body compared to the sun, intercepts such a small part of the sun's radiant output that the sun's rays are assumed to be a parallel beam. At a distance of 93 million miles from the sun, the earth intercepts approximately 2 billionths of the sun's radiant output or the equivalent of about 35,000 times the total energy used by all people in one year.

The Solar Constant, which defines the amount of radiation or heat energy reaching the outside of the earth's atmosphere, is 429.2 Btu's. per square foot per hour (1.94 calories per square centimeter per hour). In other words, if we located a square foot of material just outside the earth's atmosphere and perpendicular to the sun's rays, it would intercept 429.2 Btu's of energy each hour. There are slight variations in the numerical value of the Solar Constant because, while the earth's orbit around the sun is almost perfectly circular, within this orbit the sun is slightly off center. This difference is important to scientists doing detailed calculations out in space, but on the earth's surface the variation is so slight it has little effect on the solar heating of buildings.

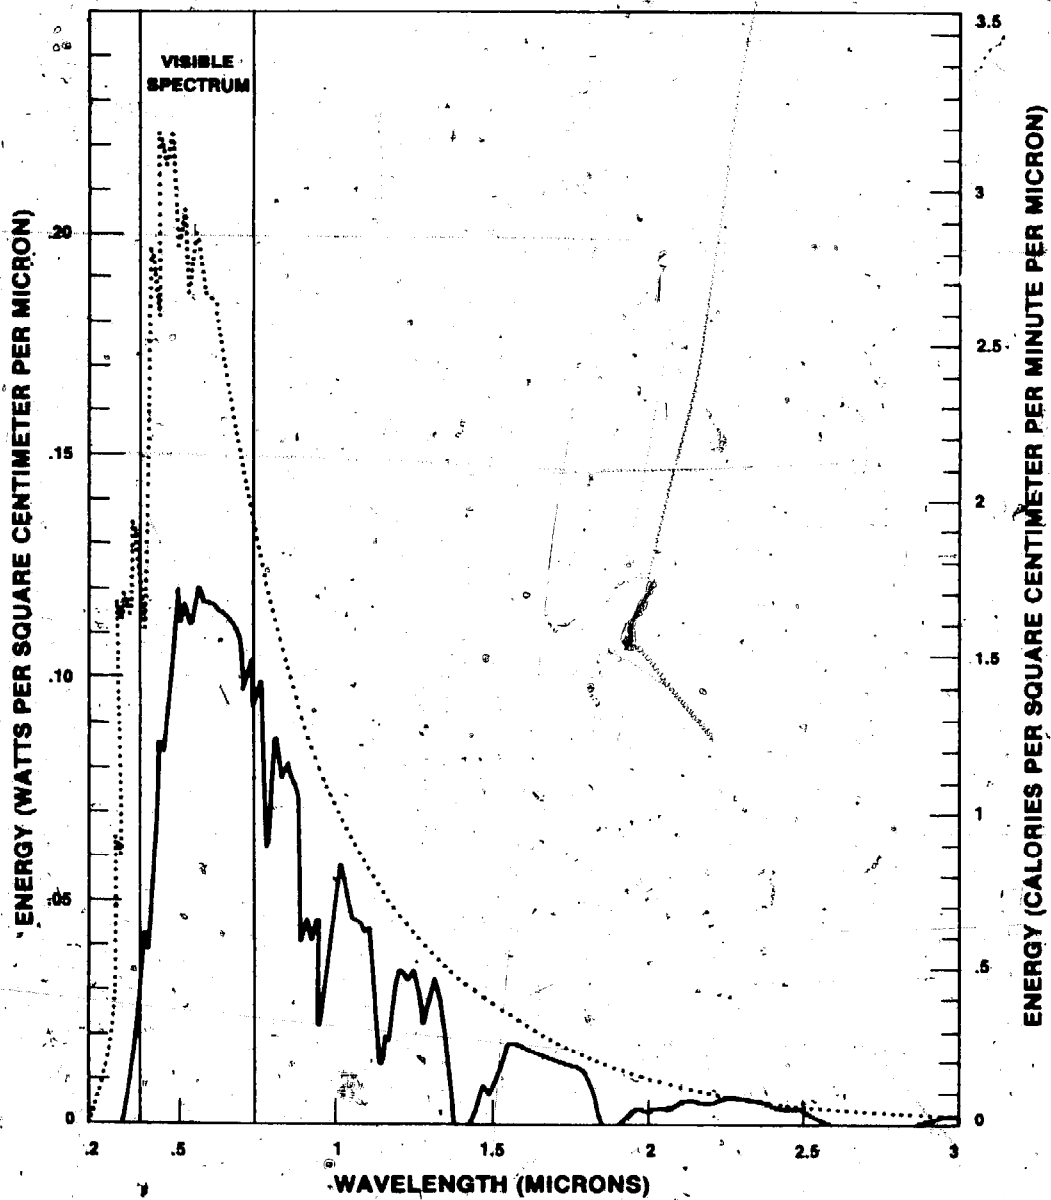


Fig. II-1: Wavelength characteristics of solar radiation are given for the top of the atmosphere (dotted) and at the earth's surface.

Radiation and the Earth's Atmosphere

Of all the solar radiation intercepted by the earth (including the atmosphere), as much as 35% of it is reflected back into space. The reflection of energy

Natural Processes

from an object is called the *albedo* of the object. The albedo of the earth taken as a whole is 35 to 40%. Most of this energy is reflected back into space from clouds and atmospheric dust, but some reflection occurs at the surface of the earth from surfaces such as water, snow and sand.

Part of the remaining portion of solar radiation, while passing through the earth's atmosphere, is scattered in all directions as it interacts with air molecules and dust particles. As a result, some of this scattered or "diffused" radiation comes to earth from all parts of the skydome. Scattered radiation, primarily in the blue portion of the visible spectrum, is responsible for the blue color of the clear sky.

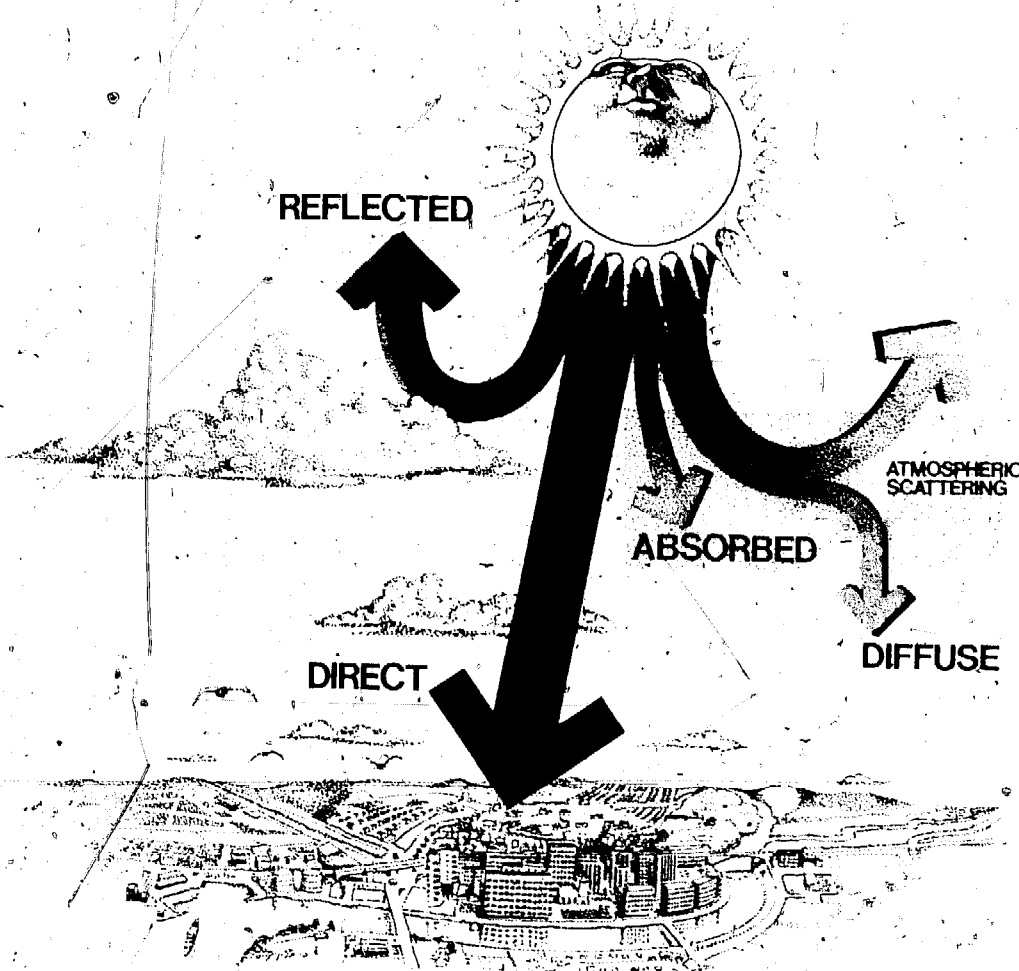


Fig. II-2: What happens to solar radiation intercepted by the earth's atmosphere.

The Passive Solar Energy Book

While clouds and dust scatter and reflect approximately a third of the incoming energy, the water vapor, carbon dioxide and ozone in the atmosphere absorb another 10 to 15%. In the upper atmosphere, ozone removes virtually all the high-frequency ultra-violet radiation reaching the earth's surface. This is essential since ultra-violet radiation can cause skin burn and eye damage and it can be lethal even in moderate doses. Water vapor and carbon dioxide in the lower atmosphere absorb portions of the radiation, primarily in the infrared band.

Besides the composition of the atmosphere, the most important factor in determining the amount of solar radiation reaching the earth's surface is the length of atmosphere the radiation must pass through. During the day when the sun is directly overhead, radiation travels through the least amount of

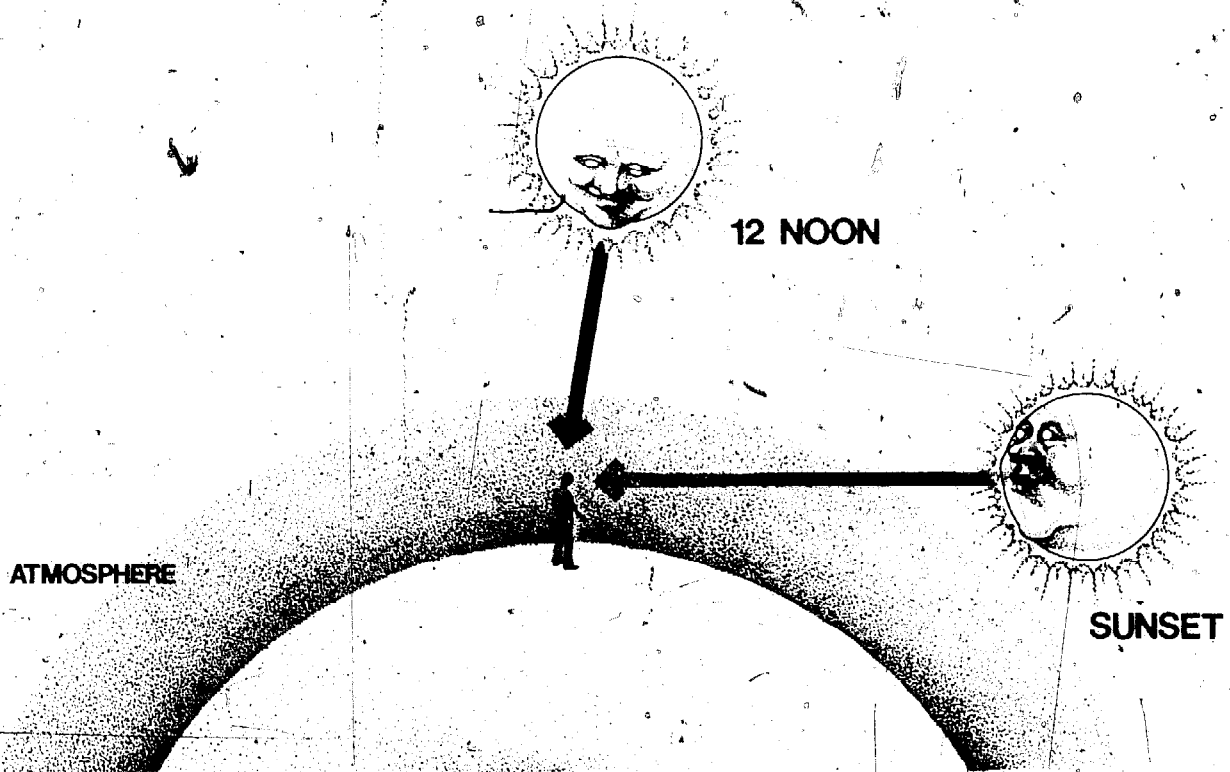


Fig. II-3: Air mass determines the intensity of direct sunlight.

atmosphere en route to the earth's surface. As the sun moves closer to the horizon (sunset), the path of the radiation through the atmosphere lengthens. The more atmosphere or air mass that radiation must pass through, the less its energy content will be due to the increased absorption and scattering of the radiation. At sunset the radiation content of the solar beam is sufficiently low to enable us to glance directly at the sun. As the height above sea level increases, the amount of atmosphere that solar radiation must pass through decreases. Therefore, the energy content of solar radiation at high altitude locations will be somewhat higher.

Because of the earth's tilt and rotation, the length of atmosphere that solar radiation passes through will vary with the time of day and month of the year. The path of the earth around the sun is a slight ellipse, barely distinguishable from a circle. As the earth orbits the sun, it rotates once a day on an axis that extends from the North Pole to the South Pole. This axis is tilted $23\frac{1}{2}^{\circ}$ (exactly 23.47°) from a vertical to the plane of the earth's orbit around the sun.

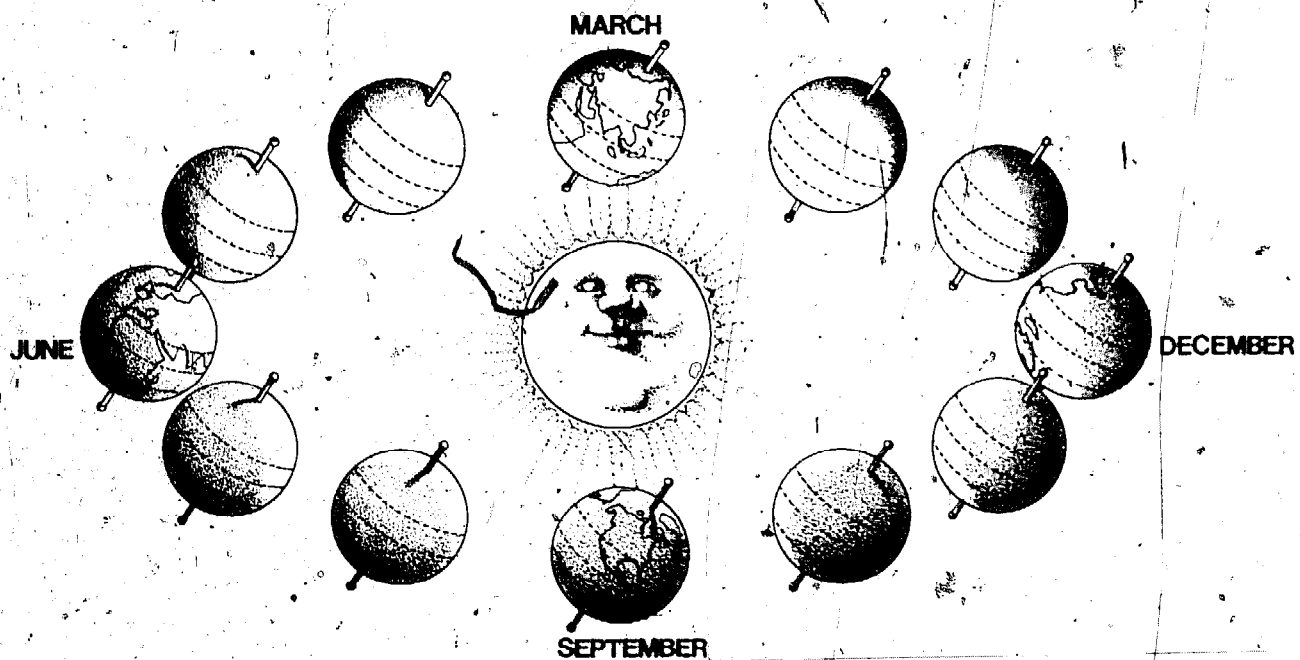


Fig. II-4: The earth's tilt remains constant.

The Passive Solar Energy Book

The earth's tilt is responsible for the seasonal variations in weather. The tilt is constant as we orbit the sun, so that in the summer months the Northern Hemisphere is slanted toward the sun. During this time the Northern Hemisphere receives more hours of sunshine and the incoming radiation is closer to perpendicular to the earth's surface. During the winter months the situation is reversed, and the Northern Hemisphere receives fewer hours of sunshine, at a lower angle, while summer prevails in the Southern Hemisphere.

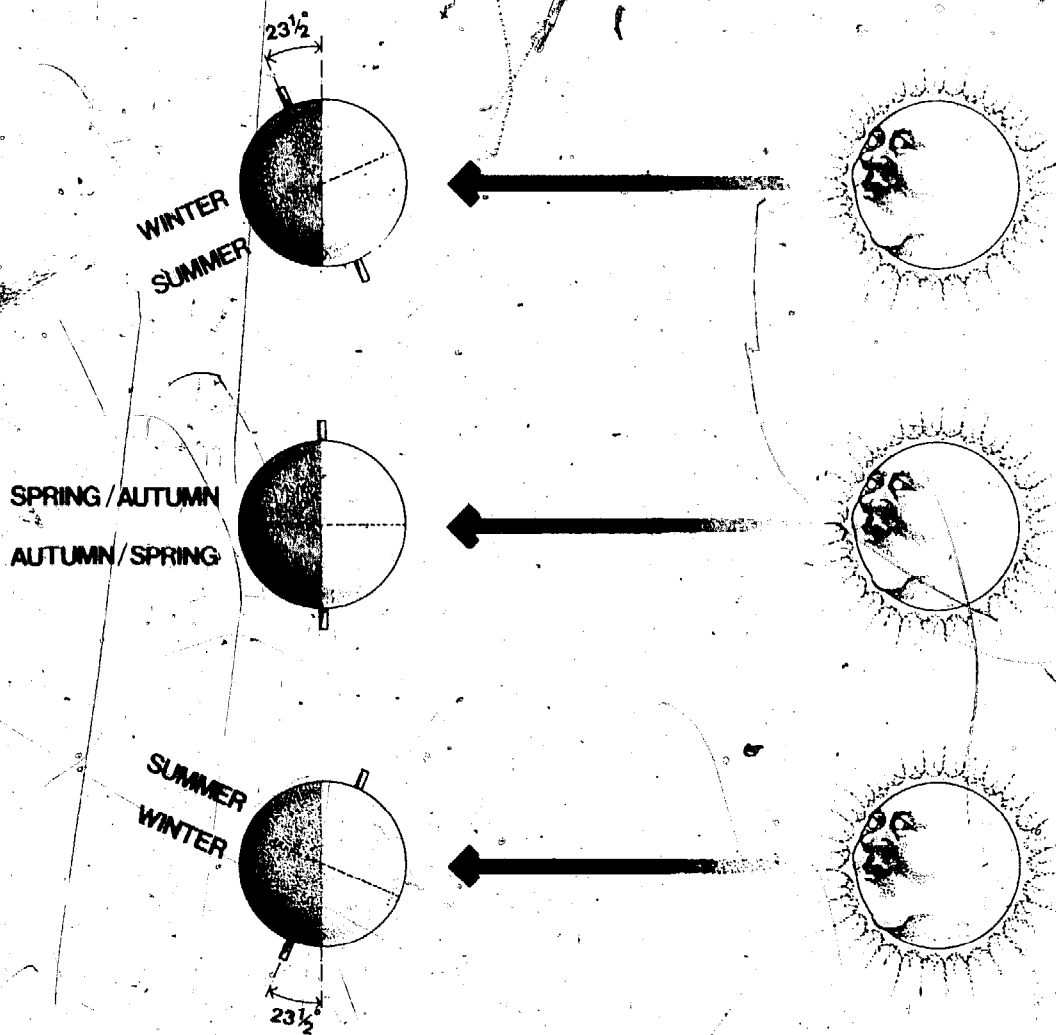


Fig. II-5: The tilt creates the seasons.

Radiation and Matter

Solar Intensity on a Surface

The angle the sun's rays make with a surface will determine how much energy that surface receives. Since solar radiation comes to earth in essentially parallel rays, a surface that is perpendicular to those rays will intercept the greatest amount of energy. As the sun's rays move away from being perpendicular, the energy intercepted by a surface will decrease.

Perhaps the best way to imagine this is to think of the parallel rays of the sun as a handful of pencils held with their points touching a tabletop. The dots made by the points represent units of energy. When the pencils are held perpendicular to the tabletop, the dots are as compactly arranged as possible: energy density per square inch is at a maximum. As the pencils are inclined toward the parallel, the dots begin to cover larger and larger areas: energy density per square inch is decreasing.

Barbara Francis*

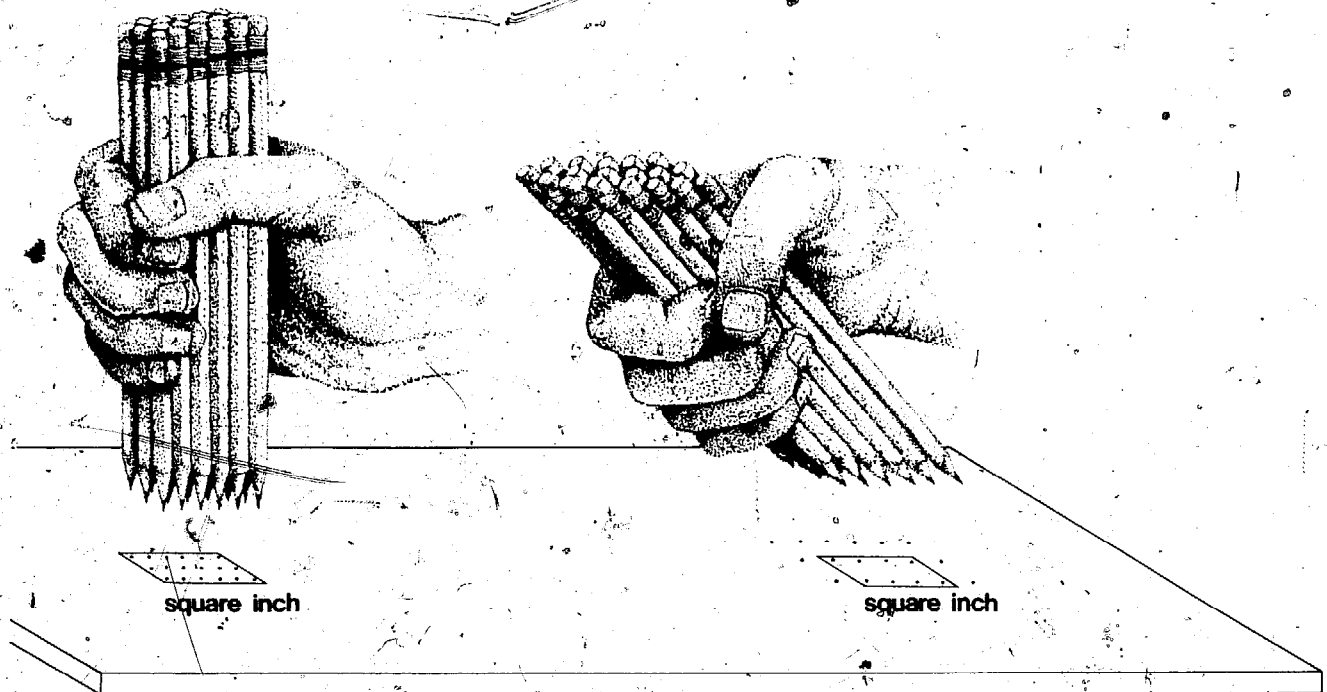


Fig. II-6: Energy density is determined by the angle of incidence.


*Master's Thesis of Barbara Francis, University of New Mexico, 1976.

The Passive Solar Energy Book

However, a surface can be facing as much as 25° away from perpendicular to the sun and still intercept over 90% of the direct radiation. The angle that the rays of the sun make with a line perpendicular to a surface (also called the angle of incidence) will determine the percentage of direct sunshine intercepted by that surface. Table II-1 lists the percentage of sunshine intercepted by a surface for different incident angles.

Table II-1 Percentage of Radiation Striking a Surface at Given Incident Angles

Incident Angle (degrees)	Solar Intercepted (percent)
0	100.0
5	99.6
10	98.5
15	96.5
20	94.0
25	90.6
30	86.6
35	81.9
40	76.6
45	70.7
50	64.3
55	57.4
60	50.0
65	42.3
70	34.2
75	25.8
80	17.4
85	8.7
90	0.0

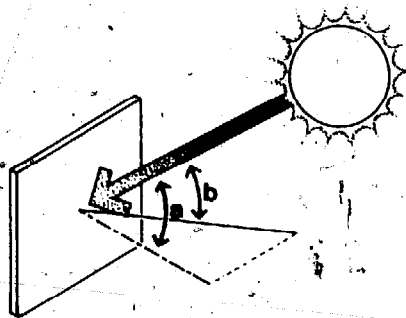

ANGLE a = ANGLE OF INCIDENCE
ANGLE b = ALTITUDE ANGLE

The total amount of energy intercepted by a surface consists of not only direct radiation, but also diffuse and reflected radiation. The total amount of radiant energy intercepted by a surface is greater than that from the direct rays alone. Diffuse radiation, or the energy scattered by the atmosphere and redirected to the earth's surface, can be as much as 50% of the total when the sun is at a low altitude, and 100% on a completely cloudy day. However, on clear days diffuse radiation comprises only a small fraction of the total. The intensity of radiation reaching a surface from a reflective material depends upon the quality of that material's surface finish and the angle of incidence between the solar beam and the reflector. The larger the angle of incidence, the more the radiation will be reflected.

It is important to realize that the collection of solar radiation is dependent on the area of the collecting surfaces. The energy content of solar radiation is fixed by the output of the sun. To collect a certain amount of energy from the sun, an area large enough to collect it is necessary. This applies to all solar-heating systems from south-facing glass in a residence to collectors that focus the sun's energy. The area intercepting the sun's rays will determine the maximum amount of radiant energy that can be collected.

Reflection, Transmission and Absorption

As solar radiation strikes the surface of a material, three things can happen. The radiation can be reflected, transmitted and/or absorbed.

Depending on the surface texture of the material, reflected radiation will either be scattered (diffused) or reflected in a predictable manner. Rough-textured surfaces will scatter radiation, while surfaces such as a mirror or highly polished aluminum will reflect light in predictable parallel rays. For example, a masonry wall, because of the irregularities of its surface, will not reflect radiation in a predictable manner. It will scatter or diffuse the radiation in all directions. In contrast, a very smooth and highly polished surface will produce a predictable reflection. (In this manner, light and other radiant energy sources can be controlled.) The angle at which the rays strike a reflecting surface will be equal to the angle of the reflected rays. Or, to put it another way, the angle of incidence will equal the angle of reflection.

What we perceive as color is the result of visible radiation in certain wavelengths being reflected from a surface, while all the other wavelengths are

The Passive Solar Energy Book

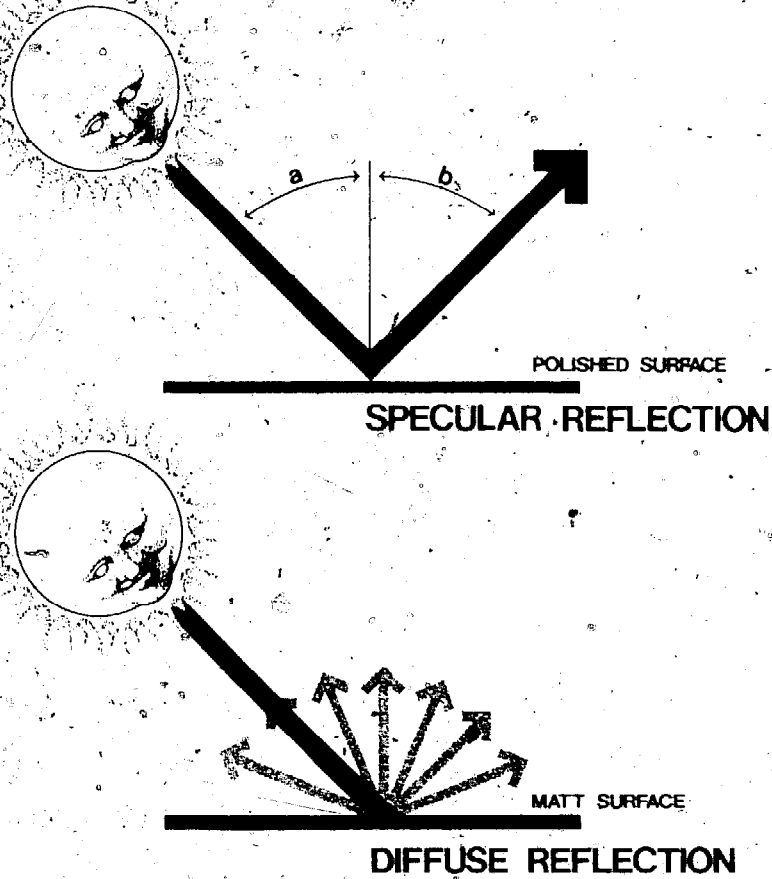


Fig. II-7: Surface finish determines the quality of reflection.

transmitted or absorbed: Since most of the radiation arriving from the sun consists of visible radiation, or radiation concentrated near the visible spectrum, the criterion for reflectivity is closely related to color values. If an object absorbs nearly all the visible radiation that strikes it, it appears black; if it reflects most of the radiation, it appears white, since white is the combination of all the colors in the visible spectrum. A red brick wall will reflect visible radiation in the red spectrum while absorbing all other colors.

The solar radiation that penetrates a material will either be transmitted or absorbed.

A material that transmits most of the visible radiation that strikes it is **TRANSPARENT**. The direct passage of sunlight through a material is best illustrated by ordinary window glass. Most of the solar radiation passes through glass with very little distortion. During a clear winter day, for example, a vertical single plate glass window transmits about 85% of the solar energy striking its surface, double glass about 75%. Other materials can be equally transmissive but will deflect or scatter the radiation that passes through it. We refer to these materials as being **TRANSLUCENT**.

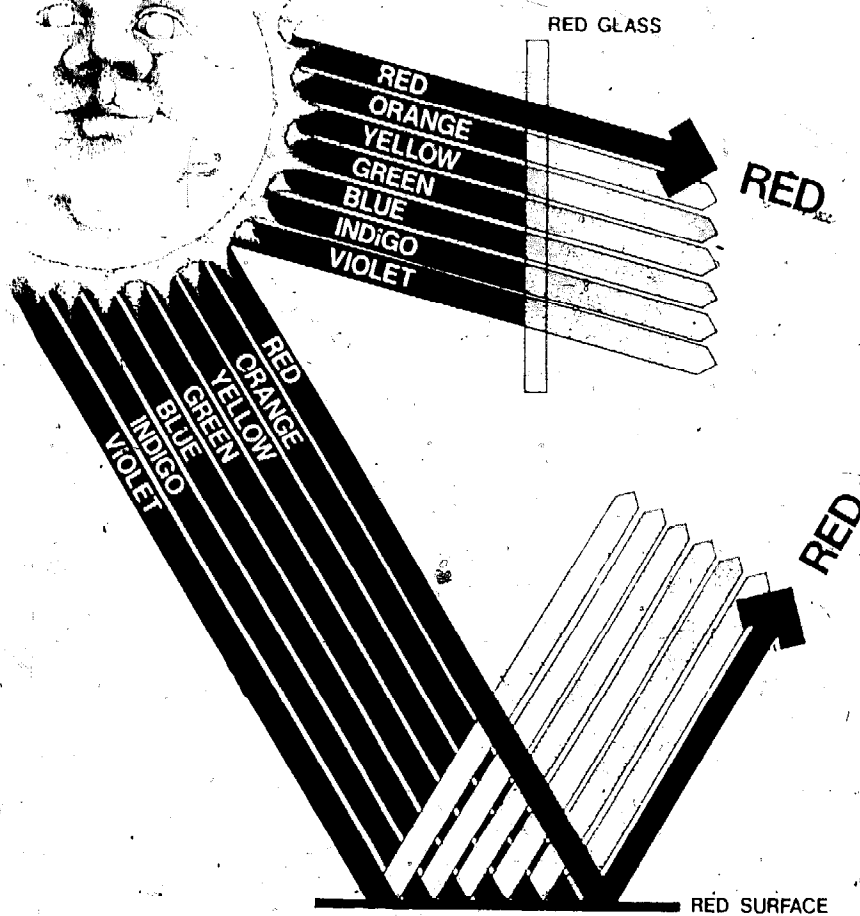


Fig. II-8: Color perception.

The Passive Solar Energy Book

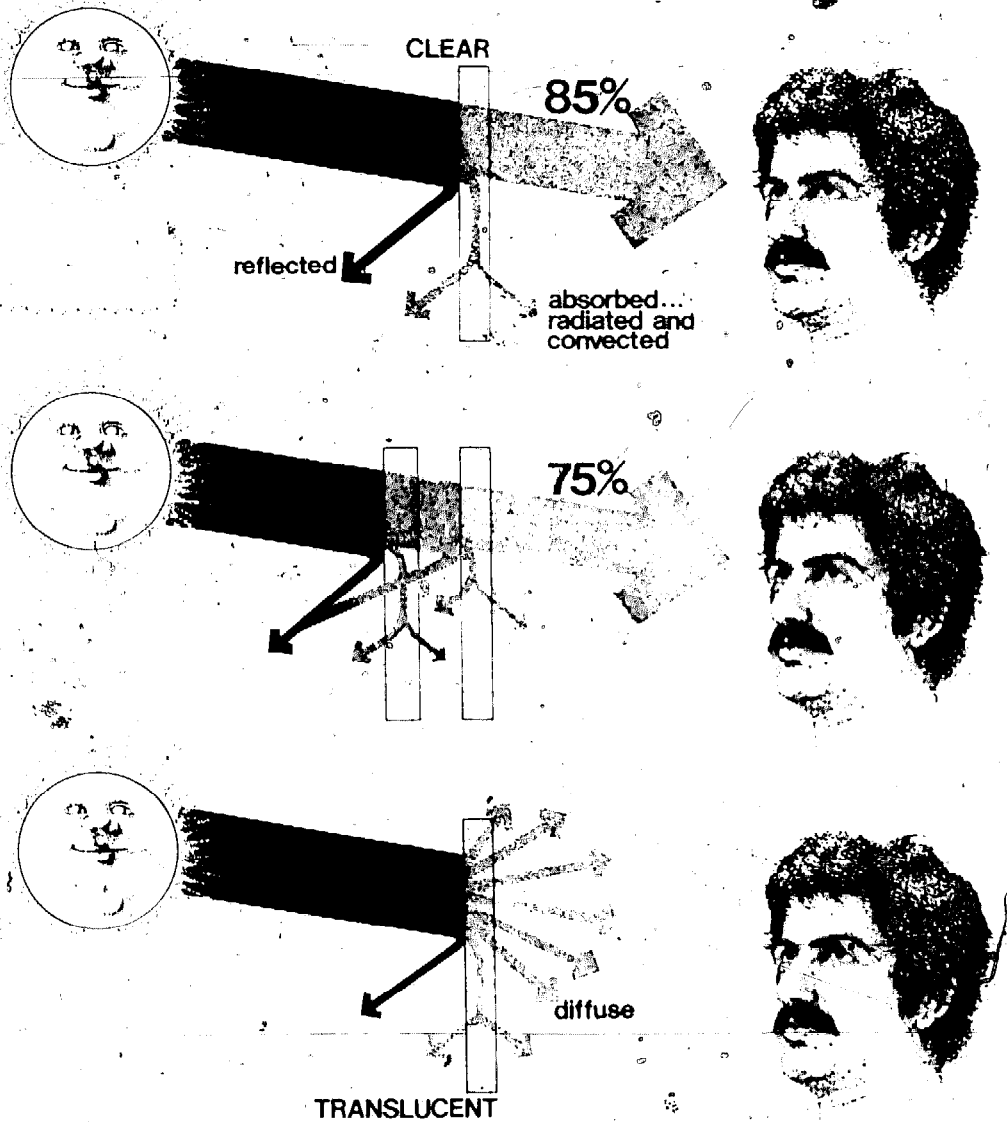


Fig. II-9: Transmission characteristics of glazing materials.

Some radiation is reflected and some is absorbed by the glass. Reflection losses are greatly dependent on the angle of incidence of the radiation striking the glass. The greater the angle of incidence, the greater the reflection. Absorption depends mainly on the iron content of the glass. Glass of high iron content

Natural Processes

has a lower transmissivity. This can be seen by observing the edge of a glass sheet; edges which appear green have a high iron content.

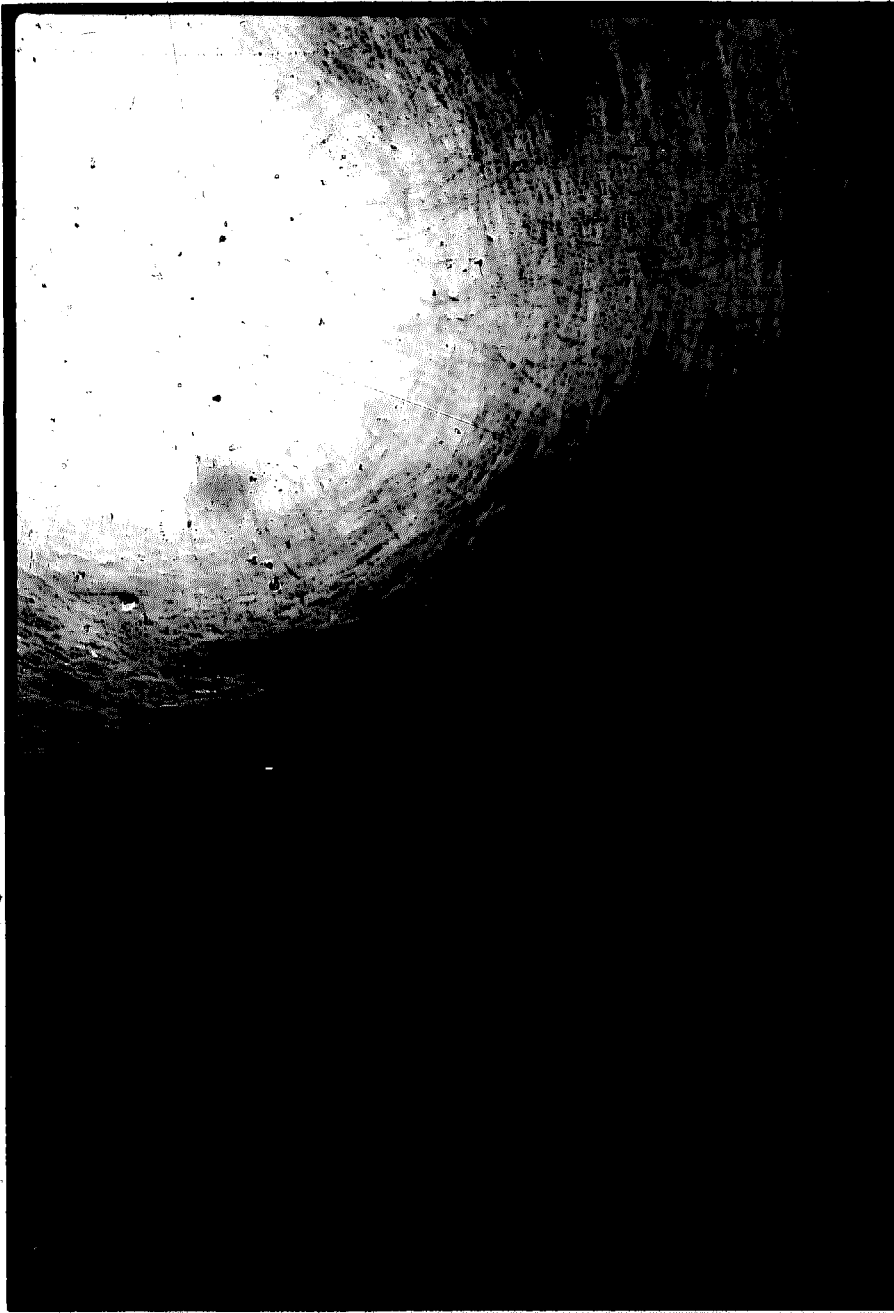


Photo II-2: Diffusing direct sunlight.

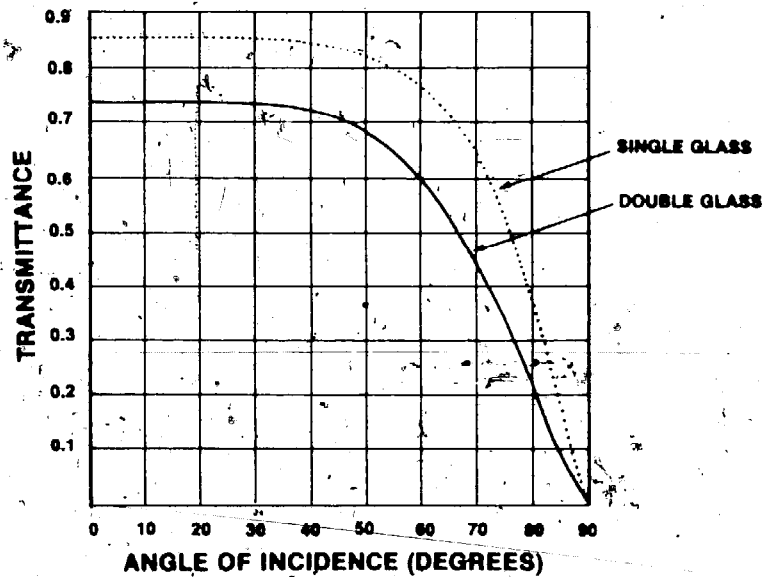


Fig. II-10: Transmission declines sharply at incidence angles greater than 50°.

Solar radiation absorbed by a substance is converted into thermal energy or heat. Solar radiation absorbed by the molecules at the surface of a material will accelerate their movement. As the vibrational movement of molecules in a material increases, the heat content of the material increases.

As heat is added to a solid material, its temperature will rise. Therefore, temperature is the measure of the intensity of heat, which is defined in terms of the movement of molecules; the more rapid this movement, the higher the temperature.

Characteristics of Heat

Heat Transfer

As it is heated by solar radiation, a material seeks to achieve equilibrium with its surroundings through three basic heat transfer processes: conduction, convection and radiation.

First, as solar radiation is absorbed by a material, the absorbed energy will redistribute itself within the material as it is passed or CONDUCTED between molecules. Conduction is the process in which heat energy is transferred between molecules within a substance, or between two substances in physical contact, by direct molecular interaction. The warmer molecules bump into and pass some of their vibrational energy to adjacent molecules. The direction of heat flow is always from warm to cool. As the molecules at the surface of a material are heated by solar radiation, they pass this energy to cooler adjacent molecules dispersing the heat through the material so that it takes on a more uniform temperature. The rate of heat flow or the thermal conductivity (k) of a substance is dependent on the capability of its molecules to send and receive heat. For example, metal will feel colder to the touch than wood of the same low temperature. This is due to the fact that metal has a higher conductivity and it will absorb heat and pass it from its surface to its interior much faster than wood. The more heat conducted from the hand, the cooler a material feels. In general, because gases are poor conductors, materials that trap tiny air pockets are usually poor conductors. A good example of this is building insulation which contains thousands of tiny air pockets.

Second, a material will transfer heat energy from its surface to the molecules of an adjacent fluid* by CONVECTION. Convection is defined as (1) the transfer of heat between a surface and a moving fluid, or (2) the transfer of heat by the movement of the molecules from one point in a fluid to another. In convection processes, heat again always moves from warm to cool. As the cool molecules of a fluid such as water or air come into physical contact with a warm surface, some of the vibrational energy at the surface of the material is transferred to the adjacent fluid molecules. The greater the temperature difference between two substances, the more heat will be transferred. Conduction from the surface of the material to the fluid is the initial heat transfer process, but as the fluid is warmed, it expands, becomes less dense and rises. As the warmer fluid molecules rise, they are replaced by cooler molecules. This results in a continual movement of the fluid. When heat alone is responsible for this movement, the process is called **NATURAL CONVECTION.**

The convection process also works in reverse. As a warm fluid comes in contact with a cool surface, the warmer molecules transfer some of their heat to the cool surface, become heavier and sink. For example, warm air in contact with a cold glass window induces a downdraft of cool air at the floor near the window.

*Fluid is the term used for a liquid or gas.

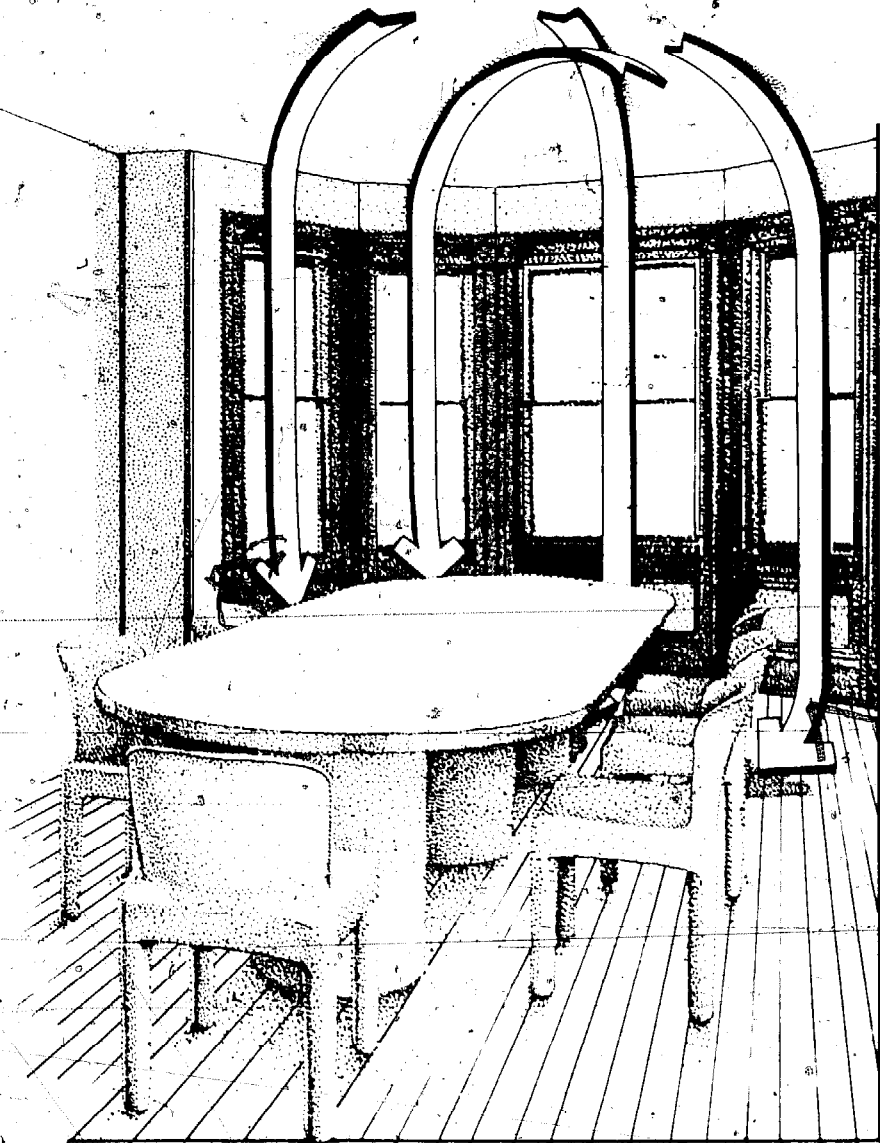


Fig. II-11: A downdraft creates uncomfortable conditions.

If the fluid is pumped or blown across a surface, the rate of convective heat transfer will increase. As a cool fluid comes in contact with a warm surface, the fluid is warmed. Since the rate of heat flow from the surface to the fluid increases as the temperature difference between two substances increases, the faster the warmed fluid molecules are removed from the surface and replaced by cooler molecules, the faster will be the rate of heat transfer. For example,

when air is blown against the surface of a hot spoonful of liquid, it cools faster. The air molecules that have been warmed at the surface of the liquid are blown away and replaced by cooler air molecules which are capable of absorbing more heat. This process is called **FORCED CONVECTION**.



Fig. II-12: Cooling by forced convection.

And third, all materials RADIATE energy all the time. All materials are constantly radiating thermal energy in all directions because of the continual vibrational movement of molecules (measured as temperature) at their surface. In contrast to solar radiation, which consists of shortwave radiation emitted at very high temperatures, thermal radiation experienced as heat consists of longwave infrared radiation emitted at a much lower temperature.

As the fire dies down and the flame and coals become more red and give off less light and slightly less heat . . . after awhile the flame disappears, the coals become dull red in appearance, then a darker red, and finally they glow no more. Light is no longer emitted from the warm coals, but heat continues to be given off. The warmth of the coals is felt for hours as radiated heat or infrared radiation, but it is not seen as light.

John Mather*

The amount of thermal energy a material radiates depends on the temperature of the radiating surface.

The output of thermal radiation from a surface not only varies with surface temperature, but also with the quality or EMISSIVITY of the surface. In general,

*John R. Mather, *Climatology: Fundamentals and Applications*.

The Passive Solar Energy Book

most materials are good emitters of thermal radiation, that is, they radiate thermal energy easily. The emittance (E) of a material is an indicator of that material's ability to give off thermal radiation. Most building materials, for example, have emissivities of 0.9 which means that they radiate 90% of the thermal energy theoretically possible at a given temperature. Normally, highly polished surfaces, such as shiny metals, are poor emitters of thermal radiation. This means they radiate very little heat at a given temperature:

Not all materials, however, absorb thermal radiation; some will reflect it and/or transmit it. The capacity of a surface to reflect thermal radiation will depend upon the density and composition of the surface rather than on its color. Although color is a good indication of the ability to reflect solar radiation, it is a poor indicator of the ability to reflect thermal radiation. Most construction materials, regardless of color, act as a "black body,"* absorbing most of the thermal radiation they intercept.

In general, only highly polished or shiny surfaces, such as aluminum foil, reflect large amounts of the thermal radiation they intercept. The designers of airplanes take advantage of this principle by providing the undersides of airplanes with a polished metal finish so that thermal energy or heat radiated from a hot asphalt runway will be reflected, thus keeping the interiors of the planes cooler when parked at a terminal.

The amount of thermal radiation a surface intercepts depends on the angle the radiation makes with that surface. This is the same principle that applies to solar radiation. Two surfaces that are parallel to and facing each other will exchange a maximum amount of thermal radiation, while surfaces facing each other at an angle will exchange less. If both bodies have the same absorptivity, the result of this energy exchange is a net radiant heat transfer from the warm body to the cool body.

Materials that transmit visible solar radiation do not necessarily transmit thermal radiation.

Glass, which allows virtually all the visible solar radiation striking its surface to pass through, will absorb most of the thermal (infrared or long wavelength) radiation it intercepts. This property of glass is highly desirable for use in collecting solar energy. Once sunlight is transmitted through glass and

*In physics, a black body is an ideal material that is able to absorb and emit radiation perfectly.

absorbed by materials in a space, thermal energy reradiated by these materials will not pass back out through the glass.*

This process of trapping heat is commonly known as the "greenhouse effect."

A good example of the result of this effect is the heat that builds up in an automobile that has been sitting in the sun for a few hours. Other materials, such as some plastic glazing materials that admit a high percentage of solar radiation, will allow as much as 40% of the thermal radiation they intercept to pass through. In this aspect, these materials are slightly less desirable for use in solar heating.

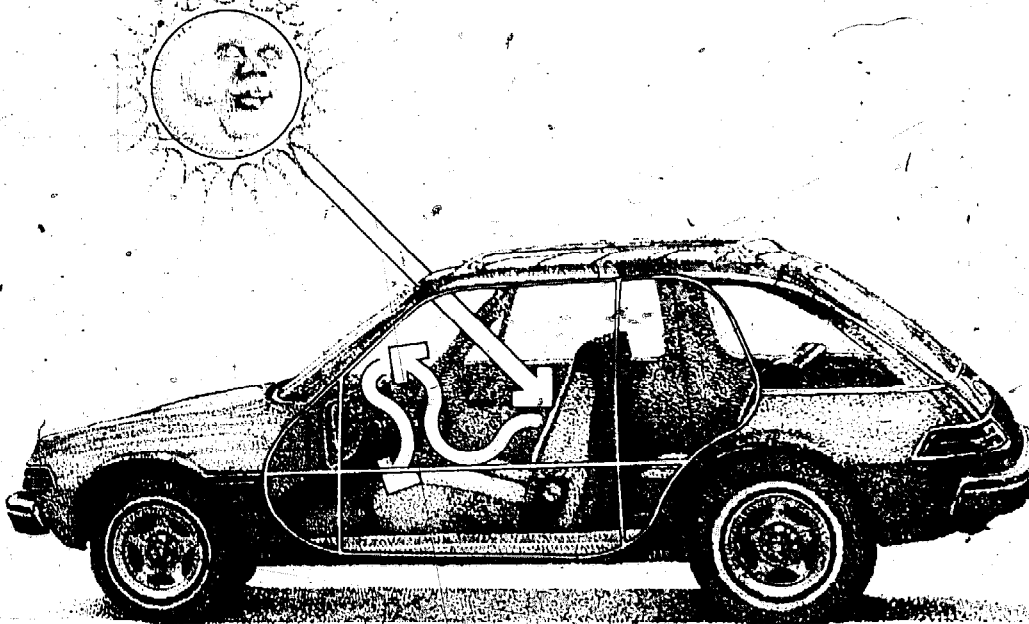


Fig. II-13: Greenhouse effect.

Heat Storage

All solar-heating systems are based on storing solar energy within a material for a period of time. This is accomplished by heating a material which will store the heat until it is needed. Cooling systems, on the other hand, do exactly the opposite. A substance is cooled, or heat is taken out, and kept

*This does not imply that radiation losses from a space are eliminated. Although glass does not transmit thermal radiation, it absorbs this energy and then reradiates and conducts it to the outside, but at the lower temperature of the glass surface.

The Passive Solar Energy Book

that way so it can absorb heat at a later time, Heating and cooling a space is essentially based on the same concept. Very simply, the idea is to keep a *temperature difference* between the substance and the surrounding temperature.

For this reason, when solar heating a building, it is important to construct the building of a substance that can store enough solar energy (or heat) in the daytime to keep the building warm during a cold winter night. The capacity of a material to store thermal energy is called its *specific heat*, which is defined as the amount of heat (measured in Btu's) one pound of a substance can hold when its temperature is raised one degree Fahrenheit. In the construction trades, however, the quantity of a substance is frequently given in cubic feet rather than pounds. Therefore, the volumetric *heat capacity* of one cubic foot of a substance is simply its specific heat multiplied by its density (number of pounds per cubic foot).

Table II-2 lists both the specific heat and heat capacities of various substances. Notice that although brick and concrete have roughly half the specific heat of expanded polyurethane, their density is much greater, so per unit volume they can store substantially more heat.

Table II-2 Specific Heat and Heat Capacity of Various Substances

Substance	Specific Heat (Btu/lb-°F)	Density (lbs/cu ft)	Heat Capacity (Btu/cu ft-°F)
Water	1.0	62.4	62.4
Wood, oak	0.57	47	26.8
Expanded polyurethane	0.38	1.5	0.57
Wool, fabric	0.32	6.9	2.2
Air	0.24	0.075	0.018
Brick	0.20	123	25
Concrete	0.156	144	22
Steel	0.12	489	59

Natural Processes

However, apart from having a high heat capacity, to be effective as a heat storage medium a substance must also have a relatively high conductivity. Wood and brick have about the same heat storage capacity; however, wood is usually not used for heat storage. The reason is simply that wood does not conduct heat as well as brick and is, therefore, not capable of transferring much heat from its surface to its interior for storage.

III Passive Solar Systems

Approaches to Solar Heating

There are basically two distinct approaches to the solar heating of buildings: active and passive.

In general, active systems employ hardware and mechanical equipment to collect and transport heat. Flat plate or focusing collectors (usually mounted on the roof of a building) and a separate heat storage unit (rock bin, water tank or combination of the two) are often the major elements of the system. Water or air, pumped through the collector, absorbs heat and transports it to the storage unit. This heat is then supplied from the storage unit to the spaces in a building by a completely mechanical distribution system.

Passive systems, on the other hand, collect and transport heat by nonmechanical means. The most common definition of a passive solar-heating and cooling system is that it is a system in which the thermal energy flows in the system are by natural means such as radiation, conduction and natural convection. In essence, the building structure or some element of it is the system. There are no separate collectors, storage units or mechanical elements. The most striking difference between the systems is that the passive system operates on the energy available in its immediate environment and the active system imports energy, such as electricity, to power the fans and pumps which make the system work:

There are two basic elements in every passive solar-heating system: south-facing glass (or transparent plastic) for solar collection, and thermal mass for

heat absorption, storage and distribution. Popular belief has it that a passive building must incorporate large quantities of these two elements. Our studies show, however, that while there must be some thermal mass and glazing in each space, when properly designed they are not necessarily excessive. This will become evident when you read the sizing procedures given in chapter 4, "Design Patterns."

To establish a framework for understanding passive systems, three concepts will be defined: DIRECT GAIN, INDIRECT GAIN and ISOLATED GAIN. Each explains the relationship between the sun, heat storage and living space. Within each of these categories we are able to identify various systems,

Direct Gain


The first and simplest approach to passive solar heating is the concept of Direct Gain. Simply defined, the actual living space is directly heated by sunlight. When the space is used as a solar collector, it must also contain a method for absorbing and storing enough daytime heat for cold winter nights. In other words, with the direct gain approach the space becomes a live-in solar collector, heat storage and distribution system all in one. One important note, Direct Gain Systems are always working. This means they collect and use every bit of energy that passes through the glazing—direct or diffuse. Because of this, they not only work well in sunny climates, but also in cloudy climates with great amounts of diffuse solar energy, where active systems can hardly perform as effectively.

In this approach, there is an expanse of south-facing glass and enough thermal mass, strategically located in a space, for heat absorption and storage. South-facing glass (the collector) is exposed to the maximum amount of solar energy in winter, and minimum amount in summer. For this reason, it is the ideal location for admitting direct sunlight into a space. Since a portion of this solar heat gain (sunlight) must be stored in the space for use at night (and possibly during periods of cloudy weather), the floor and/or walls must be constructed of materials capable of storing heat.


Today, the two most common materials used for heat storage are masonry and water. Masonry thermal storage materials include concrete, concrete block, brick, stone, and adobe, either individually or in various combinations. Typically, at least one-half to two-thirds of the total surface area in a space is constructed of thick masonry. This implies that the interior be largely con-

The Passive Solar Energy Book

structed of masonry to insure that there is enough surface area of exposed mass for adequate heat absorption and storage. Water storage, on the other hand, is usually contained in only one wall of a space. The water wall is located in the space in such a way that direct sunlight strikes it for most of the day. Materials commonly used to construct the wall are plastic or metal containers. During the daytime, the mass is charged with heat so that at night when outdoor and space temperatures begin to drop, this heat is returned to the space.

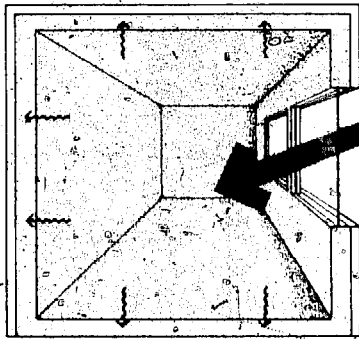


DAY

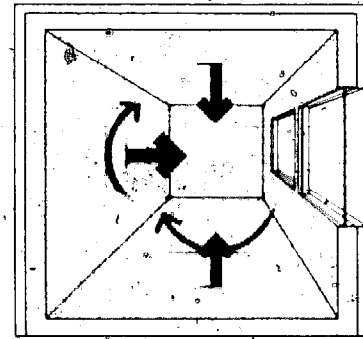


NIGHT

MASONRY HEAT STORAGE

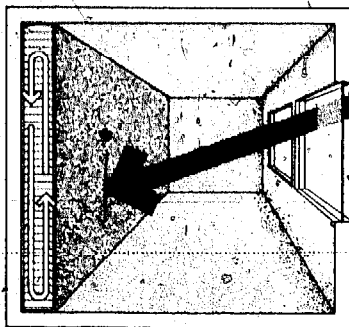

DAY

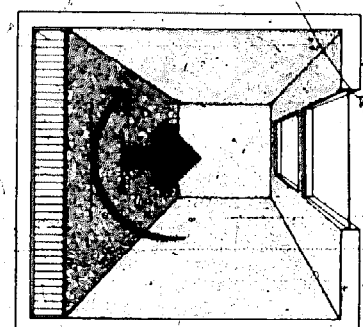

NIGHT

INTERIOR WATER WALL

Fig. III-1: Direct gain systems.

Passive Solar Systems

In hot summer climates with cool nighttime temperatures, the mass can also act to keep a building cool during the day. First, because of its time-lag properties, massive walls keep heat from reaching the interior of the building until the evening when outdoor temperatures are cooler. Second, outdoor air circulated through the building at night cools the interior mass so it absorbs heat and provides cool interior surfaces during the day.

One of the earliest and largest contemporary examples of a Direct Gain System is the St. George's County Secondary School in Wallasey, England, near Liverpool. The building, designed by architect Emslie A. Morgan, was completed in 1962. Public reaction to the building at that time was that the architect had somehow harnessed a new physical principle. It was not until the late 1960s that extensive research and testing of the building was begun.

The building, constructed of masonry, has a transparent south wall for maximum solar gain in winter. Concrete, 7 to 10 inches in thickness, forms the roof and floors, with the north wall and interior partitions made of 9-inch brick. This masonry is the principal means of heat storage in the building. It is exposed to the interior and insulated from the exterior with 5 inches of expanded polystyrene. By contrast, the entire south wall of the building is essentially transparent. Two sheets of glass, the outside layer clear and the inside translucent, make up the roughly 230-by-27-foot wall. The translucent layer refracts direct sunlight diffusing it over the surface area of interior mass, somewhat uniformly.

The masonry interior stores heat and acts to prevent large fluctuations of indoor temperatures over the day. Recorded classroom fluctuations are on the average only 7°F throughout the year (clear-day fluctuations are somewhat higher). This clearly illustrates the effect masonry has in keeping indoor temperatures relatively stable.

The south wall admits enough solar energy to supply roughly 50% of the building's heating needs during the year, and all this in a less-than-ideal climate. Wallasey is located on the west coast of England at 53°NL. Its outdoor temperatures are moderated by the warm Gulf Stream, but the current also brings with it much fog and cloudy weather. In a climate, at best thought to be marginally suited for solar energy application, the building is heated 50% by the sun with the remaining 50% supplied by lights and students. The conventional heating system, originally installed, was never used and subsequently removed.

The Passive Solar Energy Book

Table III-1 Principal Heat Sources

Source	Percentage of Heating Supplied (rough estimate) (1960-69)
Solar energy	50
Incandescent lights	34
1,300 in classroom	
2,400 in art room	
Students: 15 to 35*students per class	16

SOURCE: Joseph E. Perry, Jr., "The Wallasey School," *Passive Solar Heating and Cooling Conference and Workshop Proceedings* (Springfield, Va.: National Technical Information Service, 1976).

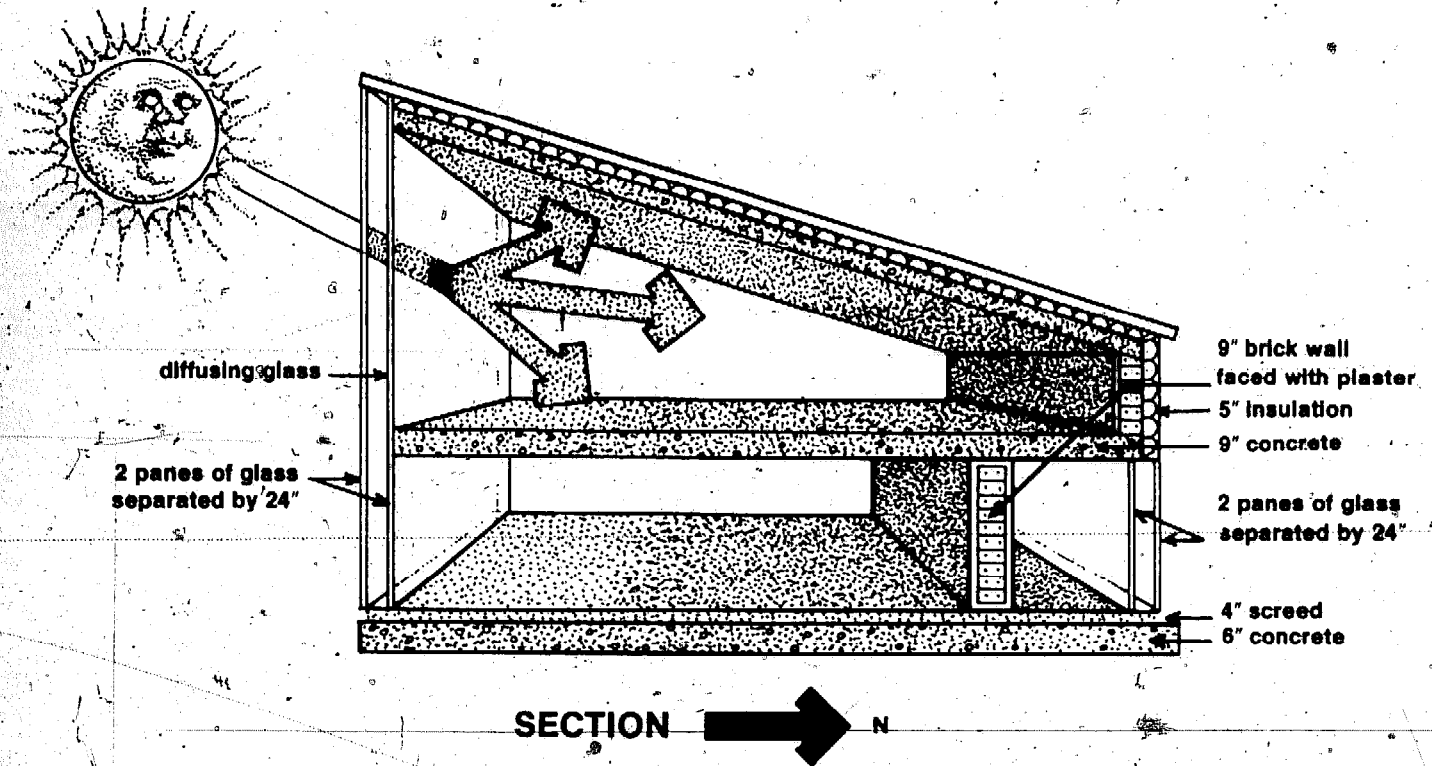


Fig. III-2: Sunlight is diffused over a large surface area of masonry.

Passive Solar Systems



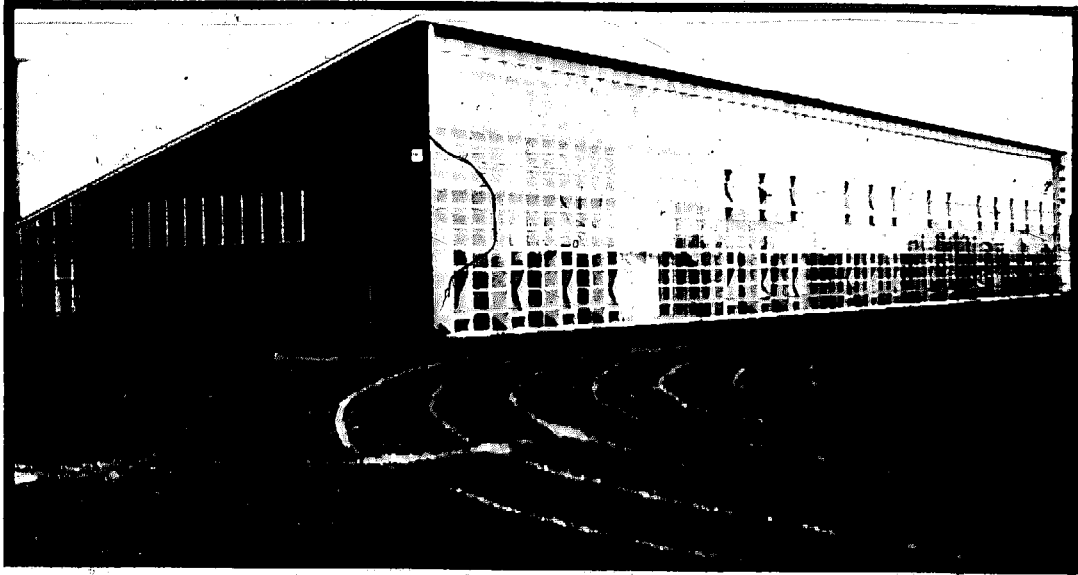


Photo III-1: South and north face of St. George's County Secondary School.

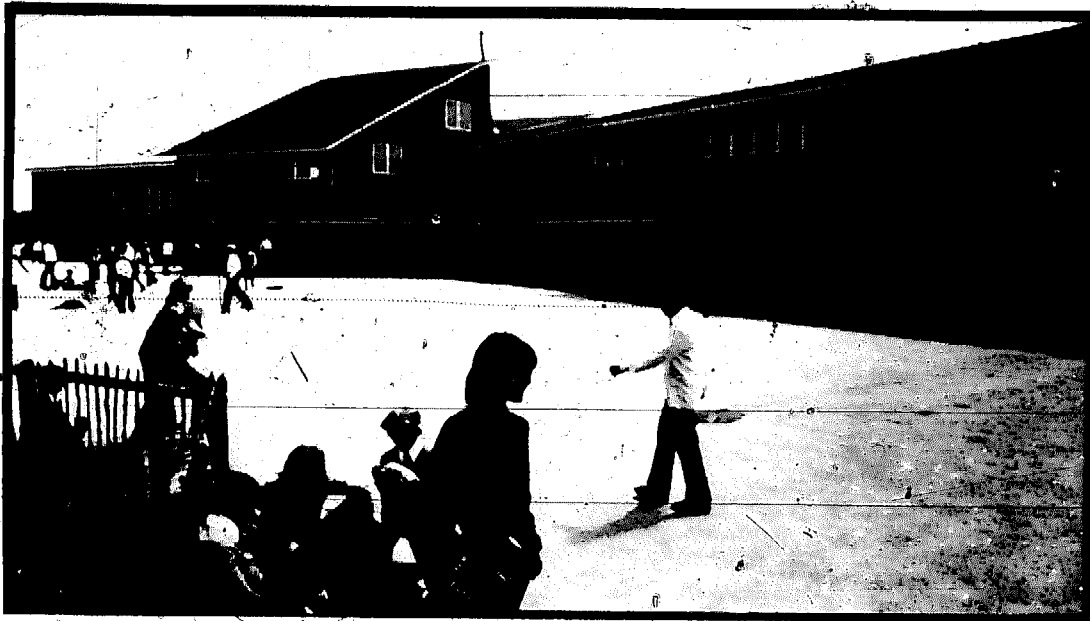

Another, very different application of a direct gain concept is Maxamillian's restaurant, located in Albuquerque, New Mexico. The restaurant employs a Direct Gain System to supply a major portion of its winter-heating needs and a natural cooling system to meet its summer cooling loads.


Its heating and cooling system consists of four south-facing, sawtooth clerestories and a masonry interior. The restaurant, originally an existing two-story adobe and brick exterior courtyard of approximately 1,600 square feet, was enclosed with four translucent glazed clerestories. In winter, direct sunlight

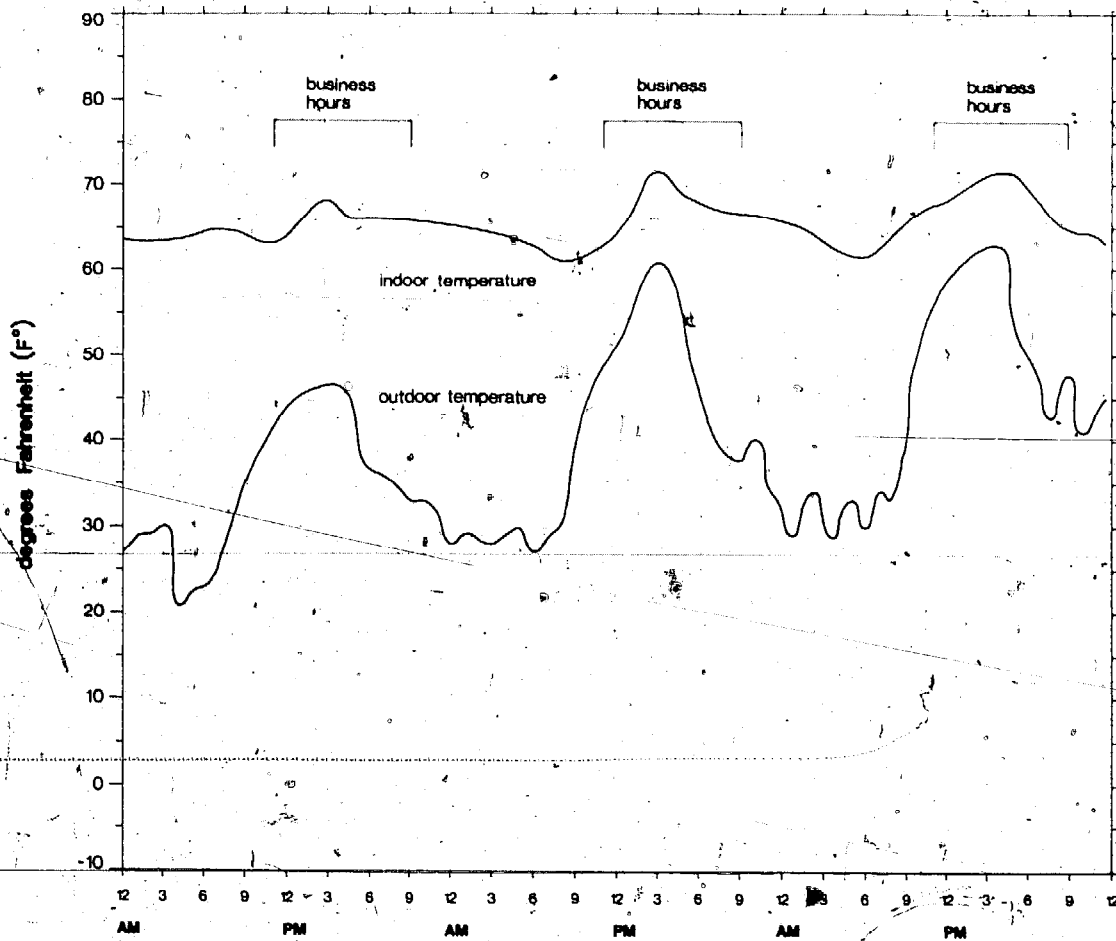

**INDOOR AND OUTDOOR TEMPERATURES—
NOVEMBER 25, 26, 27, 1977**

Fig. III-3: Maxamillian's restaurant (here and facing page).

Passive Solar Systems

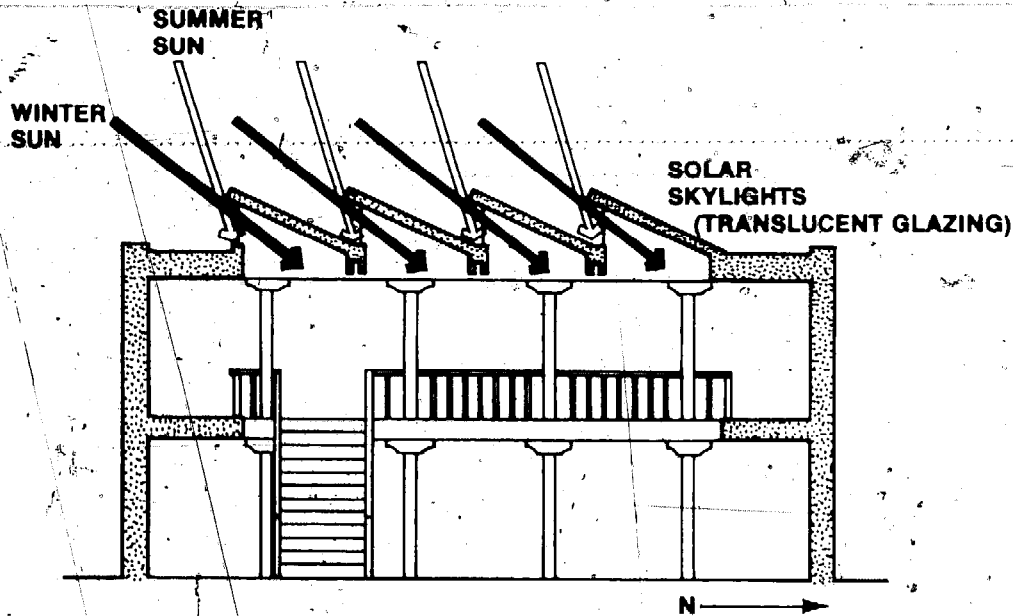

SECTION SHOWING SUMMER AND WINTER OPERATION

entering the space is diffused and distributed over the masonry interior. This enables the masonry to evenly and effectively absorb and store the incident energy. The masonry then acts as a heat sink, storing energy during the daytime and releasing it to the space at night.

In winter, the clerestories are designed to admit enough sunlight to maintain space temperatures within the comfort range without any auxiliary heating system. The restaurant is designed to operate between 65° and 75°F during business hours, then allowed to drop into the low 60's late at night when the space is not in use. To illustrate this, figure III-3 graphs restaurant temperatures for a typical three-day period in winter. It can be seen that the space maintains temperatures between 61° and 71°F, however, during business hours the temperature in the restaurant only fluctuated between 65° and 71°F. This means that the restaurant is slightly cool (65°F) until about 11:00 a.m. when people arrive for lunch and help boost the temperature well into the comfort range. Remember that 65°F air temperature in a radiant heated space is "felt" as being warmer than a conventionally heated space at that same temperature. To avoid the possibility of overheating in winter, the clerestories were slightly undersized to allow for the heat gains from lights, people and appliances.



Photo III-2: Interior of Maxamillian's restaurant (here and facing page).

Passive Solar Systems




In summer, cooling is accomplished by keeping the sun out and by ventilating the space at night. Most often, nighttime temperatures in Albuquerque drop into the low 60's. By opening both windows on the main level and the vents positioned high in the clerestories, a convection current is induced; cool air is drawn in through the low openings and warmed air rises out through the high vents. The masonry in the space, cooled throughout the evening by this

The Passive Solar Energy Book

natural flow of air, absorbs heat and provides cool interior surfaces throughout the day. Also, when outdoor temperatures and sunlight are most intense shading devices permit only indirect light to filter into the restaurant.


During the winter of 1976-77 the restaurant operated comfortably with the sun (and people) as its only heating source.

And yet another example, the Schiff residence in western Wyoming, demonstrates that passive solar heating can work effectively in very cold northern climates. The residence designed by Marc Schiff and Robert Janik was completed in 1977. It is similar to the previous example in that it has a south-facing sawtooth clerestory that admits direct sunlight into the building. However,

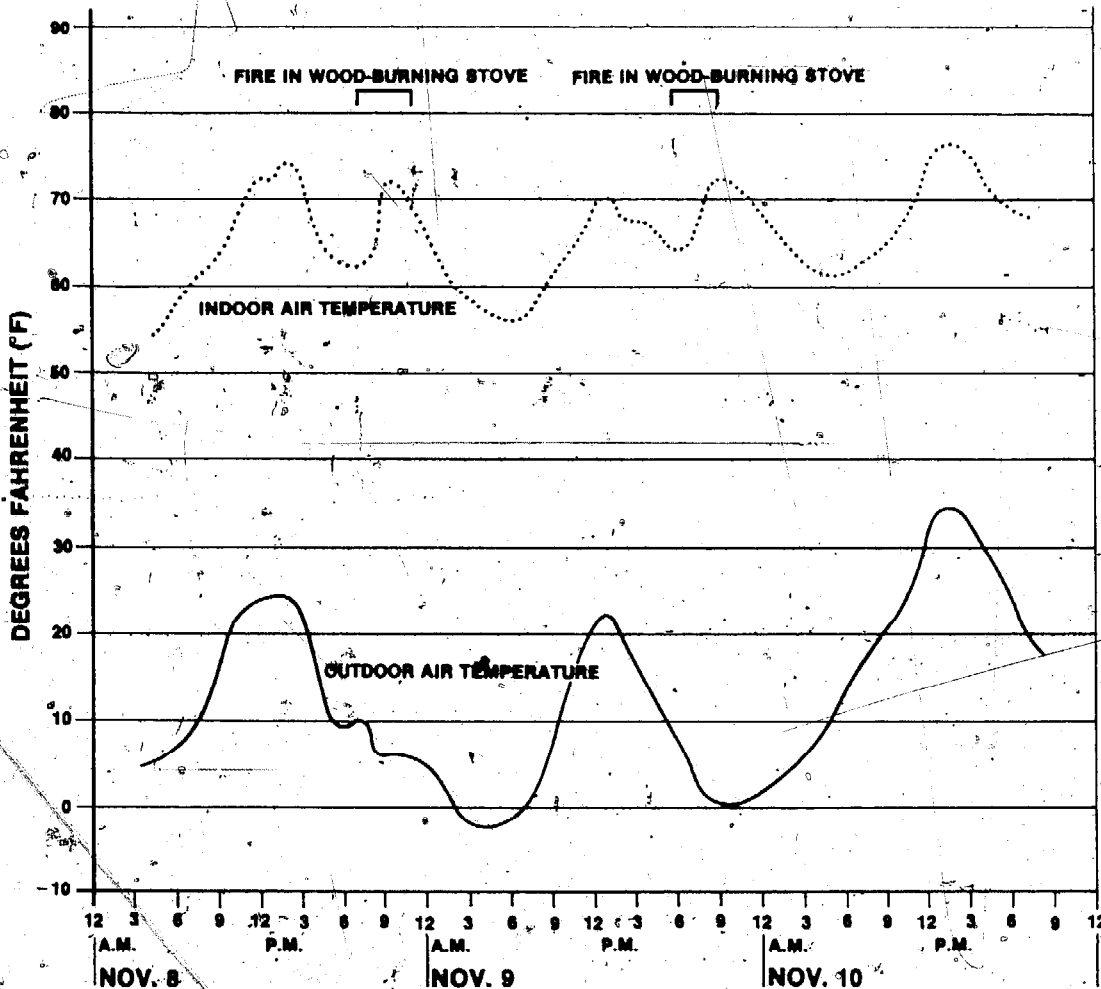


PERFORMANCE IN NOVEMBER 1977

Passive Solar Systems

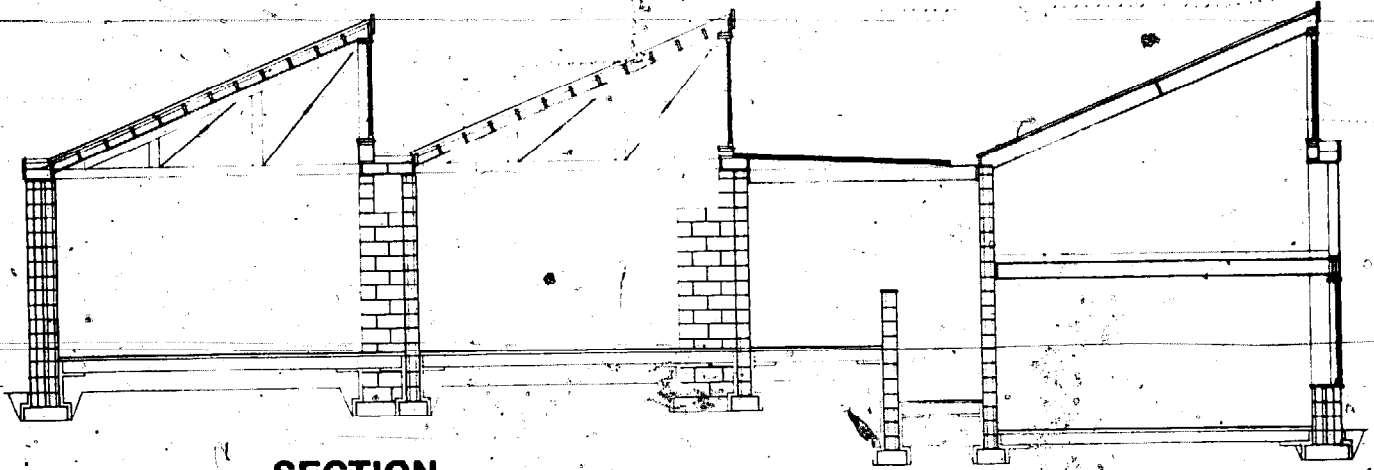

SECTION

main level

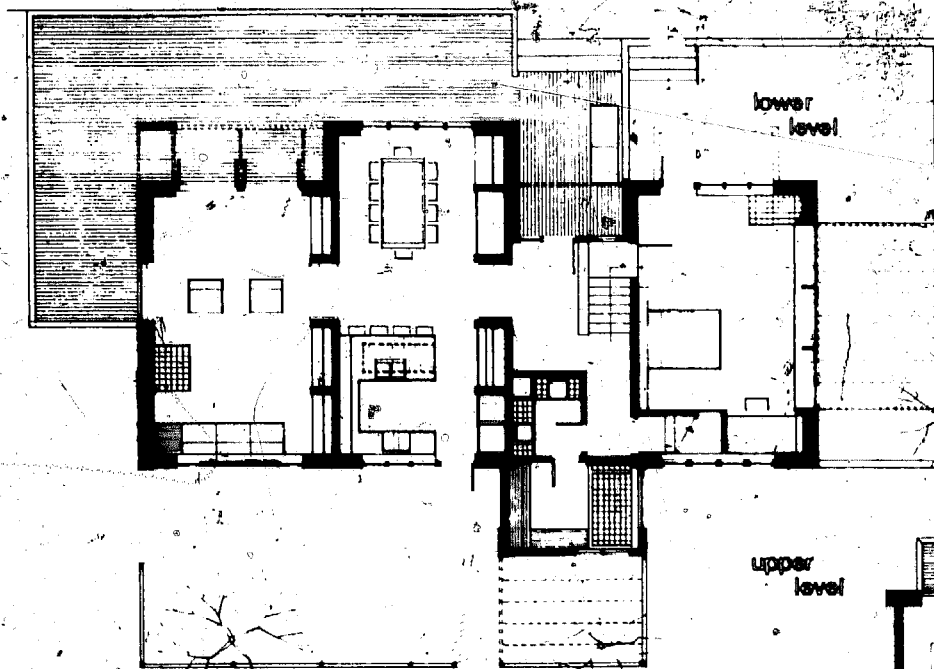

PLAN


Fig. III-4: Schiff residence (here and facing page).



The Passive Solar Energy Book

mass for heat storage is contained in concrete block walls, filled with concrete and finished with plaster, and a slate floor that is set in a mortar bed over a 6-inch concrete slab. Essentially, this Direct Gain System functions in the same way as the Wallasey School and Maxamillian's restaurant.

Figure III-4 illustrates that even during periods of 0° F weather the building maintained temperatures which were 56° F above outdoor temperatures. It is interesting to note that there is no heating system in this residence other than two wood-burning stoves, one in the living space and one in the master bedroom. The owner states that "the house feels very comfortable down to about 62° F air temperature and tolerable to about 55° F due to the fact that the walls and floor are from 3° to 10° F warmer in the evening than the air temperature."

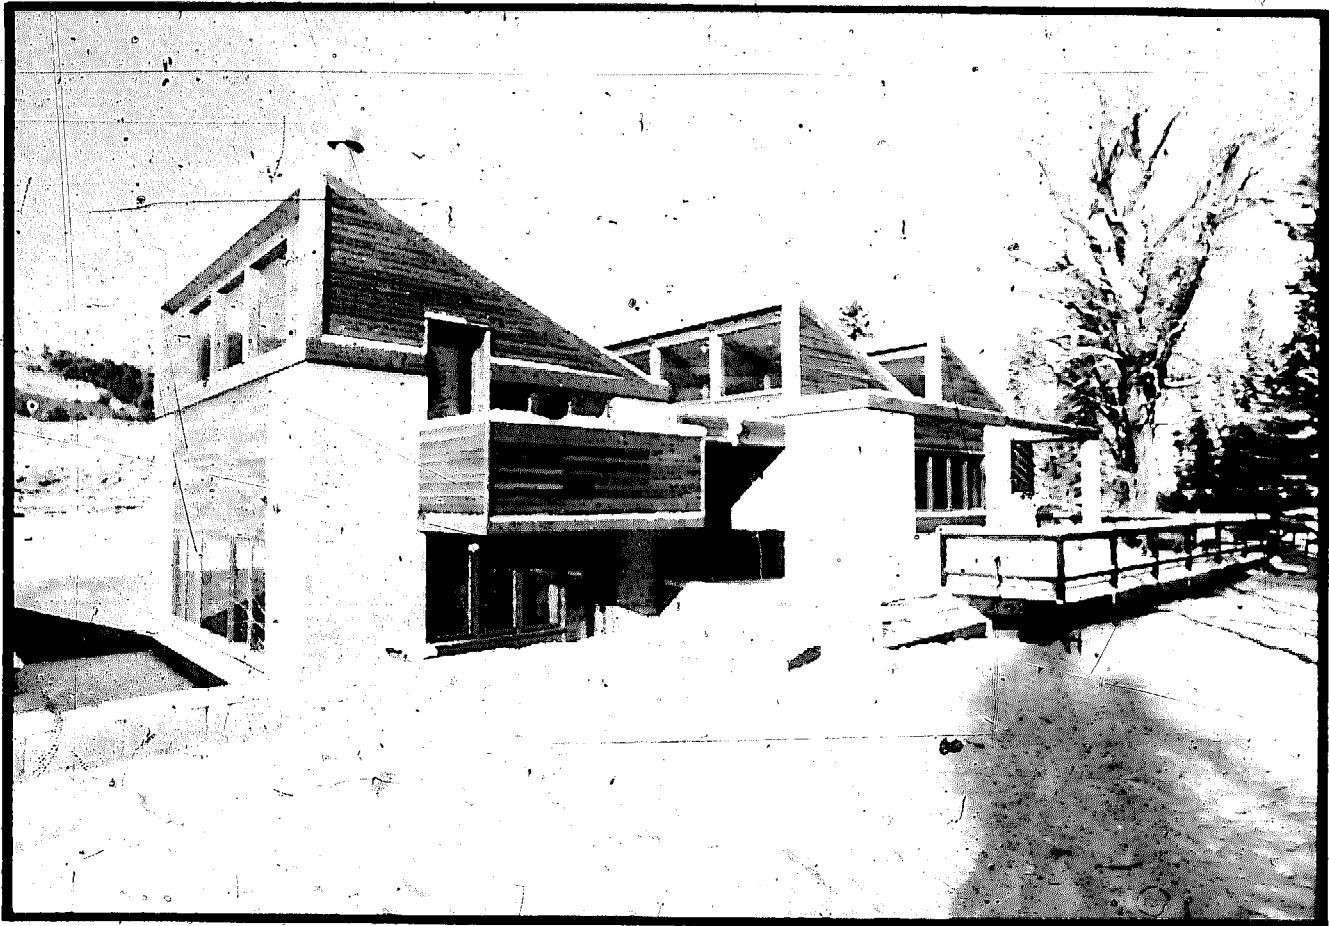

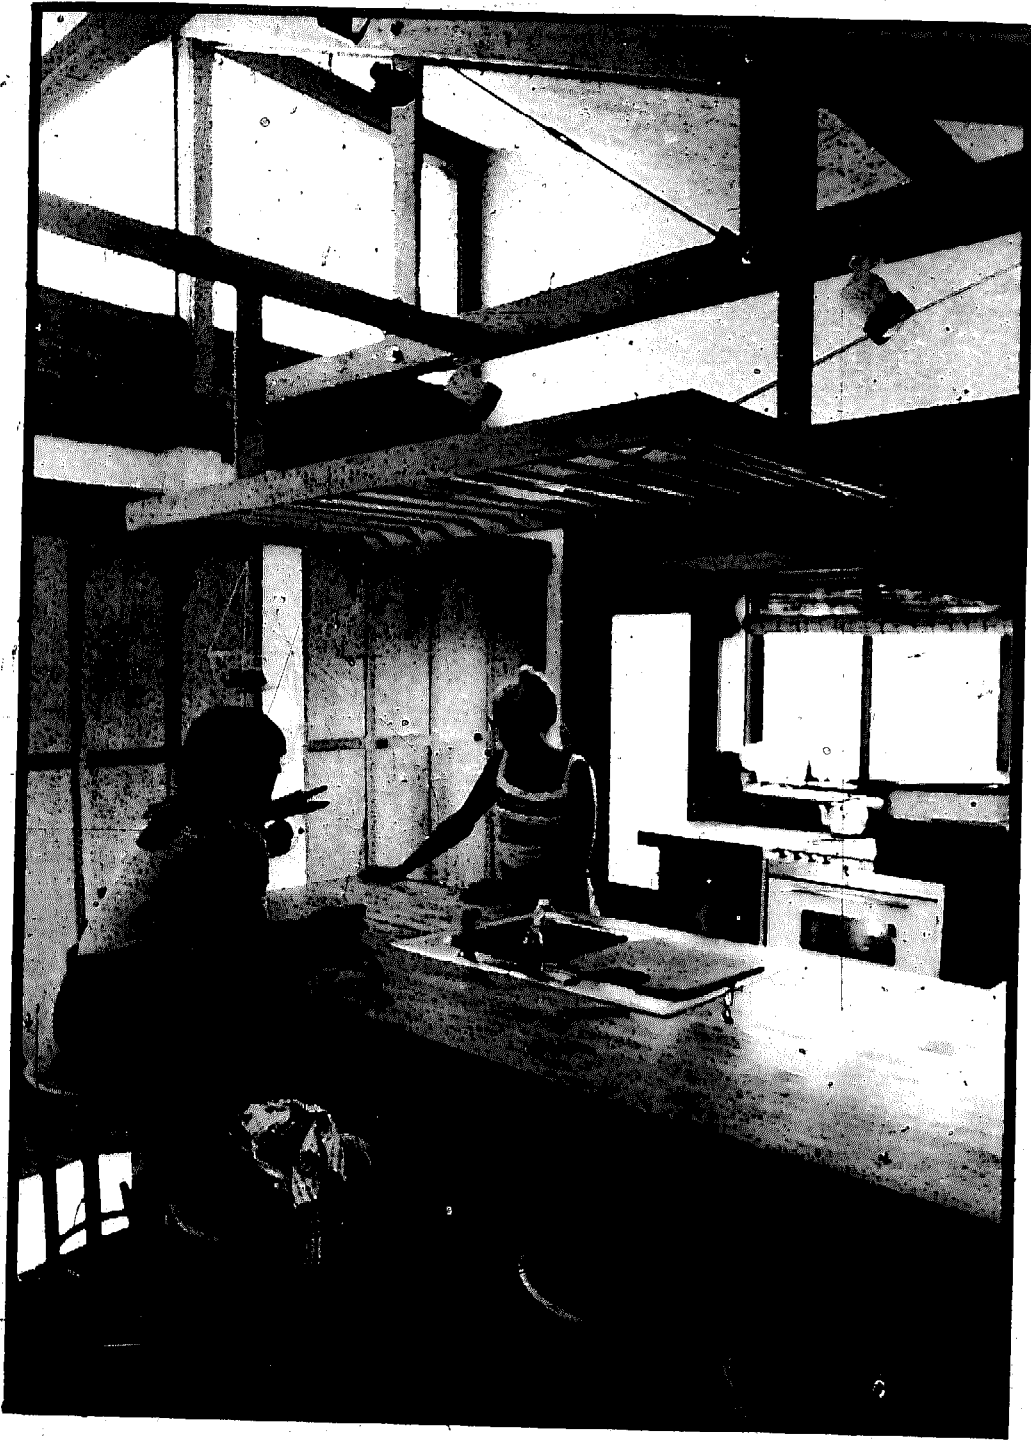


Photo III-3: The Schiff residence—south-facing clerestories admit direct sunlight; exterior (facing page) and interior (here).

The Passive Solar Energy Book

Many applications of interior water walls employ a combination of materials. For example, the Karen Terry house in Santa Fe, New Mexico, is a Direct Gain System with both interior masonry and water walls. The house, elongated along the north-south axis, follows the contour of the south-sloping terrain. The interior, separated into three levels by retaining walls containing water, is constructed mainly of brick, adobe and concrete block. The retaining walls consist of twenty-eight 55-gallon drums filled with water and an anticorrosive additive, and covered with mud plaster. Sunlight enters the space through south-facing clerestories tilted at a 45° angle from horizontal. These clerestories are placed in such a way that sunlight, at midday in winter, strikes the water walls for maximum heat absorption.

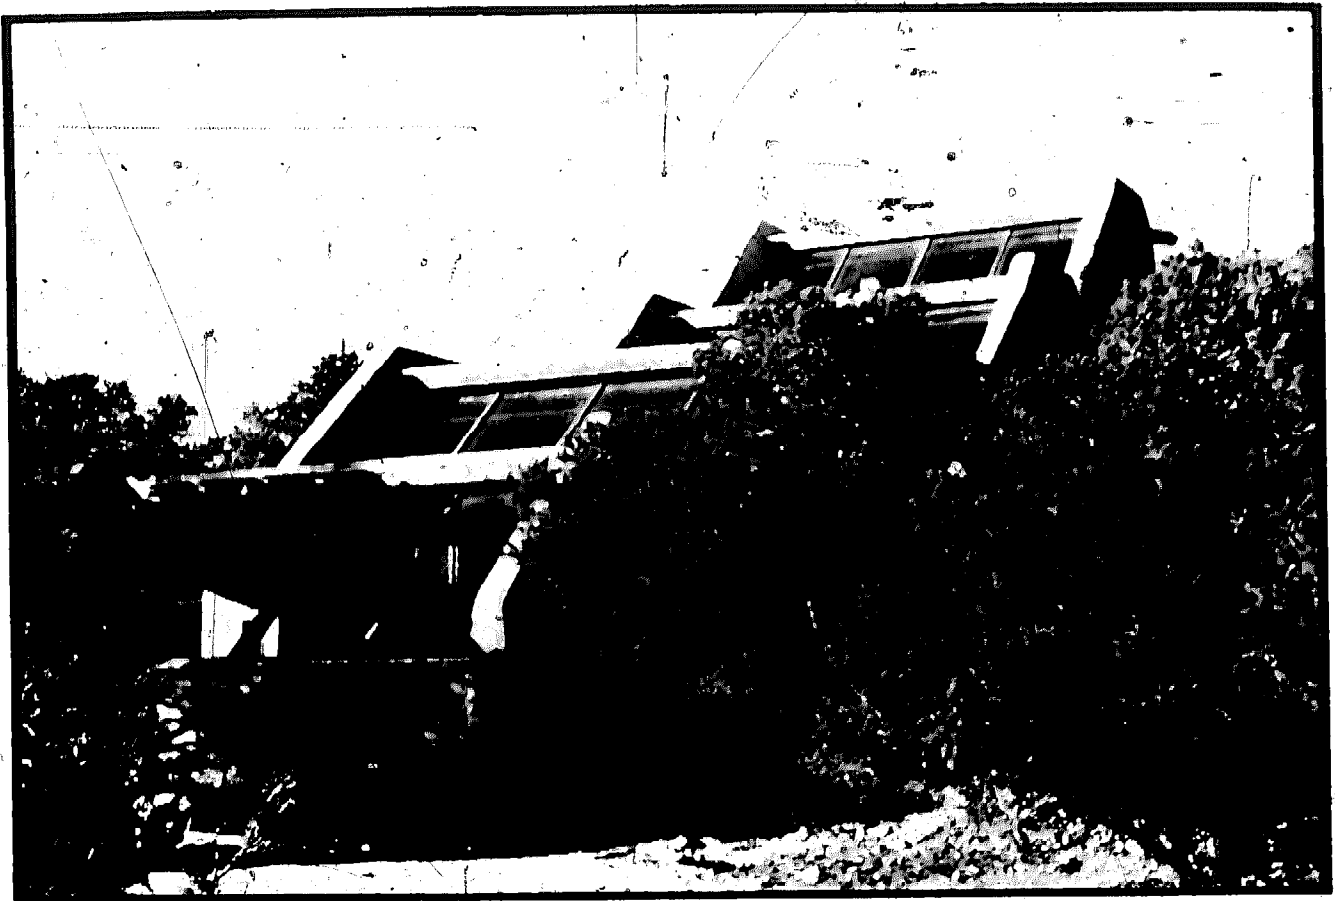


Photo III-4: The Karen Terry house—terraced to the south for maximum winter solar gain.

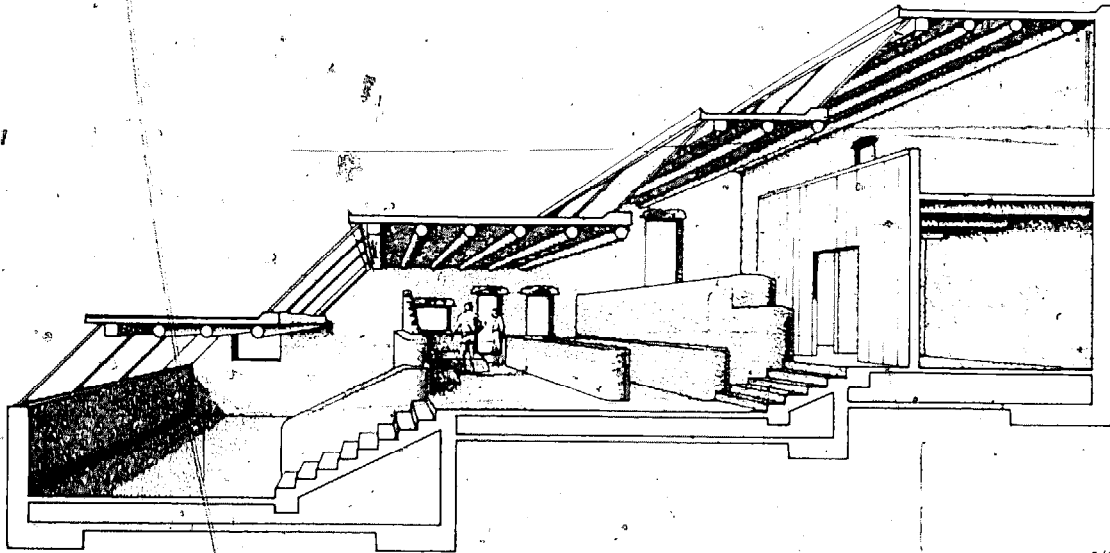


Fig. III-5: Section, Karen Terry house, Santa Fe, New Mexico

In the winter of 1975-76, the auxiliary heating supply for this house consisted of one-half cord of wood, burned in a small adobe fireplace. Without applying insulating shutters over the glazing at night, the house maintained temperatures in the 70s and high 60s for most of the winter. The coldest recorded temperature in the house that winter was 53°F early one morning.

Indirect Gain

Another approach to passive solar heating is the concept of Indirect Gain, where sunlight first strikes a thermal mass which is located between the sun and the space. The sunlight absorbed by the mass is converted to thermal energy (heat) and then transferred into the living space.

There are basically two types of Indirect Gain Systems: Thermal Storage Walls and Roof Ponds. The difference between the two systems is the location of the mass; one is contained in a wall and the other on the roof of the space being heated.

The Passive Solar Energy Book

The requirements for a Thermal Storage Wall System are south-facing glass areas (or transparent plastic) for maximum winter solar gain and a thermal mass, located 4 inches or more directly behind the glass, which serves for heat storage and distribution.

There is a wide range of appropriate thermal storage wall materials; however, most fall into two categories: either masonry or water. Masonry materials include concrete, concrete block (solid or filled), brick, stone and adobe. Containers for water include metal, plastic and concrete with a waterproof lining.

Masonry Thermal Storage Wall

A masonry wall works by absorbing sunlight on its outer face and then transferring this heat through the wall by conduction. The outside surface of the wall is usually painted black (or a dark color) for the best possible absorption of sunlight. Heat conducted through the wall is then distributed to the space by radiation, and to some degree by convection, from the inner face.

By adding vents to the wall the distribution of heat by natural convection (thermocirculation) from the exterior face of the wall is also possible, but only during the daytime and early evening. Solar radiation passing through the glass

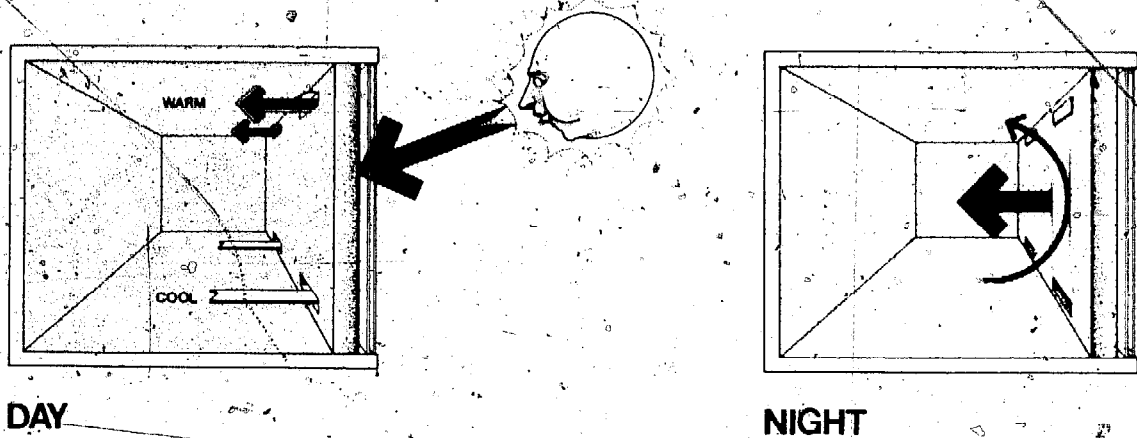


Fig. III-6: Indirect gain—masonry thermal storage wall.

Passive Solar Systems

is absorbed by the wall heating its surface to temperatures as high as 150°F. This heat is transferred to the air in the space between the wall and glass. Through openings or vents located at the top of the wall, warm air rising in the air space enters the room while simultaneously drawing cool room air through the low vents in the wall. In this way additional heat can be supplied to a space during periods of sunny weather.

A well-known example of this system is the Trombe house in Odeillo, France. The house, built in 1967, was designed by Felix Trombe and architect, Jacques Michel. The double-glazed thermal wall is constructed of concrete, approximately 2 feet thick, and painted black to absorb the sunlight that passes through the glass. The house is heated primarily by radiation and convection from the inside face of the wall.

Results from studies show that approximately 70% of this building's yearly heating needs are supplied by solar energy. Research undertaken since 1974 indicates that about 36% of the energy incident on the glass is effective in heating the building in winter. In this sense, the system's efficiency is comparable to a good active solar heating system.


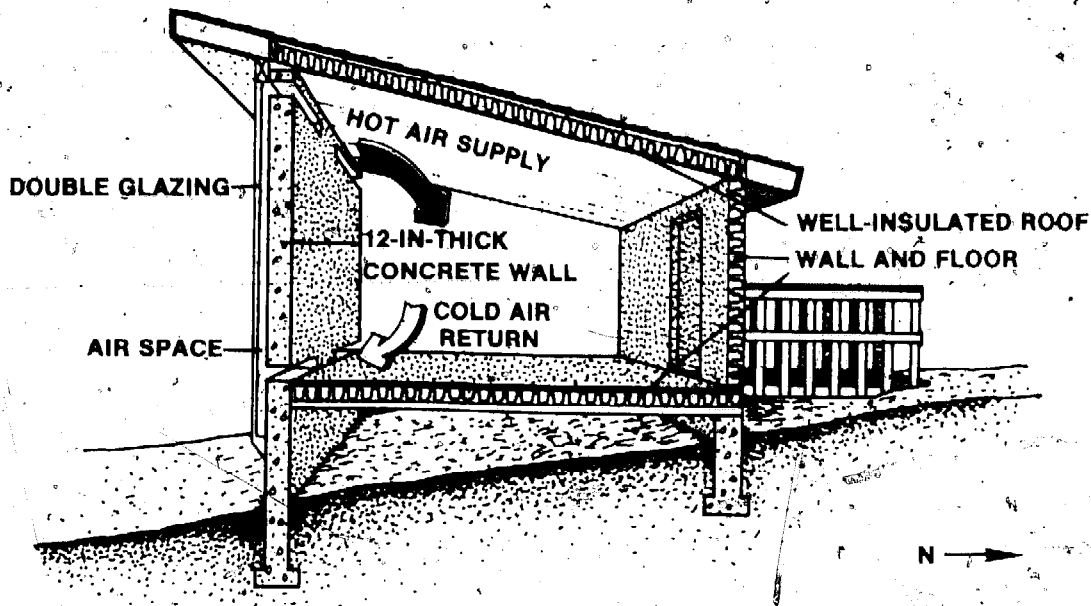



Fig. III-7: Section, Trombe house, Odeillo, France.

The Passive Solar Energy Book



Photo III-5: The first Trombe house (above); attached housing units with thermal storage walls, Odeillo, France (below).

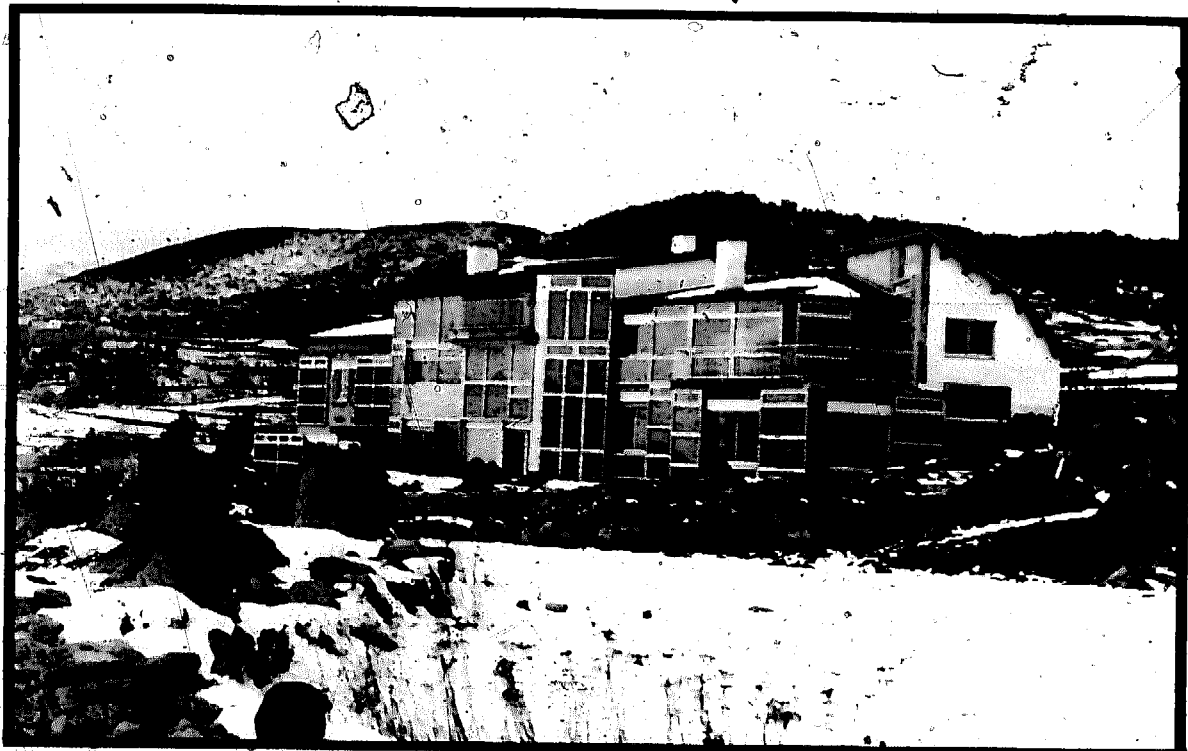

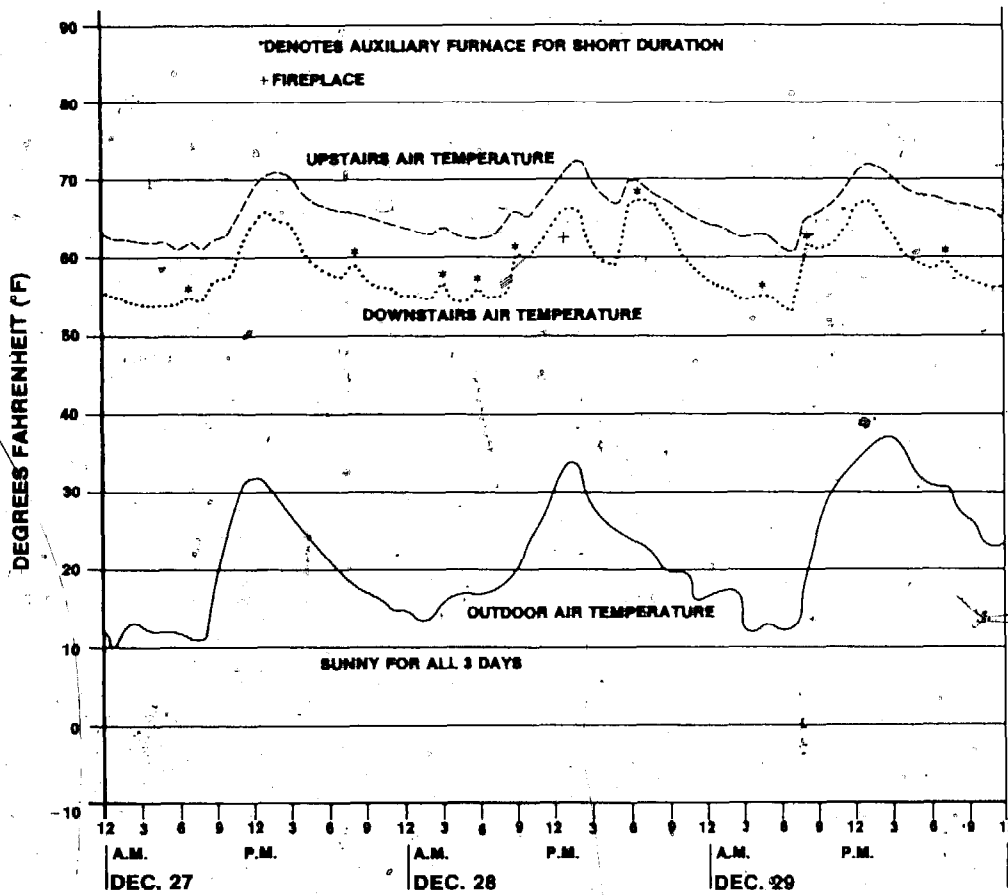

INDOOR AND OUTDOOR TEMPERATURES—
DECEMBER 27, 28, 29, 1977.

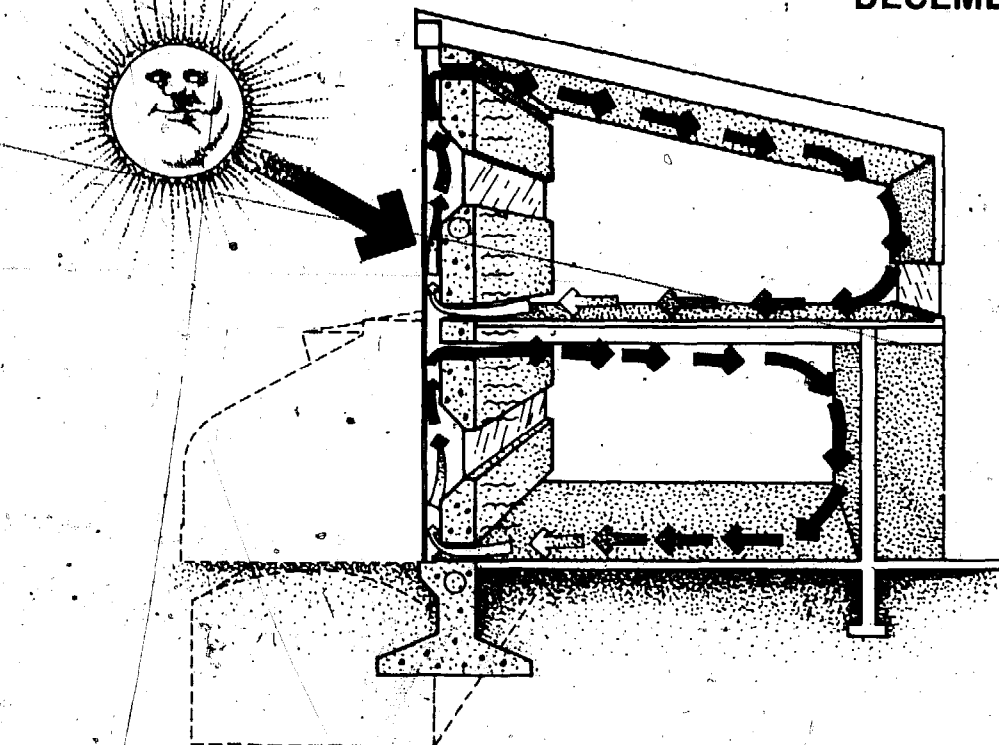


Fig. III-8:
The Kelbaugh house,
Princeton, New Jersey.

SECTION, SOLAR HEATING SYSTEM

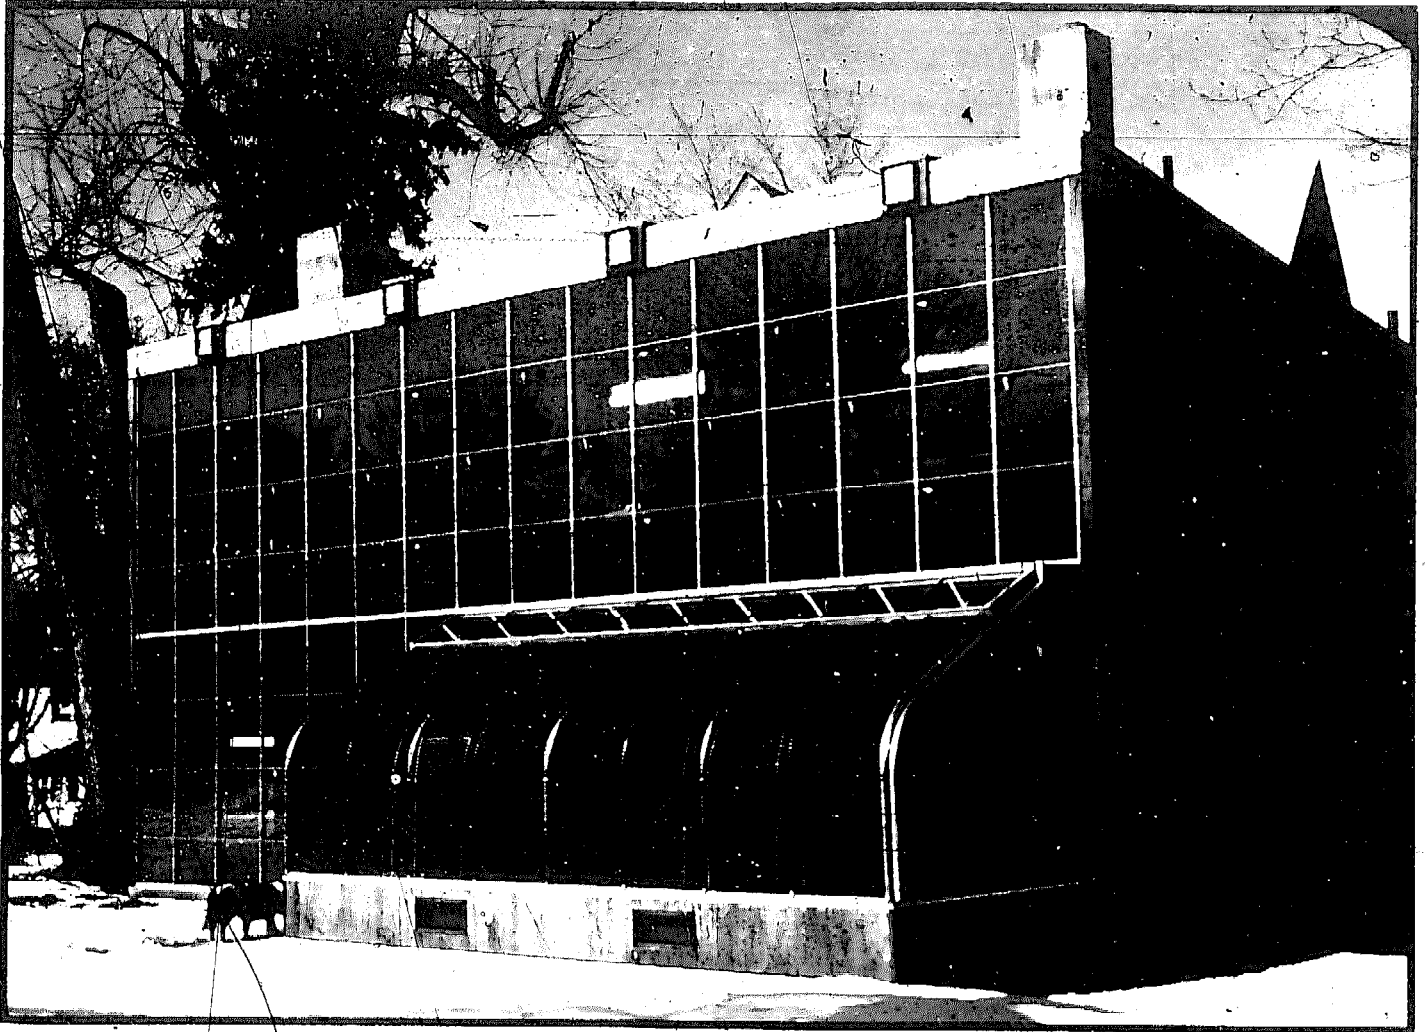


Photo III-6: The Kelbaugh house, a masonry thermal storage wall system, exterior view, and view of the entrance.

An example of a Masonry Thermal Wall System in the United States is the Kelbaugh house in Princeton, New Jersey. Princeton, located slightly north of 40° N, experiences about 55% of the possible sunshine available during the winter. The house, a two-story building, encloses 2,400 square feet of floor area with 600 square feet of thermal storage wall, plus a south-facing greenhouse. The house is located at the northern portion of the 60-by-100-foot lot. Its

Passive Solar Systems



The Passive Solar Energy Book

location clears the shadows from trees in winter and also provides for a large single south-facing outdoor space.

The solar collection system consists of a 15-inch concrete wall, painted black, with two sheets of double-strength window glass placed in front of the wall. Heating is mainly accomplished by radiation and convection from the inside face of the wall. However, vents located at the top and bottom of the wall on each floor permit daytime heating by the natural convection of warmed air from the front face.

According to data gathered in the winter of 1975-76, this passive system reduced space heating costs by 76%. Most often, temperature fluctuations in the house during this period were small, on the order of 3° to 6°F. Downstairs the seasonal high and low temperatures were 68° and 58°F, with the average about 63°F, and upstairs 72° and 62°F, with an estimated average of 67°F. The upstairs experienced slightly higher temperatures due to the migration of warmed air through the open stairwell connecting the levels. Several modifications, such as the addition of operable dampers to prevent reverse thermocirculation at night and a door at the top of the open stairwell to reduce heat migration to the second floor, were made between 1976 and 1977. This improved the system's performance so that the solar contribution was greater that year, reducing heating costs by 84%.

Water Thermal Storage Wall

Essentially masonry and water thermal storage walls collect and distribute heat to a space in the same way, only a water wall transfers this heat through the wall by convection rather than by conduction. The exterior face of a water wall is usually painted black or a dark color for maximum solar absorption. As the wall absorbs sunlight, its surface temperature rises; however, convection currents within the wall keep the surface relatively cool, while distributing the collected heat throughout the entire volume of water (see pattern 12 in the next chapter for a complete description of this process). This heat is then supplied to the space mainly by radiation (and some convection) from the interior face of the wall.

The classic example of the Water Wall System is the Steve Baer residence in Corrales, New Mexico. The house is a series of ten connected domes which enclose 2,000 square feet of floor area. The domes actually employ a com-


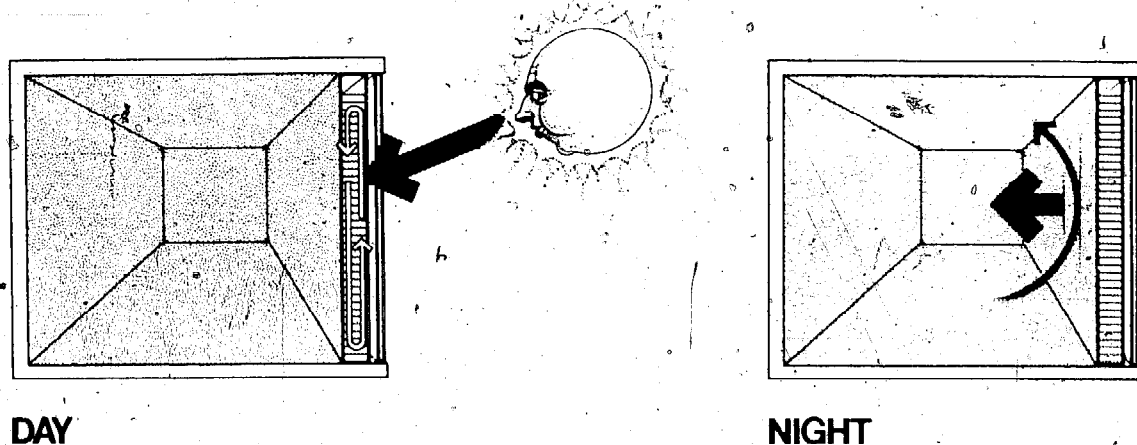


Fig. III-9: Indirect gain—water thermal storage wall.

Integration of passive heating systems—direct gain and thermal storage walls.

Some of the south-facing walls are vertical and contain water-filled 55-gallon metal drums, stacked horizontally in a metal support frame. The walls, approximately 440 square feet in area, are single-glazed and fitted with exterior insulating panels. These panels are hinged to the wall at the bottom so that during the day, in their open position, they function as reflectors, increasing the daily solar gain through the south wall. At night, hoisted into a vertical position against the wall, they insulate the wall to keep the heat collected by the drums inside the space. Control over the heat output of the system has been kept relatively simple. Curtains are drawn over the inside face of the wall when heat is not wanted.

This system keeps temperatures inside the building between 63° and 70°F throughout most of the winter. The water wall, together with interior adobe walls and a concrete floor, moderates the daily fluctuations of temperature inside the building. Fluctuations are small, on the order of 5°F. As a result of its large thermal capacity, the building responds slowly to outdoor weather extremes. For this reason, during periods of cloudy weather the average indoor

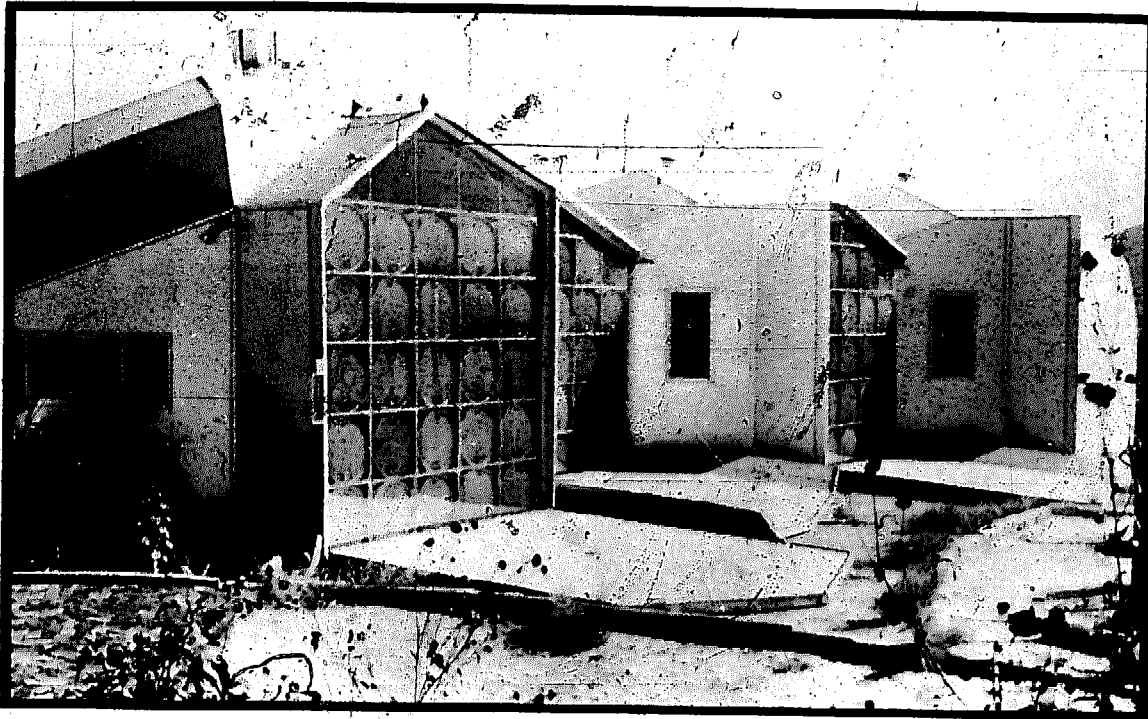

temperature will drop only 2° to 3°F each day. Auxiliary heating, provided by three wood-burning stoves, consumes a total of approximately one cord of wood each year.

Attached Greenhouse

An attached greenhouse is essentially a combination of Direct and Indirect Gain Systems. In this case, a greenhouse (or sun-room) is constructed onto the south side of a building with a mass wall separating the greenhouse from the building. Since it is directly heated by sunlight, the greenhouse functions as a Direct Gain System. However, the space adjacent to the greenhouse receives its heat from the mass wall.

Basically, sunlight is absorbed by the back wall in the greenhouse, converted to heat, and a portion of this heat is then transferred into the building. In this sense, the attached greenhouse is simply an expanded Thermal Storage Wall System, only instead of the glass face being a few inches in front of the wall, it is a few feet, or wide enough to grow plants. By constructing vents or small windows in the wall, warm daytime greenhouse air can also be circulated to adjacent spaces.

Passive Solar Systems

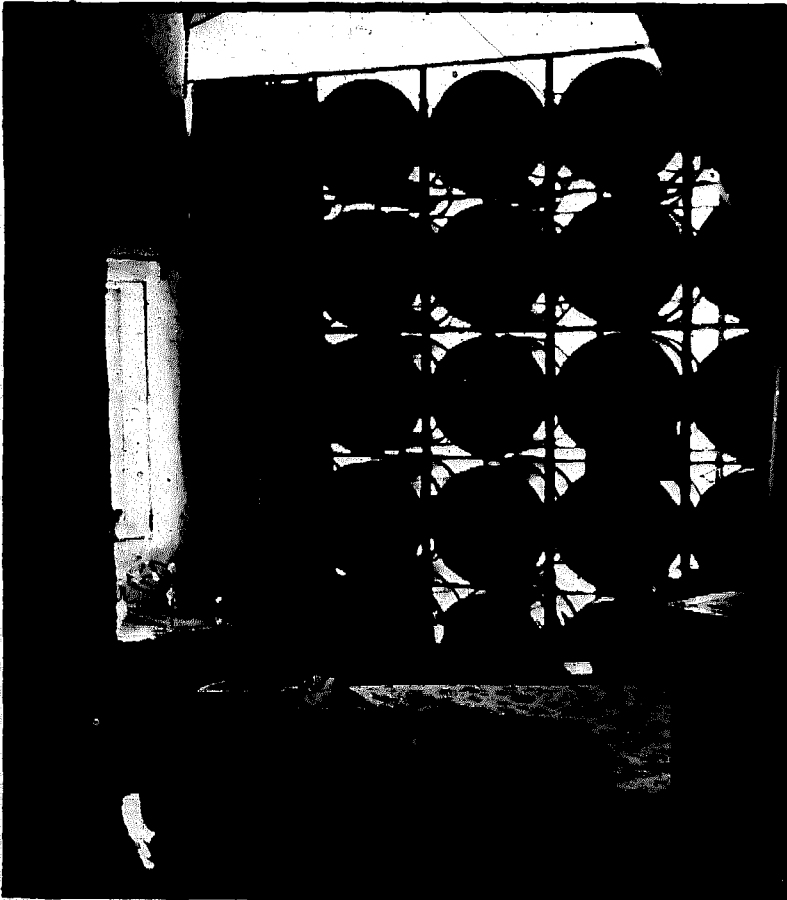


Photo III-7: Steve Baer house; exterior (facing page) and interior (here).

To be effective as a heating source for the building, the common wall is usually constructed of either masonry or water. A wall constructed of light-weight materials has very little mass, and heat storage capacity. Therefore, at night, as outdoor temperatures drop, the wall is not a heat source for the building or the greenhouse.

There are many possible variations that allow for design flexibility in attached greenhouse application. For example, active systems such as fans can be used to insure that a greater percentage of heat is extracted from the greenhouse to heat adjoining spaces (see fig. IV-16b). In this case, warm air ducted from the greenhouse is stored in a rock bed usually located under the floor of the spaces being heated. Heat is then delivered to the space passively by radiation and convection from the floor's surface.

The Passive Solar Energy Book

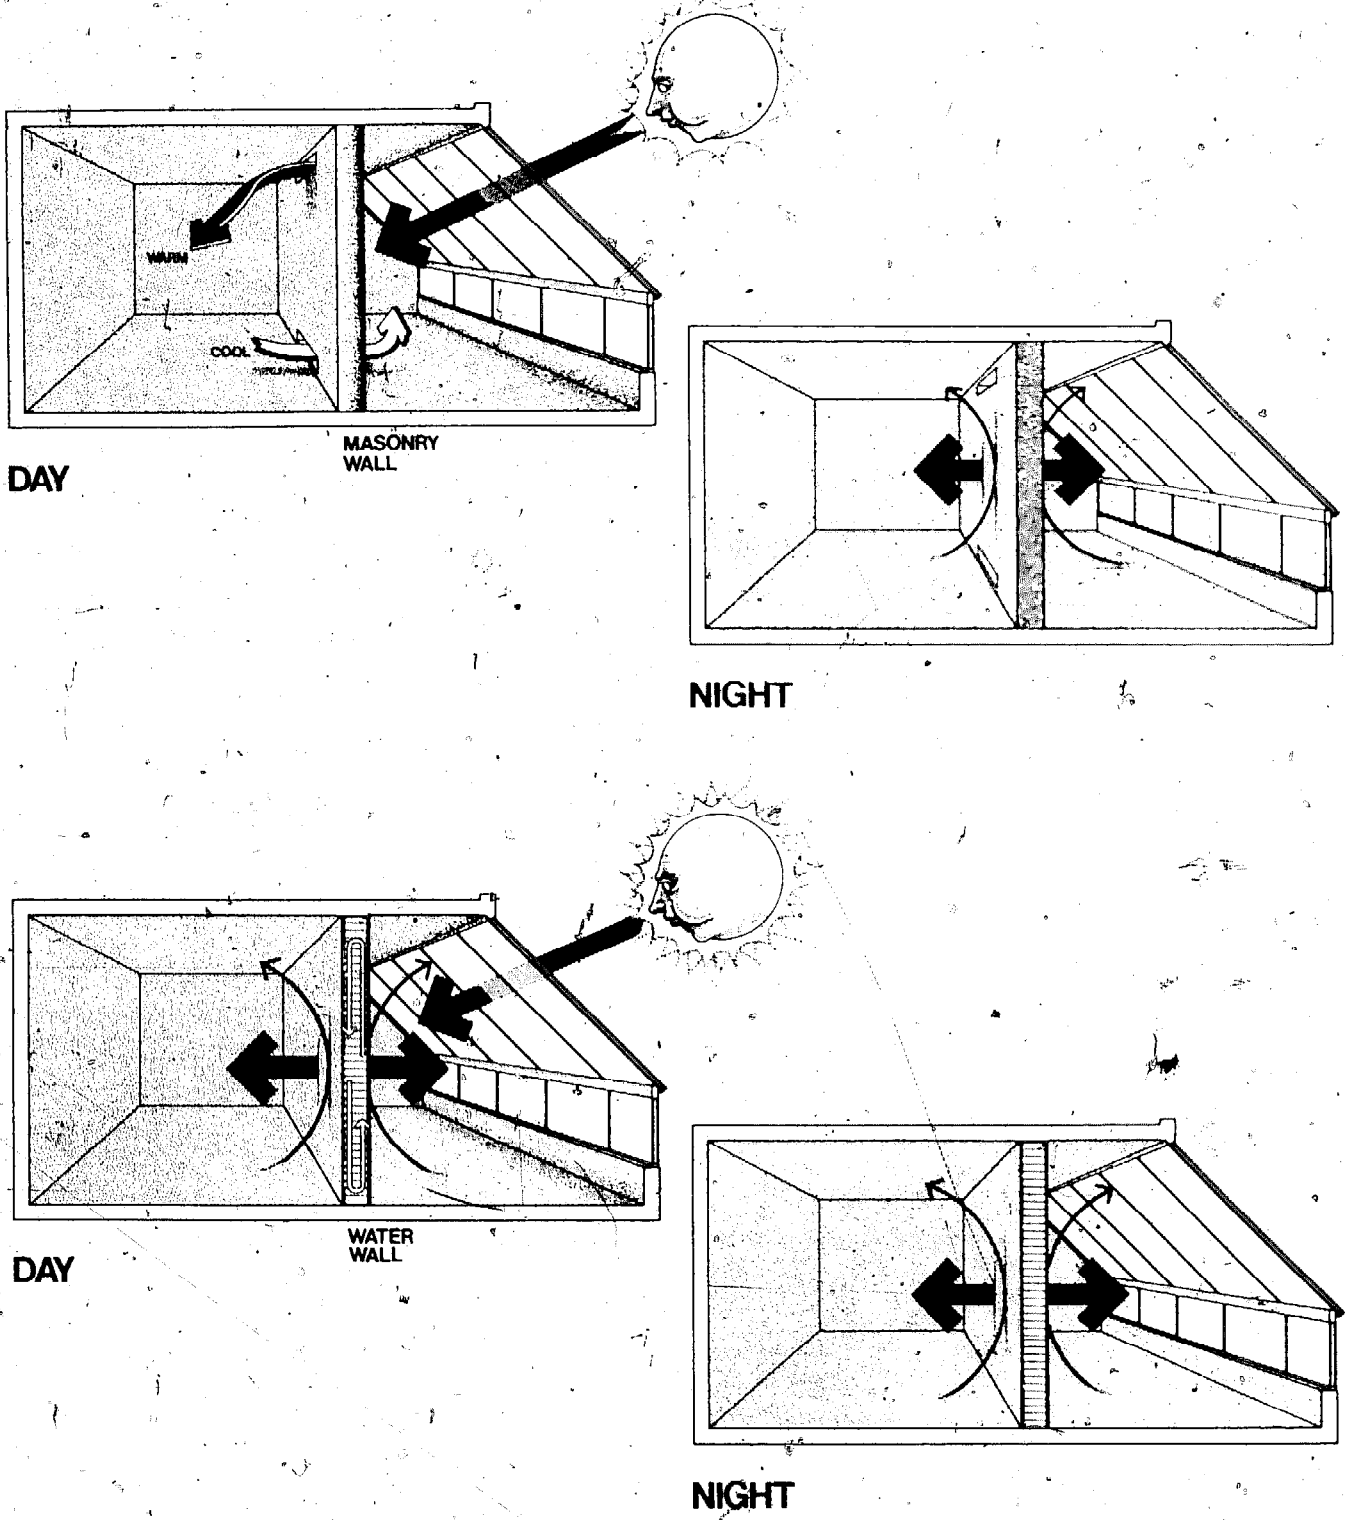


Fig. III-10: Indirect gain—attached greenhouse.



Photo III-8: Attached greenhouse to the south.

Roof Ponds

In a Roof Pond System, the thermal mass is located on the roof of the building. In this case water ponds, enclosed in thin plastic bags, are supported by a roof (usually a metal deck) that also serves as the ceiling of the room below. The system is equally suited to both heating in winter and cooling in summer.

The Passive Solar Energy Book

In winter, the ponds are exposed to sunlight during the day and then covered with insulating panels at night. Heat collected by the ponds is mostly radiated from the ceiling directly to the space below. The convection of heat from the ceiling to air in the space plays a relatively minor role.

In summer the panel positions are reversed, covering the ponds during the day to protect them from the sun and heat and removing them at night to allow the ponds to be cooled by natural convection and by radiation to the cool night sky. After being cooled at night, the ponds are then ready to absorb heat from the space below the following day.

The earliest example of a residence with a Roof Pond System is the experimental building in Atascadero, California. The Roof Pond System was perfected by Harold Hay in 1967. It was not until 1973 that the first residence, based on Hay's design, was built. The residence, designed by architects John Edmisten and Kenneth Haggard, is located in an area that has both heating and cooling requirements.

The roof of this building is constructed of ribbed steel which spans between concrete block walls spaced at 12-foot intervals. The steel deck functions as the structure, heat exchanger (radiant panel) and finished ceiling for the interior of the house. The concrete block walls and masonry floor provide additional thermal mass which increases the building's heat storage capacity and helps reduce daily fluctuations of indoor temperature.

Transparent plastic bags, filled with water, are then placed directly on the steel deck to form the roof ponds. The ponds act as solar collector, storage mass and heat dissipators for cooling. Since they cover the entire roof, the collector area is the same size as the interior floor area, or 1,100 square feet.

The house has been 100% solar heated and naturally cooled since it was occupied in 1973. The Roof Pond System was able to keep indoor temperatures between 66° and 74°F all year. In winter, when outdoor temperatures fluctuated between 32° and 68°F, the house remained between 68° and 72°F. The indoor temperature 5 feet from the floor varied less than 4°F daily.

Also, because the heat exchange area in the building is so large, and, because both heating and cooling are predominantly radiant, comfort conditions were found to be more superior during both seasons than the conventional forced-air system found in many homes.




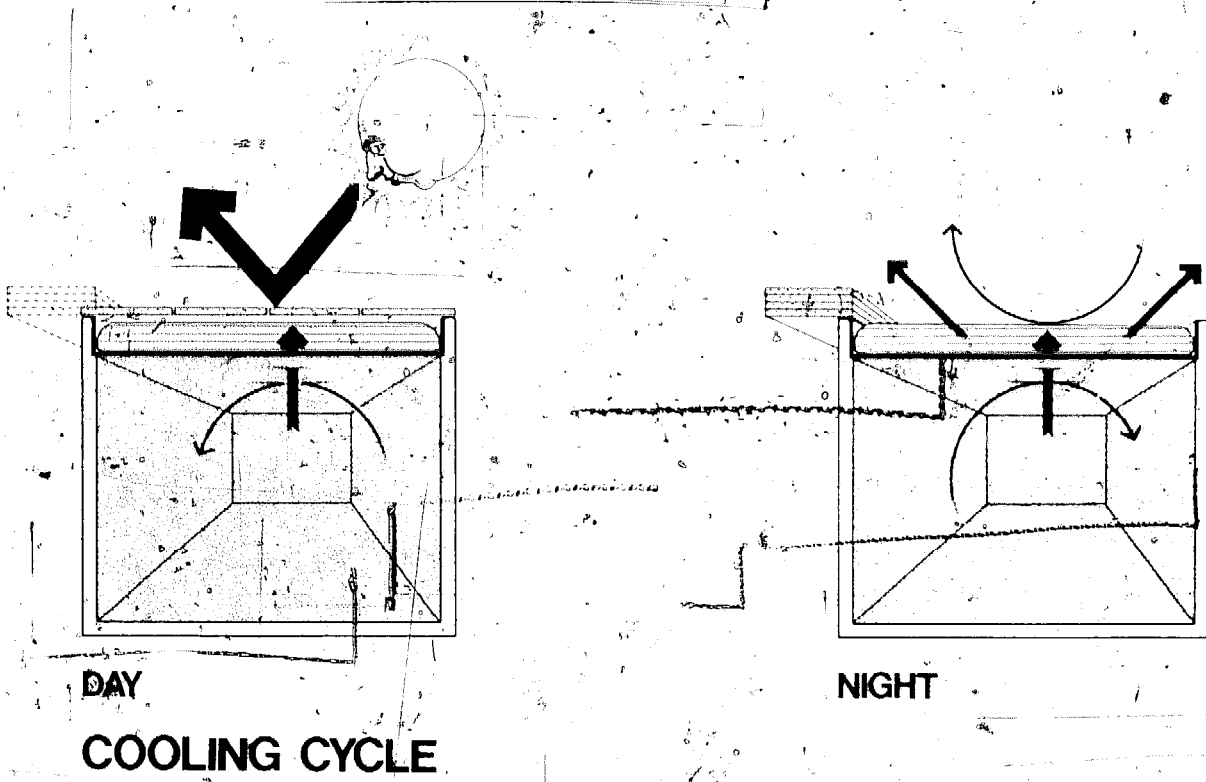


Fig. III-11: Indirect gain roof pond.

The Passive Solar Energy Book

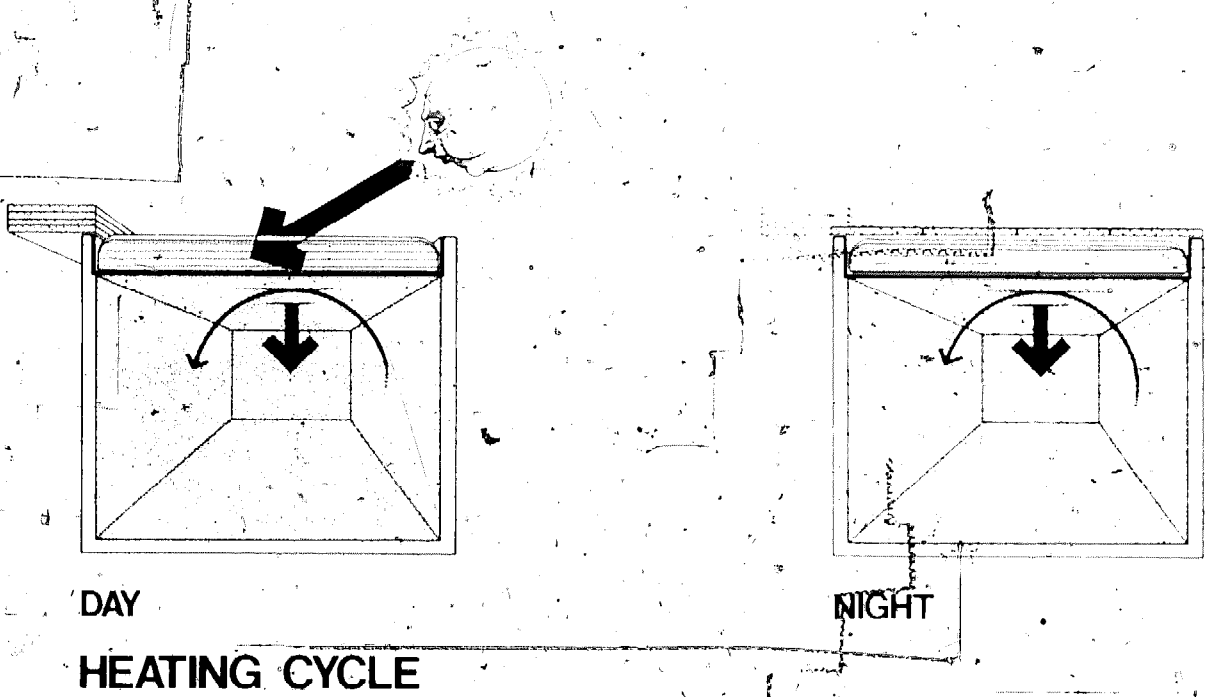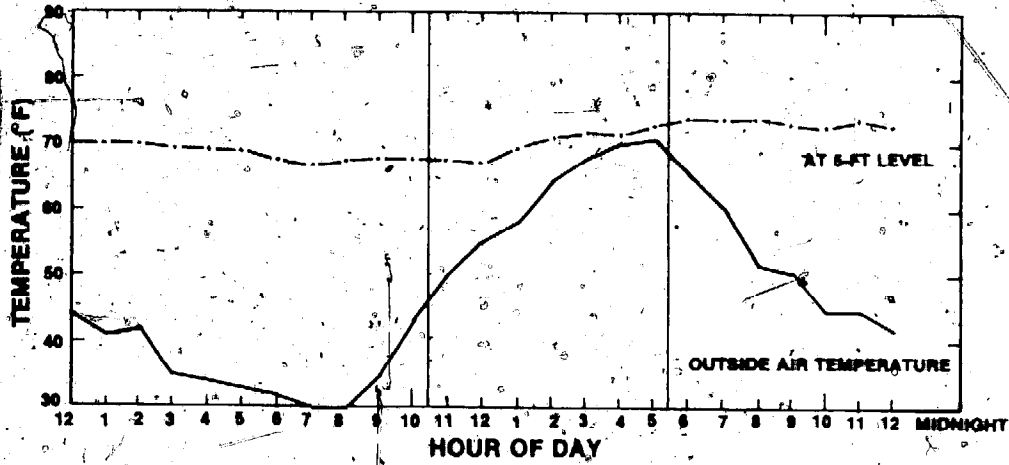

TYPICAL HEATING DAY—FEBRUARY 24

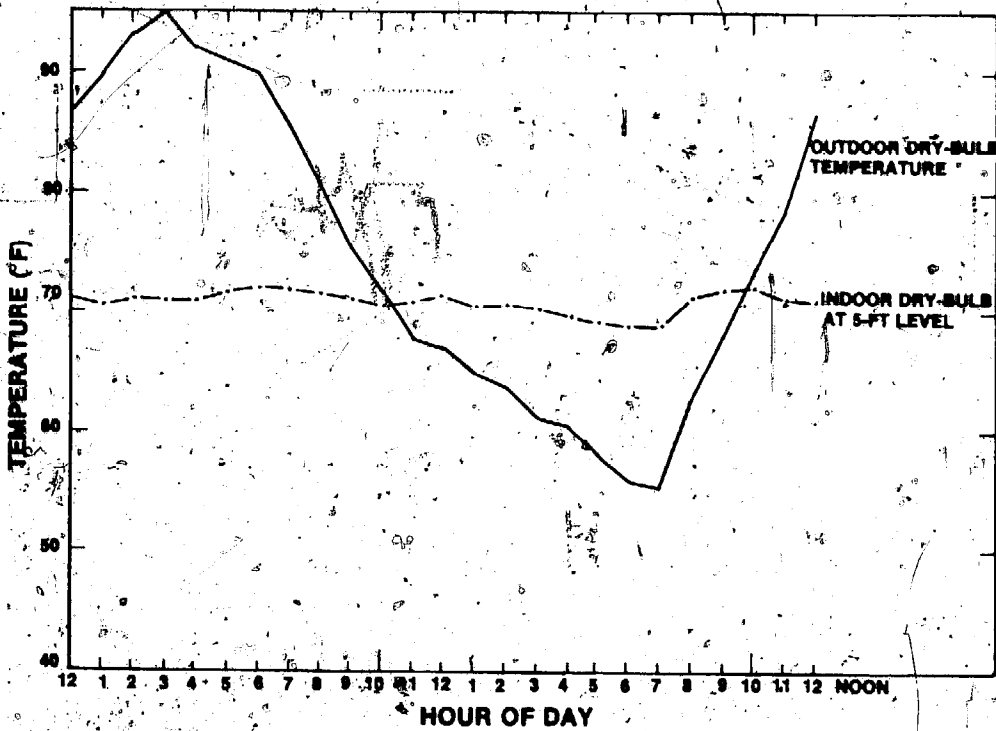

TYPICAL COOLING DAY—AUGUST 23

Fig. III-12: Heating and cooling temperature profiles, Skytherm System, Atascadero, California.

Source: R. P. Stromberg and S. O. Woodall, *Passive Solar Buildings: A Compilation of Data and Results*.



Photo III-9: Atascadero residence—first residential prototype incorporating a roof pond system.

Isolated Gain

A third approach to passive solar heating is the concept of Isolated Gain. In principle, solar collection and thermal storage are isolated from the living spaces. This relationship allows the system to function independently of the building, with heat drawn from the system only when needed.

The most common application of this concept is the natural convective loop. The major components of this system include a flat plate collector and heat

The Passive Solar Energy Book

storage tank. Two types of heat transfer and storage mediums are used: water, and air with rock storage. As the water or air in a collector is heated by sunlight, it rises and enters the top of the storage tank, while simultaneously pulling cooler water or air from the bottom of the tank into the collector. This natural convection current continues as long as the sun is shining.

Perhaps the simplest use of the convective loop is the thermosiphoning hot water heater. Although there are many variations of this system, most are characterized by a flat plate collector connected to a well-insulated water tank by insulation-wrapped piping. The tank is always located above the collector to induce a convective flow of fluid.

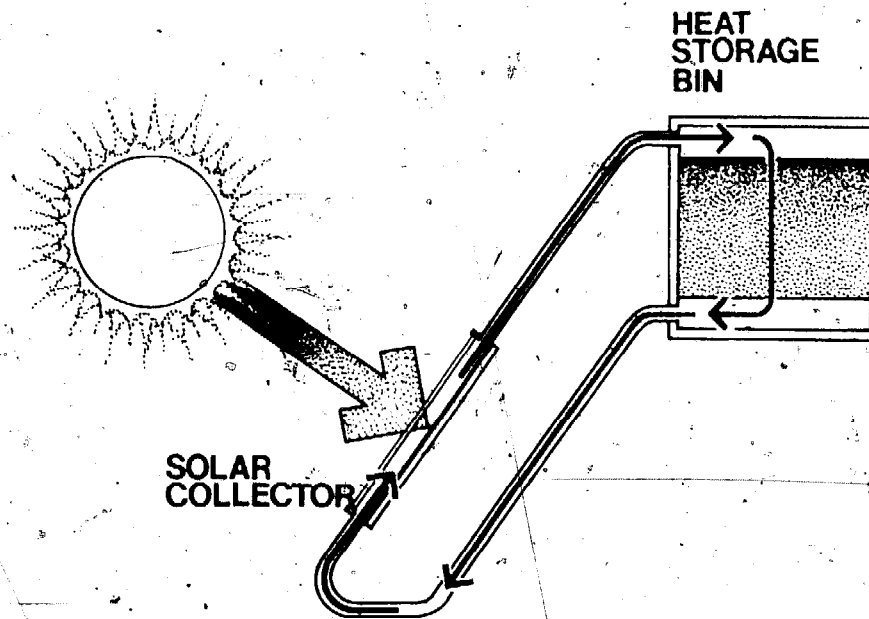


Fig. III-13: Convective loop.

The earliest example using an Air Loop Rock Storage System is the Paul Davis house in Corrales, New Mexico. Air heated in a 320-square-foot collector rises to the top of a rock bin located directly beneath the front porch of the house. As warm air comes in contact with the rocks, it cools and falls to the bottom of

Passive Solar Systems

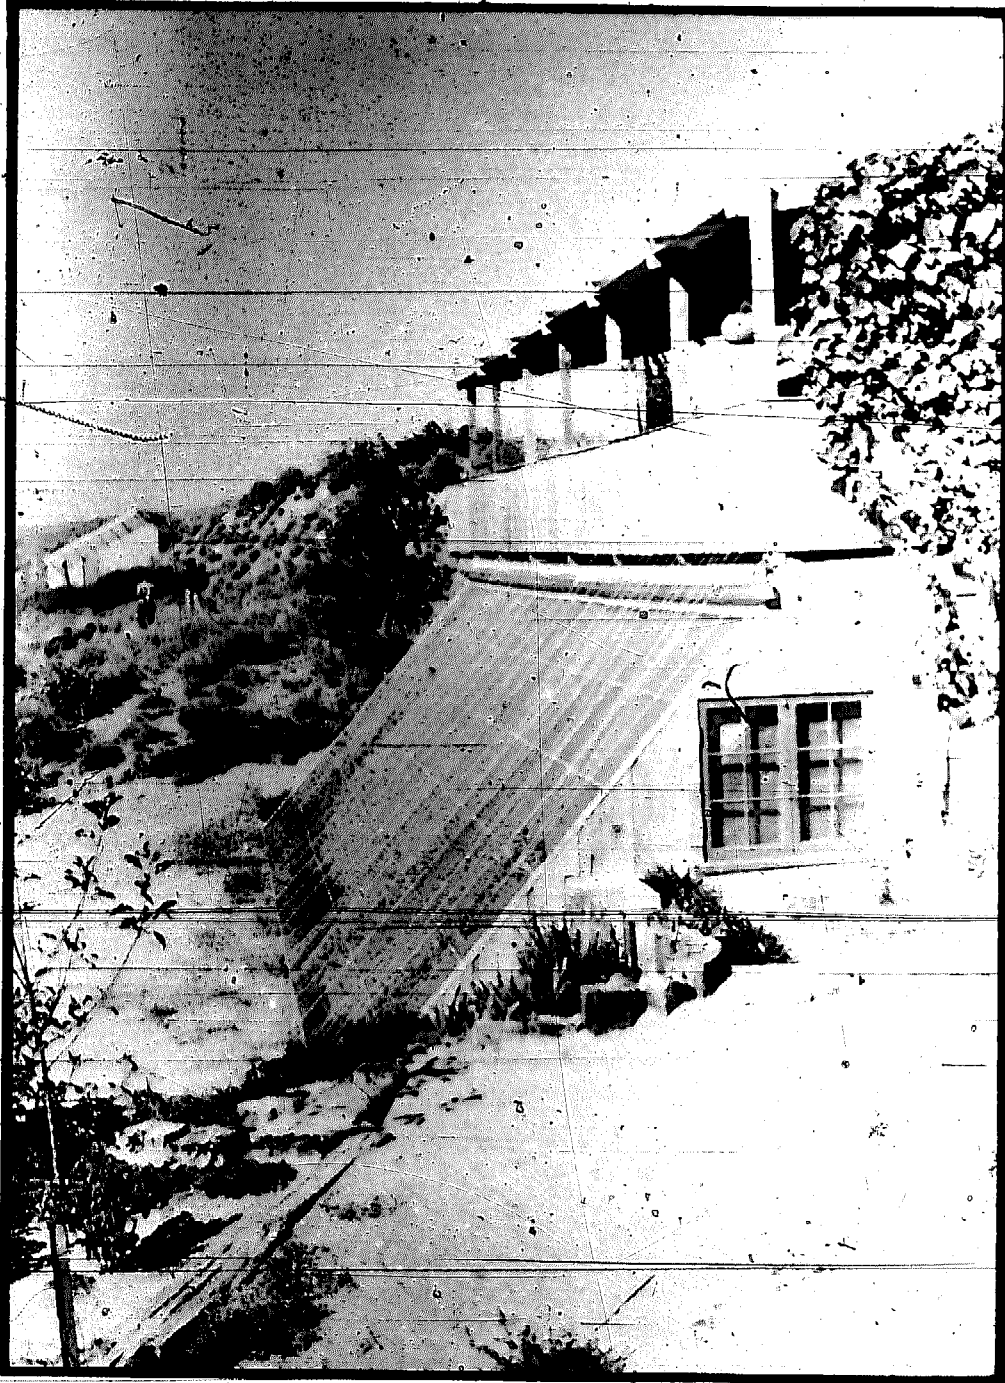


Photo III-10: Paul Davis house—to accommodate the natural heat distribution system, the house sits above the solar collectors and rock storage bin.

The Passive Solar Energy Book

the bin where it is returned to the collector by a duct. At night, warm air is supplied convectively to the house from the top of the bin while cooler air is being drawn from the house to the bottom of the bin.

The convective loop is essentially a Flat Plate Collector System. The methods used to design and size these systems are similar to those used for active systems. The convective loop will not be discussed further since it is outside the scope of this book.

Advantages and Disadvantages of Passive Solar Systems

Many claims have been made for the advantages of passive solar heating systems. These claims can be separated into three categories: economic, architectural and comfort/health. It is important to realize that the extent to which any of these claims is realized depends on the extent to which the actual design is successful in achieving its goals.

Of great interest to those involved in passive systems is the possibility that the system not only affords large savings of energy for heating, but that it also can be included at little or no additional cost in the original design and construction of a building. Since the price of materials varies greatly from place to place, it is not possible to generalize about this claim. In some situations, such as a masonry building, it is possible to include a Direct Gain System at no extra cost. In other cases, where masonry replaces wood frame construction, the extra cost may be considerable. The significant economic advantages of a system can only be evaluated in terms of a particular installation.

Perhaps the greatest advantage of a passive system is the simplicity of its design, operation and maintenance. A passive system can usually be installed, operated and maintained by people with a limited technical background. These systems are built with common construction materials and usually have a long life, low operating temperature, no fans, pumps, compressors, pipes or ducts and few moving parts. Since there is no mechanical equipment, there is little or no noise associated with passive systems. In addition, most systems are completely invisible from the interior of the building; there are no radiators, convectors or grills to deal with.


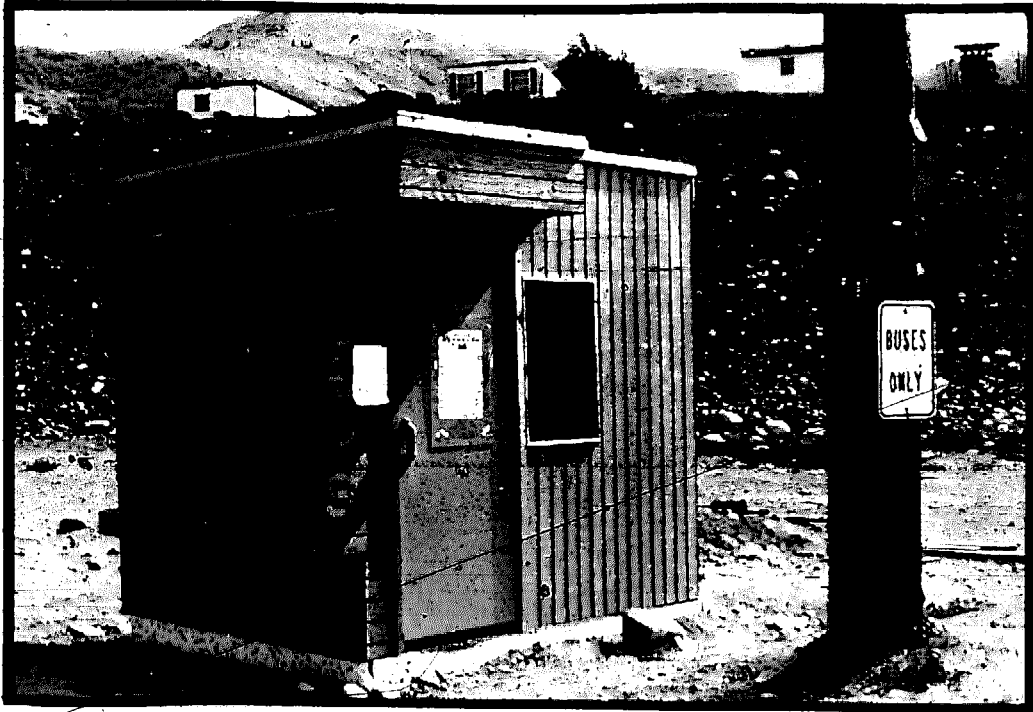


Photo III-11: Bus shelter—simplicity of design, operation and maintenance; north and south views.

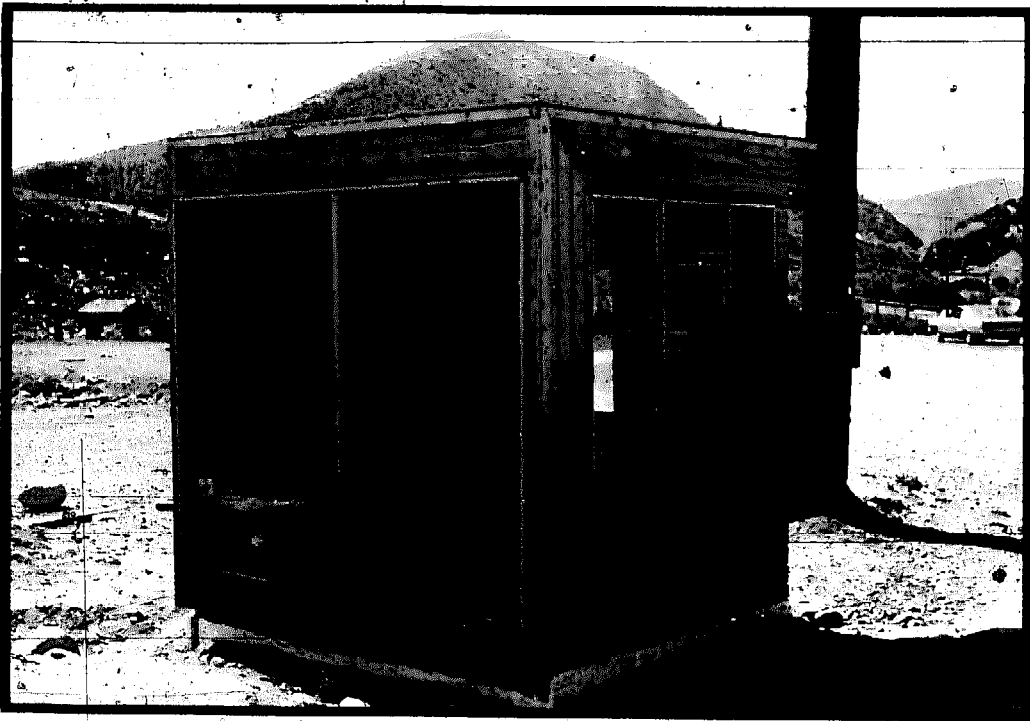

The Passive Solar Energy Book

The question of comfort depends primarily on the maintenance of a thermal environment in which the body can lose heat at a rate equal to its production without the need to sweat on the one hand or shiver on the other. The average adult at rest must continually work to maintain circulation, respiration and other bodily functions. The energy needed to carry out these functions is approximately 80 Btu's per hour. Since the human body is essentially a heat engine with a thermal efficiency of about 20%, it must dissipate 400 Btu's per hour of waste heat to its surroundings.

The body dissipates this heat by three mechanisms: evaporation, convection and radiation. For standard conditions, an adult at rest with light clothing in 74°F air temperature and 50% relative humidity has an evaporation of perspiration from the skin of approximately 25% of the total body heat loss or 100 Btu/hr. The loss of heat by convection to the surrounding air constitutes another 25% or 100 Btu/hr. The remaining 50% or 200 Btu/hr is by radiation to surrounding objects (walls, floor and furniture).

From these figures it is possible to establish a relationship between the average temperature of all the surrounding surfaces or mean radiant temperature (mrt) and space air temperature. A 1°F change in mrt is assumed to have a 40% greater effect on body heat loss than a one degree change in air temperature. Or, for the same feeling of comfort (70°F), for each 1°F increase in mrt the space air temperature can be reduced 1.4°F. Table III-2 gives the values of mrt and the corresponding air temperature needed to produce a feeling of 70°F. Notice that a mrt of 75°F and air temperature of 63°F will produce the same feeling of comfort as a 70°F mrt and 70°F air temperature.

Table III-2 Equivalent Mean Radiant and Air Temperatures for a Feeling of 70°F

Mean radiant temperature	65	66	67	68	69	70	71	72	73	74	75	76	77	78	79	80
Air temperature	77	75.6	74.2	72.8	71.4	70	68.6	67.2	65.8	64.4	63	61.6	60.2	58.8	57.4	56

Since psychological as well as physiological factors play an important role in the feeling of comfort, opinion as well as "sensation" must be considered.

Passive Solar Systems

This makes it difficult to state conclusively, in terms of hard facts, that certain interior conditions are more comfortable than others.

Within their comfort range, most people will accept the statement that the lower the air temperature in a space, the greater the sensation of comfort and health. Many people feel cooler air is more invigorating, fresher and less stuffy, and that their ability to work and think increases in a space where they are warm but, the air temperature is lower than 70°F.

As has been previously noted, the inside air temperature for comfort in a passively heated space is usually somewhat lower, and frequently substantially lower, than in a space heated by conventional (convective) means.

Another relatively intangible advantage of passive solar heating is the maintaining of a warmer floor. In cold climates, convection-type heating systems can lead to unusually large floor-to-ceiling temperature gradients, with low floor temperatures causing thermal discomfort. In a passively heated space, however, the surface temperature of the floor is usually found to be higher than a similar floor in a space with a convective heating system, regardless of whether the system is a direct gain, thermal storage wall or roof pond.

By contrast, the major problem associated with passive systems is one of control. Since each system has a large heat storage capacity which is an integral part of the building's structure, its ability to respond quickly to changes is greatly impeded. Also, storing heat requires a change in the temperature of a material, and since storage materials are an integral part of the living space, the space will also fluctuate in temperature. Excessive space temperature fluctuations can lead to unsatisfactory comfort conditions if the system is not properly designed.

Fortunately, however, there are relatively simple solutions to these problems. For residential applications, temperature control includes operable windows, shading devices and a back-up heating system. In large-scale applications, the solution to control lies in choosing a back-up system that can respond effectively to the users' comfort requirements. There will always be fluctuations of indoor temperature but these can be minimized by properly sizing and locating thermal mass in a space.

IV Design Patterns

Using the Patterns

All acts of building, no matter how large or small, are based on rules of thumb. Architects, contractors, mechanical engineers and owner-builders design and build buildings based on the rules of thumb they have developed through years of their own or other people's experiences. For example, a rule of thumb to determine the depth of 2-inch roof joists is given as *half the span of the joists (feet) in inches*; in other words, to span a 20-foot space one would need roughly 2-by-10-inch joists. Calculations are used to verify and modify these rules of thumb *after* the building has been designed.

We call these rules of thumb "patterns." Each pattern tells us how to perform and combine specific acts of building. We perceive these patterns in our mind. They are the accumulation of our experiences about the design and construction of buildings. The quality of a building, whether it works well or not, will depend largely upon the patterns we use to create it.

To be useful in a design process, rules of thumb must be specific, yet not overly restrictive. For example, if you are required to know the heat loss of a space before applying a rule of thumb to size south-facing glass areas, then the rule of thumb is too specific and of little use since a building has not yet been defined. If, on the other hand, the rule of thumb recommends an approximate size of glass needed for each square foot of building floor area, then the glass can be incorporated into the building's design. After completing a preliminary design, space heat losses can be calculated and the glazing areas adjusted accordingly.

This chapter contains twenty-seven patterns for the application of passive solar energy systems to building design. The patterns are ordered in a rough sequence, from large-scale concerns—BUILDING LOCATION(1), BUILDING SHAPE AND ORIENTATION(2)—to smaller ones—MOVABLE INSULATION (23), REFLECTORS (24); from applications with the most influence on a building's design to ones which deal with specific details of the heating system. When used in this sequence, the patterns form a step-by-step process for the design of a passive solar heated building. Each pattern contains a rule of thumb, based on all the available information at this time for that particular aspect of the building's design.

Each pattern is connected to other patterns which relate to it. Every pattern is independent, yet it needs other patterns to help make it more complete. Large-scale patterns set the context for the ones that follow, and each succeeding pattern helps refine the one that came before it. For example, a window will be more effective as a solar energy collector if the pattern, MOVABLE INSULATION(23), which recommends using insulating shutters over windows at night, is used with the pattern, SOLAR WINDOWS(9).

Each pattern has the same format. First, most patterns begin with a photograph or a visual representation of the pattern. Second, there is an introductory paragraph which relates the pattern to the larger patterns that set the context for it. Then there is a statement of the problem. After the problem statement is the recommendation—the solution to the problem—which gives a specific rule of thumb which can be applied to the building's design. Also included in most recommendations is a diagram describing the rule of thumb. Then, the pattern is cross-referenced to the smaller patterns that relate to it and help make it more complete. And finally, there is the information, which contains all the available data about the pattern and evidence for its validity.

Together the patterns form a coherent picture of a step-by-step process for the design of a passive solar heated building. Each pattern is written in such a way that the headlines (bold type) summarize and describe the essence of the pattern. To understand the whole design process, first read only the headlines (problem statement and recommendation) of all the patterns in the sequence presented in this chapter. Once the whole process is understood, it is easy to go back and read the information in each pattern when a more detailed explanation is needed.

The patterns can also be used to analyze or critique existing buildings or proposed designs. It is possible to look at a building pattern by pattern and see

Heading—description of the content of the pattern

Photograph—actual implementation of the pattern?

Related Larger Scale Patterns—patterns which help set the context for this pattern

Problem Statement—describes the essence of the problem

The Recommendation—a rule of thumb that gives the physical relationships necessary to solve the problem

Illustration—a visual representation of the rule of thumb

Related Smaller Scale Patterns—patterns which embellish this pattern, help implement it and fill-in the details

The Information—provides all the available information about the pattern, evidence for its validity and the range of different ways the pattern can be applied to a building

Fig. IV-1: Structure of a pattern.

9. Solar Windows




9. Solar Windows

After choosing to use a direct gain system (COMBINING THE SYSTEMS) and with a rough idea for the location of major south-facing glass areas (WINDOW LOCATIONS) and (CORRIDORS AND VESTIBULES) for this pattern, determine the area of south-facing glazing needed to solar heat each space.

Direct Gain systems are currently characterized by large amounts of south-facing glass. Although our present information about Direct Gain Systems has been learned through the performance of various existing projects which still contain south-facing glass areas for winter solar gain. These buildings are often thought of as overheating on sunny winter days. This happens because solar windows are frequently oversized due to the lack of an accurate method for predicting a system's performance. These drawbacks have led to a very limited application of Direct Gain Systems in building design and construction.

The Recommendation

In cold climates (average winter temperatures 20 to 30°F) provide between 0.75 and 0.18 square feet of south-facing glass for each one square foot of space floor area. In temperate climates (average winter temperatures 35 to 45°F) provide 0.11 to 0.25 square feet of south-facing glass for each one square foot of space floor area. This amount of glazing will admit enough sunlight to keep the space at an average temperature of 65 to 70°F during much of the winter.

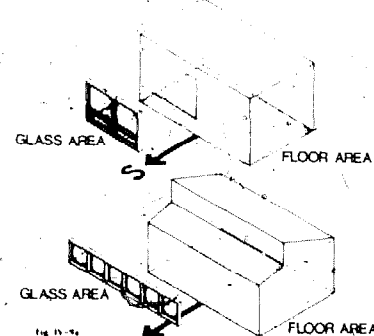

To prevent daytime overheating and large space temperature fluctuations store a portion of the heat gained during the daytime for use at night by insulating a thermal mass within each space (MASSIVE THERMAL STORAGE) and INTERIOR WALL MASS (2). Use MAXIMUM INSULATION (2); Store the solar windows at night to reduce heat loss and protect the windows from hot summer sun by applying SHADING DEVICES (2). The area of window needed to heat a space can be substantially reduced by using exterior REFLECTORS (2). A Direct Gain System with undersized solar windows can be combined with other passive systems to achieve the same recommended performance (COMBINING SYSTEMS (2)).

The Information

In a Direct Gain System the most important factor in collecting the sun's energy is the size and placement of window openings. A window skylight or clerestory that faces south and opens directly into a space is a very efficient solar collector. WINDOW LOCATIONS: Light entering the space is unlikely to be reflected back out regardless of the color or shape of the space. This means that usually all the sunlight is absorbed by the walls, floor, ceiling and other objects in the space and is converted into heat. Openings that are designed primarily to admit solar energy into a space are referred to as solar windows. You can orient a solar window as much as 25° to the east or west of true south and still intercept over 90% of the solar radiation incident on a south-facing surface.

The size of a solar window determines the average temperature in a space over the day. During a typical sunny winter day, if a space becomes uncomfortably hot from too much sunlight, then the solar windows are either oversized or there is not enough thermal mass distributed within the space to properly absorb the incoming radiation. As a space becomes too warm, heated air is vented by opening windows or activating an exhaust fan to maintain comfort. This reduces the system's efficiency since valuable heat is allowed to escape. For this reason, our criterion for a well-designed space is that it gain enough solar energy, on an average sunny day in December or January, to maintain an average space temperature of 70°F for that 24-hour period.

Design Patterns

which patterns are present and which are missing. In this way changes or repairs necessary to improve the building can be readily seen.

However, not all of the patterns apply to each project. For example, the pattern, CHOOSING THE SYSTEM(7), gives criteria to help you select the most appropriate passive system for your project. After making this choice, patterns which define other passive systems are not relevant. Also, a pattern may not apply to your specific situation. In this case, it is important to understand the spirit of the pattern and modify it, so that it makes sense for you.

Select the patterns most useful to your project, more or less in the sequence presented here. The following list of patterns is divided into three major groups. First are the design patterns which give the building its overall shape and fix its position on the site according to the sun, wind and trees:

1. BUILDING LOCATION
2. BUILDING SHAPE AND ORIENTATION
3. NORTH SIDE
4. LOCATION OF INDOOR SPACES
5. PROTECTED ENTRANCE
6. WINDOW LOCATION

Second are patterns which provide criteria for the selection of a passive system and give specific details for its design:

7. CHOOSING THE SYSTEM
8. APPROPRIATE MATERIALS

Direct Gain Systems

9. SOLAR WINDOWS
10. CLERESTORIES AND SKYLIGHTS
11. MASONRY HEAT STORAGE
12. INTERIOR WATER WALL

Thermal Storage Wall Systems

13. SIZING THE WALL
14. WALL DETAILS

The Passive Solar Energy Book

Attached Greenhouse Systems

15. SIZING THE GREENHOUSE
16. GREENHOUSE CONNECTION

Roof Pond Systems

17. SIZING THE ROOF POND
18. ROOF POND DETAILS

Greenhouse

19. SOUTH-FACING GREENHOUSE
20. GREENHOUSE DETAILS
21. COMBINING SYSTEMS
22. CLOUDY DAY STORAGE

And third are the patterns with specific instructions to make the building more efficient as a passive system:

23. MOVABLE INSULATION
24. REFLECTORS
25. SHADING DEVICES
26. INSULATION ON THE OUTSIDE
27. SUMMER COOLING

Remember that these patterns are evolving and will change over time. Each pattern represents a current recommendation of how to solve a particular problem. As new information becomes available, the solutions to these problems may change slightly. As new problems are defined, new patterns will be generated and added to the process. All the patterns may evolve over time as new experiments, experiences and observations become available.

This means that the patterns should not be taken too literally. Since research into passive systems is relatively new, there is a need to question and refine the patterns over a period of time. There may be some instances where you have information which is more accurate or relevant to your particular situ-

Design Patterns

ation. You can see then that the patterns are meant to be flexible. They are presented in such a way that if you want to add new information to a pattern, or change a pattern, you can do so without losing the essence of it.

Finally, the reader must realize that the extent to which any or all of the patterns are realized in practice depends in large measure on the extent to which the designer succeeds in understanding and applying the patterns.



1. Building Location



Photo: IV-1a

1. Building Location

The amount of care taken in placing a building on a site with respect to open space and sun is perhaps the single most important decision you will make about the building.



Buildings blocked from exposure to the low winter sun between the hours of 9:00 a.m. and 3:00 p.m. cannot make direct use of the sun's energy for heating. During the winter months, approximately 90% of the sun's energy output occurs between the hours of 9:00 a.m. and 3:00 p.m. sun time (see chap. 5 for an explanation of sun time). For example, in New York City (40°NL) on a square foot of south-facing surface on a clear day in the month of December, 1,610 Btu's out of a daily total of 1,724 Btu's (or 93% of the total) are intercepted between the hours of 9:00 a.m. and 3:00 p.m. Between the hours of 9:30 a.m. and 2:30 p.m. 1,272 Btu's (or 74% of the total) are intercepted. Any surrounding elements, such as buildings or tall trees, that block the sun during these times will severely limit the use of solar energy as a heating source.

The Recommendation

To take advantage of the sun in climates where heating is needed during the winter, find the areas on the site that receive the most sun during the hours of maximum solar radiation—9:00 a.m. to 3:00 p.m. (sun time). Placing the building in the northern portion of this sunny area will (1) insure that the outdoor areas and gardens placed to the south will have adequate winter sun and (2) help minimize the possibility of shading the building in the future by off-site developments.

The Passive Solar Energy Book

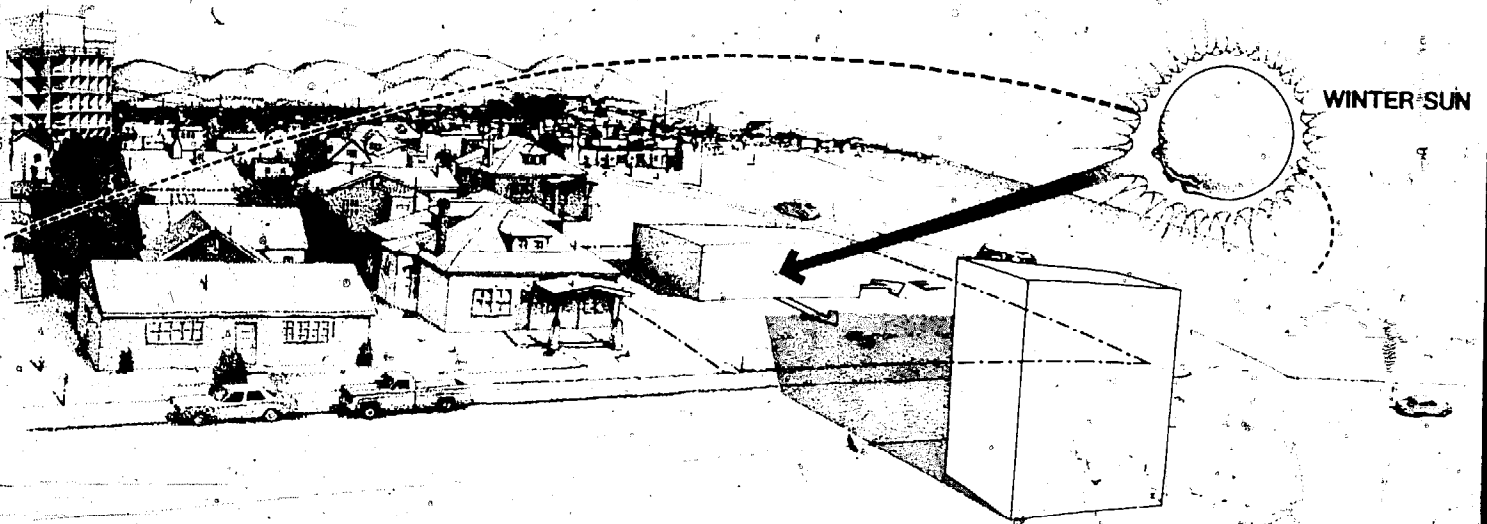


Fig. IV-1a



When deciding on the exact location for the building within a sunny area, give the building a rough shape—**BUILDING SHAPE AND ORIENTATION(2)**—and place the entrance of the building so that it receives the greatest protection from the cold winter winds—**PROTECTED ENTRANCE(5)**.

The Information

To take advantage of the winter sun, first the sunny places on the site need to be located. To do this, explore the site and determine which places have an open view to the south with minimum blockage of the low winter sun. The sun chart (chap. 5) is very useful in visualizing site obstructions that block direct sun from reaching any point on the site. Remember to use the correct sun chart for your latitude.

If the skyline to the south is low with no obstructions such as tall trees, buildings or abruptly rising hills, then the following procedure is unnecessary as all points on the site will receive sun during the winter. If there are obstructions, then the skyline should be accurately plotted on the sun chart to determine the extent of solar blockage. (See "Plotting the Skyline" in chap. 5.)

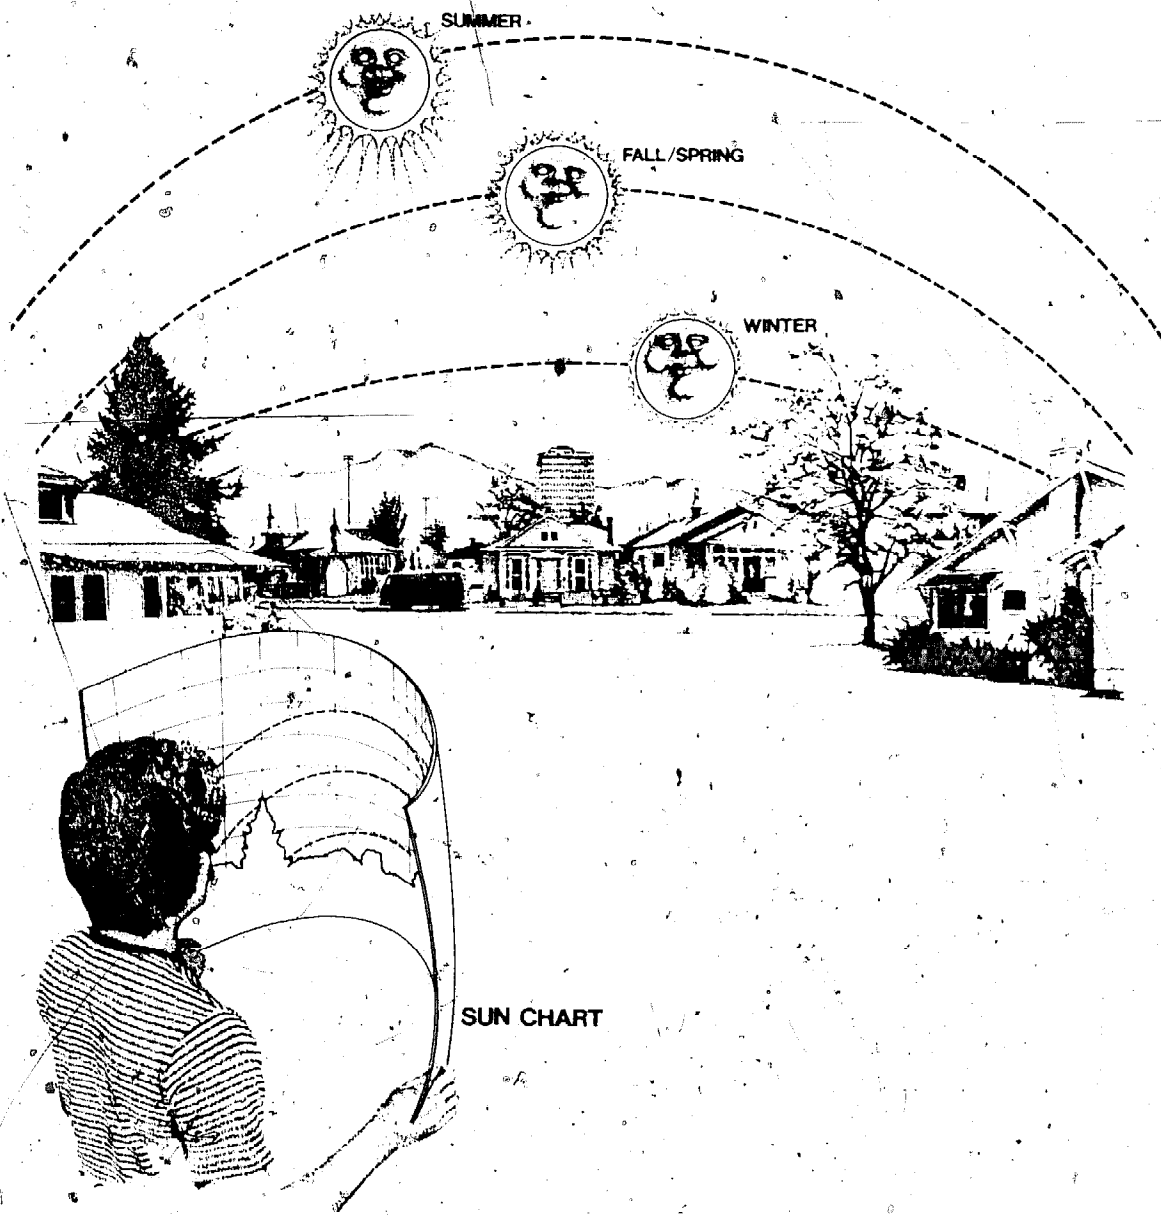


Fig. IV-1b: Using the sun chart to visualize solar obstructions.

For small urban sites surrounded by large obstructions, it may not be feasible to plot the skyline since the skyline changes drastically when seen from different points on the site only a few feet away from each other. In this situation a simple three-dimensional model of the site and its surroundings should be built. This model, when used in conjunction with a sundial, will help you determine the best building locations with exposure to the winter sun.

When deciding on the exact location of the building, you must also choose the place for the outdoor spaces next to the building. Christopher Alexander, in

The Passive Solar Energy Book

This book *A Pattern Language: Towns, Buildings, Construction* makes this observation about the use of open space:

*People use open space if it is sunny, and don't use it if it isn't, in all but desert climates.**

The recently built Bank of America building in San Francisco—a giant building built by a major architect—has its plaza on the north side. At lunchtime, the plaza is empty, and people eat their sandwiches in the street, on the south side where the sun is.

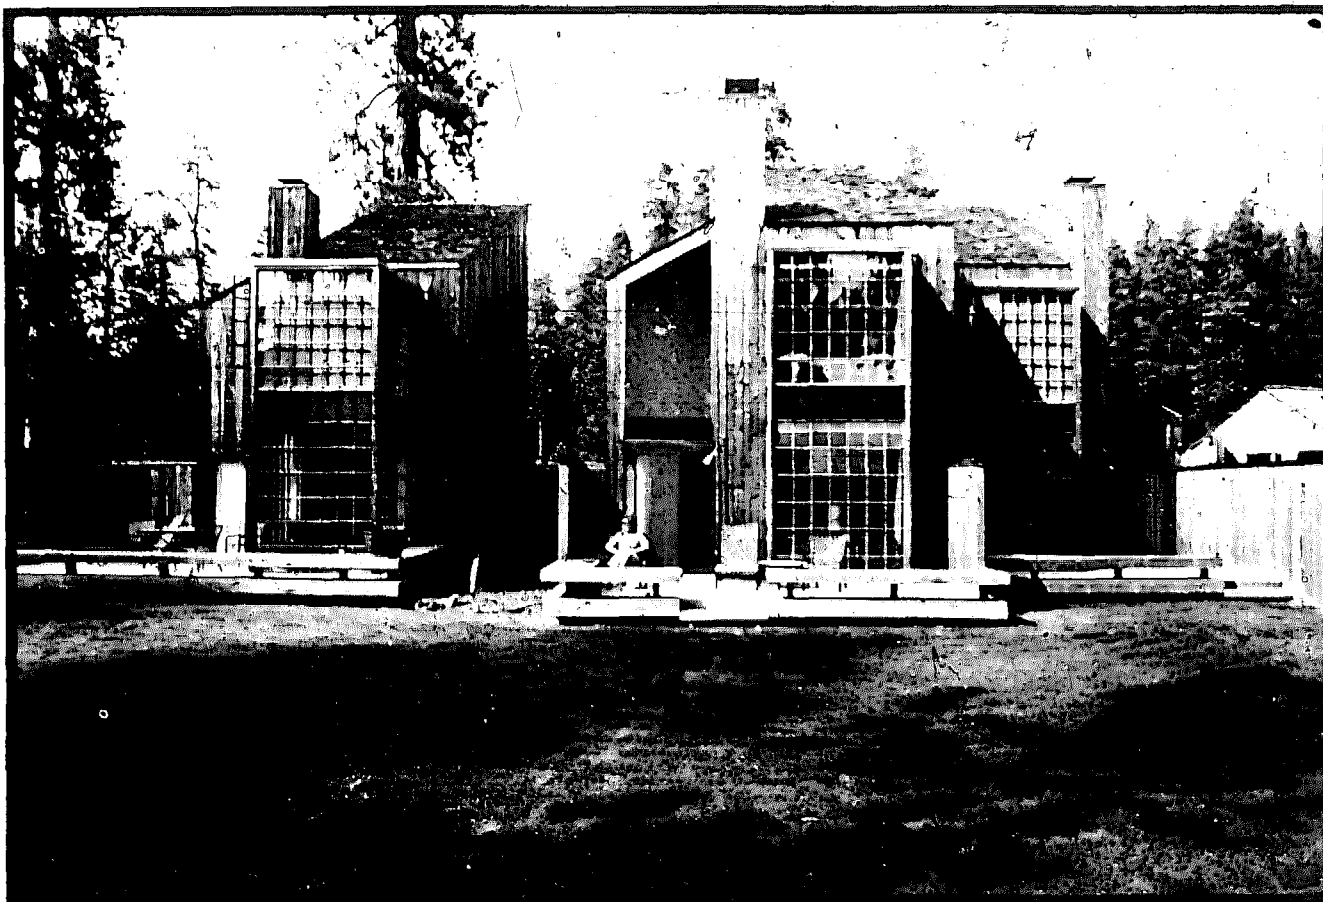


Photo IV-1b: South-facing outdoors.

*Author's italics.

1. Building Location

A survey of a residential block in Berkeley, California, confirms this problem dramatically. Along Webster Street—an east-west street—18 of 20 persons interviewed said they used only the sunny parts of their yards. Half of these people living on the north side of the street—*these people did not use their backyards at all*,* but would sit in the front yard, beside the sidewalk, to be in the south sun.

Note that this pattern was developed in the San Francisco Bay Area. Of course, its significance varies as latitude and climate change. In Eugene, Oregon, for example, with a rather rainy climate, at about 44° latitude, the pattern is even more essential: the south faces of the buildings are the most valuable outdoor spaces on sunny days.

It is evident that the south faces of buildings are not only important for the collection of solar radiation, but are also the most valuable outdoor spaces on sunny days.



*Author's italics.

2. Building Shape and Orientation

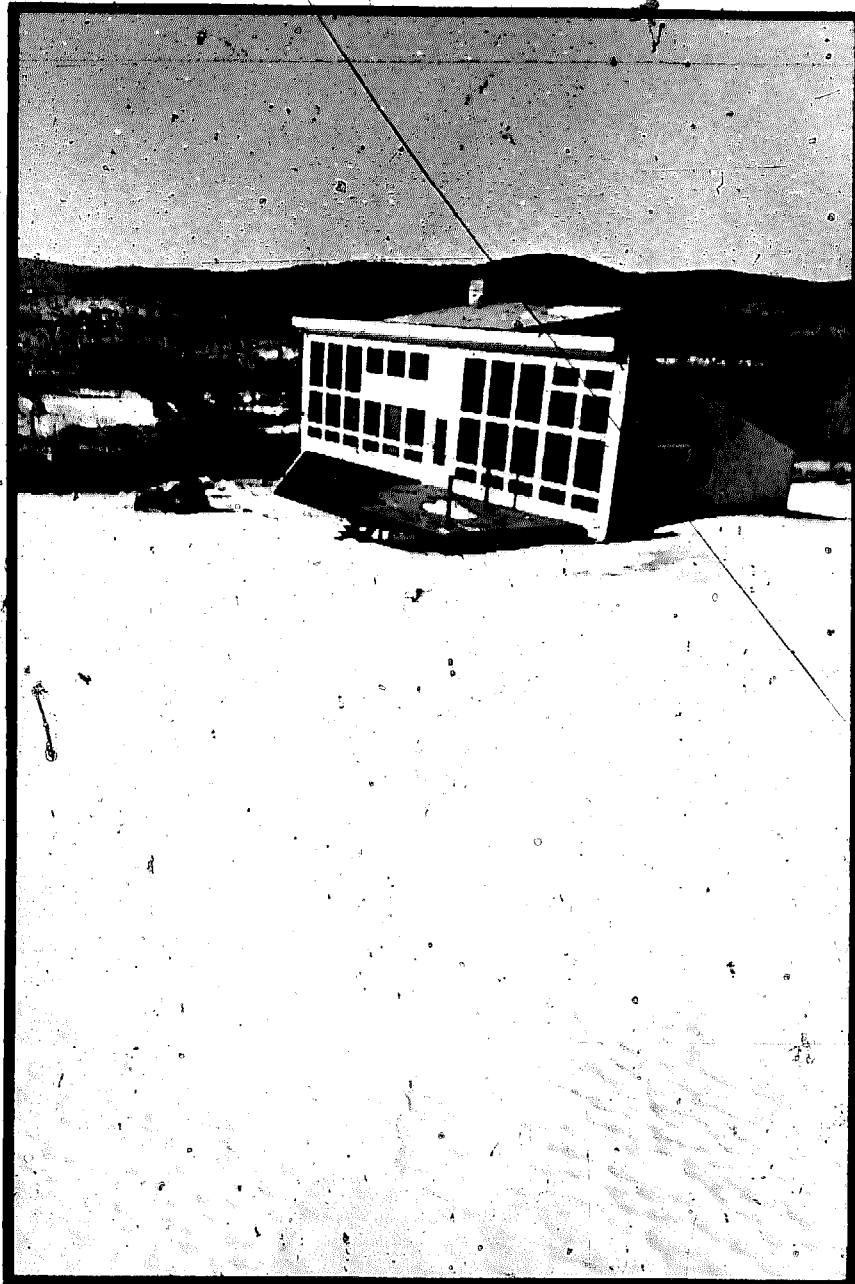


Photo IV-2a

2. Building Shape and Orientation

With an idea for the location of the building on the site—BUILDING LOCATION(1), it is necessary to define the rough shape of the building, with consideration for admitting sunlight into the building, before laying out interior spaces.



Buildings shaped without regard for the sun's impact require large amounts of energy to heat and cool. Approximately 20% of the energy consumed in the United States is used for the space heating and cooling of buildings. In spite of worldwide dwindling energy resources, many buildings today are still shaped without regard for the sun's impact on, and potential contribution to, space heating and cooling.

The Recommendation

When deciding on the rough shape of a building, it is necessary to think about admitting sunlight into the building. A building elongated along the east-west axis will expose more surface area to the south during the winter for the collection of solar radiation. This is also the most efficient shape, in all climates, for **MINIMIZING** heating requirements in the winter and cooling in the summer.

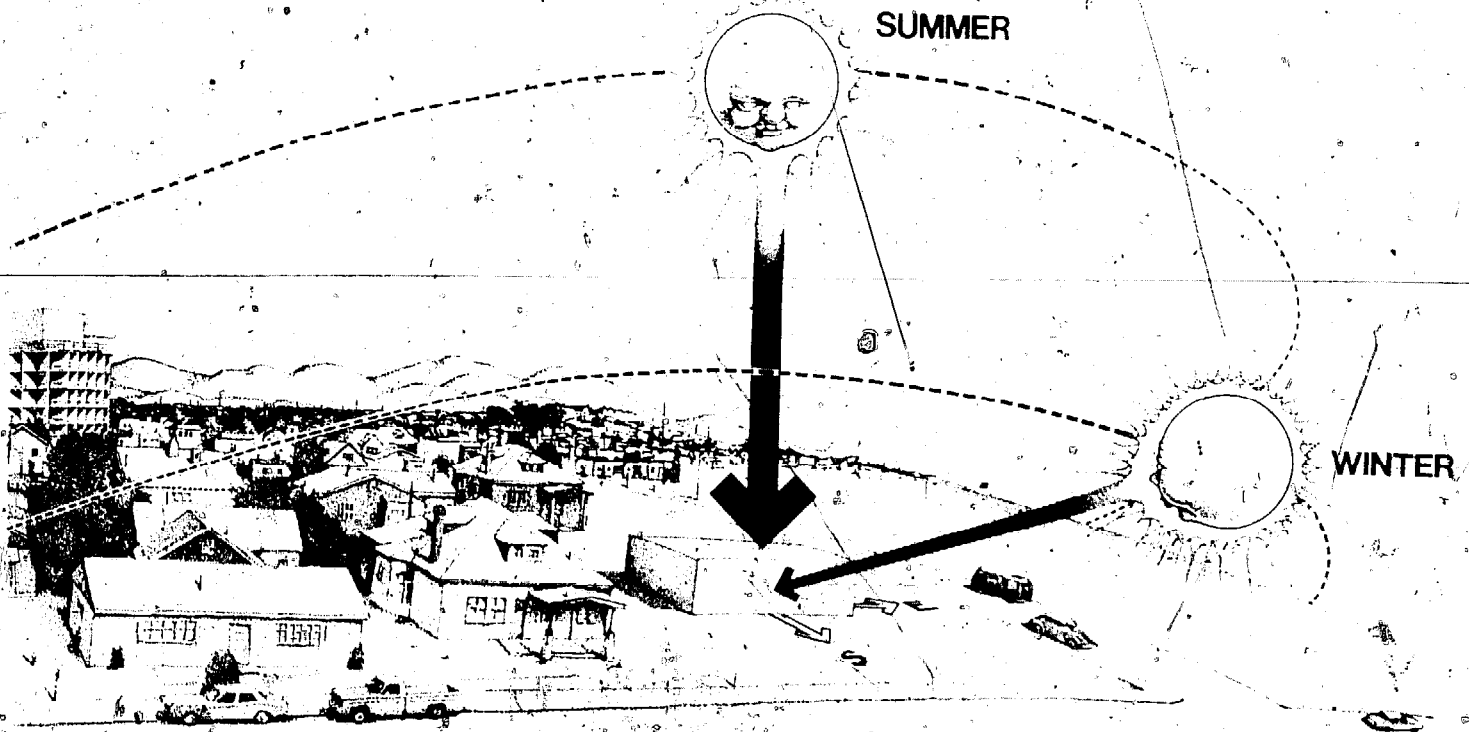


Fig. IV-2a

After giving the building a rough shape, locate the spaces with maximum heating and lighting requirements along the south face of the building and the buffer areas (storage, garage and utility room) along the north face—LOCATION OF INDOOR SPACES(4).

The Information

The optimum shape of a building is one which loses a minimum amount of heat in the winter and gains a minimum amount of heat in the summer. Victor Olgay, in his book *Design with Climate*, has investigated the effect of thermal impacts (sun and air temperature) on building shapes for different climates in the United States. From these investigations he drew the following conclusions:

1. The square house is not the optimum form in any location.
2. All shapes elongated on the north-south axis work both in winter and

2. Building Shape and Orientation

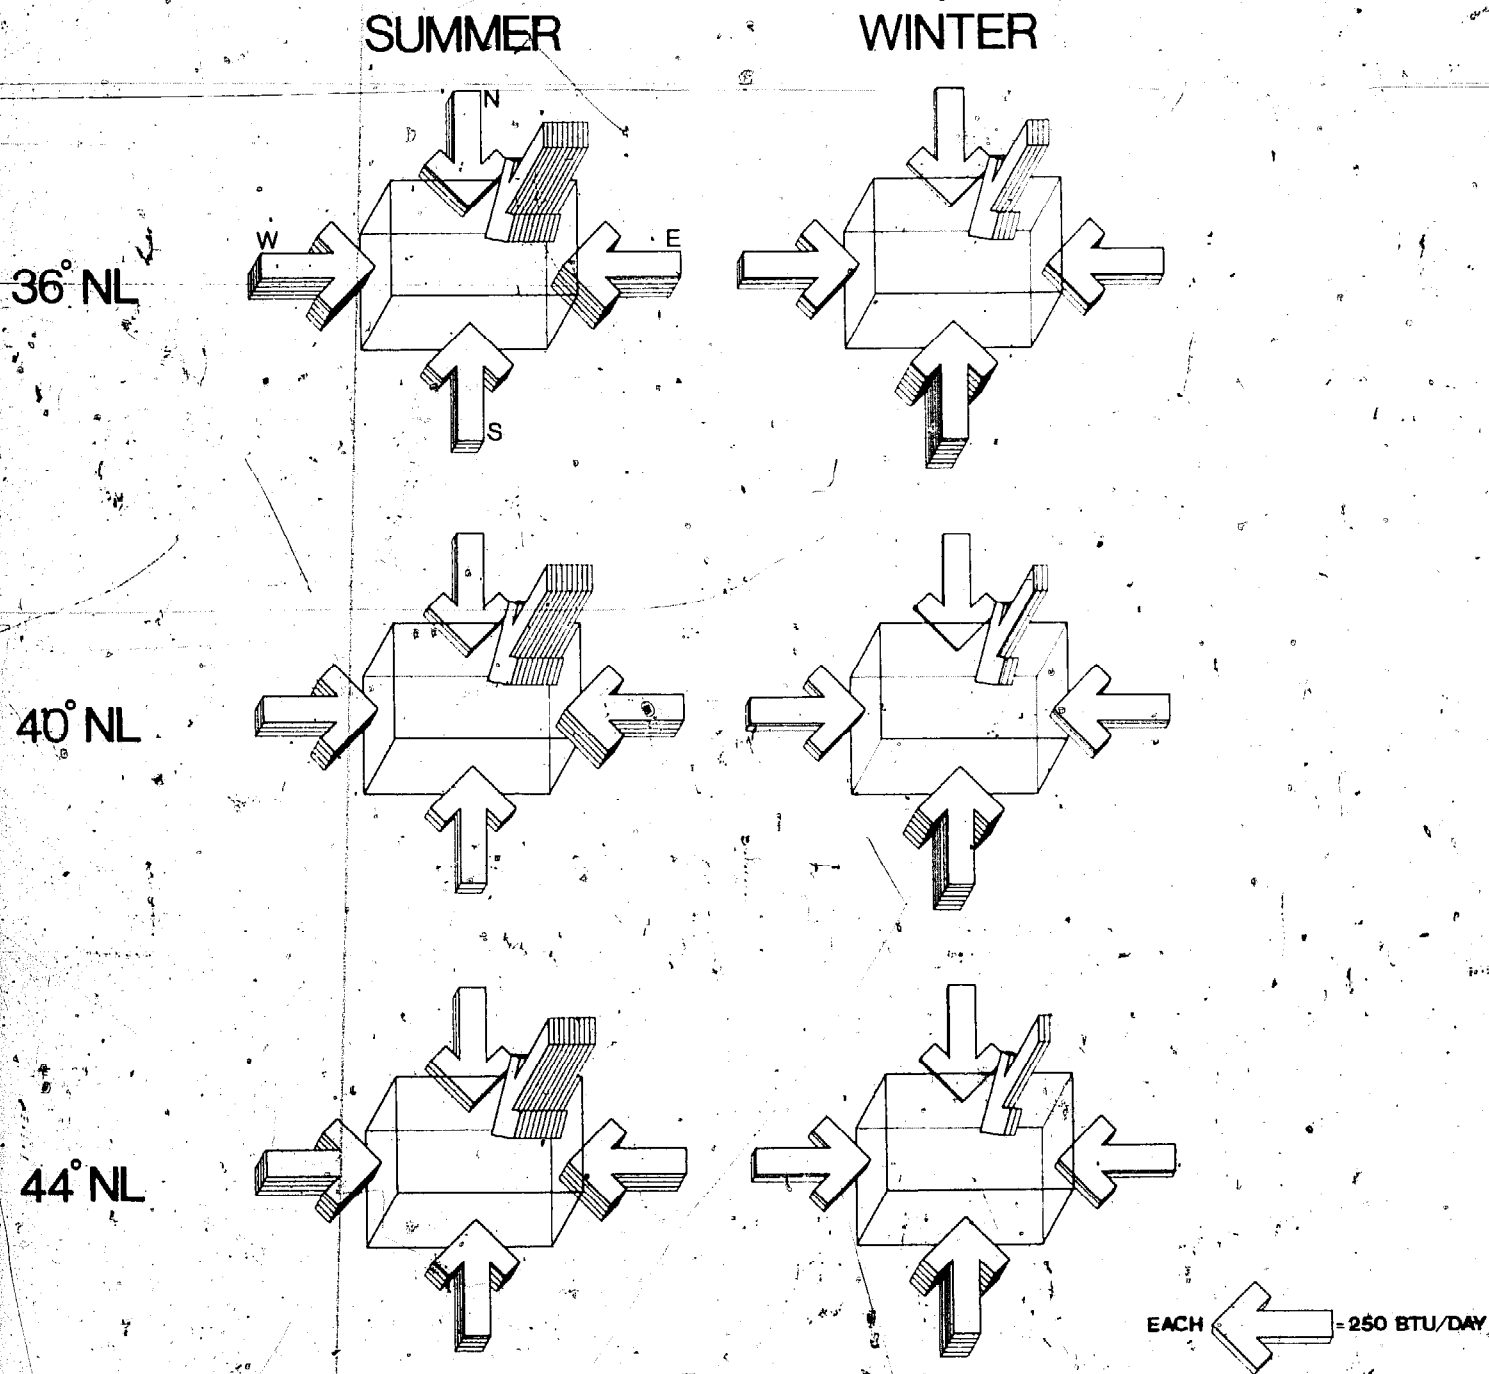


Fig. IV-2b: Solar radiation impacts at different latitudes.

The Passive Solar Energy Book

summer with *less efficiency* * than the square one.

3. The optimum shape lies in every case (all climates †) in a form elongated somewhere along the east-west direction.

By looking at the radiation impacts on the sides of a building, at different latitudes, both in winter and summer, Olgyay's conclusions become readily apparent.

A building elongated along the east-west axis exposes the longer south side of the building to maximum heat gain during the winter months, while exposing the shorter east and west sides to maximum heat gain in the summer, when the sun is not wanted. In all northern latitudes (32° to 56°), the south side of the building receives nearly 3 times as much solar radiation in the winter

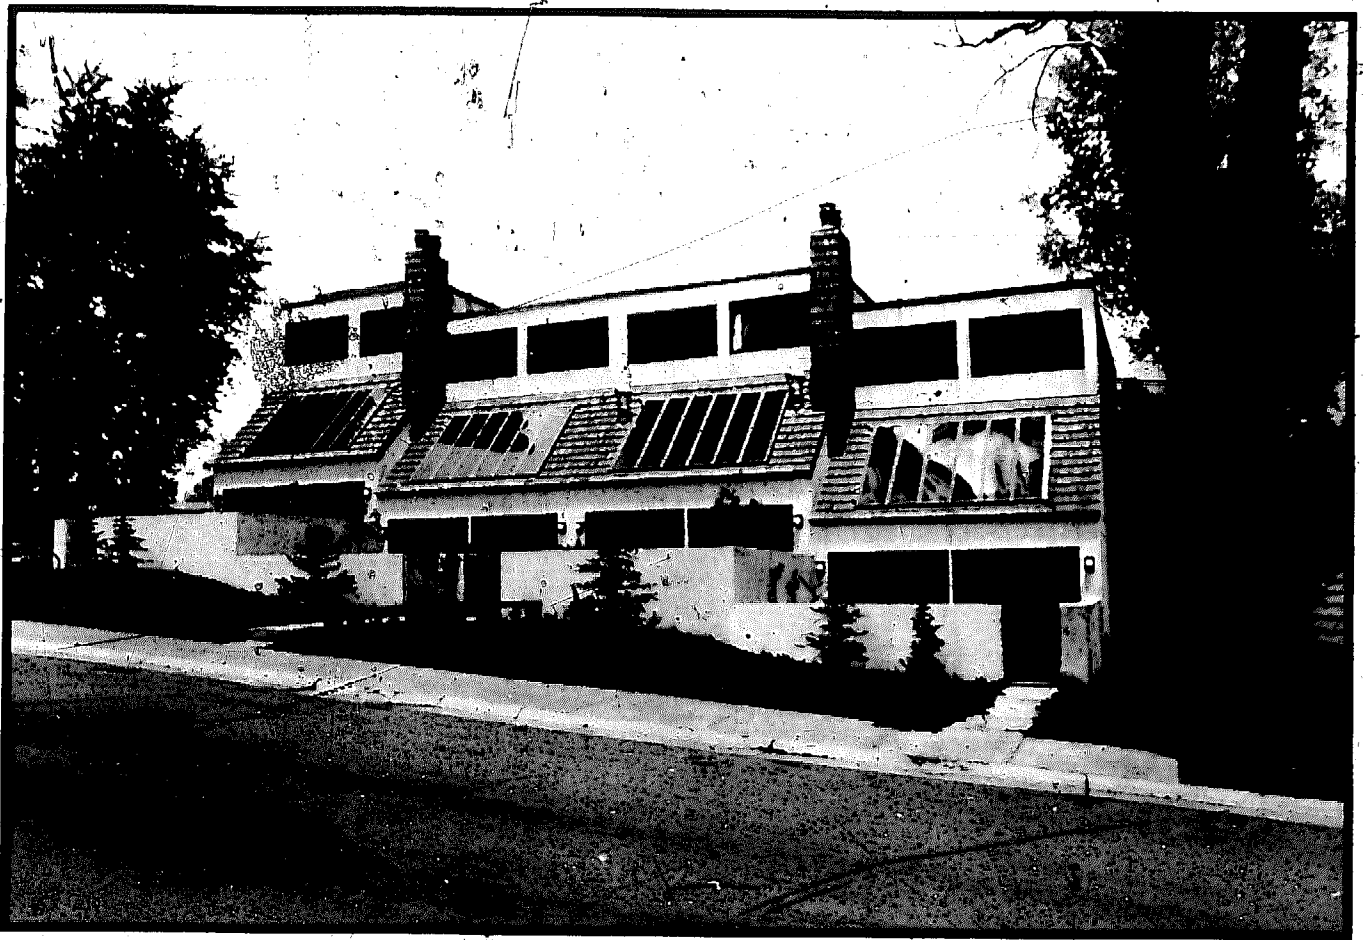


Photo IV-2b: Housing units attached along the east-west axis.

*Author's italics.

†Author's addition.

2. Building Shape and Orientation

than the east and west sides of the building. During the summer the situation is reversed and the south side receives much less radiation in comparison to the roof and east and west sides of the building. Both in summer and winter the north side of the building receives very little radiation. Besides being an efficient shape, the large southern exposure is ideal for the collection of solar radiation. Major collecting areas (glazing) of the building oriented to the south will intercept the maximum amount of solar radiation available during the winter months.

At all latitudes, although buildings elongated along the east-west axis are the most efficient, the amount of elongation depends upon the climate. Some general principles can be stated for different climates. In cool (Minneapolis) and hot-dry (Phoenix) climates a compact building form, exposing a minimum



Photo IV-2c: Winter sunlight penetration.

The Passive Solar Energy Book

of surface area to a harsh environment is desirable. In temperate (New York City) climates there is more freedom of building shape without severe penalty (excessive heat gain or loss). In hot-humid climates (Miami), buildings should be freely elongated in the east-west direction. In this climate because of intense summer solar radiation on the east and west sides, buildings shaped along the north-south axis pay a severe penalty in energy consumption (for cooling). In all climates, attached units (such as row houses) with east and west common walls are most efficient since only the end units are exposed on the east or west face.

Assuming that a building elongated along the east-west axis is compatible with other site and design considerations, to give the building a rough form we need to determine the width of the building. When the primary source of sunlight entering a space is through south-facing windows, then the depth of spaces along the south wall of the building should not exceed $2\frac{1}{2}$ times the height of the windows from the floor. This assures that sunlight will penetrate the entire space.

Also, this rule of thumb provides for the adequate daylighting of interior spaces. According to studies done by the Illuminating Engineering Society, the depth of a space for adequate natural illumination should be limited to the range of 2 to $2\frac{1}{2}$ times the window height (from the floor to the top of the window). For an average window height of 7 feet, this means a maximum space depth of 14 to 18 feet. For Thermal Storage Wall and Attached Greenhouse Systems, room depth is limited to 15 to 20 feet. This is considered the maximum distance for effective heating from a radiant wall.

If the major spaces of the building are placed along the south wall (for sunlight requirements) and the buffer spaces placed along the north wall, then the maximum depth of the building will be roughly 25 to 30 feet. Spaces which need to be deeper or do not want large south-facing windows with direct sun shining directly through the space can let the sun in through south-facing clerestory windows or skylights. Admitting the major portion of sunlight into a space through the roof has the advantage of allowing flexibility in distributing light and heat to different parts of a space—CLERESTORIES AND SKYLIGHTS (10). This allows for the maximum flexibility in locating thermal mass within a space—MASONRY HEAT STORAGE(11), INTERIOR WATER WALL(12).



3. North Side

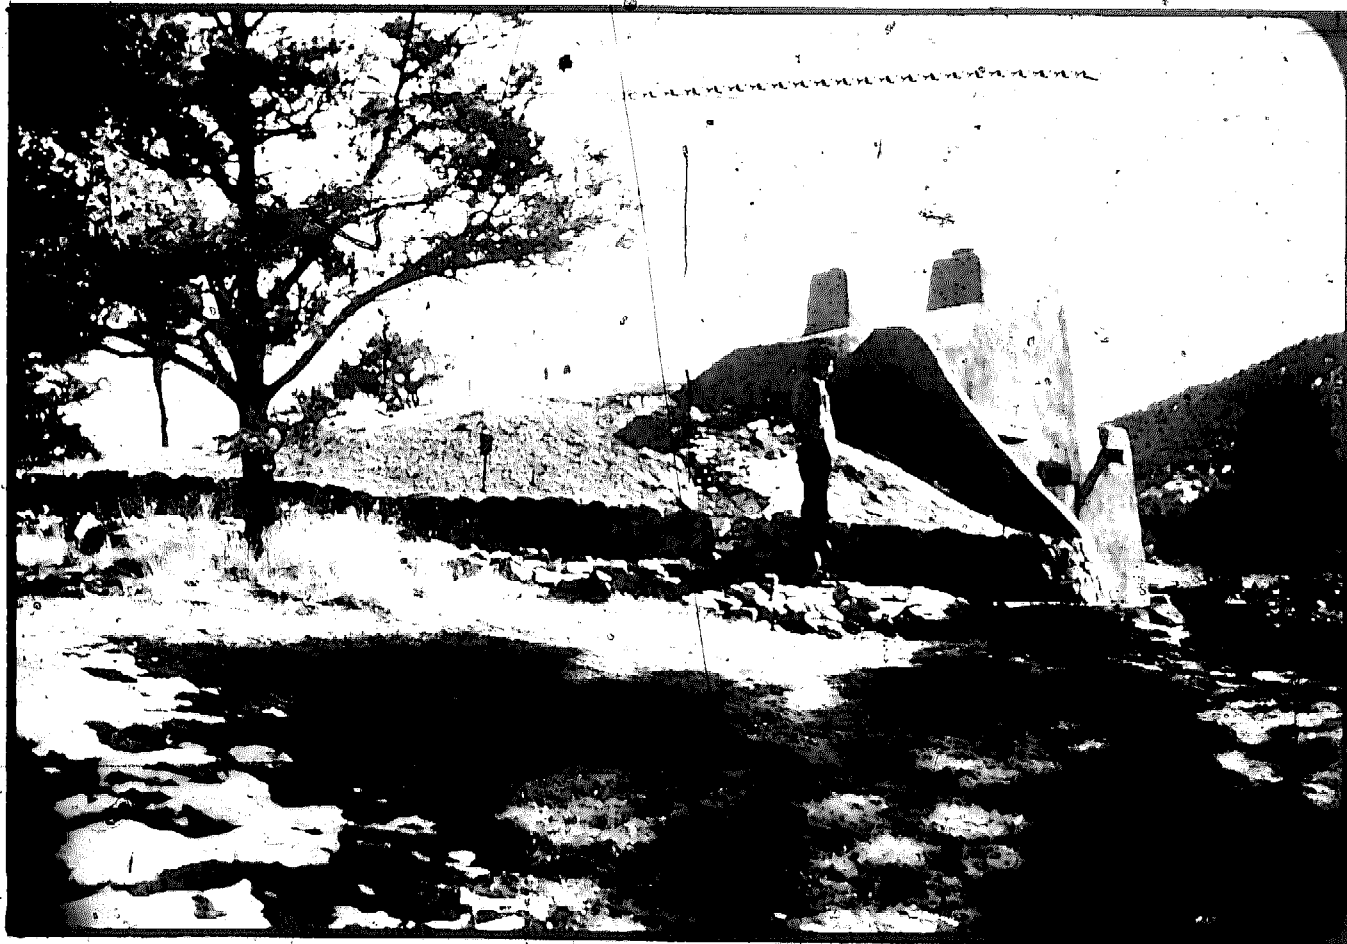


Photo IV-3a

3. North Side

Even though a building is located in the northern portion of a sunny site—**BUILDING LOCATION(1)**—the adjoining outdoor spaces to the north need sunlight to make them alive. When giving the building a rough shape—**BUILDING SHAPE AND ORIENTATION(2)**—it is necessary to consider the building's impact on the outdoor spaces to the north.



The north side of a building is the coldest, darkest and usually the least used side because it receives no direct sunlight all winter. From September 20 to March 20 (6 months) the north wall of a building and its adjoining outdoor spaces are in continual shade. During these months the sun is low in the southern sky, rising along the horizon in the southeast and setting in the southwest. Any ice, snow or water on the north side of the building will remain there for long periods of time, making the area unusable. With the prevailing winter winds from the north and/or west in the United States, the north side of a building is even less desirable as an outdoor place.

The Recommendation

Shape the building so that its north side slopes toward the ground. When possible build into the side of a south-facing slope and/or berm earth against the north face of a building to minimize the amount of exposed north wall. As the height of the north wall is reduced, the shadow cast by the building in winter is shortened. Use a light-colored wall (or nearby structure) to the north of the building to reflect sunlight into north-facing rooms and outdoor spaces.

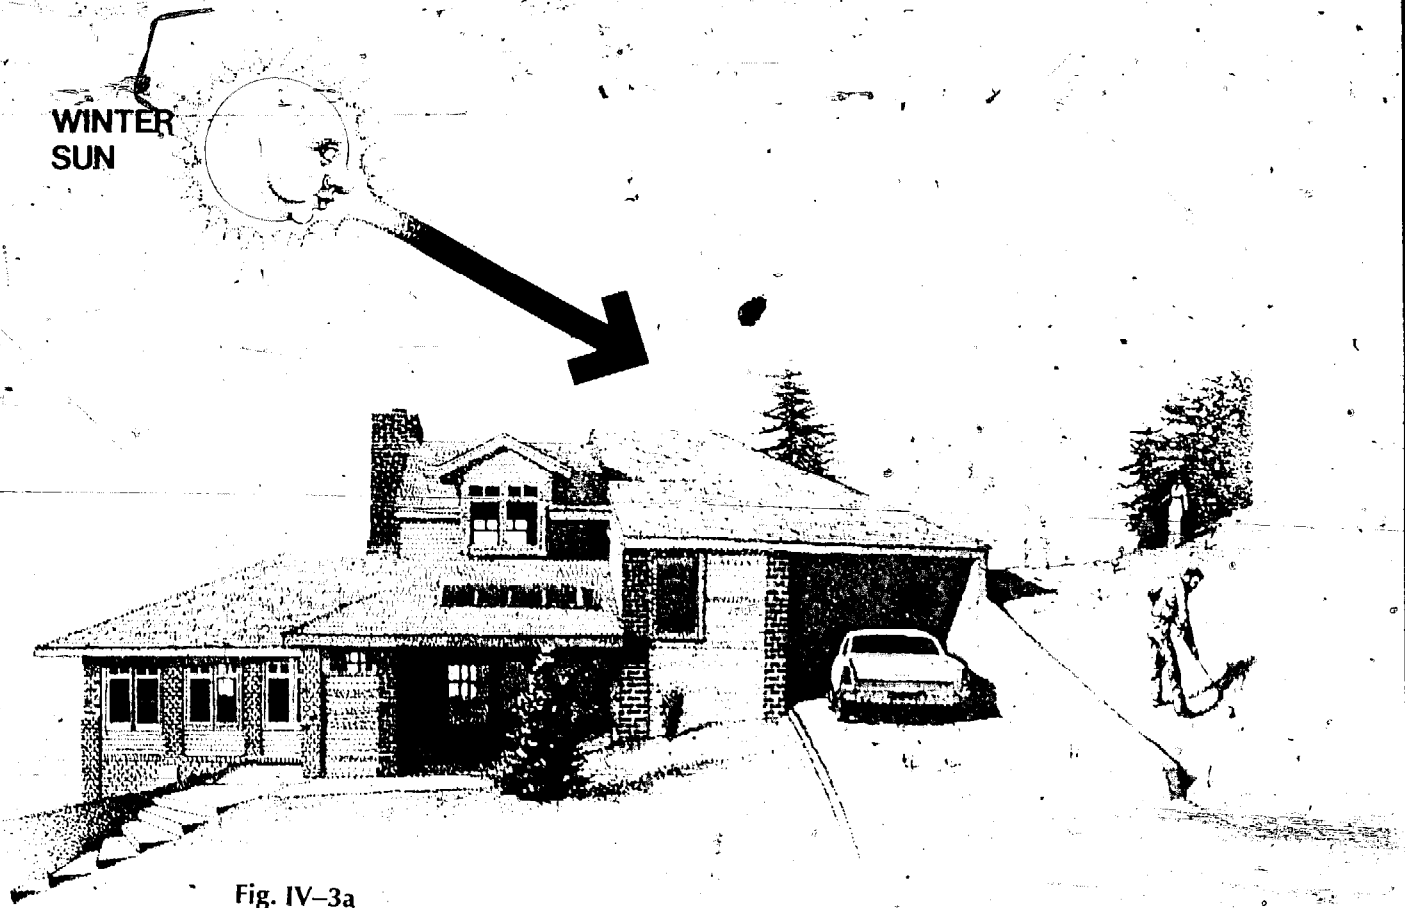


Fig. IV-3a



Locate spaces in the building that have small lighting and heating requirements to the north. These spaces act as a buffer between the living spaces and the cold north face of the building—LOCATION OF INDOOR SPACES(4).

The Information

Spaces in continual shade for most of the winter are wasted because people do not use them.

There are ways, though, to make these places alive and useful. For example, siting a building into a south-facing slope or berming earth against the north wall reduces or eliminates the shadow cast by the building. Besides providing sunlight to the north side, covering a north wall with earth reduces heat loss

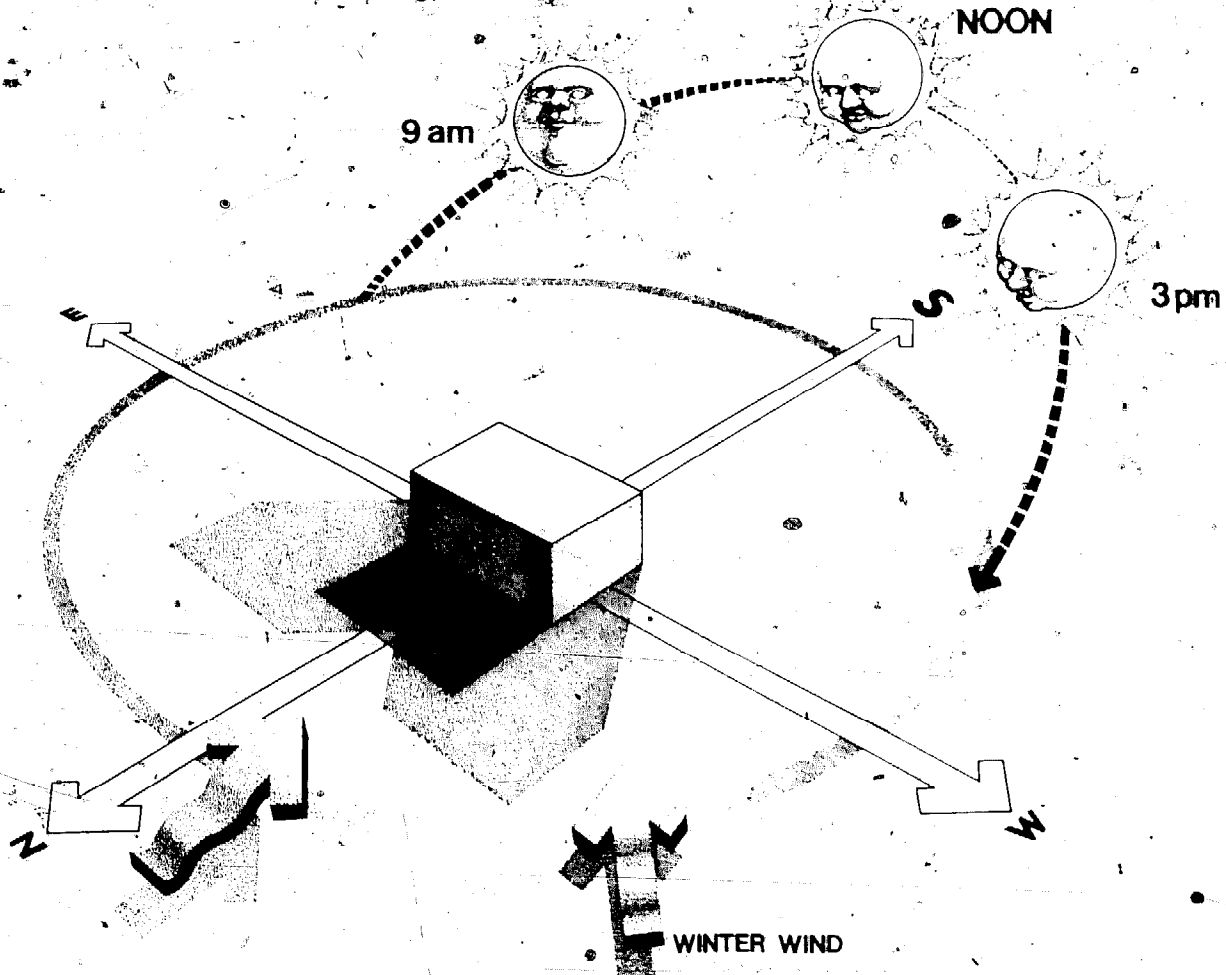


Fig. IV-3b: A building with a high north wall casts a long shadow over adjoining outdoor spaces for most of the winter.

through the wall in winter and prevents heat gain in summer, since ground temperatures are higher in winter and lower in summer than the outdoor air. Burying the north wall also protects the building from the prevailing winter winds which usually come from the north and/or west in the continental United States.

When berming or building into the earth is not feasible, a building can be shaped so that enough sunlight is available to north-facing outdoor spaces. By sloping the north roof of the building to the ground, at an angle roughly equal to the altitude of the sun at noon during the winter months, the shadow cast by the building will be minimal. If the shadow is small, the outdoor space beyond it will have enough sun all year for a garden, greenhouse, patio and walkway. To protect these outdoor areas in winter, plant a dense row of evergreen trees and shrubs or locate a solid obstruction (wall) to block the prevailing winter winds.

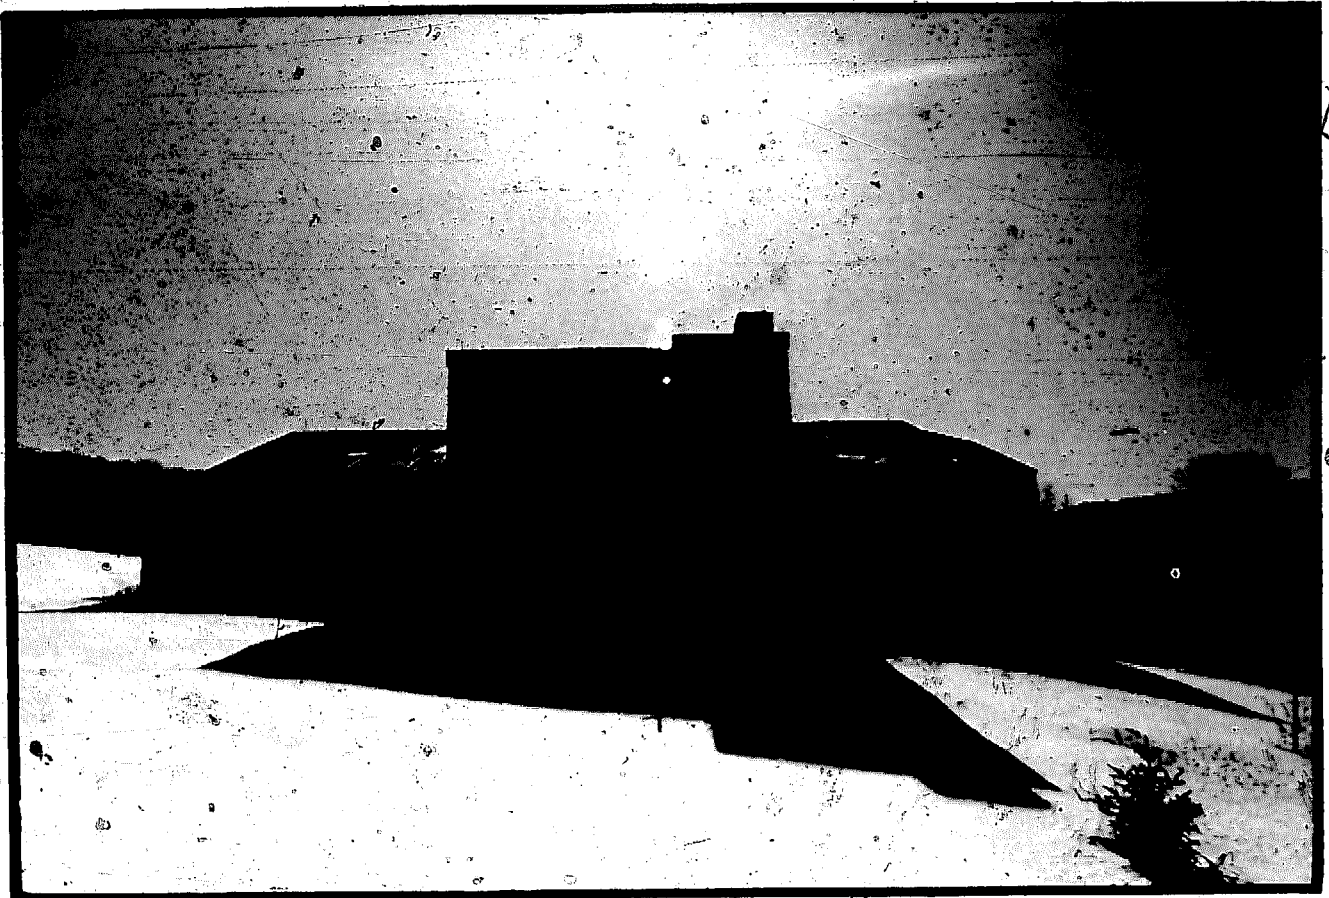


Photo IV-3b: North shadow.

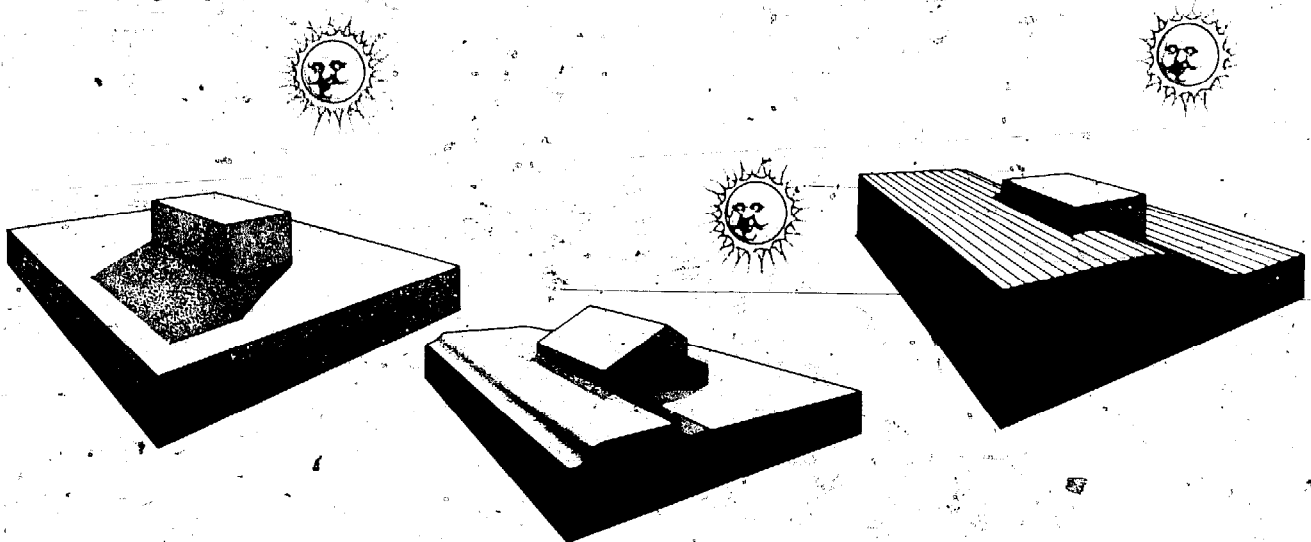


Fig. IV-3c: Berming or sloping the north roof reduces the shadow to the north.



4. Location of Indoor Spaces

A building placed in the northern portion of a sunny area will receive direct sunlight during the winter months. After giving the building a rough shape—**BUILDING SHAPE AND ORIENTATION(2)**—the interior spaces need to be placed within this shape according to their requirements for sunlight.



A space that does not directly utilize sunlight for heating during the winter months will use proportionally more conventional energy than one that does. Approximately 58% of the energy consumed by the average American household each year is for space heating. The more direct sunlight used to heat a space, the less conventional energy is required for space heating. This also applies to active solar-heating systems. If the design of a space does not directly take advantage of the winter sun to supply some of its heating requirements, an active solar-heating system will be proportionally that much larger and more expensive.

The Recommendation

Interior spaces can be supplied with much of their heating and lighting requirements by placing them along the south face of the building, thus capturing the sun's energy during different times of the day. Place rooms to the southeast, south and southwest, according to their requirements for sunlight. Those spaces having minimal heating and lighting requirements such as corridors, closets, laundry rooms and garages, when placed along the north face of the building, will serve as a buffer between the heated spaces and the colder north face.

4. Location of Indoor Spaces

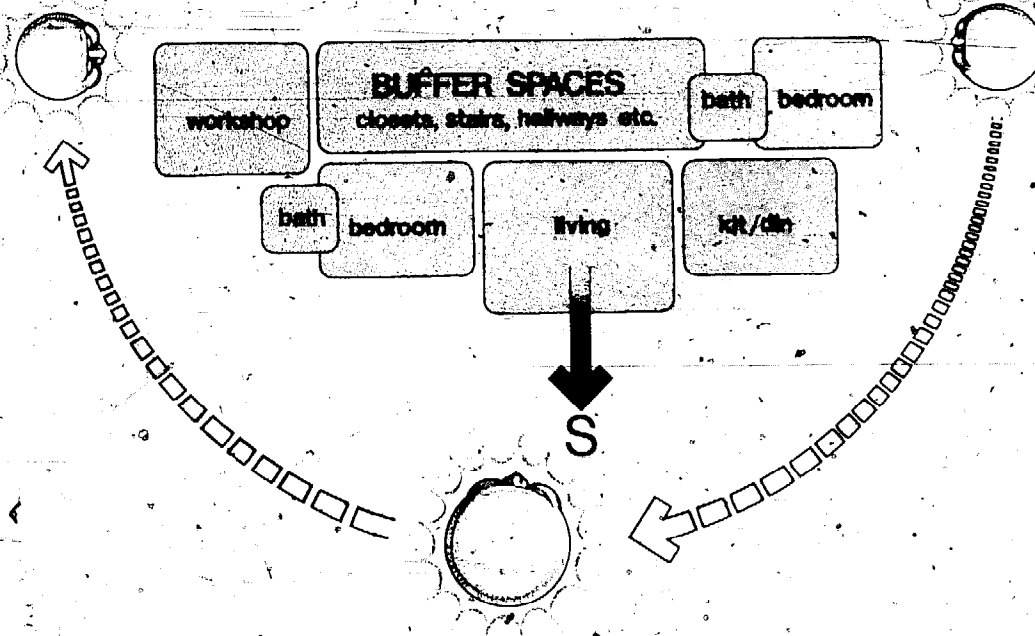


Fig. IV-4a



Locate openings to admit sunlight and provide for ventilation—WINDOW LOCATION(6)—while at the same time choosing the most appropriate heating system for each space—CHOOSING THE SYSTEM(7). If a greenhouse is integrated into the building—SIZING THE GREENHOUSE(15)—place it along the south face of the building for maximum exposure to the winter sun.

The Information

During the winter, the microclimatic conditions along the sides of a building (outside walls) are the key to the location of indoor spaces. The north side of a building remains the coolest during the winter because it receives *no* direct sunlight. The east and west sides of a building receive equal amounts of direct sunlight for half-a-day since the sun's path across the sky is symmetrical along

The Passive Solar Energy Book

the southern axis. But over the period of a day, the west side will be slightly warmer than the east side because of the combination of solar radiation and higher afternoon air temperatures. The south side of a building will be the warmest and sunniest during the winter because it receives sunlight throughout the day. Common sense tells us to place spaces with specific heating and lighting requirements along the side of the building which has microclimatic conditions that can easily satisfy those requirements.

The south side of a building is a good location for spaces that are continually occupied during the day. These spaces usually have large heating and lighting requirements. Since the south face of a building receives nearly 3 times as much sunlight in the winter as the east and west sides, spaces placed along the south face can make direct use of the sun's energy to fill these requirements. Also, the extent to which a continually used space is felt as bright, sunny and cheerful will depend upon the amount of direct sunlight it receives.

Arrange these spaces to the south, southeast and southwest according to your own special requirements for sunlight. For example, in a residence, orient a breakfast area to the southeast for good morning sunlight, a common area (living room) which is used throughout the day to the south, and a workshop that is used only late in the day to the southwest. Placing the frequently inhabited spaces to the south means the building will be elongated along the east-west axis. Spaces needing sunlight that are not located along the south face of a building can receive direct sunlight through south-facing CLERESTORIES AND SKYLIGHTS(10).



5. Protected Entrance

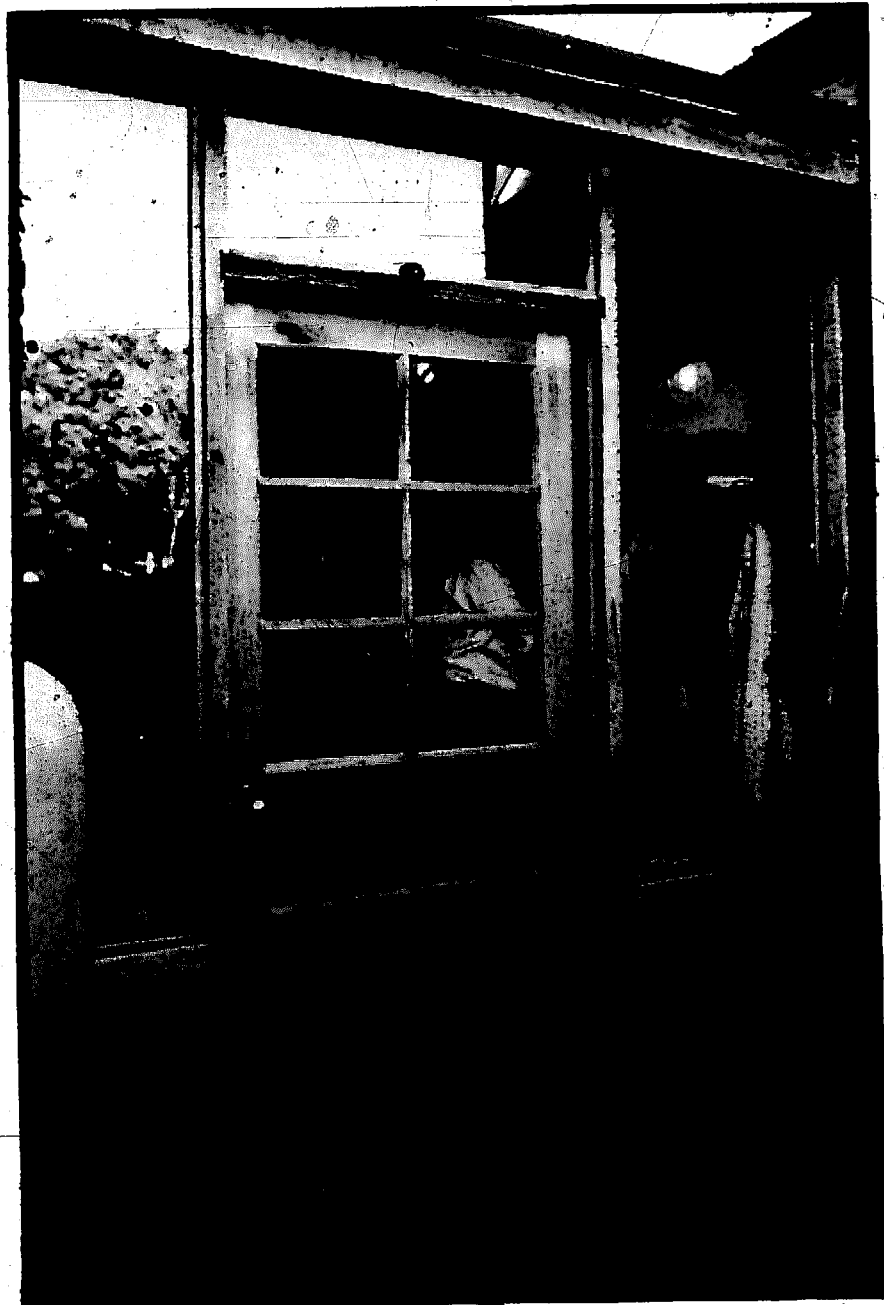


Photo IV-5a.

5. Protected Entrance

The location and design of the entrance must be developed while simultaneously locating indoor spaces—LOCATION OF INDOOR SPACES(4). This pattern describes the thermal criteria for locating the entrance and provides information for its design.



In winter, a great quantity of cold outdoor air enters a building through cracks around the entrance door and frame as well as each time the door is opened. All edges around entrances leak air. Through these cracks warm indoor air is exchanged with cold outdoor air. When an entrance door is opened, a large quantity of outdoor air enters the adjoining space. In a small residence this infiltration of cold air coupled with the conduction loss through the door can account for as much as 10% of the building's total heat loss.* For small commercial buildings, such as shops and offices, the heat loss through entrance doors will be higher due to increased traffic into and out of the building.

The Recommendation

Make the main entrance to the building a small enclosed space (vestibule, foyer) that provides a double entry or air lock between the building and exterior. This will prevent a large quantity of warmed (or cooled) air from leaving the building each time a door is opened, since only the air within the enclosed space can escape. The infiltration of cold air that normally occurs around exterior doors will be virtually eliminated because the entry creates a still-air space between the interior and exterior doors. Orient the entrance away from the prevailing winter winds or provide a windbreak to reduce the wind's velocity against the entrance. Make use of the entry space for the storage of unheated items, as a place to remove winter clothing or for activities that require little space heating.

*Heat loss is calculated for a standard 1½-inch solid wood door without weather stripping or a storm door.

5. Protected Entrance

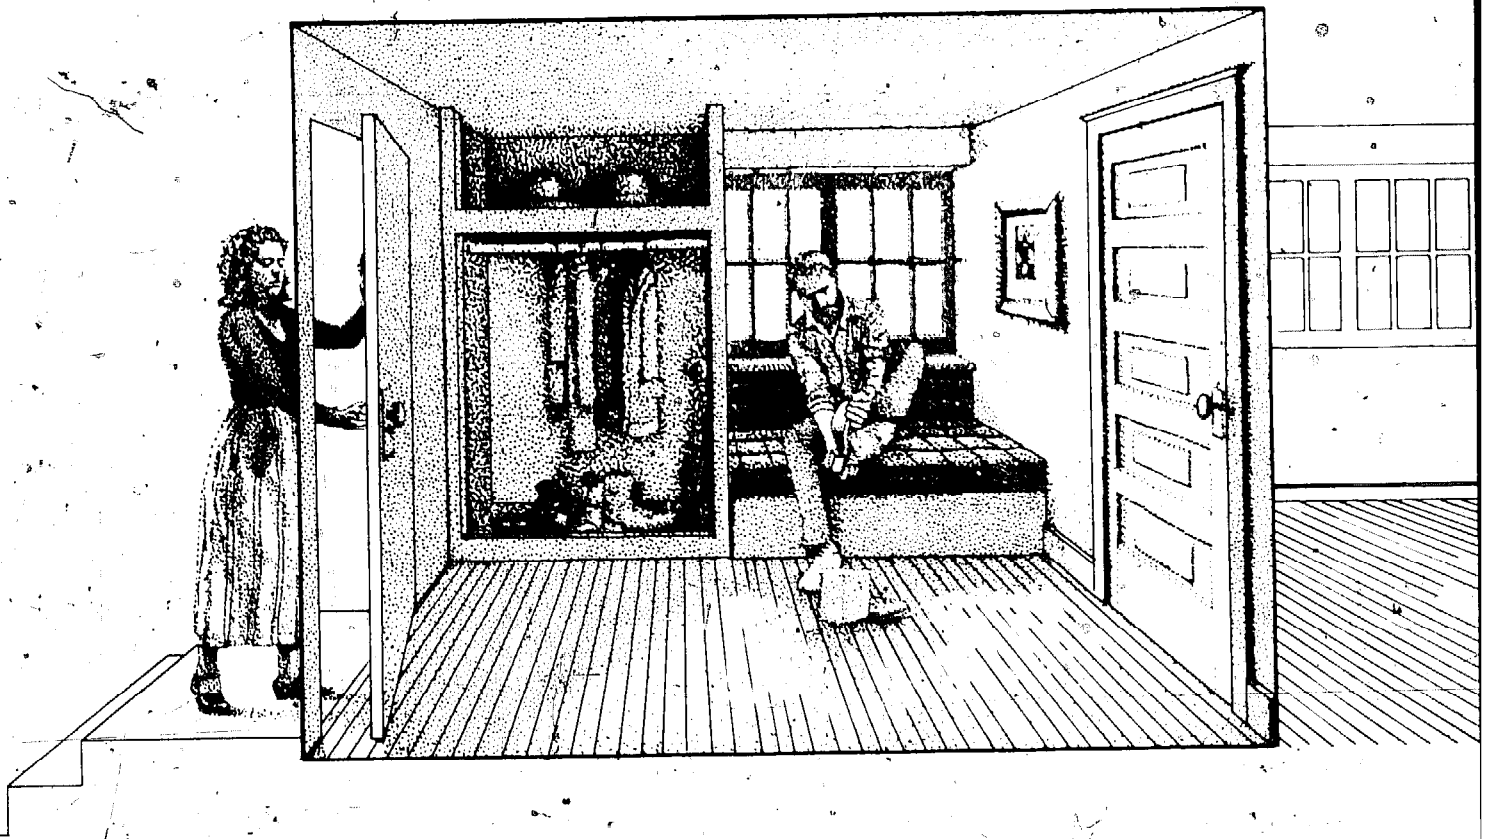


Fig. IV-5a



If the entry is large and supports other activities, provide a way to passively heat the space in winter—CHOOSING THE SYSTEM(7).

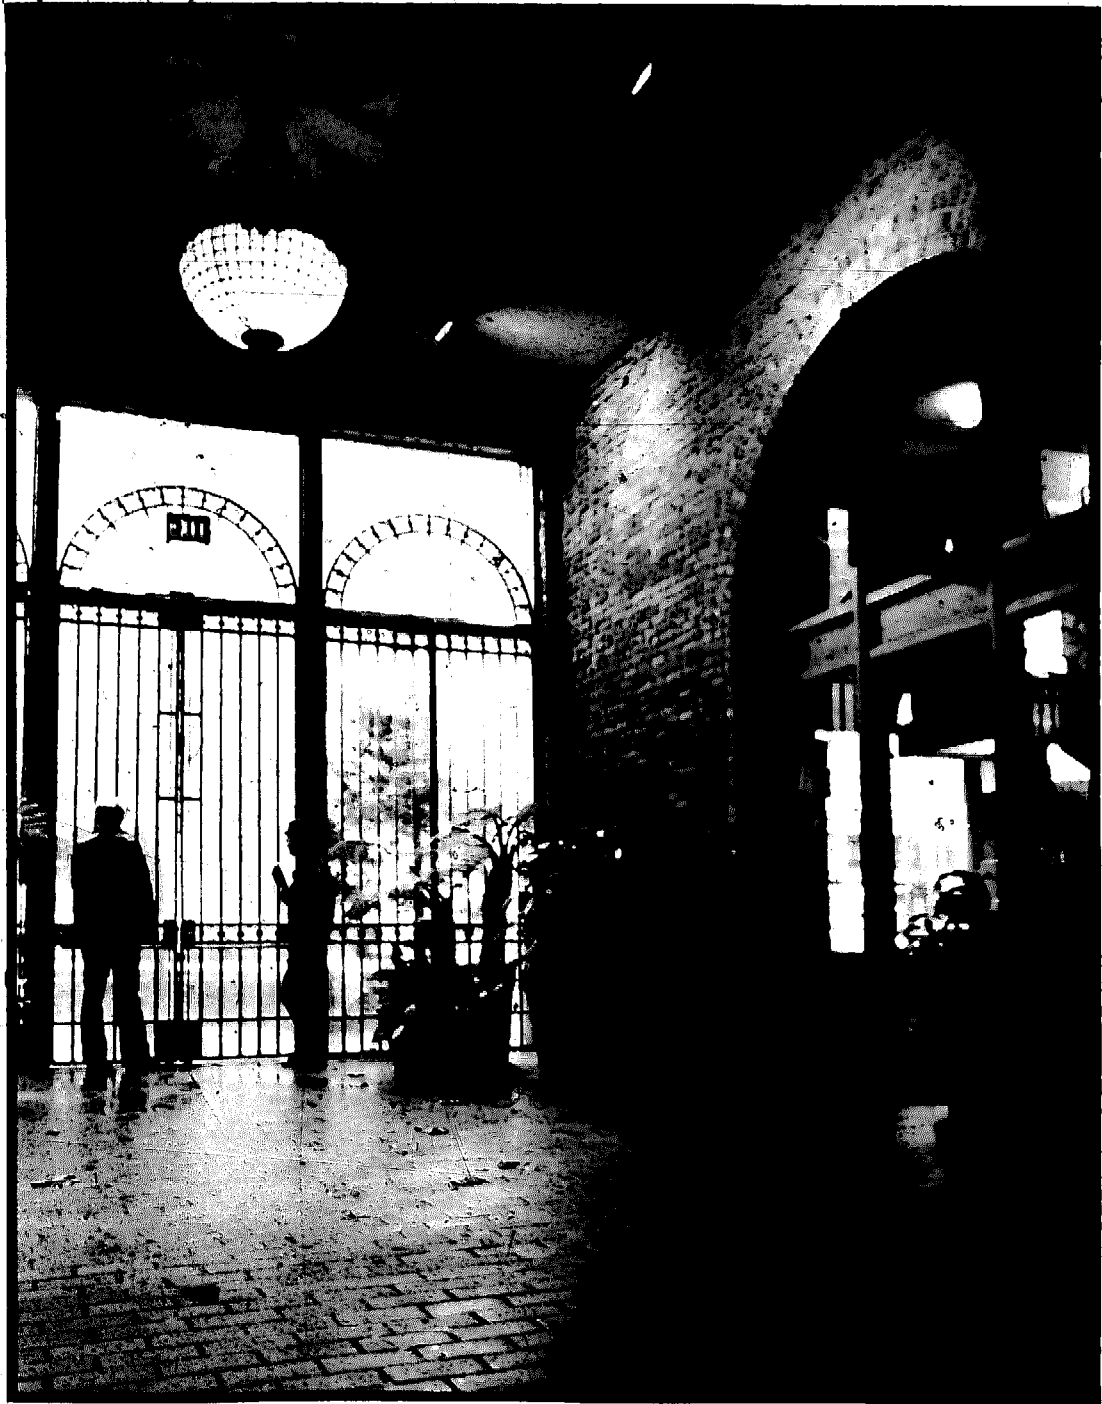


Photo IV-5b: A transition space for shoppers.

5. Protected Entrance

The Information

Providing an air lock or double entry will decrease the heat loss due to both infiltration and conduction. A double entry has two doors, one that opens to the exterior and one to the interior of the building, trapping a still-air space between them. Since the interior entrance to the building faces a still-air space, infiltration is minimized. Also, when the exterior door is opened, only the small quantity of *unheated* air in the entry is exchanged with cold outdoor air, thus the spaces near entrance doors are protected from becoming cold and drafty each time a person enters the building. During the summer, the double entry works in reverse, keeping cooled indoor air from being replaced by hot outdoor air. A double entry or entry space, when properly designed, can serve other functions besides the reduction of heat loss. It can also be a place to leave frequently used items, and a protected place to wait for transportation. When arriving and leaving a building, people need a transition space to accommodate a number of activities, such as removing and storing outer garments.

Protecting the building's entrance from winter winds and sealing edges around the door frame as tightly as possible will minimize heat transfer. The rate of infiltration of cold air through an entrance increases as the velocity of the wind against the entrance increases. In the Northern Hemisphere the prevailing winter winds are usually from the north and/or west (check with the U.S. Weather Bureau in your area for the direction of the prevailing winter winds). Entrances placed on the east and south sides of a building will be protected from the wind's impact. If an entrance is placed on the north or west side of the building, careful siting of a windbreak (dense evergreen planting or solid fence), recessing the entrance into the building or the addition of wing walls will reduce the wind's velocity and impact.

Weather stripping, when properly applied, prevents air leakage by making a weathertight seal between the exterior door and door frame. Caulking should be applied around the door frame and the wall to prevent air leakage through these joints. By providing an effective seal around the edges of the door and frame, infiltration at the entry can be reduced by as much as 50%.

The Passive Solar Energy Book



5. Protected Entrance

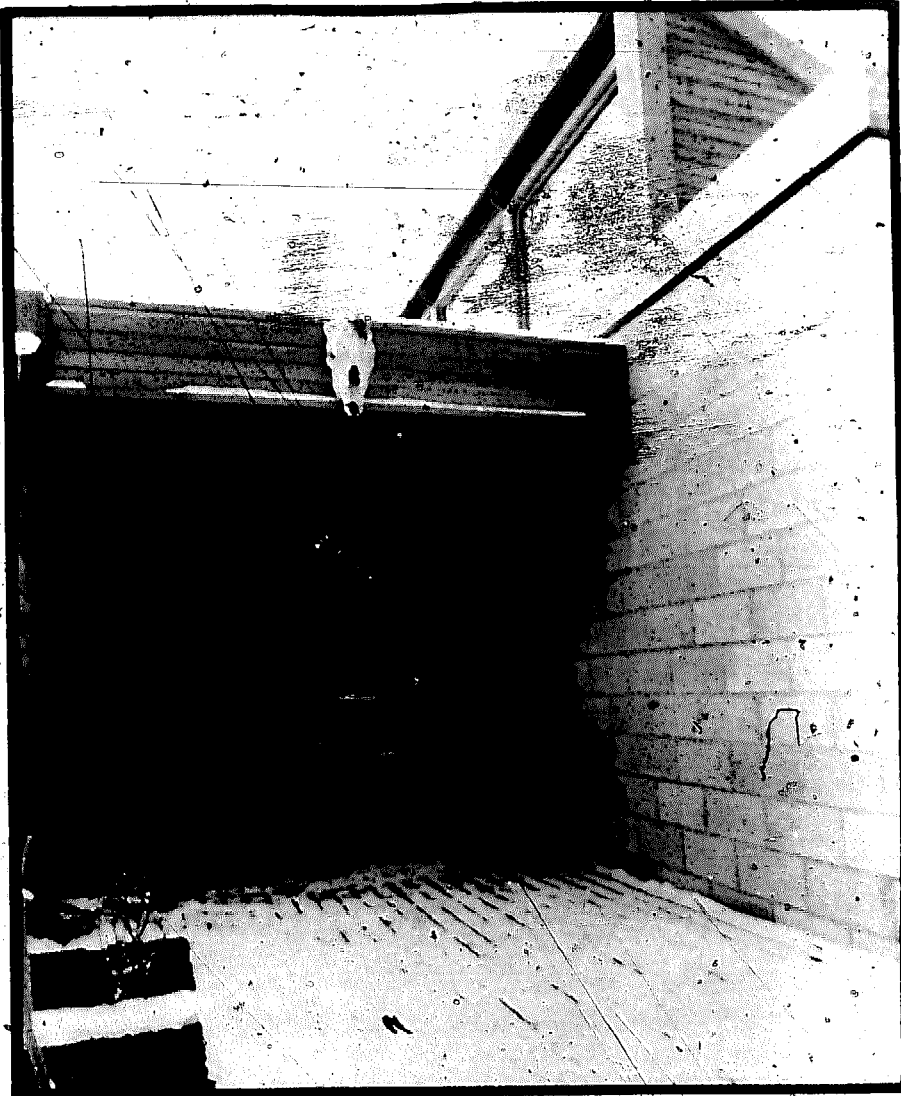


Photo IV-5c: Protected entries (here and facing page).



6. Window Location

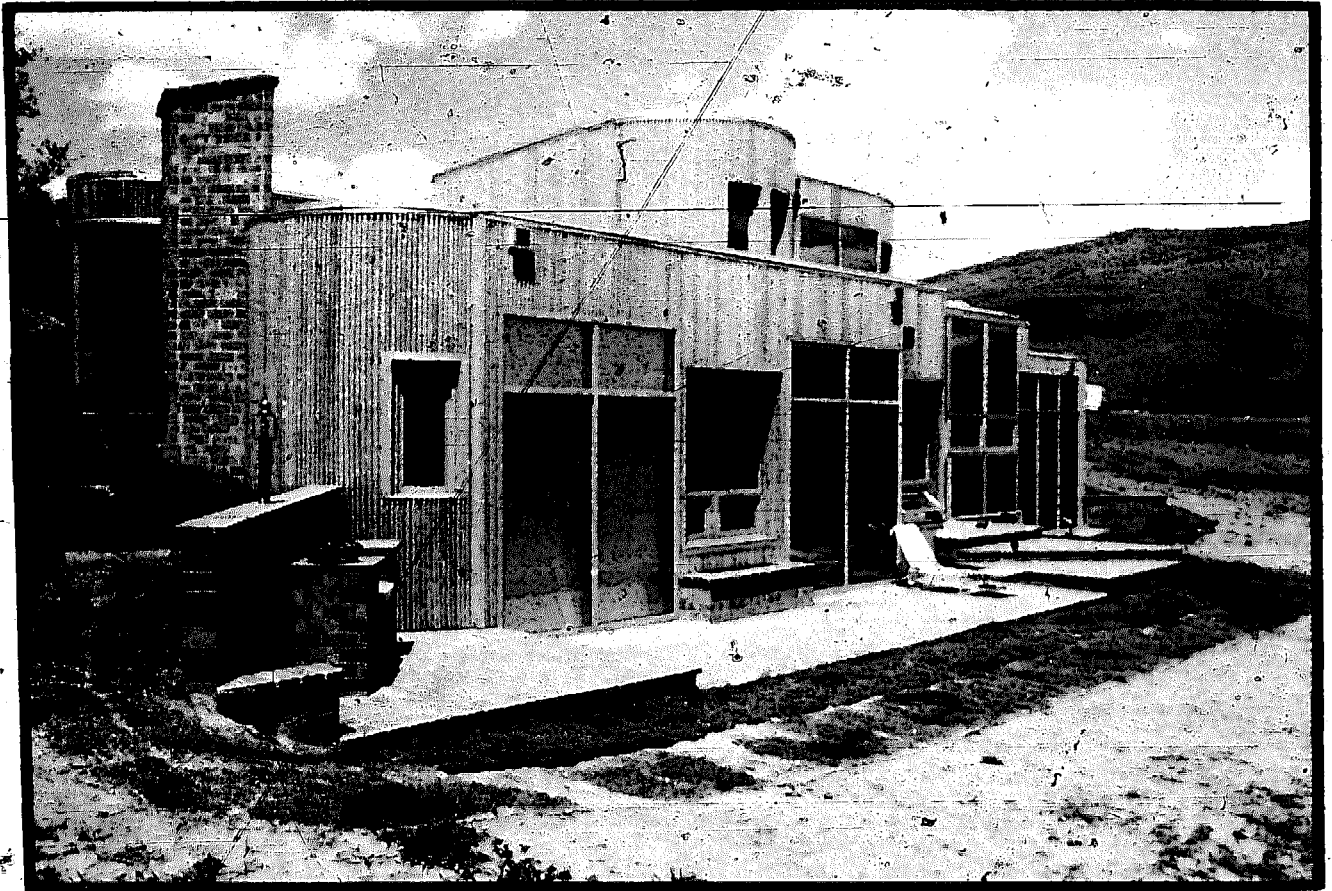


Photo IV-6a



6. Window Location

With the sun shining directly onto the building during the winter months—BUILDING LOCATION(1)—and the major occupied spaces located to the south to admit direct sunlight—LOCATION OF INDOOR SPACES(4)—this pattern tells where and how to locate window openings.



One of the largest single factors affecting building energy consumption is the location and size of windows. Windows placed without consideration for the amount of sunlight they admit will usually be an energy drain on the building. The heat lost through a window in winter is very large when compared to the heat lost through a well-insulated wall. For example, a square foot of standard wood frame wall with 3½ inches of insulation will lose approximately 2 Btu's each hour when the temperature outside is 30°F and is 68°F inside. A square foot of single pane glass, with the same outside temperature, will lose approximately 43 Btu's each hour or over 20 times as much heat as the wall. The heat lost through the window is basically the same regardless of which direction it faces. It is important, then, to place windows so that their heat gain (from sunlight) is greater than their heat loss during the winter. During the summer, windows need to be shaded from direct sunlight so that heat gains are kept to a minimum.

The Recommendation

Locate major window openings to the southeast, south and southwest according to the internal requirements of each space. On the east, west and especially the north side of the building, keep window areas small and use double glass. When possible, recess windows to reduce heat loss.

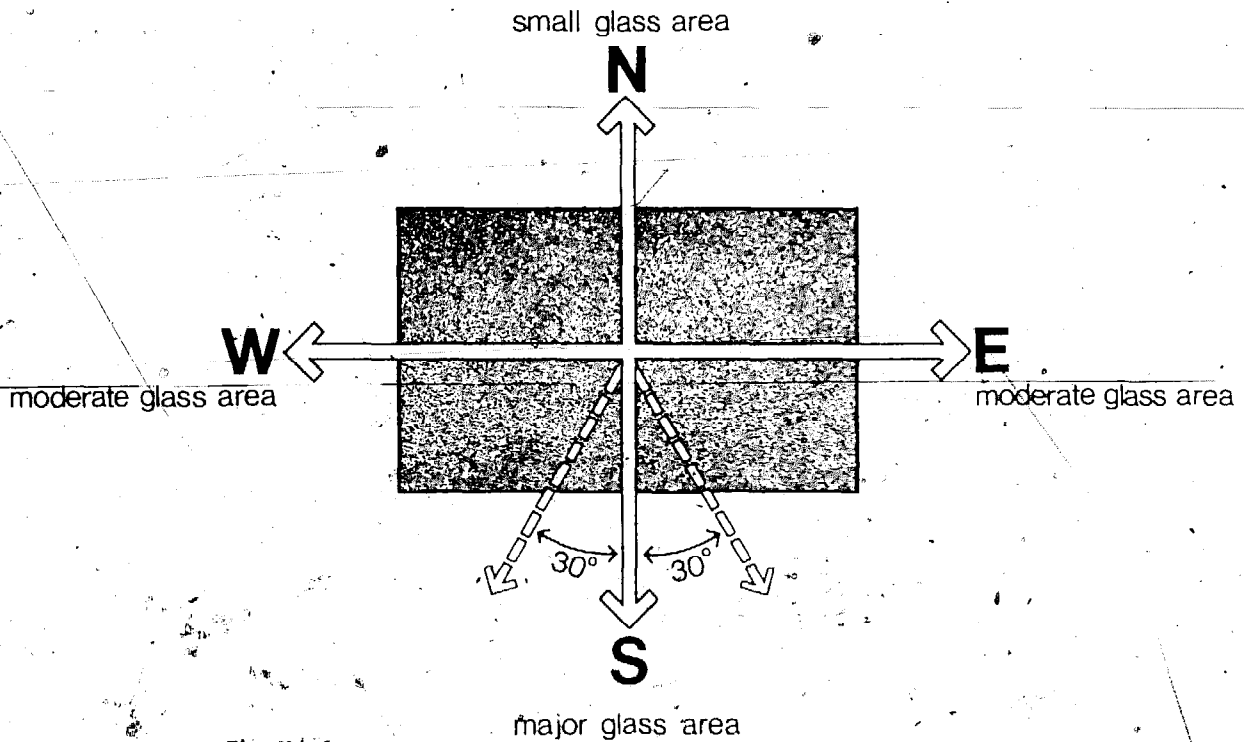


Fig. IV-6a

Direct sunlight can also be admitted into a space through south-facing CLERESTORIES AND SKYLIGHTS(10). Protect the major glass areas from the cold winter winds and use MOVABLE INSULATION(23) over large glass areas at night to prevent the heat gained during the day from escaping at night. Locate trees and vegetation and apply SHADING DEVICES(25) to windows to keep out the summer sun. Determine which windows will be operable to provide adequate ventilation for SUMMER COOLING(27).

The Information

The best orientation for the major glass areas of a building is one which receives the maximum amount of solar radiation (heat gain) in the winter and the minimum amount in the summer. According to BUILDING SHAPE AND ORIENTATION(2), the south side of a building receives nearly 3 times more solar radiation in winter than any other side. During the summer the situation is reversed and the south side receives much less radiation in comparison to

6. Window Location

the roof and east and west sides of the building. There are two reasons for this. First, there are more hours of sunshine striking the south face of a building in winter than in summer, even though summer days are longer and have more hours of daylight (refer to fig. IV-2b). And second, since the sun is lower in the sky during the winter, the sun's rays striking the south face of the building are closer to perpendicular than in the summer when the sun is higher in the sky. Because of this, a square foot of vertical south-facing surface will receive a greater amount of solar radiation during the same hour in winter than in summer. As the sun's rays striking the surface of a window are closer to perpendicular in winter, the percentage of solar radiation transmitted through the window is greater than in summer. These seasonal characteristics of south glazing insure a degree of automatic control for solar collection.

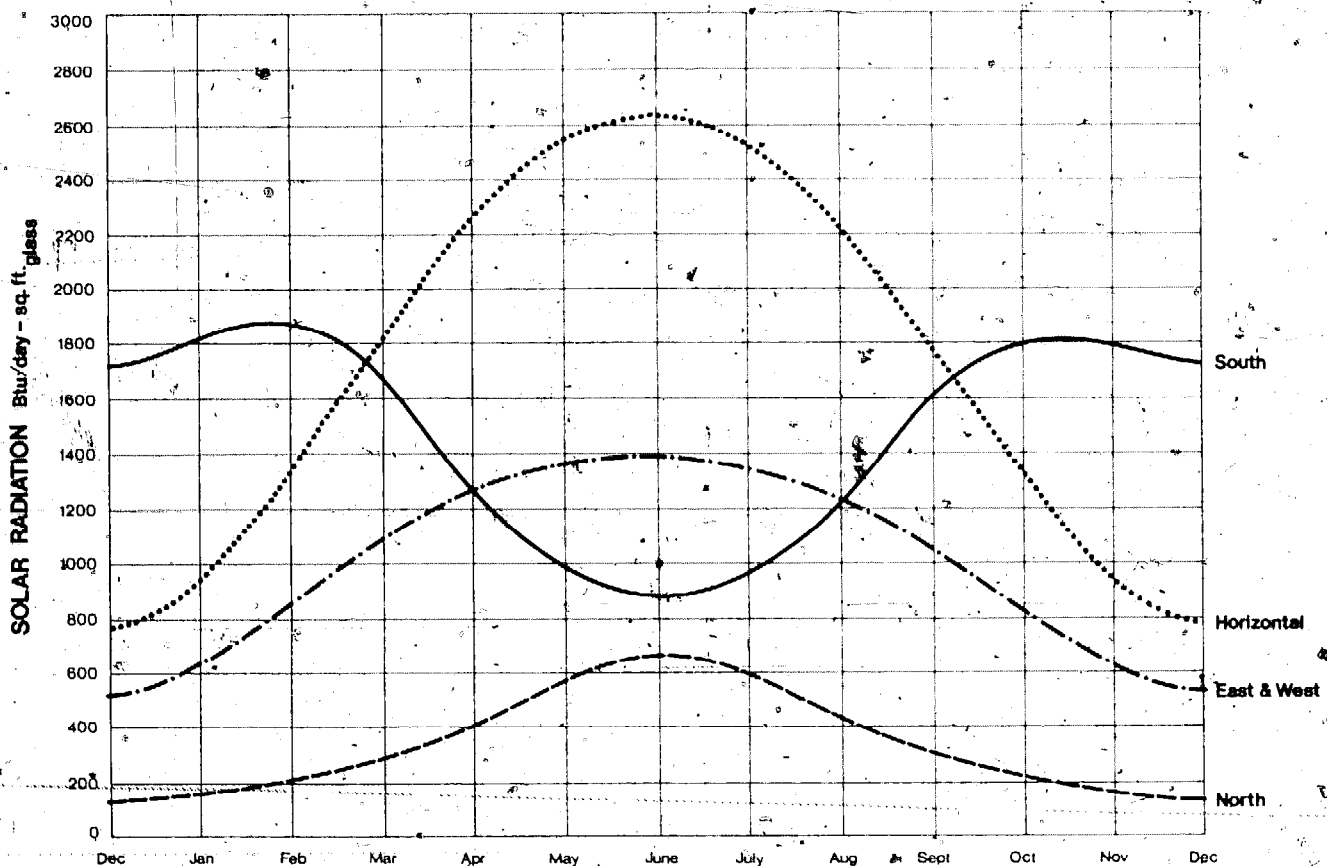


Fig. IV-6b: Comparison of window orientations.

Note: This graph represents clear-day solar radiation values, on the surfaces indicated; for 40°NL.

The Passive Solar Energy Book

The optimum window orientation for solar gain is due south. However, variations to the east or west of south, up to 30°, will reduce performance only slightly. Larger variations, though, will reduce window performance substantially.

In most climates, the heat gained from sunlight during the winter through south-facing glass will exceed the heat loss. For example, on an average January day in Albuquerque, New Mexico (35°NL), a square foot of south-facing window (single glass) receives 1,883 Btu's, of which about 85% or 1,622 Btu's are transmitted through the glass. The heat lost through the same square foot of window for that day is 749 Btu's. When the heat loss is subtracted from the heat gain, there is a net gain of 873 Btu's for the day. For the entire month of January the net gain will be (873 Btu's × 31 days) 27,063 Btu's/sq ft. By calculating the heat gained for each month of the heating season (months when heating is needed), the total net gain for each square foot of south-facing glass is 192,328 Btu's. This is the equivalent of 102 cubic feet of propane, 246 cubic feet of natural gas, 24 pounds of coal or 1.9 gallons of heating oil. Figure IV-23c graphs, by city, the heat gain or loss during the heating season for a square foot of south-facing window (both single and double glass).

Openings should be carefully placed according to the light and heating requirements of each space. For example, a sleeping area may require some southeast or east openings to admit early morning sunlight and heat into the space. It is important to note that east- and west-facing single or double pane windows either come out even or lose heat during the winter in most climates. Since there is no direct sunlight in winter on the north side of a building, north-facing windows are a continuous heat drain.

The solar radiation calculator in chapter 5 is a quick graphic method for determining the amount of hourly or daily radiation intercepted by a surface facing in different directions. Of course the location and size of windows will be influenced by other considerations as well, such as views, privacy and natural lighting.



7. Choosing the System


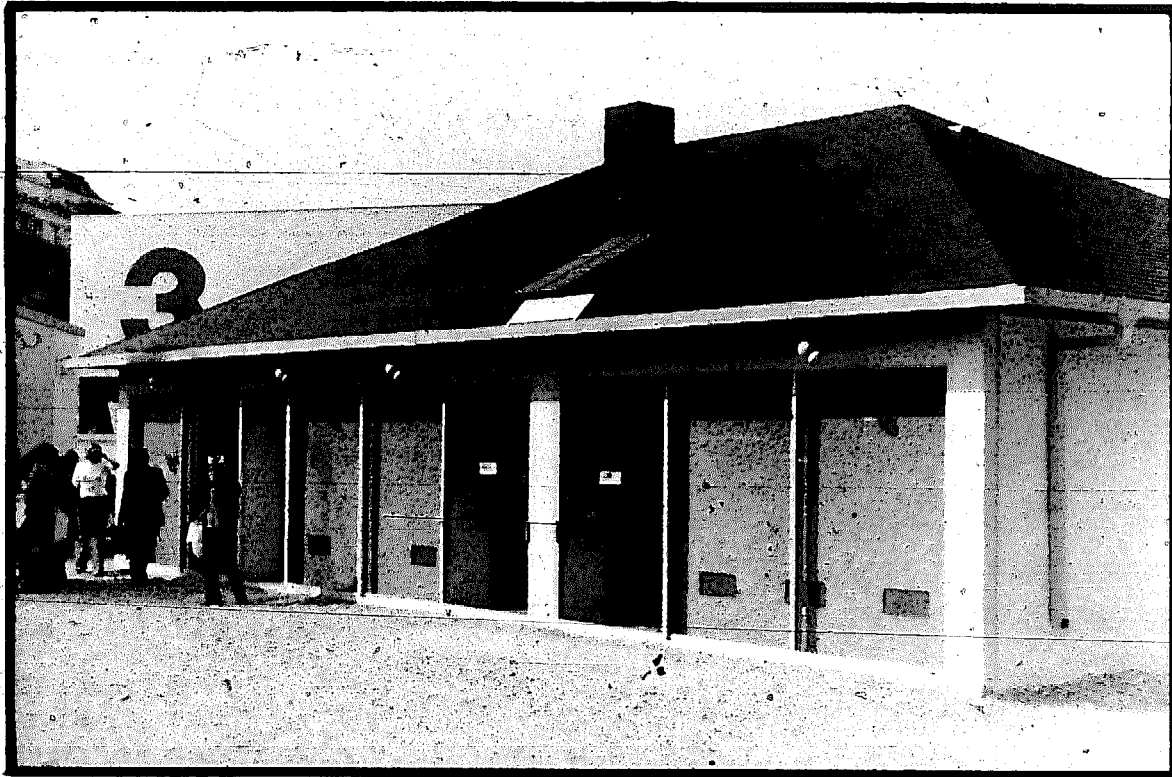


Photo. IV-7a



7. Choosing the System

After indoor spaces are roughly arranged—LOCATION OF INDOOR SPACES (4)—the heating system for each space must be determined before proceeding further with the design of the building. Since a passive system is an integral part of the building, it must be included at the beginning of the design process.

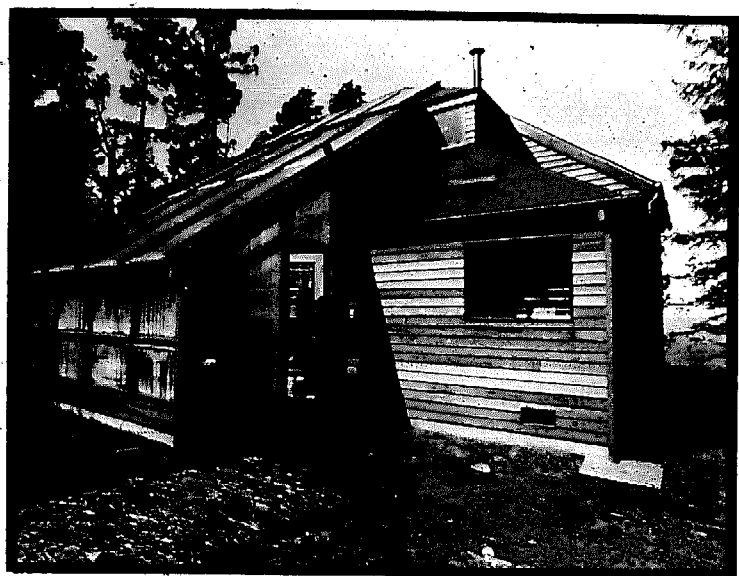

Which is the best passive system to use? The question of which system to use is one of the most loaded questions that can be asked about passive solar heating. Whenever the question arises, it generates a heated discussion and much disagreement. To prove a point, people will defend their system to the last Btu. Which is the best system to use? When properly analyzed, each space or building will require a particular system best suited to its thermal needs.

The Recommendation

Each system has specific design limitations and opportunities. Choose a particular system that satisfies most of the design requirements you generate for each space. Remember that different systems can be used for different spaces, or systems can be combined to heat one space. Consult the rest of this pattern for an assessment of each system.



Recommended sizing procedures for each system are given in SOLAR WINDOWS(9), SIZING THE WALL(13), SIZING THE GREENHOUSE(15) and SIZING THE ROOF POND(17). When desirable, a combination of systems can be used to heat a space—COMBINING SYSTEMS(21).

The Information

With a rough plan for each space, select the most appropriate system(s) for your building. To help make the best possible choice, each system is assessed according to the following design considerations: building form, glazing, construction materials, thermal control, efficiency and the system's feasibility as a retrofit to an existing building. All the systems assessed will perform well in a wide variety of climates, although slight modifications should be made to optimize efficiency.

Direct Gain

Design Element	Assessment
----------------	------------

Building Form	The building is usually elongated in the east-west direction, with spaces needing heat located along the south wall. However, a different building shape is possible if spaces are stacked or staggered, or direct sunlight is admitted into the building through clerestories and skylights.
---------------	---

CLERESTORIES

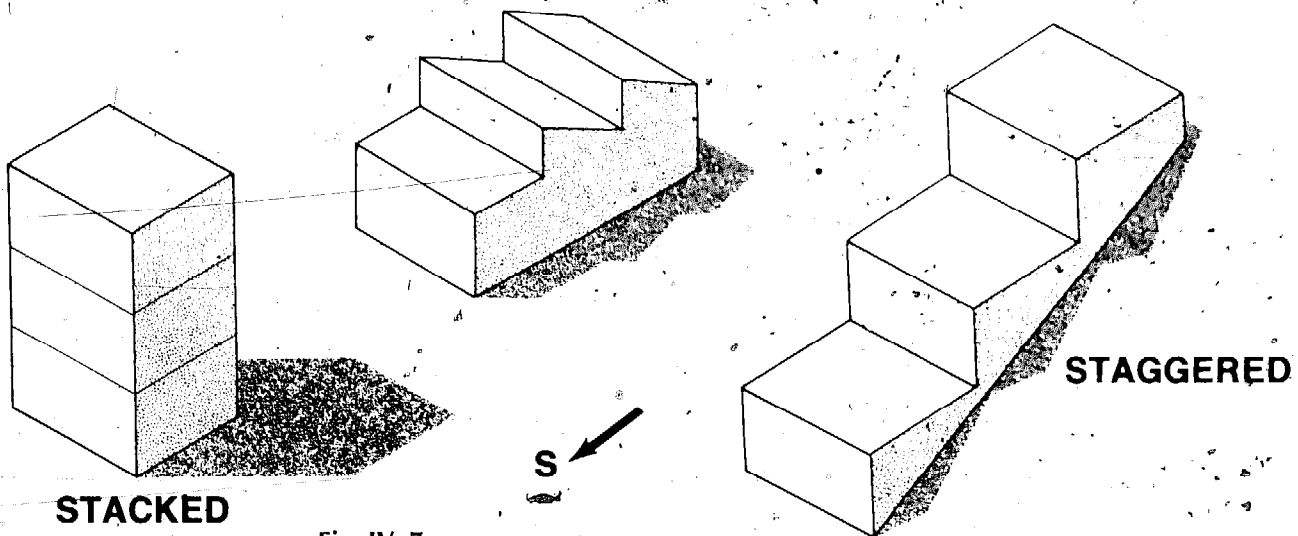


Fig. IV-7a

The Passive Solar Energy Book

Glazing

The major glass areas of each space must be oriented to the south for maximum solar heat gain in winter. Naturally, these windows can serve other functions as well, such as openings for light and views. It is essential, though, that the windows be carefully designed to eliminate the problem of glare often associated with Direct Gain Systems. As we shall see, a Direct Gain System utilizes the least amount of south-facing glass to heat a space.

Construction Materials and Added Mass

Each space must have thermal mass for the storage of solar heat. This implies a heavy building with interior walls and floors constructed of masonry materials. However, the masonry can be as thin as 4 inches. If an interior water wall is used for heat storage, then lightweight construction (wood frame) can be used.

Thermal Control

Direct Gain Systems are characterized by daily indoor temperature fluctuations, which may range from 10° to 30°F, depending upon the location and size of solar windows, thermal mass and the color of interior surfaces. The heating system cannot be turned on or off since there is little control of natural heat flows in the space. To prevent overheating, shading devices are used to reduce solar gain, or excess heat is vented by opening windows or activating an exhaust fan. However, when a conventional forced-air heating system is added to a space, uniform interior temperatures can be maintained.

Efficiency*

When properly designed, a Direct Gain System is roughly 30 to 75% efficient in winter. This means that most of the sunlight transmitted through the glass is used for space heating.

*Efficiency is defined as the percentage of the solar energy incident on the face of the collector (glazing) that is used for space heating. When the glazing area normally used in a space doubles as the collector area, then the system's efficiency will be high, approximately 75%. However, if the collector area is additional to the amount of glazing that would normally be used in a space, then the system's efficiency will be lower, on the order of 30 to 60%.

7. Choosing the System

Retrofitting

Retrofitting an existing building with a Direct Gain System is very difficult, since the building is the system. Only when a space is constructed with masonry walls and floors exposed on the interior, and has a clear southern exposure, is it possible to add solar windows and modify interior surface finishes to solar heat the space.

Conclusion

This system demands a skillful and total integration of all the architectural elements within each space—windows, walls, floor, roof and interior surface finishes. In general, the way in which the interior mass is heated by solar radiation will determine the efficiency and level of thermal comfort provided by the system. Since there are no heating units, ducts or registers, the system is completely invisible. A direct gain building can usually be built for the same cost as a conventional masonry building. In comparison, adding thermal mass to a wood frame building will raise construction costs.

Thermal Storage Wall

Design Element

Assessment

Building Form

The depth of a space is limited to approximately 15 to 20 feet since this is considered the maximum distance for effective radiant heating from a solar wall. The requirement of a southern exposure dictates a linear arrangement

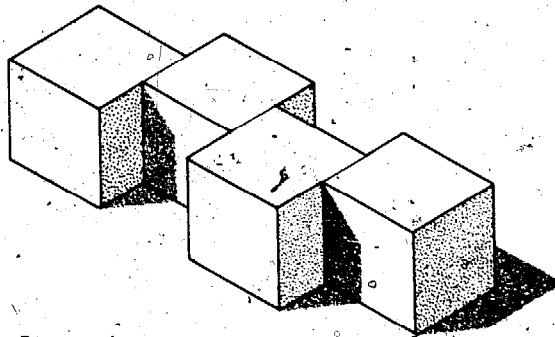


Fig. IV-7b: Staggering spaces.

The Passive Solar Energy Book

ment of spaces along the south wall of the building unless modified by stacking and/or staggering spaces. However, staggering spaces along the length of the south wall results in some solar blockage during part of the day.

Glazing

The predominant architectural expression of the building is south-facing glass. The glass functions as a collecting surface only, and admits no natural light into a space. However, windows can be included in the wall to admit natural light, direct heat and also permit a view.

Construction Materials and Added Mass

Either water or masonry can be used for a thermal mass wall. Double glazing in front of the wall is necessary unless insulating shutters are applied over the glazing at night. Since the thermal mass is concentrated along one wall, there is no limit to the choice of construction materials and interior finishes in the remainder of the space.

Thermal Control

Indoor temperature fluctuations are controlled by wall thickness. The heat output of a masonry wall can be regulated by the addition of thermocirculation vents with operable dampers or by movable insulating panels or drapes placed over the inside face of the wall.

Efficiency

The overall efficiency of this system is comparable to most active solar systems, approximately 30 to 45%. For the same area of wall and heat storage capacity, a water wall will be slightly more efficient than a masonry wall.

Retrofitting

This system is easily added to the south wall of a space *with a clear southern exposure.*

Conclusion

The system allows for a wide choice of construction materials (exclusive of the thermal wall) and interior fin-

7. Choosing the System

ishes, and offers a high degree of control over the indoor thermal environment. Obviously, the large expanse of south-facing glass requires careful integration into the building's design.

Attached Greenhouse

Design Element	Assessment
Building Form	The greenhouse must extend along the south face of the building adjoining the spaces to be heated. This usually means a greenhouse elongated in the east-west direction. It is important to cover a large surface area of south wall for the most efficient transmission of heat to adjacent spaces.
Glazing	To heat one square foot of building floor area (excluding the greenhouse), approximately 1½ times as much greenhouse glass area is needed as is required in a Thermal Storage Wall System. The area of glass can be somewhat reduced if an active heat storage system is used. In this case, daytime heat is actively taken from the greenhouse and stored for use in the building at night.
Construction Materials and Added Mass	The major construction material in the greenhouse is double glass or transparent plastic. The common wall between the greenhouse and building should be constructed with thermal mass (masonry or water), unless active heat storage is employed. The remainder of the building can be constructed of any material.
Thermal Control	The temperature of the greenhouse can be effectively controlled within a predictable range by properly sizing the collector area (glazing) and thermal mass. Temperature control in adjoining spaces is the same as for a Thermal Storage Wall System.

The Passive Solar Energy Book

Efficiency

When properly designed, the greenhouse will heat itself *and* supply heat to adjoining spaces. All the sunlight admitted into the greenhouse is used for heating. The overall efficiency of the system is approximately 60 to 75% during the winter months. The percentage of heat supplied to adjoining spaces is roughly 10 to 30% of the energy incident on the collector face. However, this percentage can be increased if an active heat storage system is employed.

Retrofitting

This system is easily added to the south wall of an existing building which has a clear southern exposure.

Conclusion

The attached greenhouse is unique in that it not only produces fresh food but has the potential to heat itself *and* spaces adjoining it. It lends itself easily to both new *and* existing construction and usually pays for itself in 1 to 3 years by a reduction in heating and food bills.

Roof Pond

Design Element

Assessment


Building Form

Since the roof is the collector, this system is most suitable for heating one-story buildings, or the upper floor of a two- or three-story structure. The roof area containing the ponds can be flat, stepped up to the north or pitched. Although the system is somewhat restrictive as to building height, it does not dictate a building shape or orientation and allows complete freedom with regard to the arrangement of indoor spaces. In addition, the roof pond is invisible from the street level.


Glazing

When used primarily for heating, the glazed surface area of the pond should be unobstructed by shadow between the hours of 10:00 a.m. and 2:00 p.m. in winter. For summer cooling, the pond should be exposed to as much of the night skydome as possible.

7. Choosing the System

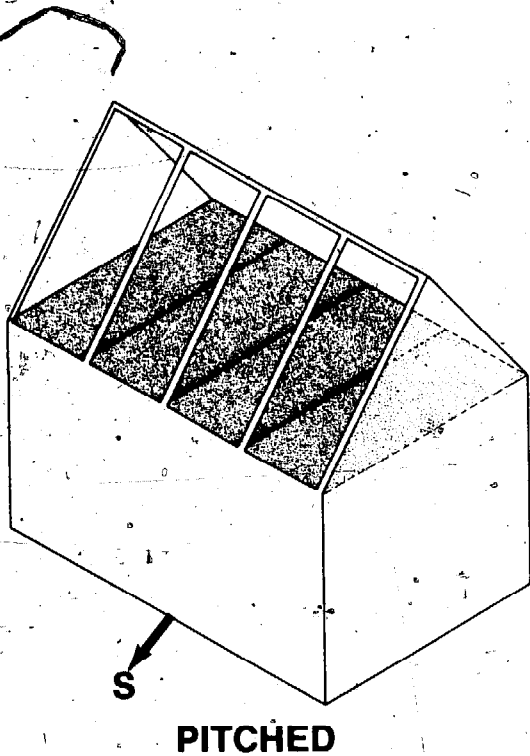

PITCHED

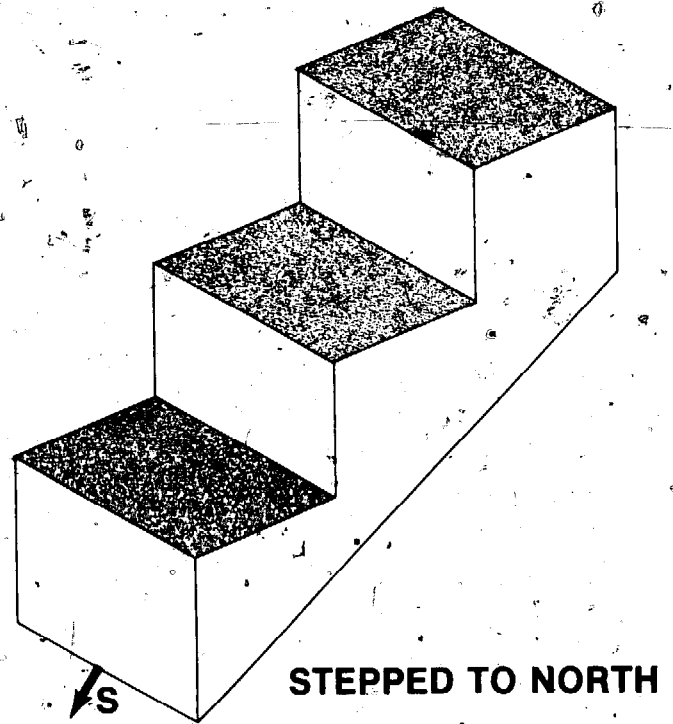

STEPPED TO NORTH

Fig. IV-7c: Roof ponds.

Construction
Materials and
Added Mass

Roof ponds are generally between 6 and 12 inches in depth. Therefore, the building's structure must support the 32 to 65 lbs/sq ft dead load the pond system will add to the roof. A structural metal deck, which also acts as a finished ceiling and radiating surface, is the most commonly used support for the ponds themselves. Since the entire system is located on the roof, the remainder of the building can be constructed of any material. Using masonry interior walls and/or floors will help moderate indoor temperature fluctuations and reduce the recommended depth of the pond.

Thermal Control

Roof pond heating and cooling is characterized by stable indoor temperatures and high levels of comfort due to the large area of radiative surface (usually the entire ceiling). Daily fluctuations of space temperature range from only 5° to 8°F in a masonry building, and 9° to 14°F in a building constructed of all lightweight materials

The Passive Solar Energy Book

Efficiency

(such as wood frame). An advantage of this system accrues from the fact that interior partitions can be rearranged without altering the heating or cooling system.

Roof ponds which are double-glazed (usually with an inflated plastic air cell) range in efficiency from 30 to 45%. It should be noted that the effectiveness of the seal made by the movable insulation will have an impact on the efficiency of the system.

Retrofitting

Roof ponds are most efficient when they are integral to the architecture. The requirements of a large area of radiating surface plus structural and modular considerations make it difficult to apply to existing structures.

Conclusion

Solar roof ponds are an inexpensive and effective method of providing both heating at lower latitudes (i.e., 36° NL or lower) and cooling in dry climates with clear night-skies. Furthermore, there are several modifications which can be made to the system to make it applicable to a variety of climates. For example, spraying or flooding the outside surface of the enclosed ponds to provide additional cooling by evaporation (up to 4 times the amount provided by night sky radiation) can extend the system's cooling capability to humid regions. Or, placing the ponds under a pitched roof, with the south slope glazed, can adapt the roof pond to northern latitudes where horizontal collectors would otherwise be inefficient.



8. Appropriate Materials

The materials used in constructing a building will influence the choice of a passive solar system—CHOOSING THE SYSTEM(7). This pattern explains the range of good materials available.



More energy is consumed in the construction of a building than will be used in many years of operation. Building materials and equipment require considerable quantities of energy during their manufacture, transportation to the construction site and assembly. Robert A. Kegel, in an article concerning energy and building materials ("The Energy Intensity of Building Materials," *Heating/Piping/Air Conditioning*, June 1975, pp. 37-41), analyzed the energy consumption of a conventional educational facility (432,000 sq ft) in Chicago. He looked at the building from the standpoint of building construction, materials, equipment and operation. His results indicated that the building could operate for over 6 years before exceeding the energy it took to construct it. These results did not include the energy expended in mining and transporting materials to the mill or factory. Conventional housing reflects similar patterns of energy use.

The Recommendation

In building construction, use mostly biodegradable and low energy-consuming materials which are locally produced. For thermal mass and bulk materials use adobe, soil-cement, brick, stone, concrete, and water in containers; for finish materials use wood, plywood, particle board and gypsum board. Use the following materials only in small quantities or when they have been recycled: steel panels and containers, rolled steel sections, aluminum and plastics.



The Passive Solar Energy Book

Distribute and size bulk materials so they work effectively for heat storage. For Direct Gain Systems see MASONRY HEAT STORAGE(11) and INTERIOR WATER WALL(12); for Thermal Storage Wall Systems see WALL DETAILS(14); for Attached Greenhouse Systems see GREENHOUSE CONNECTION(16); for Roof Pond Systems see ROOF POND DETAILS(18); and for a freestanding greenhouse see GREENHOUSE DETAILS(20).

The Information

The primary intention behind modern construction practices is to use technology to keep the costs of construction as low as possible:

To make buildings less expensive to construct, we have been willing to use non-renewable resources, such as energy expended in the production and transportation of manufactured building materials, rather than pay the cost of labor. This trade-off does not result in ecologically sound building practices since the result is buildings that are constructed and run at the expense of our future ability to adequately maintain our resources.

There are many building attitudes ranging from a total ecological consciousness to the continuation of what is easiest in today's construction market. Fortunately, the requirement for thermal mass in a passively heated building is compatible with the notion of ecological consciousness. As indicated in previous patterns, mass materials include adobe, stabilized earth, stone, brick, tile, concrete, and water in containers. It can be seen from the following table that these materials require relatively little energy to produce when compared to energy-intensive materials such as aluminum and high-grade steel alloys.

In some cases mass materials will be as much as 80 to 90% of the total volume of the materials used in a passively heated building. With some consideration given to energy consciousness in choosing secondary and finish materials, a passive solar heated building will, by its nature, be energy conservative.

Because some of our forests have been terribly mismanaged, some devastated by clear-cutting, wood as a bulk or primary material is to be avoided. As a secondary material, however, wood is excellent. Other good finish and secondary materials include plywood, particle board, gypsum board, plaster, paper, canvas and vinyl. The use of energy-intensive materials is appropriate when applied in moderation or when the materials are recycled.

8. Appropriate Materials

Table IV-8a Materials and Energy Use

Item	Source	To Produce	
		Btu/lb	Btu per unit
Steel (rolled)	(1)	19,974	
Aluminum	(1)	112,676	
Copper	(1)	34,144	
Concrete	(2)	413	
Cement	(1)	3,755	
Sand and gravel	(1)	30	
Lead	(1)	20,486	
Concrete block	(2)		15,200 per block
Silicone, metal and high-grade steel alloys	(1)	99,018	
Glass	(1)	11,438	
Titanium (rolled)	(1)	239,010	
Plastics	(1)	4,097	
Drywall	(2)	2,160	
Insulation (board)	(2)		2,040 per sq ft
Paint	(2)	4,134	
Lumber	(1)		5,019 per board ft
Paper	(1)	10,072	
Roofing	(2)		6,945 per sq ft
Vinyl tile	(2)	8,000	
Brick	(3)	138	682 per block
10% soil-cement block	(3)	34	170 per block

SOURCES: (1) A. B. Makhijani and A. J. Lichtenberg, "Energy and Well-Being," p. 14.
 (2) Robert A. Kegel, "The Energy Intensity of Building Materials," p. 39.
 (3) Andrew MacKillop, "Low Energy Housing," p. 8.

When selecting building materials, be aware of what is locally produced. By supporting people in the local labor market, we not only save transportation costs (money and energy) but maintain the life of industries which are compatible with our life style and welfare.



Direct Gain System

9. Solar Windows



Photo IV-9a

9. Solar Windows

After choosing to use a Direct Gain System—CHOOSING THE SYSTEM(7)—and with a rough idea for the location of major south-facing glass areas—WINDOW LOCATION(6) and CLERESTORIES AND SKYLIGHTS(10)—this pattern defines the area of south-facing glazing needed to solar heat each space.



Direct Gain Systems are currently characterized by large amounts of south-facing glass. Most of our present information about Direct Gain Systems has been learned through the performance of various existing projects which utilize large south-facing glass areas for winter solar gain. These buildings are often thought of as overheating on sunny winter days. This happens because solar windows are frequently oversized due to the lack of any accurate methods for predicting a system's performance. These drawbacks have led to a very limited application of Direct Gain Systems in building design and construction.

The Recommendation

In cold climates (average winter temperatures 20° to 30°F), provide between 0.19 and 0.38 square feet of south-facing glass for each one square foot of space floor area. In temperate climates (average winter temperatures 35° to 45°F), provide 0.11 to 0.25 square feet of south-facing glass for each one square foot of space floor area. This amount of glazing will admit enough sunlight to keep the space at an average temperature of 65° to 70°F during much of the winter.

The Passive Solar Energy Book

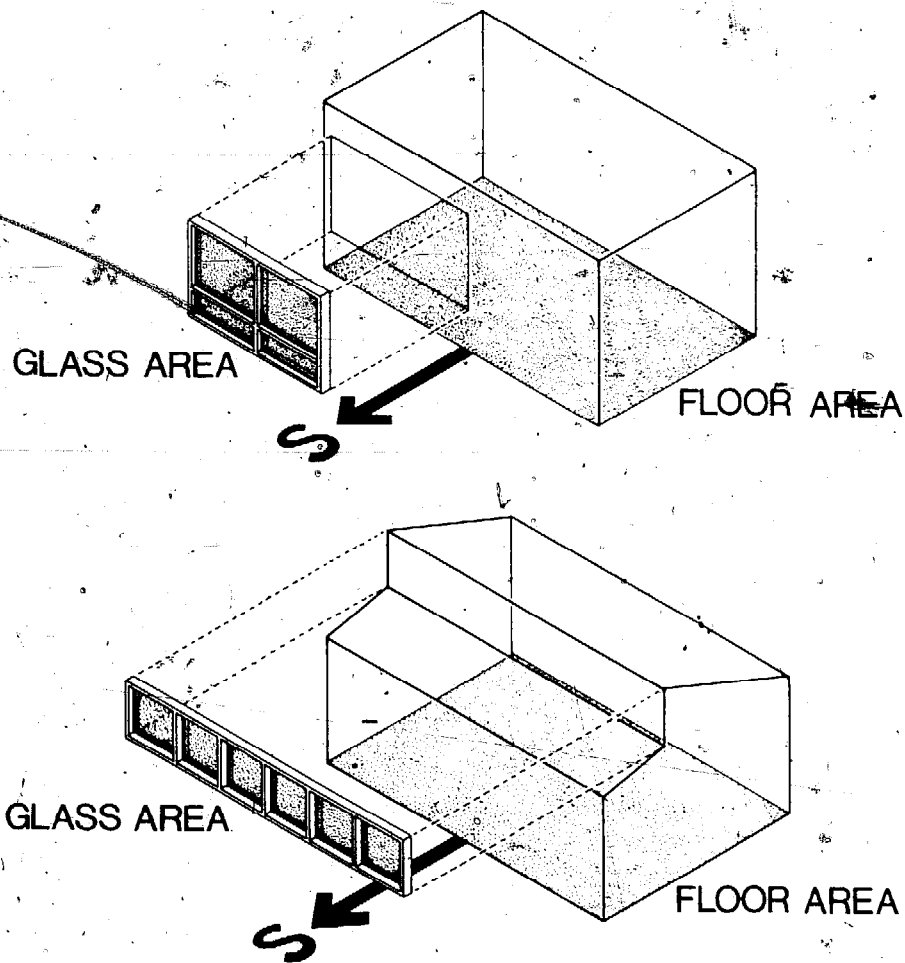


Fig. IV-9a



To prevent daytime overheating and large space temperature fluctuations, store a portion of the heat gained during the daytime for use at night by locating a thermal mass within each space—MASONRY HEAT STORAGE(11) and INTERIOR WATER-WALL(12). Use MOVABLE INSULATION(23) over the solar windows at night to reduce heat loss and protect the windows from the hot summer sun by applying SHADING DEVICES(25). The area of window needed to heat a space can be substantially reduced by using exterior REFLECTORS(24). A Direct Gain System with undersized solar windows can be combined with other passive systems to achieve the same recommended performance—COMBINING SYSTEMS(21).

The Information

In a Direct Gain System the most important factor in *collecting* the sun's energy is the size and placement of window openings. A window, skylight or clerestory that faces south and opens directly into a space is a very efficient solar collector—WINDOW LOCATION(6). Light entering the space is unlikely to be reflected back out regardless of the color or shape of the space. This means that virtually all the sunlight is absorbed by the walls, floor, ceiling and other objects in the space and is converted into heat. Openings that are designed primarily to admit solar energy into a space are referred to as "solar windows." You can orient a solar window as much as 25° to the east or west of true south and still intercept over 90% of the solar radiation incident on a south-facing surface.

The size of a solar window determines the average temperature in a space over the day. During a typical sunny winter day, if a space becomes uncomfortably hot from too much sunlight, then the solar windows are either oversized or there is not enough thermal mass distributed within the space to properly absorb the incoming radiation. As a space becomes too warm, heated air is vented by opening windows or activating an exhaust fan to maintain comfort. This reduces the system's efficiency since valuable heat is allowed to escape. For this reason, our criterion for a well-designed space is that it gain enough solar energy, on an average sunny day in December or January, to maintain an average space temperature of 70°F for that 24-hour period.

By establishing this criterion we are able to develop ratios for the preliminary sizing of solar windows, skylights and clerestories. Table IV-9a lists ratios for different climates that apply to a well-insulated residence.

For example, in Seattle, Washington, at 47°NL with an average January temperature of 38.9°F, a well-insulated space needs approximately 0.22 square feet of south-facing glass for each square foot of building floor area (a 200-square-foot space needs 44 square feet of south-facing glass).

Of course, the exact location and size of window openings depends upon other design considerations such as special views, natural lighting and space use. Because of these considerations, it may not be desirable to use the amount of south-facing glass recommended in this pattern. The system works with the

The Passive Solar Energy Book

Table IV-9a Sizing Solar Windows for Different Climatic Conditions¹

Average Winter Outdoor Temperature (°F) (degree-days/mo.) ²	Square Feet of Window ³ Needed for Each One Square Foot of Floor Area
Cold Climates	
15° (1,500)	0.27–0.42 (w/night insulation over glass)
20° (1,350)	0.24–0.38 (w/night insulation over glass)
25° (1,200)	0.21–0.33
30° (1,050)	0.19–0.29
Temperate Climates	
35° (900)	0.16–0.25
40° (750)	0.13–0.21
45° (600)	0.11–0.17

- NOTES:** 1. These ratios apply to a residence with a space heat loss of 8 to 10 Btu/day-sq ft_{ri}-°F. If space heat loss is less, lower values can be used. These ratios can also be used for other building types having similar heating requirements. Adjustments should be made for additional heat gains from lights, people and appliances.
2. Temperatures and degree-days are listed for December and January, usually the coldest months.
3. Within each range, choose a ratio according to your latitude. For southern latitudes, i.e., 35°NL, use the lower window-to-floor-area ratios; for northern latitudes, i.e., 48°NL, use the higher ratios.

same efficiency using smaller openings than those recommended; however, the annual percentage of solar heating supplied to the space is reduced.

Recessing windows and using wood sash construction will further reduce heat loss. Single glazing with wood frame construction transmits approximately 10% less heat than glazing with a metal assembly. As the glazing becomes more insulative (double or triple glazing), the type of framing becomes more significant. A double-glazed wood frame opening will transmit 20% less than a metal-framed opening. Only use metal sash that has a thermal break between

9. Solar Windows

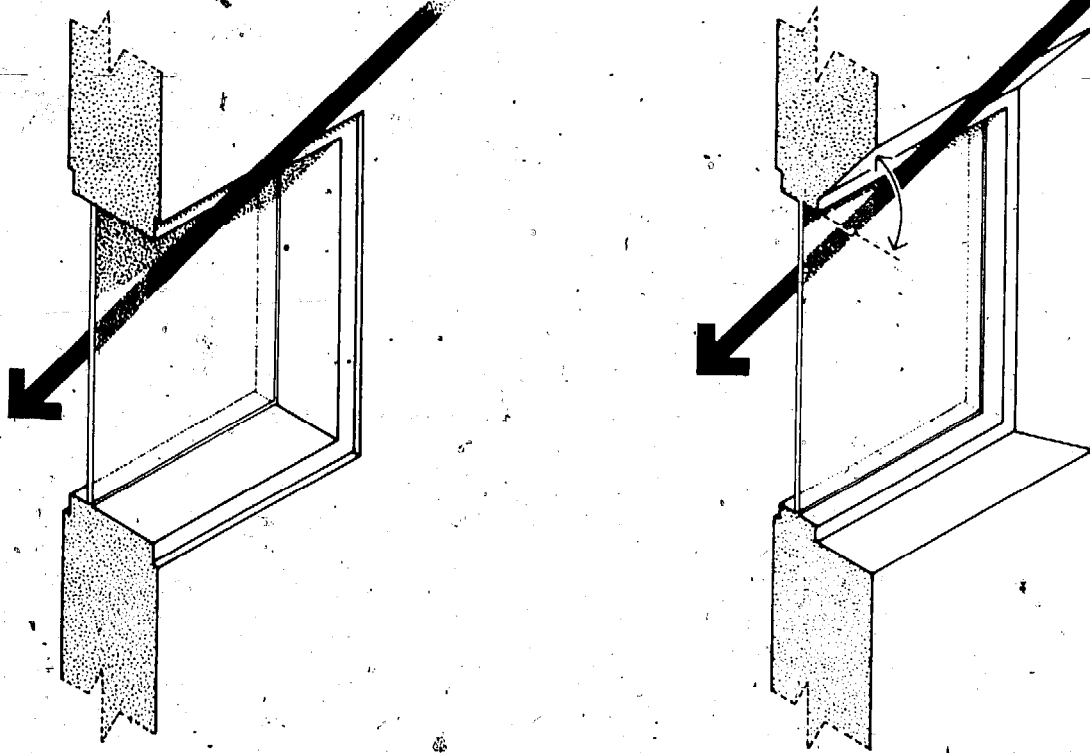


Fig. IV-9b: Splaying the wall will increase heat gain in winter.

the inside and outside face. At the outside surface of a window, wind will increase the infiltration of cold air into a building and will carry away heat at a faster rate than still air. Recessing windows back from the face of the exterior wall will decrease the movement of air against the window. However, when recessing windows, care should be taken on the south face to avoid excessive shading.



Direct Gain System

10. Clerestories and Skylights

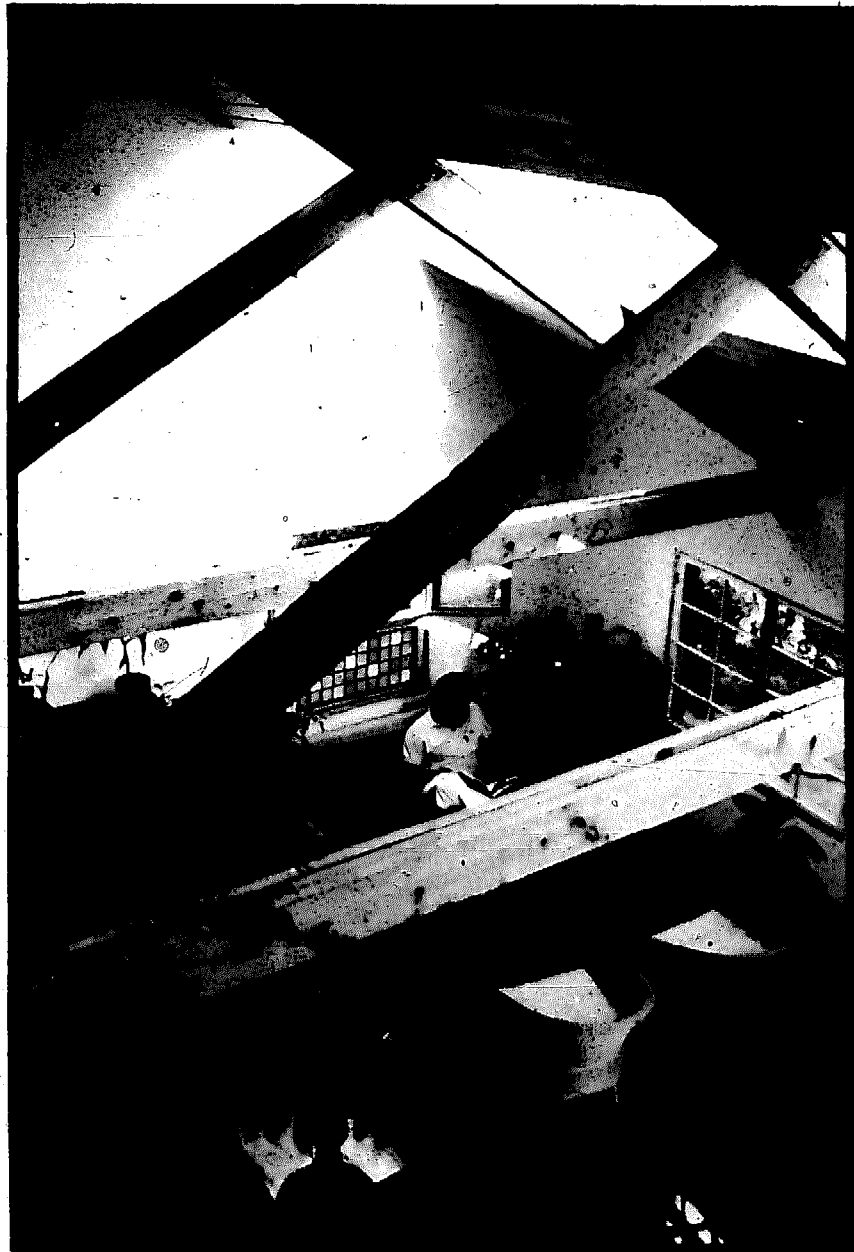


Photo IV-10a

10. Clerestories and Skylights

SOLAR WINDOWS(9) recommends the area of south-facing glass needed to admit direct sunlight, to solar heat a space. This pattern describes methods, other than windows, for collecting the sun's energy.



There are many situations when admitting direct sunlight through south-facing windows is not feasible or desirable. Solar blockage of the south wall by nearby obstructions, or spaces without a clear southern exposure, make it impossible to use windows for solar gain. Also, the distance from a solar window to a thermal storage mass is limited by the height of the window. A mass located too far from the window will not receive and absorb direct sunlight. Large solar windows, which are the primary source of direct sunlight in a space, may result in troublesome glare, create uncomfortably warm and bright conditions for people occupying the space and discolor certain fabrics. For these and other reasons (privacy and aesthetics) it is necessary to explore alternative methods for collecting the sun's energy in a direct gain building.

The Recommendation

Another method for admitting sunlight into a space is through the roof. Use either south-facing clerestories or skylights to distribute sunlight over a space or to direct it to a particular interior surface. Make the ceiling of the clerestory a light color and apply shading devices to both clerestories and skylights for summer sun control.

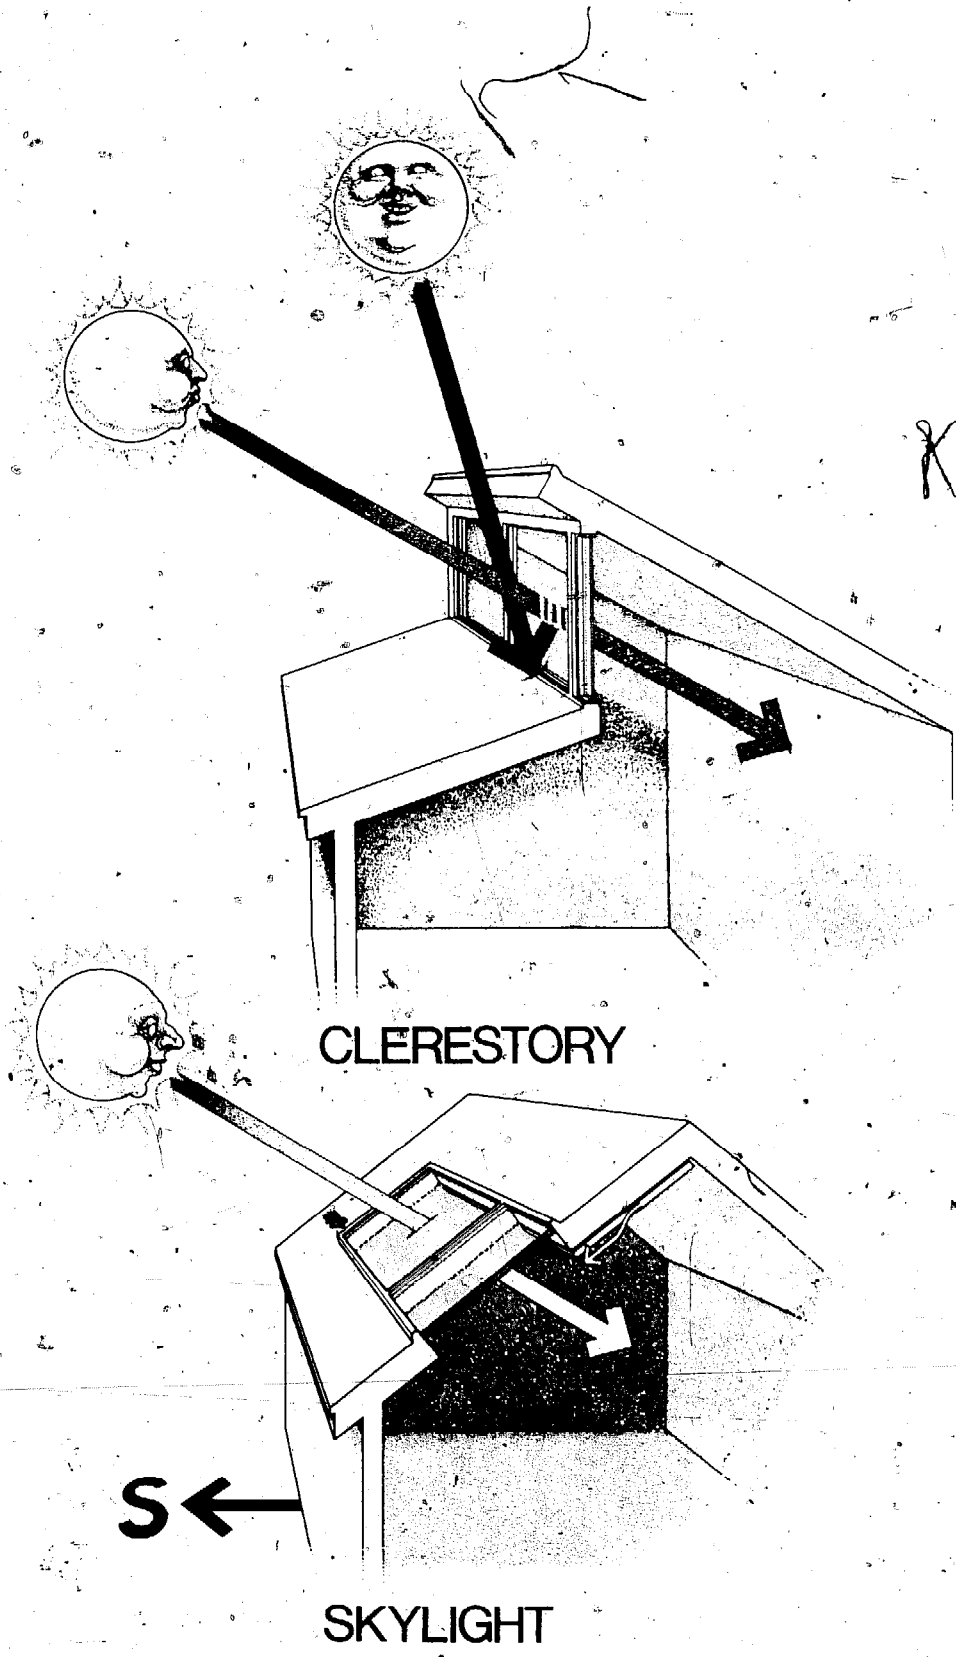


Fig. IV-10a



10. Clerestories and Skylights

Apply MOVABLE INSULATION(23) and REFLECTORS(24) to make clerestories and skylights more efficient as solar collectors. Shade all glass areas, especially horizontal and south-facing glass, to protect them from the hot summer sun—SHADING DEVICES(25).

The Information

Collecting sunlight through south-facing clerestories and skylights has several advantages. Sunlight admitted through the roof can be distributed to any part of a space or building. This allows for maximum freedom when locating an interior thermal storage mass. When properly designed, toplighting eliminates the problem of glare since light entering the space from above reduces the contrast between interior surfaces and windows. Because clerestories and skylights are located high in a space, they reduce the chance of solar blockage by off-site obstructions and allow for large openings in crowded building situations where privacy is desirable.



Photo IV-10b: Clerestory location.

The Passive Solar Energy Book

Most passive solar clerestory and skylight configurations are derived from consideration for collecting sunlight and distributing it within a space. In a Direct Gain System, an important consideration in the selection and location of a particular configuration is whether sunlight is to be diffused throughout a space—MASONRY HEAT STORAGE(11), or directed to a particular surface—INTERIOR WATER WALL(12).

Clerestory, Sawtooth and Skylight Configurations

Clerestory—A clerestory is a vertical or near vertical opening projecting up from the roof plane. It is a particularly effective way to direct sunlight entering a space so that it strikes an interior thermal storage wall. Be careful to locate the clerestory at a distance in front of the wall which insures that direct sunlight will strike most of the wall during the winter. This distance will vary with latitude and ceiling height but is roughly 1 to 1½ times the height of the wall.

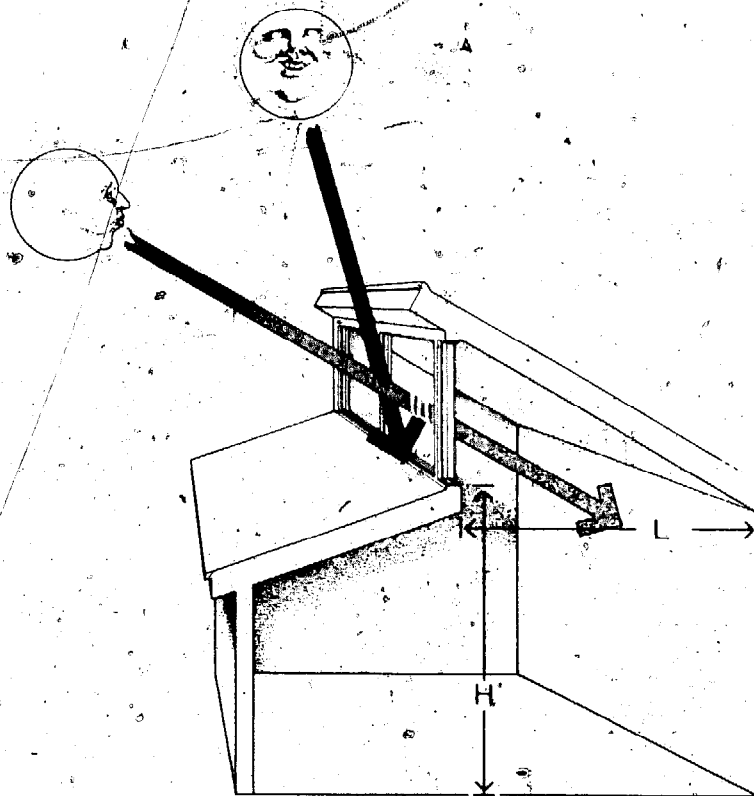


Fig. IV-10b: Clerestory location.

10. Clerestories and Skylights

Make the ceiling of the clerestory either a light color to reflect and diffuse sunlight down over the space, or a polished surface to direct the sunlight to a thermal wall. Shade the clerestory in summer by extending its roof to provide an overhang—SHADING DEVICES(25). The angle of the glass can be tilted to increase solar gain in winter, but tilting the glazing also increases solar gain in summer, making sun control devices essential. The exterior roof below a clerestory can be treated as a reflecting surface for maximum solar gain—REFLECTORS(24).


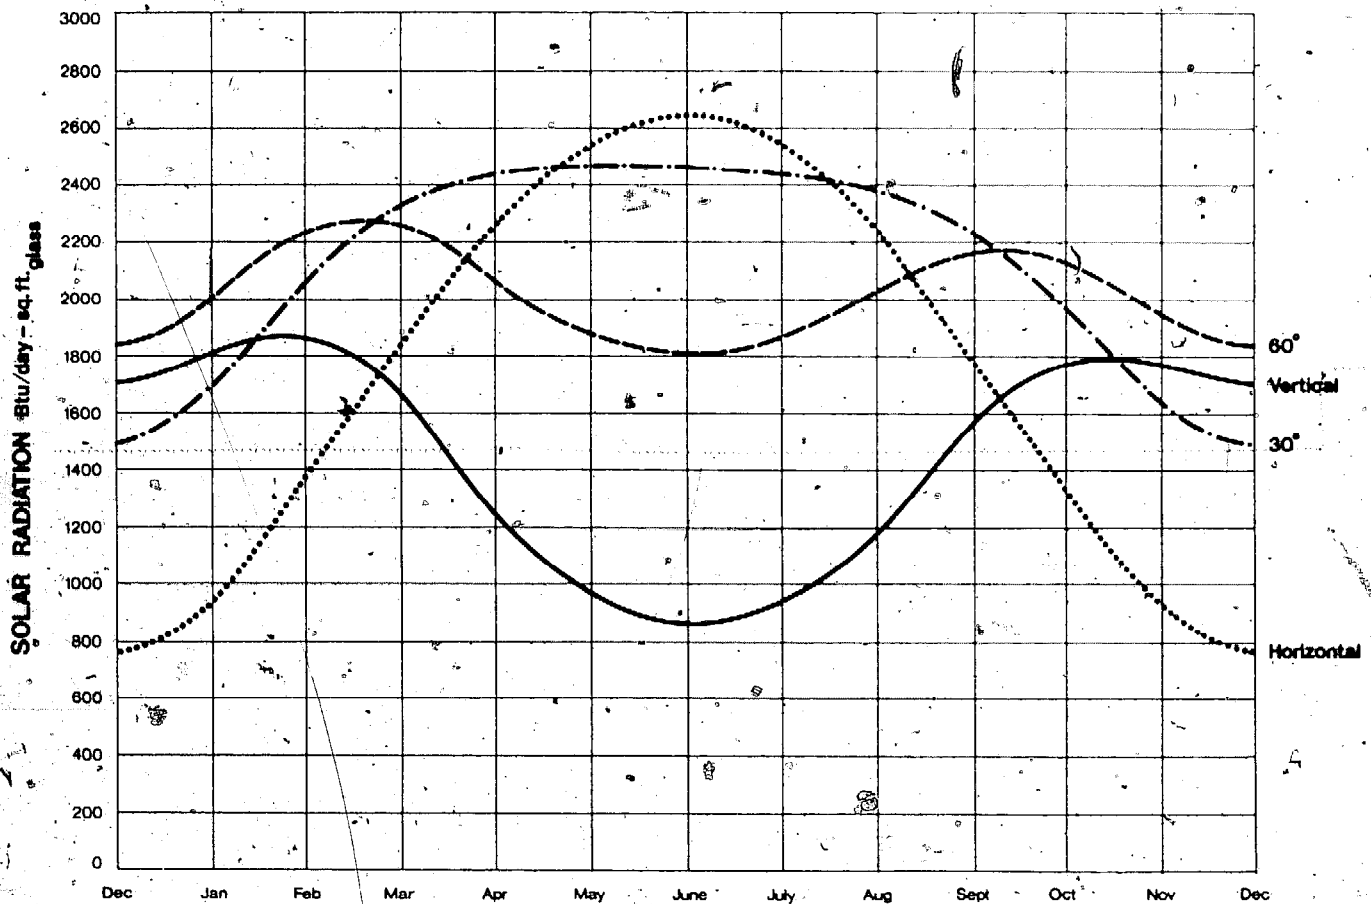


Fig. IV-10c: Comparison of south-facing tilted surfaces.

Note: This graph represents clear-day solar radiation values, on the surfaces indicated, for 40°N.

The Passive Solar Energy Book

Sawtooth—The sawtooth is a series of clerestories, one directly behind the other. When glazed with a translucent glazing material, the sawtooth effectively distributes sunlight over an entire space. As a rough guide, make the angle of each clerestory roof (as measured from horizontal) equal to, or less than, the altitude of the sun at noon, on December 21, the winter solstice. (Use the sun chart in chap. 5 for your latitude to find the altitude of the sun.) This assures that the clerestories will not shade each other during the winter hours of maximum solar radiation. If a steeper angle is used, then clerestories should be spaced apart accordingly.

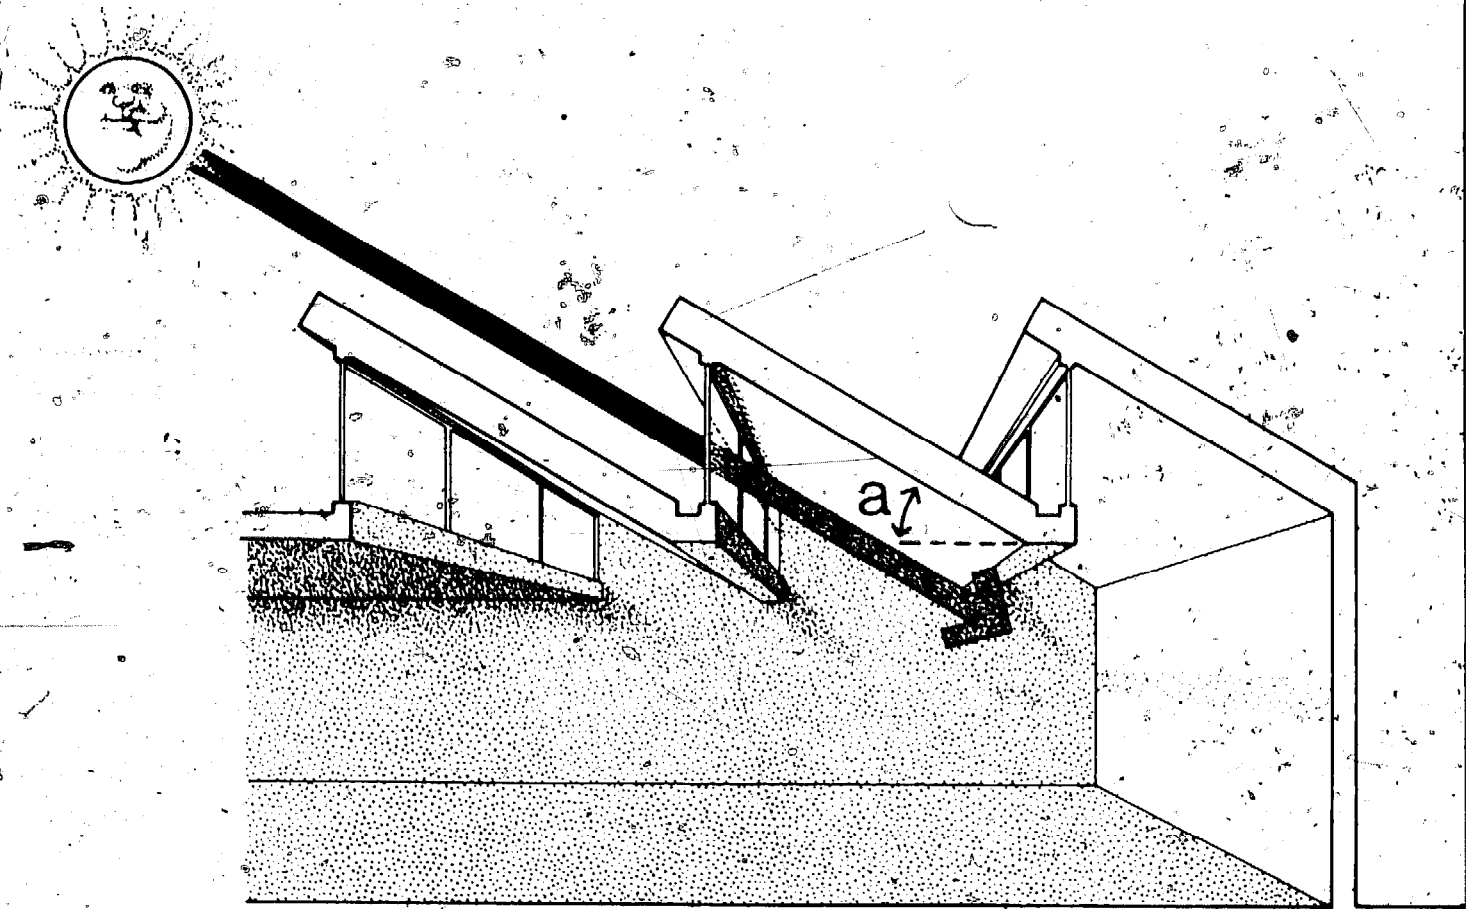


ANGLE a = ALTITUDE OF THE SUN AT NOON ON DECEMBER 21
EXAMPLE: AT 36°NL ANGLE a = 30°

Fig. IV-10d: Sawtooth configuration design.

10. Clerestories and Skylights



Photo IV-10c:
Sawtooth clerestories; view looking up,
and clerestories mounted on the roof.

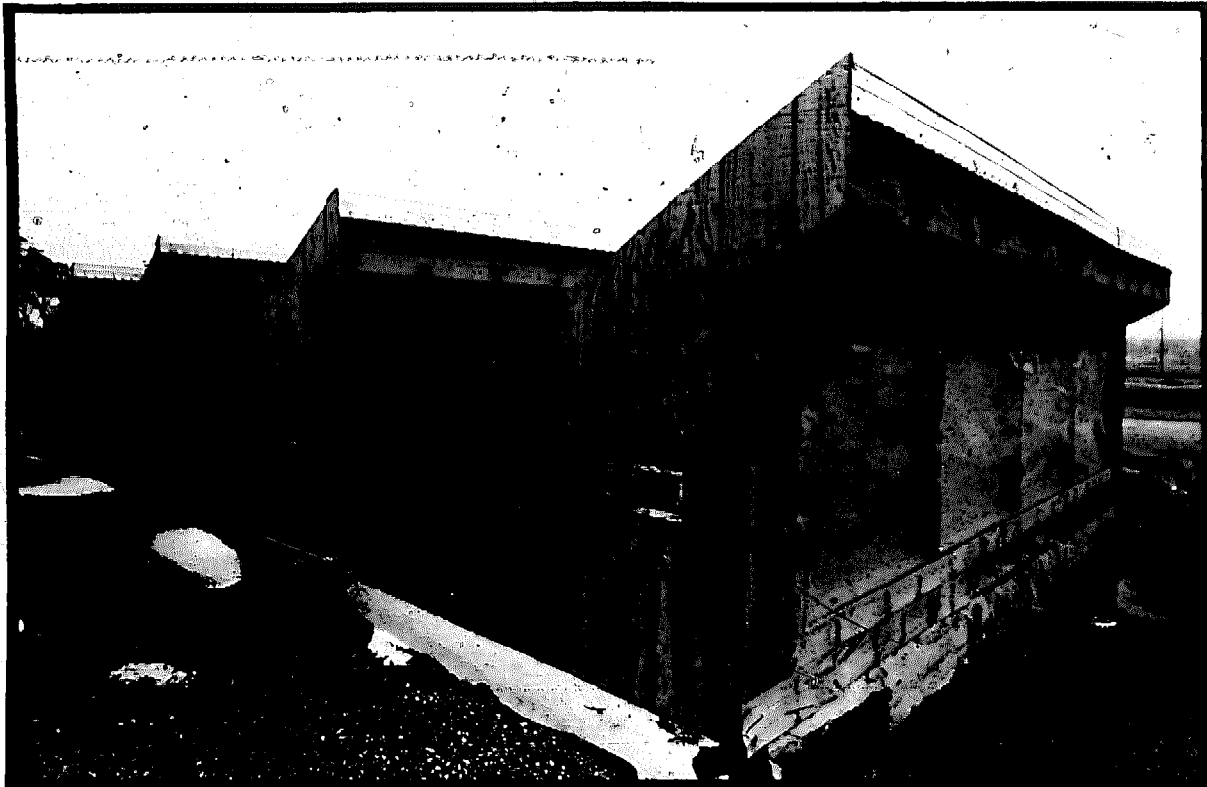

The Passive Solar Energy Book

Skylight—There are two types of skylight configurations: horizontal and those located on a tilted roof. It is important when designing a horizontal skylight to use a reflector to increase solar gain in winter, since the amount of solar energy incident on a horizontal surface is considerably less than that incident on a south-facing vertical or sloping surface (see fig. IV-10c). Remember that all skylights of any considerable size should have either interior or exterior shading devices to prevent excessive solar gain in summer.

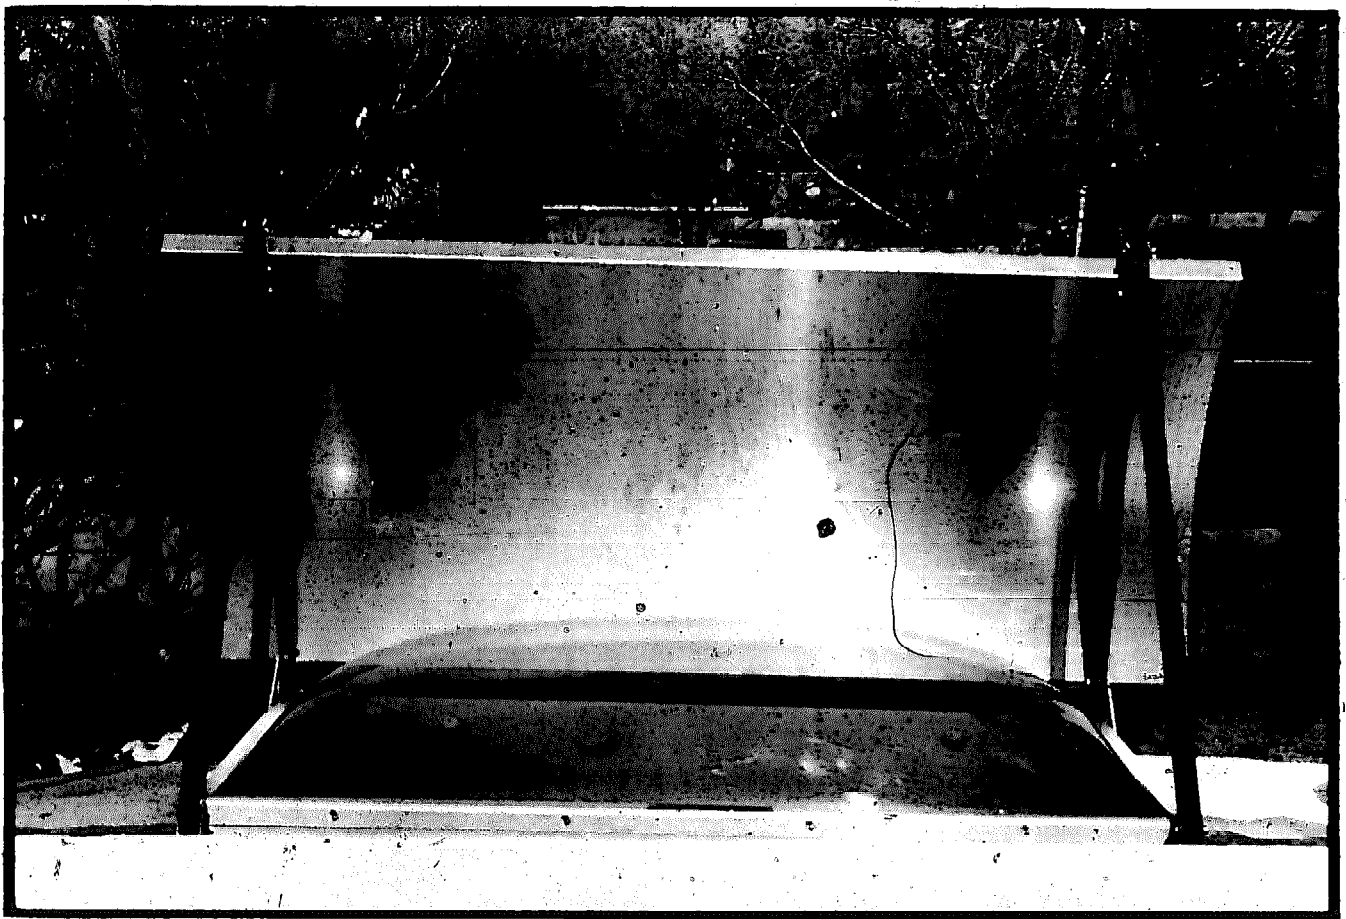


Photo IV-10d: Horizontal skylight augmented by a reflector.



Direct Gain System

11. Masonry Heat Storage



Photo IV-11a

11. Masonry Heat Storage

After sizing SOLAR WINDOWS(9), a portion of the sunlight (heat) admitted into each space must be stored for use during the evening hours.



The storage and control of heat in a masonry building is the major problem confronting the designer of a Direct Gain System. In a Direct Gain System, the amount of solar energy admitted into a space through windows, skylights or clerestories determines the average temperature in the space over the day. A large portion of this energy must be stored in the masonry walls and/or floor of the space for use during the evening. In the process of storing and releasing heat, the masonry fluctuates in temperature, yet the object of the heating system is to maintain a *relatively* constant interior temperature. The location, quantity, distribution and surface color of the masonry in a space will determine the indoor temperature fluctuation over the day.

The Recommendation

To minimize indoor temperature fluctuations, construct interior walls and floors of masonry with a minimum of 4 inches in thickness. Diffuse direct sunlight over the surface area of the masonry by using a translucent glazing material, by placing a number of small windows so that they admit sunlight in patches, or by reflecting direct sunlight off a light-colored interior surface first, thus diffusing it throughout the space. Use the following guidelines for selecting interior surface colors and finishes.

1. Choose a dark color for masonry floors.
2. Masonry walls can be any color.
3. Paint all lightweight construction (little thermal mass) a light color.
4. Avoid direct sunlight on dark-colored masonry surfaces for long periods of time.
5. Do not use wall-to-wall carpeting over masonry floors.

11. Masonry Heat Storage

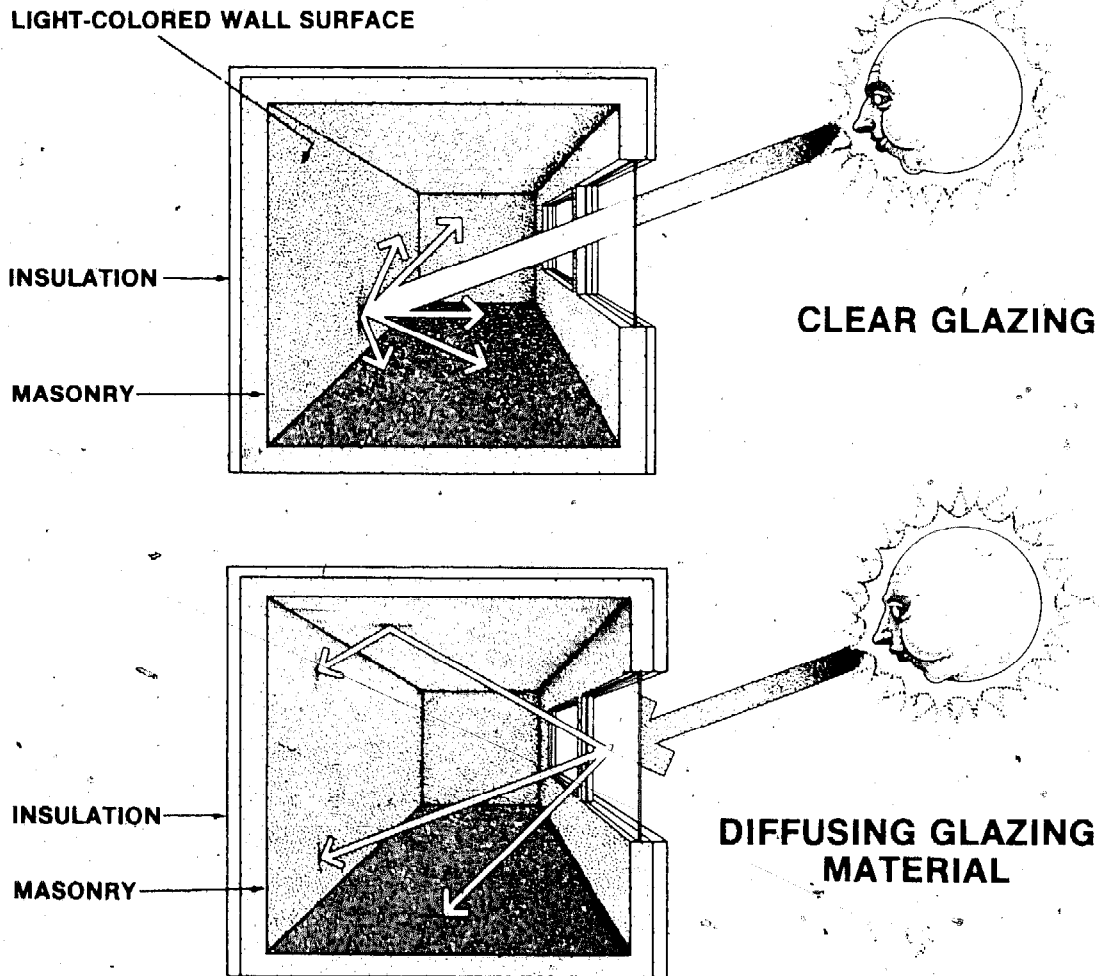


Fig. IV-11a

Slightly oversize solar windows and thermal mass to collect and store heat for cloudy days—CLOUDY DAY STORAGE(22). It is essential to insulate the exterior face of the mass to keep stored heat inside the space—INSULATION ON THE OUTSIDE(26). Also, a thermal mass cooled during summer evenings will absorb heat and provide cool interior surfaces on hot days—SUMMER COOLING(27). When masonry construction is not possible or desirable, an INTERIOR WATER WALL(12) can be used for heat storage.

The Passive Solar Energy Book

The Information

Since thermal mass is integrated into the living spaces in a Direct Gain System, the amount of energy stored in the mass (walls and floor) at sunset determines the indoor temperature fluctuation in the space over the day. In winter, approximately 65% of the total space heat loss occurs at night; 35% during the day. If solar windows are sized to admit enough sunlight on a clear winter day to heat the space for a 24-hour period—SOLAR WINDOWS(9)—then roughly 65% of this energy must be stored for use at night. When only a small portion of this energy is stored, then an abundance of heat is available during the day and not enough at night. This condition results in daytime overheating and low nighttime temperatures.

Solar gain through south-facing glass is easily calculated; however, predicting the amount of heat stored in the masonry or the daily temperature fluctuations in a space are presently beyond the capability of most building designers. In 1976, a study of Direct Gain Systems, performed at the University of Oregon, clearly illustrated the influence of each parameter on the system's performance (see E. Mazria, M. S. Baker, and F. C. Wessling, "Predicting the Performance of Passive Solar Heated Buildings," *Proceedings of the 1977 Annual Meeting of the American Section of the International Solar Energy Society*, vol. 1, sec. 2, 1977). It concluded that the percentage of heat stored in a thermal mass depends on the location, size and distribution of the mass and its surface color.

Location, Size and Distribution of Thermal Mass

Since the relationship between solar windows and thermal mass (masonry interior surfaces) greatly influences interior temperature fluctuations, three different case studies are presented in figure IV-11b to illustrate system performance. Results for a concrete mass of different thicknesses are described for each case.

For residential use where relatively stable indoor air temperatures are desired, Case 3 is the most preferable building configuration.* Both Cases 1 and 2 would require ventilation to prevent daytime overheating. It is obvious that ventilation lowers a system's performance by disposing of excess heat which could be utilized for space heating during the evening hours. Case 3 stores the largest percentage of solar heat admitted into the space, 60%. By storing


(continued on page 140)

*In some building types, such as a warehouse or greenhouse, larger temperature fluctuations may be tolerable or even desirable.

11. Masonry Heat Storage

Fig. IV-11b: Case 1: Building configuration.

A dark-colored concrete mass is placed against the rear wall or in the floor of the space in direct sunlight. The surface area of concrete exposed to direct sunlight over the day is $1\frac{1}{2}$ times the area of the glazing. This system represents a space with a horizontal band of south-facing windows or clerestories coupled directly to a dark-colored mass which is insulated on the exterior face.



Results:

During a clear winter day, an increase in masonry thickness beyond 8 inches results in little improvement in the system's performance. The graph here illustrates the indoor air temperatures over a 24-hour period for a mass thickness of 4, 8 and 16 inches. By increasing the mass from 4 to 8 inches, maximum air temperatures are relatively unchanged while minimum air temperatures are changed slightly; the 8-inch masonry wall increases the minimum room air temperature 5°F . Increasing the thickness to 16 inches has little impact on air temperatures. For all wall thicknesses studied, space temperature fluctuations over the day were about 40°F .


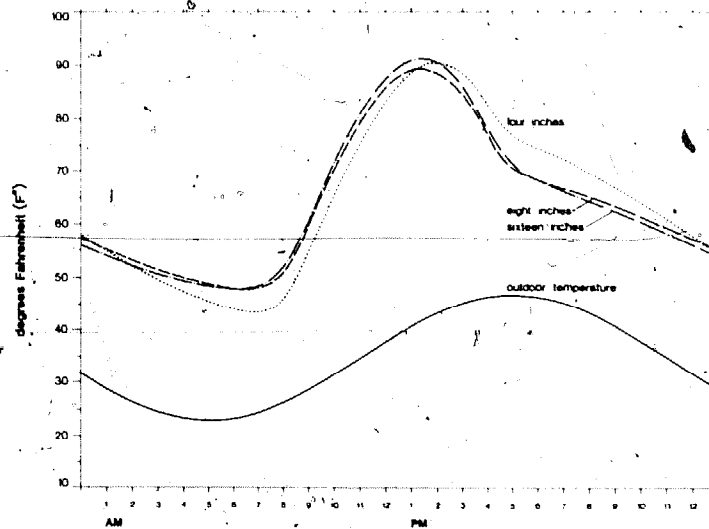


Fig. IV-11b: System performance for a concrete mass of different sizes.

The Passive Solar Energy Book

Case 2: Building configuration.

A dark-colored concrete mass is placed against the rear wall, or in the floor of the space in direct sunlight. **The surface area of concrete exposed to direct sunlight over the day is 3 times the area of the glazing.** This system represents a space with vertical windows (evenly spaced) and/or translucent (diffusing) glazed openings with light-colored interior surfaces and a dark-colored mass.

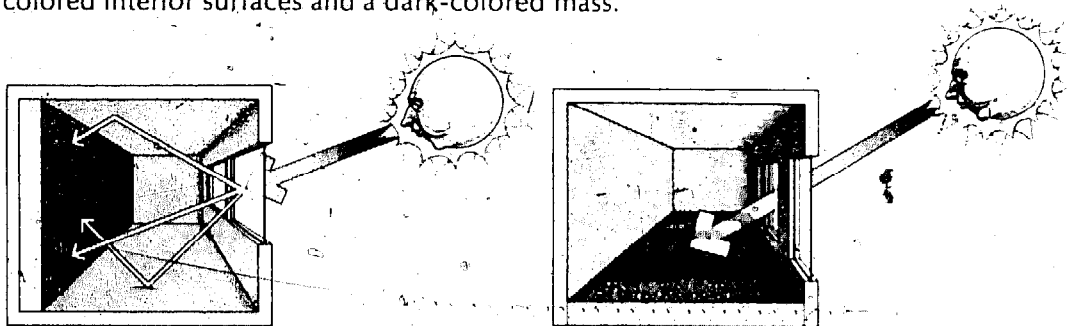

Results:

An increase in masonry thickness beyond 8 inches results in little change in system performance. The graph here illustrates room air temperatures for a wall or floor thickness of 4, 8 and 16 inches. The major temperature difference occurs by increasing the thickness from 4 to 8 inches; maximum room air temperature remains unchanged while the minimum air temperature is raised 3°F. Beyond an 8-inch thickness, there is very little variation in room temperatures. **The temperature fluctuation over the day is 26°F.**


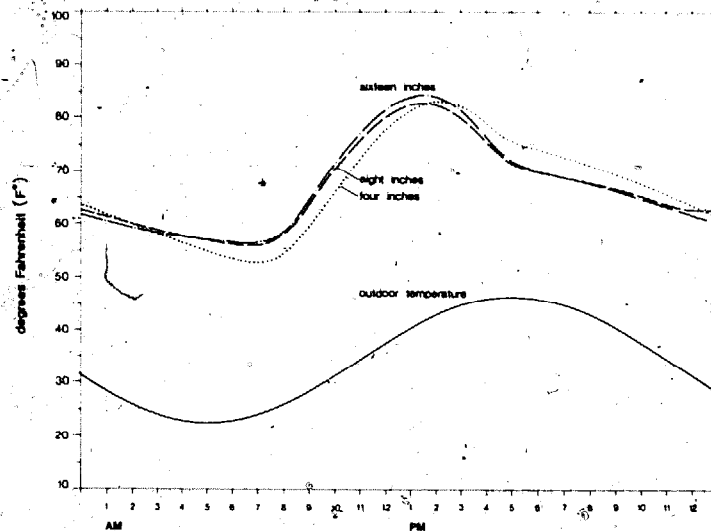


Fig. IV-11b

11. Masonry Heat Storage

Case 3: Building configuration.

The entire space, walls and floor, becomes the thermal storage mass. **The surface area of concrete exposed to direct sunlight is 9 times the area of the glazing.** This system represents a space constructed of masonry materials with translucent glazed openings, or clear glazed openings with sunlight striking a white surface first and then diffusing over the entire space.

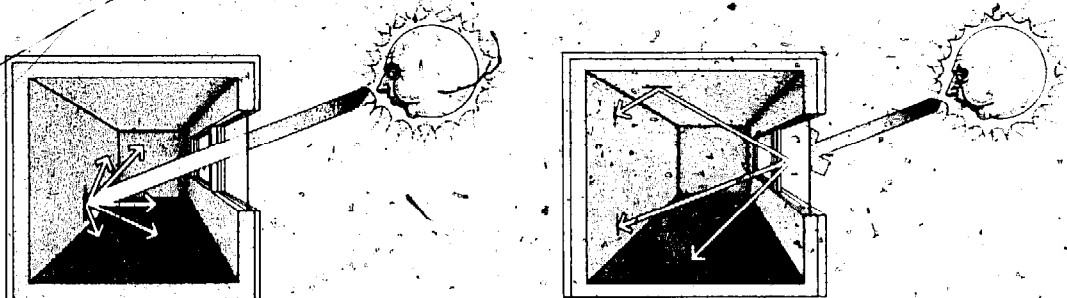

Results:

An increase in masonry thickness beyond 4 inches results in little change in system performance. After 4 inches, room air temperatures are very similar and the **daily space temperature fluctuation is only 13°F**, comfortable for most building interiors. If the same space were constructed of all lightweight materials (wood frame with a 1/2-inch gypsum board finish), it would fluctuate 38°F. This demonstrates the dampening effect of thermal mass on temperature fluctuations.

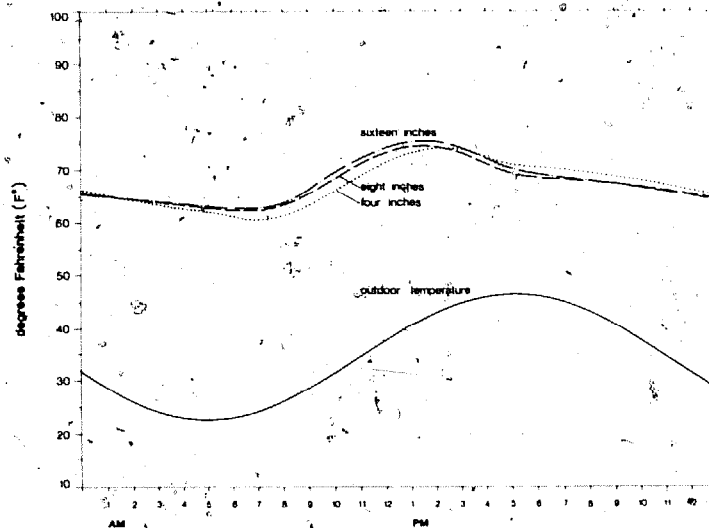


Fig. IV-11b

The Passive Solar Energy Book

more heat at sunset (5:00 p.m.), daytime temperatures are reduced and nighttime temperatures increased.

Table IV-11a Comparison of Systems

	Case 1 (8 in thickness or more)	Case 2 (8 in thickness or more)	Case 3 (4 in thickness or more)
Max. space air temperature	89°F	82°F	74°F
Min. space air temperature	48°F	56°F	61°F
Space air temperature fluctuation	41°F	26°F	13°F
Max. masonry surface temperature	99°F	84°F	75°F
Percentage of solar stored (at 5:00 p.m., sunset)*	50%	55%	60%

NOTE: *Percentage of solar radiation admitted into the space.

One further word about masonry heat storage: When the entire interior of a space is constructed of masonry, then walls can be as thin as 3 to 4 inches without indoor fluctuations becoming extreme.

These results show that for a space to remain comfortable during the day, each square foot of direct sunlight must be diffused over at least 9 square feet of masonry surface. Masonry can be used to store heat, but even thick masonry cannot absorb and store enough heat when exposed to direct sunlight throughout the day. Most masonry materials transfer heat from their surface to their interior at a slow rate. If too much heat is applied, the surface layer of the material becomes uncomfortably hot, giving much of the heat to the air in the space

11. Masonry Heat Storage

rather than conducting it away from the surface for storage. This condition is clearly illustrated by Case 1.

This analysis was extended to other latitudes, weather conditions, glass-to-floor-area ratios and space heat losses. Changing these parameters had little effect on the results presented for Cases 1, 2 and 3.

Comparison of Masonry Materials

All three cases were analyzed for different masonry materials. These materials include concrete (dense), brick (common), brick (magnesium additive) and adobe, which have the physical properties listed in table IV-11b.

Table IV-11b Thermal Storage Material Properties

Material	Conductivity (k)	Specific Heat (Cp)	Density (ρ)
	Btu hr/ft ² -°F/ft	Btu/lb-°F	lb/ft
Concrete (dense)	1.00	0.20	140.0
Brick (common)	0.42	0.20	120.0
Brick (magnesium additive)	2.20	0.20	120.0
Adobe	0.30	0.24	106.0

By using masonry of higher conductivity, air temperature fluctuations in the space were minimized. This is the result of a rapid transfer of heat away from the surface of a material to its interior, where it is stored for use during the evening. For the same quantity of masonry, the largest temperature fluctuations occurred when using adobe which has the poorest conductivity; and the smallest were with brick, which has magnesium as an additive to increase its conductivity. After extensive computer analyses, table IV-11c has been prepared as a guide to determine daily indoor air temperature fluctuations for Case 1, 2 and 3 type spaces. Fluctuations for each case are given for four commonly available materials.

The Passive Solar Energy Book

**Table IV-11c Approximate Range of Indoor Temperature (°F)
Fluctuations for Case 1, 2 and 3 Type Spaces**

	Thickness of Material (in)	Material ²			
		Concrete ³ (dense)	Brick (common)	Brick (magnesium additive)	Adobe ⁴
Case 1	8 or more	34°-46°	45°-60°	30°-40°	50°-65°
Case 2	8 or more	24°-31°	33°-40°	20°-26°	36°-45°
Case 3	4 or more	~11°	~15°	~9°	~17°

NOTES: 1. If additional masonry is located in a space (but not in direct sunlight), temperature fluctuations will be slightly less than those indicated. Fluctuations listed are for a winter-clear day. During periods of cloudy weather, fluctuations will be considerably less.

2. When using a combination of materials, i.e., brick walls and concrete floor, interpolate between the temperatures given.

3. When using hollow, dense concrete or clay blocks, fill the cores with masonry (concrete) to increase the heat storage capacity of the material.

4. Although adobe has the poorest conductivity of the materials tested, it is the one material that is likely to be used in greatest quantity.

Interior Surface Colors

To diffuse direct sunlight over a wide interior surface area, use either translucent glass or plastic, or reflect direct sunlight, transmitted through clear glass, off a white-colored surface first, scattering it in all directions over an entire space. Another method might be to use several small windows that admit direct sunlight in patches. Masonry, swept by patches of sunlight, will not become too warm and will store a greater portion of the energy incident on its surface. The following general rules can be applied to help you select interior surface colors and finishes for spaces of predominantly masonry construction:

1. Select masonry floors of medium-dark colors. This assures that a portion of the heat will be absorbed and stored in the floor, low in the room, where it can provide for greater human comfort.
2. Masonry walls can be any color. Sunlight reflected from light-colored

11. Masonry Heat Storage

masonry walls (20 to 30% solar absorption) will eventually be absorbed by other masonry surfaces in the space.

3. Make all lightweight construction, such as wood frame partitions (little thermal mass), a light color so it reflects sunlight to the masonry walls or floor. Sunlight striking a dark-colored material of little thermal mass quickly heats that material. Since it has little capacity to store heat, it gives this heat to the space during the daytime when it is not needed, causing the space to overheat.
4. Avoid direct sunlight on dark-colored masonry surfaces for long periods of time since these surfaces will also become uncomfortably warm.
5. Do not cover a masonry floor with wall-to-wall carpet. Carpet insulates the heat storage mass from the room. Scatter or area rugs, covering a small area of the floor, make little difference.



Direct Gain System

12. Interior Water Wall

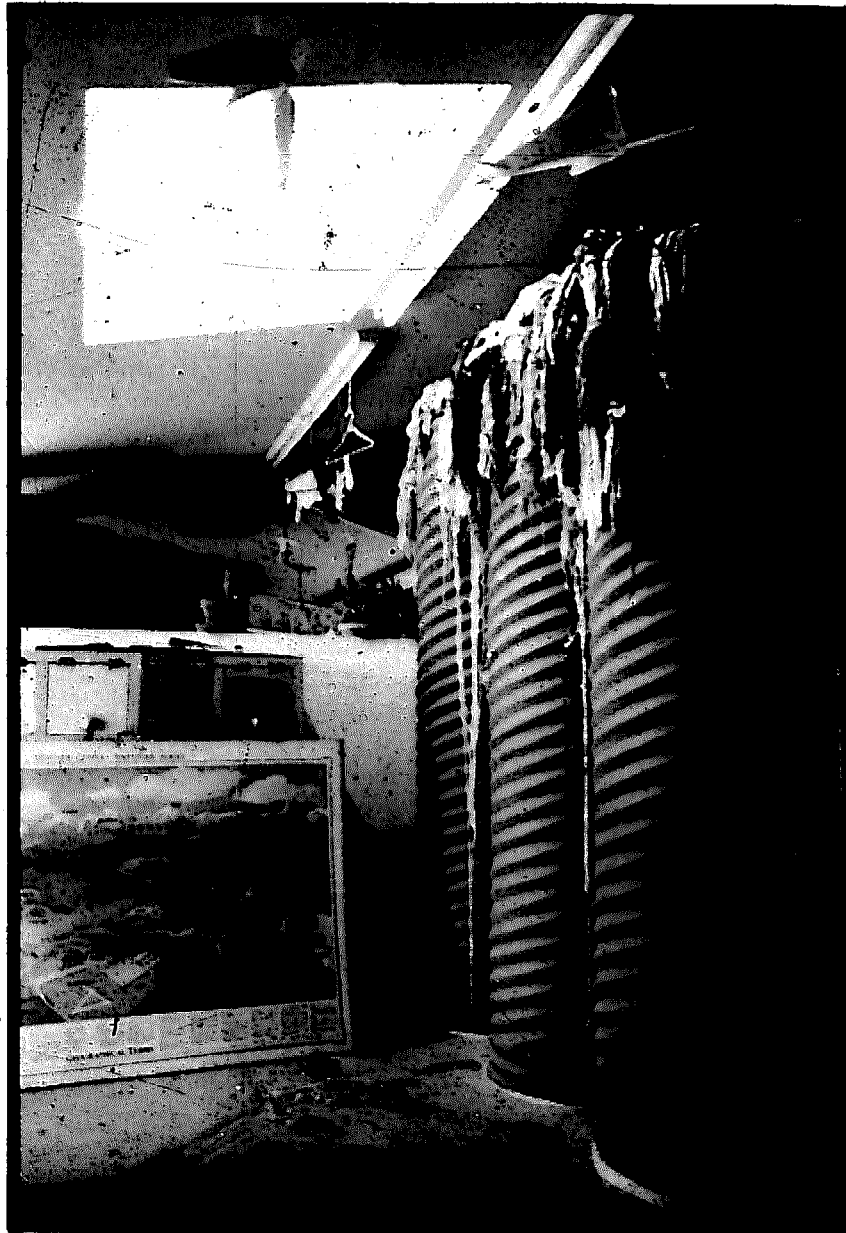


Photo IV-12a

12. Interior Water Wall

After sizing SOLAR WINDOWS(9) and CLERESTORIES AND SKYLIGHTS(10), a portion of the sunlight (heat) admitted into each space can be stored in a water wall for use during the evening hours.



The size of a water wall and its surface color determine the temperature fluctuation in a space over the day. Solar windows are sized to admit enough sunlight to keep a space at an average temperature of 65° to 70°F during most of the winter. The volume of water in the space and surface color of the container will influence the indoor temperature fluctuation above and below this average. The size of the water wall needed to maintain a comfortable environment is directly related to the area of the solar windows.

The Recommendation

When using an interior water wall for heat storage, locate it in the space so that it receives direct sunlight between the hours of 10:00 a.m. and 2:00 p.m. Make the surface of the container exposed to direct sunlight a dark color, of at least 60% solar absorption, and use about one cubic foot (7½ gallons) of water for each one square foot of solar window.



Slightly oversize the solar windows and water wall to collect and store heat for cloudy days—CLOUDY DAY STORAGE(22). Insulate the exterior face of the wall when exposed to the outside—INSULATION ON THE OUTSIDE(26). In dry climates a water wall cooled during the summer with cool night air will provide for SUMMER COOLING(27).

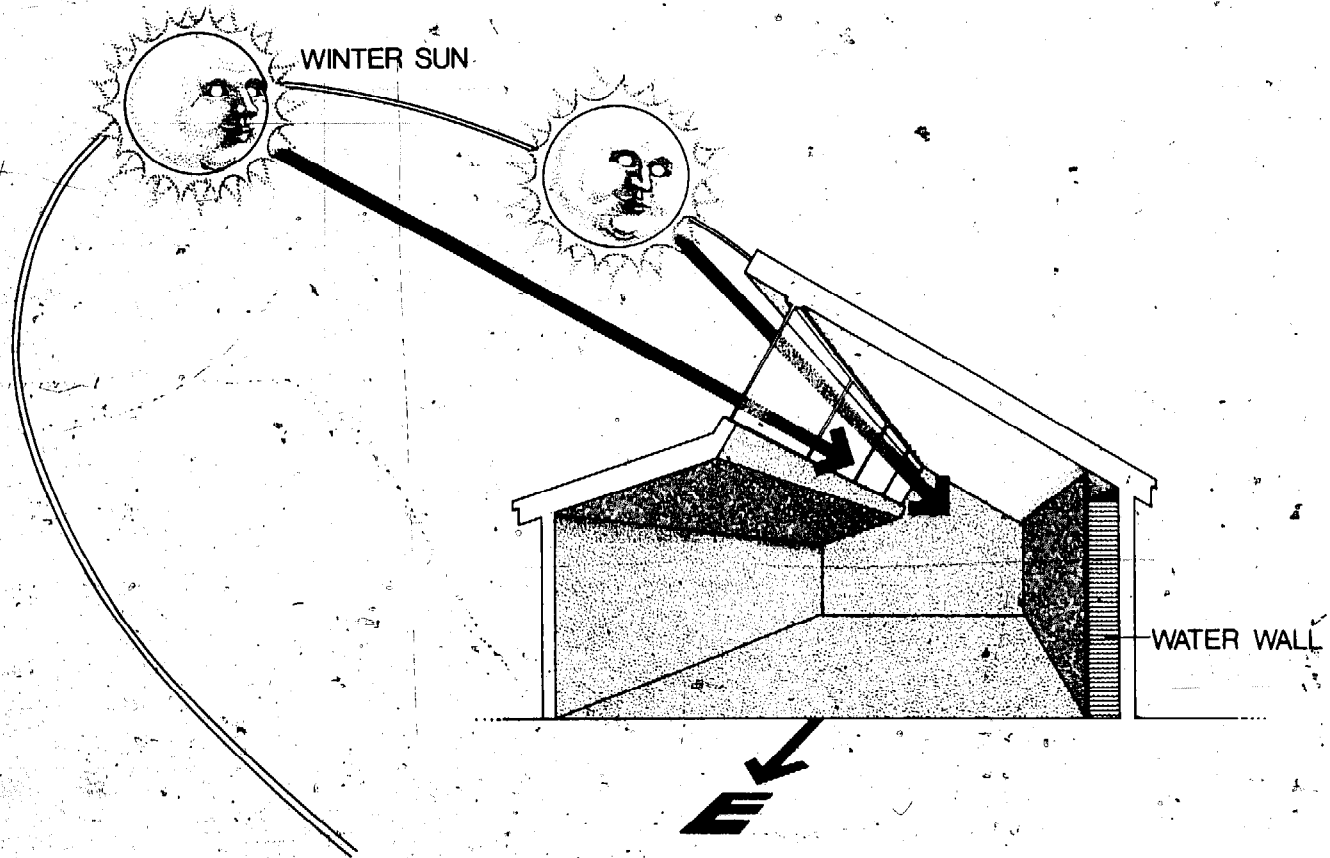


Fig. IV-12a

The Information

Masonry may need sunlight diffused over a large surface area, but water in containers can absorb heat effectively even when it's concentrated by a reflector. There are two reasons for this.

12. Interior Water Wall

First, water is a more efficient storage medium than masonry. A cubic foot of water will store 62.4 Btu's for each 1°F temperature rise, while the same volume of concrete stores only 28 Btu's for each 1°F rise in temperature.

Second, a water wall heats up uniformly, using all its mass for storage, while masonry passes heat slowly from its surface to its interior. When a dark-colored masonry wall is exposed to direct sunlight, the surface temperature rises rapidly while its interior remains cool. Since masonry conducts heat slowly, only a small portion of the wall stores heat. It will take approximately 5 hours for heat to pass through an 8-inch concrete wall.

In contrast, a water wall transfers heat rapidly from the collecting surface to the entire volume of water. As sunlight heats the surface of the container, water in contact with the inside face is heated, becomes less dense, and rises. This movement of water produces a convection current which distributes the heat throughout the container. By using all its mass for heat storage, the surface temperature of a water wall rises very slowly when compared to a masonry wall.

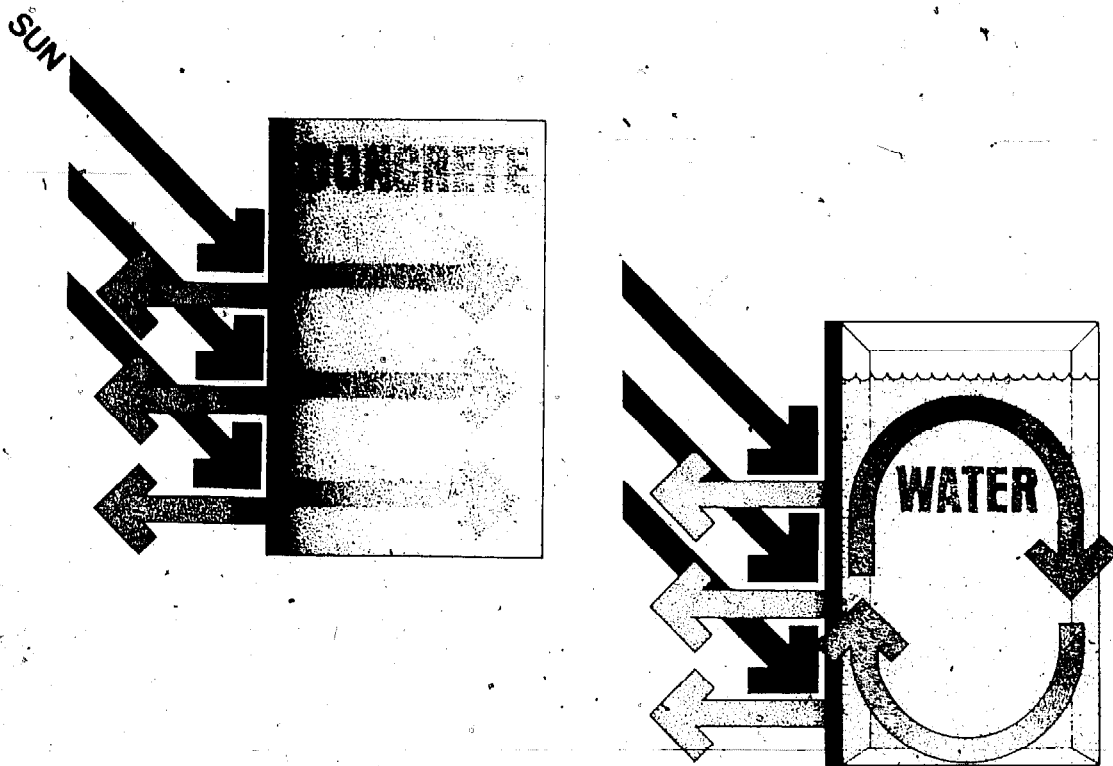


Fig. IV-12b: Heat transfer in a concrete and water storage mass.

The Passive Solar Energy Book

The volume of water in direct sunlight is the major determinant of temperature fluctuation in a space over the day. To illustrate this, an interior water wall was analyzed by computer for different quantities of water (wall thickness) using January clear-day, solar radiation and weather data for New York City. Note that space air temperature fluctuations decrease as the volume of the wall increases. The space with 1 cubic foot of water for each 1 square foot of glass has a temperature fluctuation of 17°F, while the same space with 3 cubic feet of water for 1 square foot of glass fluctuates only 12°F.

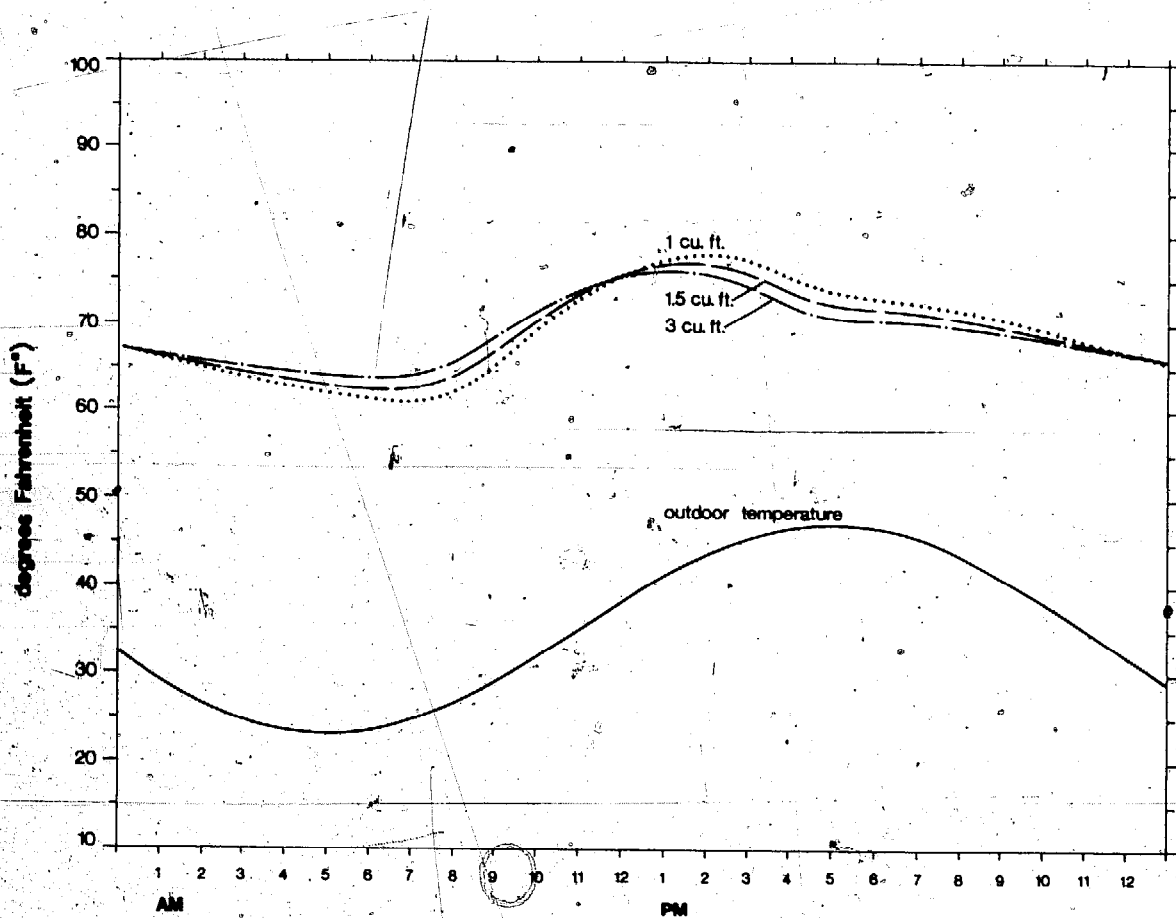


Fig. IV-12c: Indoor temperatures using various water walls.

Note: Clear-day indoor air temperatures are for a well-insulated space with 0.25 square feet of south-facing glass for each one square foot of building floor area, i.e., a 200-square-foot space would have 50 square feet of south-facing glass.

12. Interior Water Wall

This analysis was extended to different latitudes, weather conditions, south-facing-glass-to-floor-area ratios and space heat losses. *Changing these parameters had little effect on space temperature fluctuations in relation to wall volume (thickness).* Table IV-12a lists the approximate air temperature fluctuations that can be expected in a space with various quantities of water and south-facing glass.

When thermal storage materials are concentrated in a small area, such as a water wall in a wood frame building, it is important to absorb and store as much direct sunlight in the mass as possible. The greater the absorption of sunlight, the smaller the daily temperature fluctuation in the space. Table IV-12a also illustrates winter-clear day space temperature fluctuations for a water wall as a function of surface color. It is estimated that if the wall is not exposed to direct sunlight, roughly 4 times the amount of storage is needed.

Table IV-12a Daily Space Air Temperature (°F) Fluctuations¹ for Water Storage Wall Systems

Solar Absorption ² (surface color)	Volume ³ of Water Wall for Each One Square Foot of South-Facing Glass			
	1 cu ft	1.5 cu ft	2 cu ft	3 cu ft
75% (dark color)	~17°	~15°	~13°	~12°
90% (black)	15°	12°	10°	9°

NOTES: 1. Temperature fluctuations are for a winter-clear day with approximately 3 square feet of exposed wall area, for each one square foot of glass. If less wall area is exposed to the space, temperature fluctuations will be slightly higher. If additional mass is located in the space, such as masonry walls and/or floor, then fluctuations will be less than those listed.


2. Assumes 75% of the sunlight entering the space strikes the mass wall.

3. One cubic foot of water = 62.4 pounds or 7.48 gallons.

Testing the performance of interior water walls using various surface colors, a research team at the University of Oregon concluded:

As expected the black surface performed best. What surprised us though, was how well the blue and red painted containers per-

The Passive Solar Energy Book

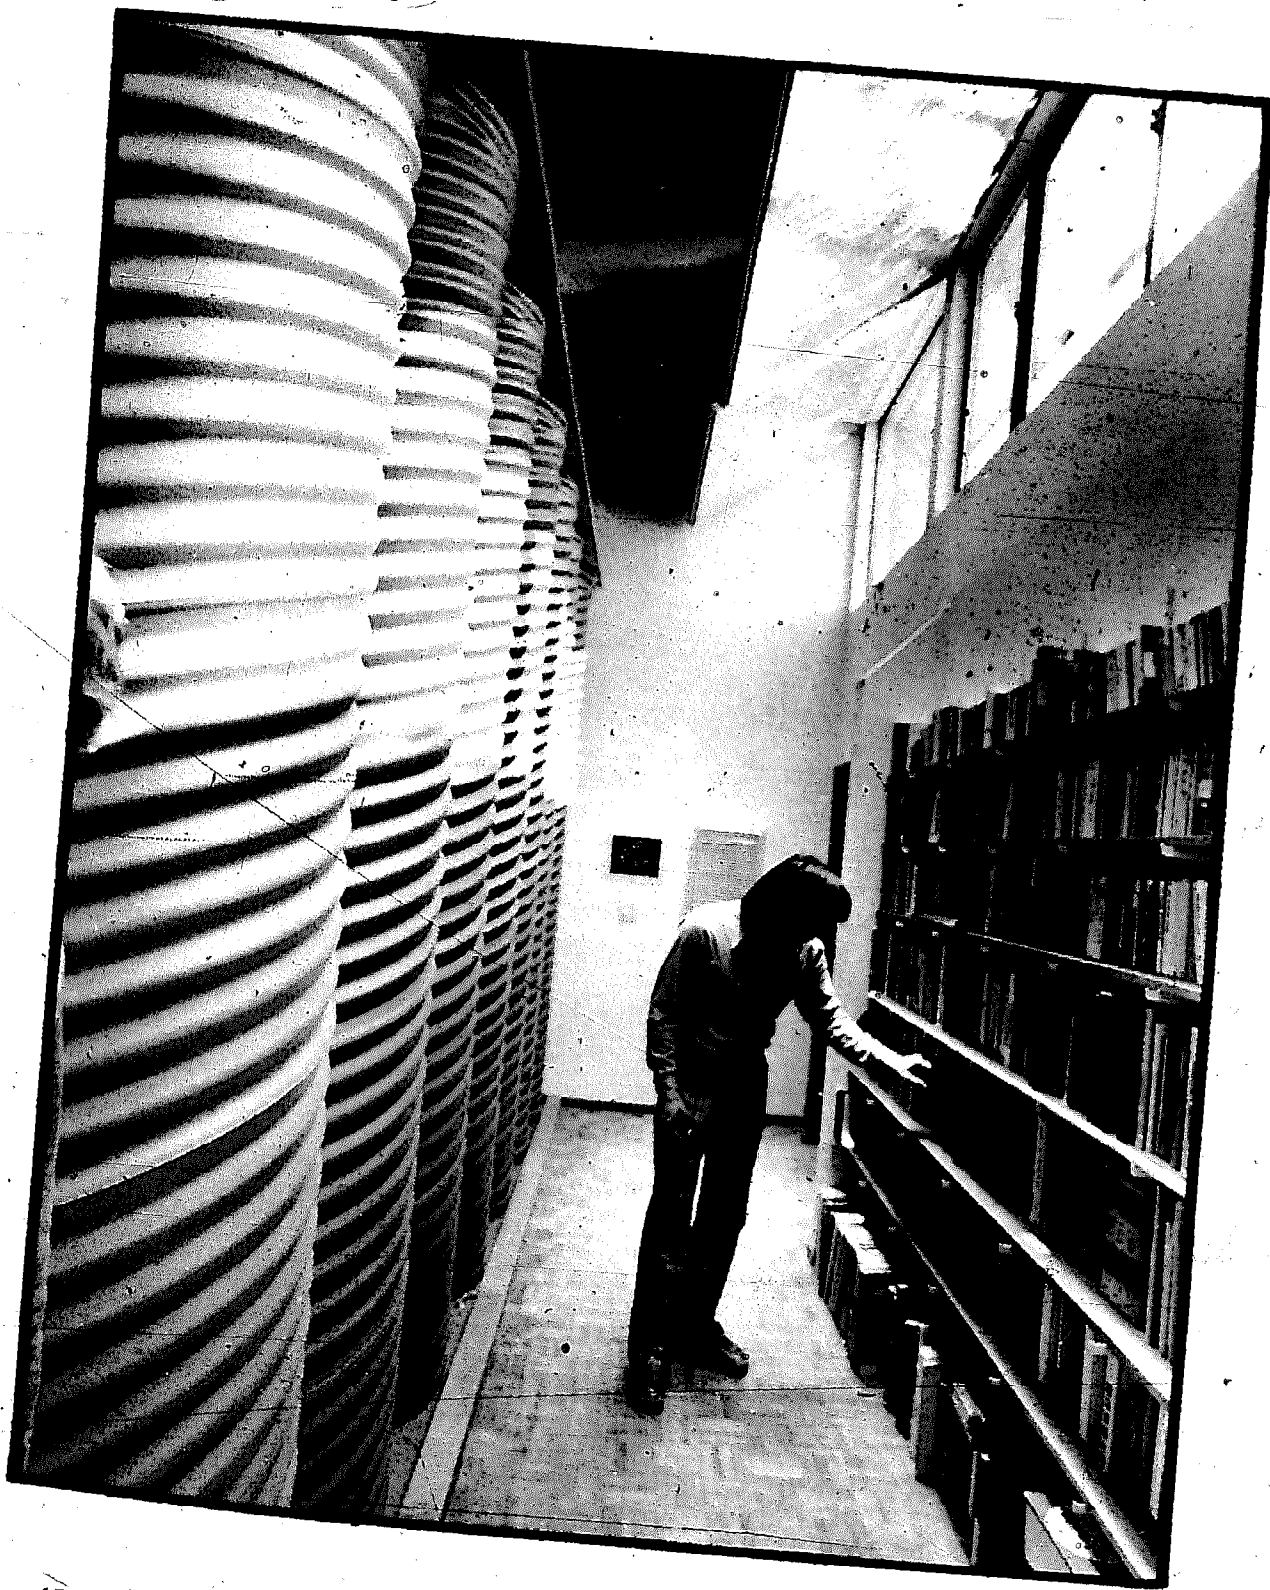

12. Interior Water Wall

formed. Those people who prefer blue or red to black will be glad to know that the blue containers were only 5% less efficient, and red 9%, than the black.*



Photo IV-12b: Interior water wall heats adjacent spaces (here and facing page).



*Study performed by Ran Rands and Randy Shafer at the University of Oregon, Dept. of Architecture, under the direction of Assistant Professor Edward Mazria, 1977.

Thermal Storage Wall System

13. Sizing the Wall


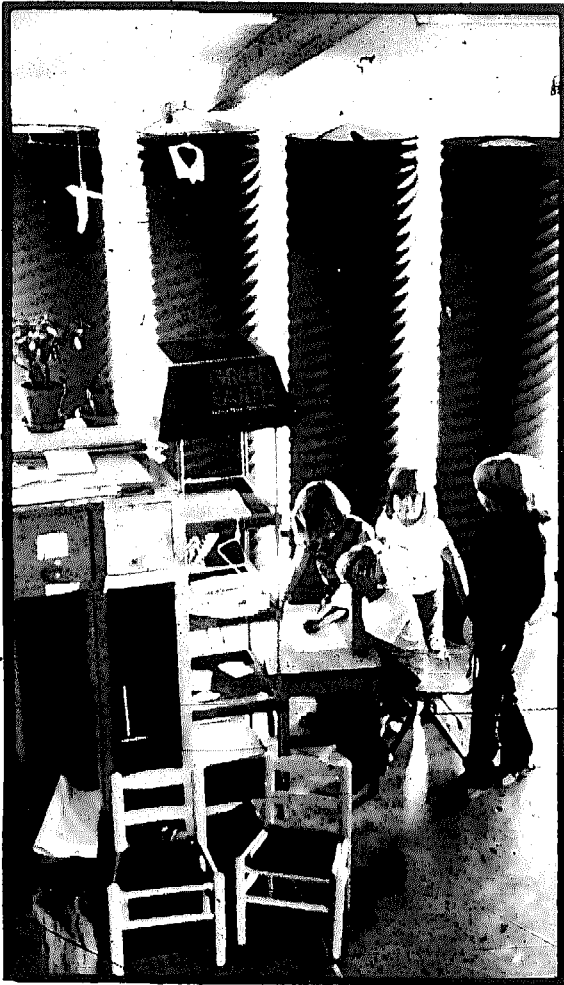


Photo IV-13a



13. Sizing the Wall

After locating the major south-facing living spaces—LOCATION OF INDOOR SPACES(4)—and choosing the heating system for each space—CHOOSING THE SYSTEM(7)—this pattern describes the sizing procedure for a Thermal Storage Wall System.

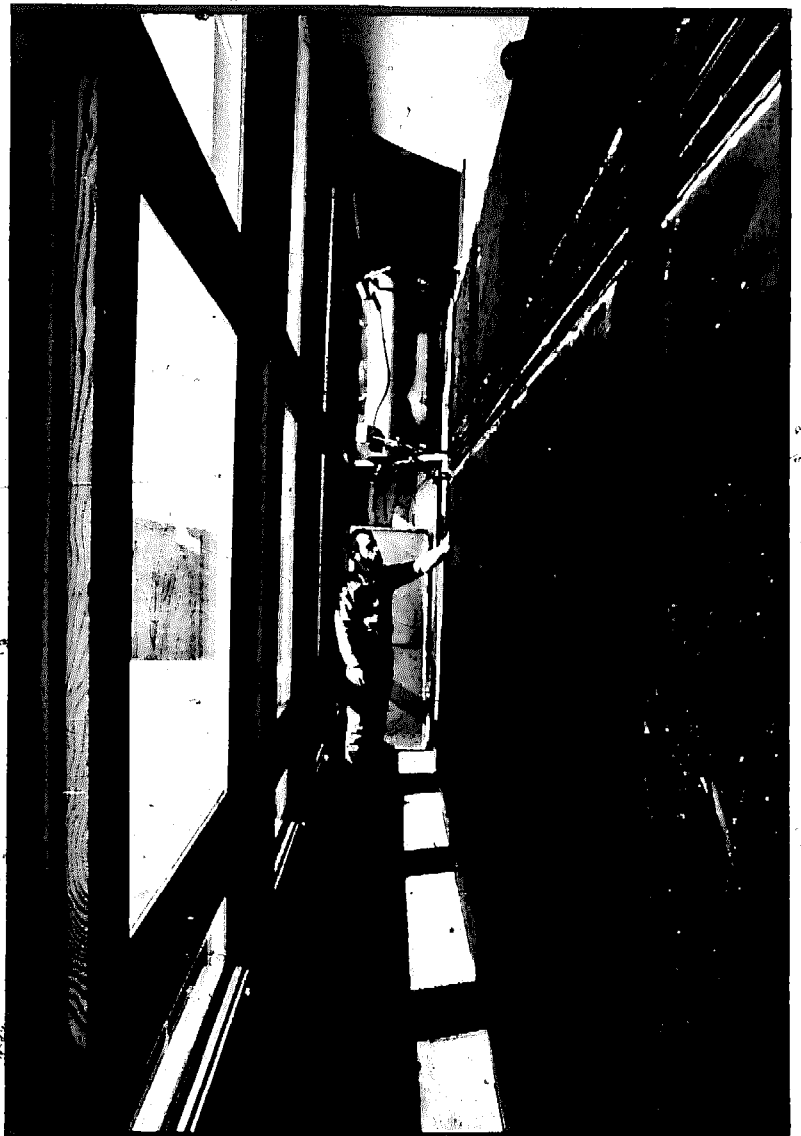

When a Thermal Storage Wall is properly sized, the temperature in a space will remain comfortable throughout much of the winter without any additional heating source. However, if a thermal wall is oversized, then more heat is transmitted through the wall than is needed, resulting in a space that is uncomfortably warm. Of course, heat will be vented from a warm space to reduce interior temperatures. This also reduces the system's efficiency by disposing of valuable heat in winter. If a wall is undersized, then there is not enough heat transmitted through the wall, and supplementary heating will be needed in the space. The correct size of a Thermal Storage Wall will change as climate, latitude and space heating requirements change.

The Recommendation

In cold climates (average winter temperatures 20° to 30°F) use between 0.43 and 1.0 square feet of south-facing, double-glazed, masonry thermal storage wall (0.31 and 0.85 square feet for a water wall) for each one square foot of space floor area. In temperate climates (average winter temperatures 35° to 45°F) use between 0.22 and 0.6 square feet of thermal wall (0.16 and 0.43 square feet for a water wall) for each one square foot of space floor area.



Detail the wall so it performs efficiently—WALL DETAILS(14). The area of thermal wall needed to heat a space can be substantially reduced by using

The Passive Solar Energy Book

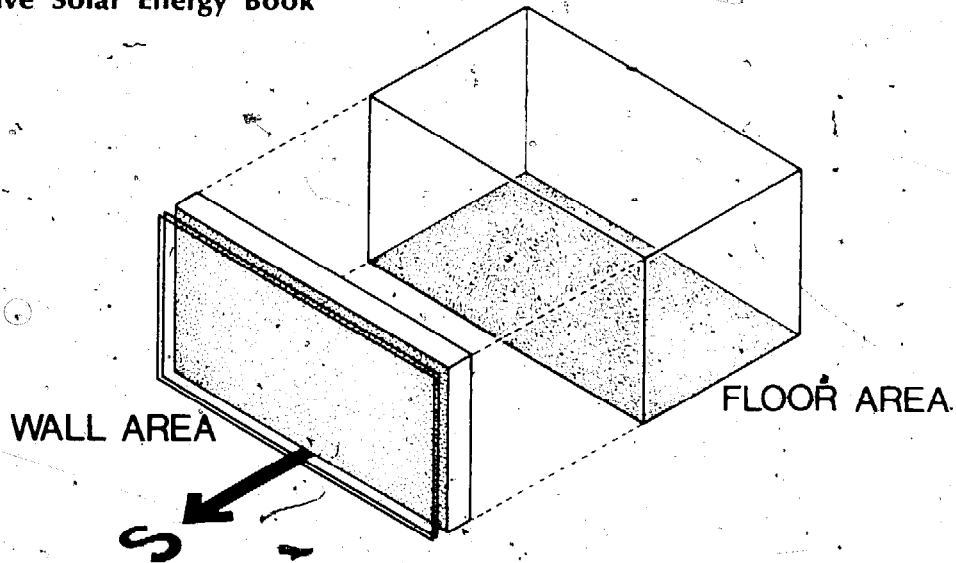


Fig. IV-13a

exterior REFLECTORS(24) and/or MOVABLE INSULATION(23). In fact, their use is strongly recommended in cold northern climates. Remember that an undersized thermal wall can be combined with other passive systems to provide adequate space heating—COMBINING SYSTEMS(21).

The Information

The size or surface area of a thermal storage wall is dependent upon three factors: the *local climate*, *latitude* and *space heat loss*. Each factor influences the size of a wall in the following way:

Climate

The rate of heat loss from a space is largely determined by the difference between indoor and outdoor air temperatures. The larger this difference, the faster the rate of building heat loss. Therefore, in cold climates, more heat or a larger thermal storage wall is needed to keep a space at $\pm 70^{\circ}\text{F}$.

Latitude

Solar energy incident on a south-facing wall during the winter changes as the location or latitude of the building changes. For example, at 36°NL (Tulsa, Oklahoma) each square foot of thermal wall intercepts approximately 1,883 Btu's during a clear January day, while at 48°NL (Seattle, Washington), the same wall receives only 1,537 Btu's. As a general rule, a Thermal Storage Wall System will increase in size the farther north a building is located.

13. Sizing the Wall

Space Heating Requirements

A well-insulated and tightly sealed space requires less heat to keep it at a specified temperature and, therefore, requires less wall.

In 1976, a simple analytical computer model was developed to evaluate the behavior of thermal energy flows in masonry and water Thermal Storage Wall Systems.* Each wall was analyzed using hourly solar radiation and weather data as input for different parameters of climate, latitude and space heating requirements. The advantages of this computer model are, first, the model can be used to predict the performance of a passive heating system in any location without actually constructing numerous identical systems in each location, and second, the results can be obtained in seconds rather than years.

The results of numerous computer simulations were used in developing the following preliminary sizing procedure for a Thermal Storage Wall System.

Sizing the System

Our criterion for a well-designed thermal storage wall is that it transmit enough thermal energy (heat), on an average sunny day in January, to supply a space with all its heating needs for that day. This means that the energy transmitted through the wall will be sufficient to maintain an average space temperature of 65° to 75°F over the 24-hour period.

By establishing this criterion, we are able to develop ratios for the amount of *double-glazed*, south-facing thermal storage wall needed for each square foot of space floor area. Table IV-13a lists ratios for different climates that apply to a well-insulated residence.† Notice that in very cold climates (average January temperatures 15° to 20°F) the area of thermal wall needed to heat a space is very large. In these areas use night insulation and/or reflectors to reduce the size of the system.

For example, in Albuquerque, New Mexico, at 35°N, with an average January temperature of 35.2°F, a well-insulated space will need approximately 0.4 square feet of double-glazed, masonry thermal storage wall for each one

*Mazria, Baker, and Wessling, "Predicting the Performance of Passive Solar Heated Buildings."

†These ratios apply to a residence with a space heat loss between 7 and 9 Btu/day-sq ft¹¹-°F. (This assumes no heat loss through the thermal wall.) The ratios can be used for other building types having similar heating requirements; however, adjustments should be made for additional heat gains from lights, people and appliances.

The Passive Solar Energy Book

Table IV-13a: Sizing a Thermal Storage Wall for Different Climatic Conditions.

Average Winter Outdoor Temperature (°F) (degree-days/mo.) ¹	Square Feet of Wall ² Needed for Each One Square Foot of Floor Area	
	Masonry Wall	Water Wall
Cold Climates		
15° (1,500)	0.72-1.0	0.55-1.0
20° (1,350)	0.60-1.0	0.45-0.85
25° (1,200)	0.51-0.93	0.38-0.70
30° (1,050)	0.43-0.78	0.31-0.55
Temperate Climates		
35° (900)	0.35-0.60	0.25-0.43
40° (750)	0.28-0.46	0.20-0.34
45° (600)	0.22-0.35	0.16-0.25

NOTES: 1. Temperatures and degree-days are listed for December and January, usually the coldest months.

2. Within each range choose a ratio according to your latitude. For southern latitudes, i.e., 35°N, use the lower wall-to-floor-area ratios; for northern latitudes, i.e., 48°N, use the higher ratios. For a poorly insulated building always use a higher value. For thermal walls with a horizontal specular reflector equal to the height of the wall in length, use 67% of recommended ratios. For thermal walls with night insulation (R-8), use 85% of recommended ratios. For thermal walls with both reflectors and night insulation, use 57% of recommended ratios.

square foot of building floor area (i.e., a 200-square-foot space will need about 80 square feet of thermal wall). If night insulation were applied to the wall, then use only 85% of the recommended size or 80 square feet \times .85 = 68 square feet of thermal wall.

A Thermal Storage Wall System will perform effectively if either more or less than the recommended wall areas is used. The exact size of the wall depends on many considerations such as views, natural lighting, solar blockage and cost. Because of these and other considerations, it may be desirable to use a different wall size than is recommended by this pattern.

13. Sizing the Wall

Table IV-13b Annual Percentage of Solar Heating for 16 Various Climates

Location	Heating Degree-Days	Latitude	Solar Heating* ^a (Btu/ft ² ·yr)	Percentage of Solar Heating
Los Angeles, Calif.	1,700	34.0	53,700	99.9
Ft. Worth, Tex.	2,467	32.8	38,200	80.8
Fresno, Calif.	2,622	36.8	43,200	83.3
Nashville, Tenn.	3,805	36.1	39,500	65.2
Albuquerque, N. Mex.	4,253	35.0	63,600	84.1
Dodge City, Kans.	5,199	37.8	58,900	71.8
Seattle, Wash.	5,204	47.5	42,400	52.2
New York, N.Y.	5,254	40.6	48,000	60.2
Medford, Oreg.	5,275	42.3	47,400	56.1
Boulder, Colo.	5,671	40.0	62,500	70.0
Lincoln, Nebr.	5,995	40.8	53,500	59.1
Madison, Wis.	7,838	43.0	44,900	41.6
Bismarck, N. Dak.	8,238	46.8	53,900	46.4
Ottawa, Canada	8,838	45.3	37,900	31.9
Denmark	6,843	56.0	43,100	43.8
Tokyo, Japan	3,287	34.6	50,300	85.8

NOTE: *The values in the solar heating column are the net energy flow through the inner face of the wall into the building.

SOURCE: J. D. Balcomb, J. C. Hedstrom, and R. D. McFarland, "Passive Solar Heating Evaluated," *Solar Age*, August 1977, pp. 20-23.

If a wall is *slightly* undersized, or oversized, the amount of heat transferred through each square foot of wall surface is the same. However, the size of the wall determines the percentage of solar heating provided over the year. For example, a well-insulated space with an 18-inch-thick concrete wall was analyzed for various locations, using hour-by-hour computer simulations for a one-year period (see table IV-13b). The surface area of wall, *constant for all locations*, is 0.38 square feet for each one square foot of building floor area, i.e., a building 21 by 70 feet has an 8-by-70-foot thermal wall. According to our recommendations, in most locations this wall is undersized, and in some, slightly oversized (for example, Los Angeles). In all locations, though, the system performs well.



Thermal Storage Wall System

14. Wall Details



Photo IV-14a



14. Wall Details

Once a rough size for a thermal storage wall is determined—SIZING THE WALL(13)—this pattern helps to detail the wall so the system performs efficiently.





The efficiency of a Thermal Storage Wall System is largely determined by the wall's thickness, material and surface color. A space will overheat if more energy is transmitted through a thermal wall than is needed. This happens when a wall is either too large in surface area, or too thin. If a wall is too thick or painted the wrong color, it becomes inefficient as a heating source since little energy is transmitted through it. For each type of wall material there is an optimum thickness.

The Recommendation

Use the following table as a guide for selecting a wall thickness:

Material	Recommended Thickness (in)
Adobe	8-12
Brick (common)	10-14
Concrete (dense)	12-18
Water	6 or more

Make the outside face of the wall a dark color. In cold climates add thermo-circulation vents, of roughly equal size, at the top and bottom of a masonry wall to increase the system's performance. Make the total area of each row of vents equal to approximately one square foot for each 100 square feet of wall area. Prevent reverse air flow at night by placing an operable panel (damper), hinged at the top, over the inside face of the upper vents.

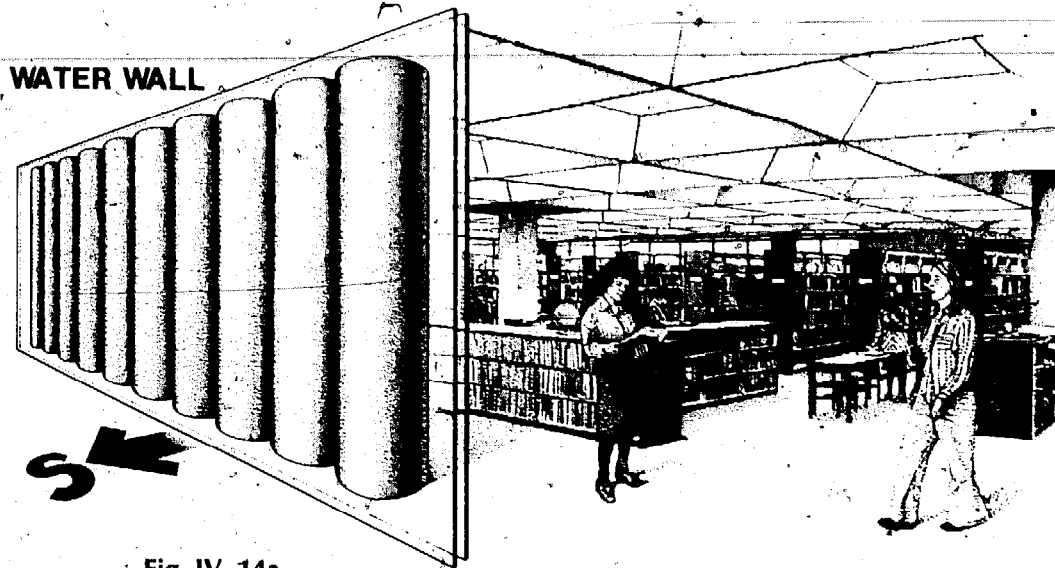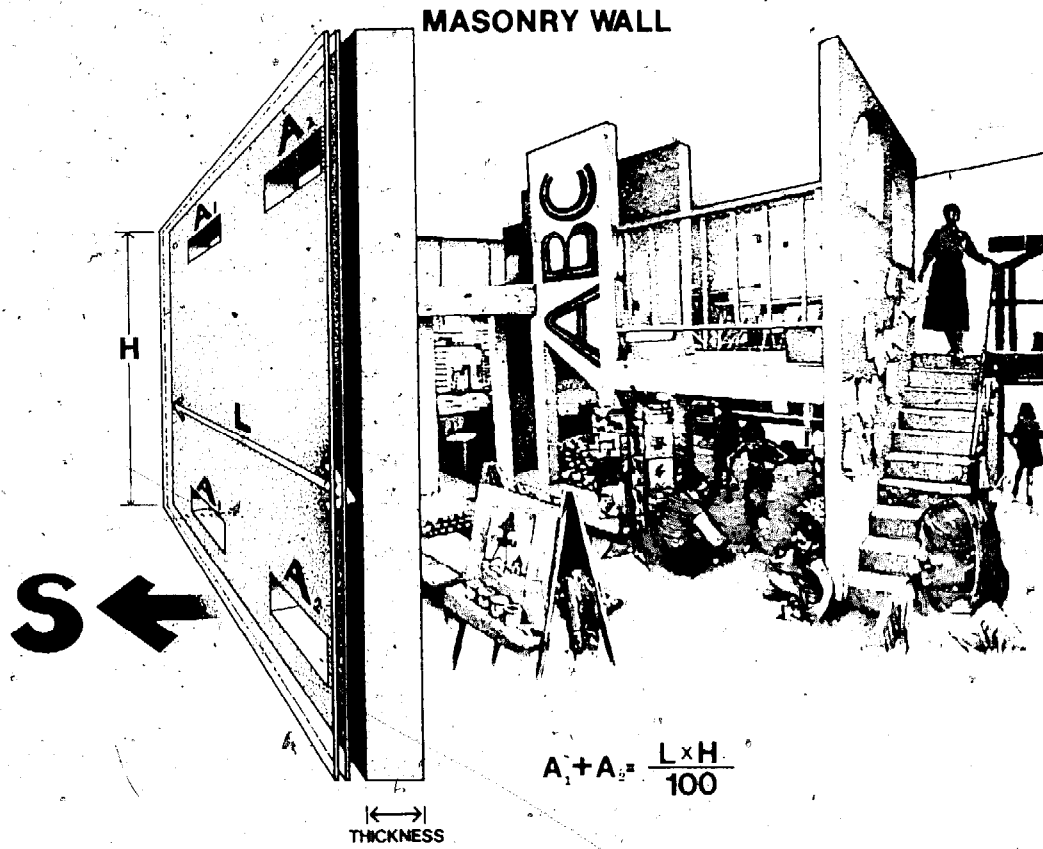

14. Wall Details

Placing MOVABLE INSULATION(23) over the glazing at night increases the system's performance. If possible, design the movable insulation to be used as REFLECTORS(24) and/or SHADING DEVICES(25). Shading the wall in summer and early fall will prevent the space from overheating.

The Information

In sizing the system, the area of wall needed for each space has been established. The details of the wall, its *thickness*, *surface color* and the addition of *thermocirculation vents* and *temperature control devices*, determine the efficiency of the system and its ability to provide thermal comfort in winter. To help you make the best possible choice of wall details, each variable is discussed at length.

Wall Thickness

The optimum thickness of a thermal storage wall (based on annual performance) is dependent on the conductivity of the material used to construct the wall. The effect of conductivity for various wall thicknesses is shown in figure IV-14b. The graph represents annual system performance for Los

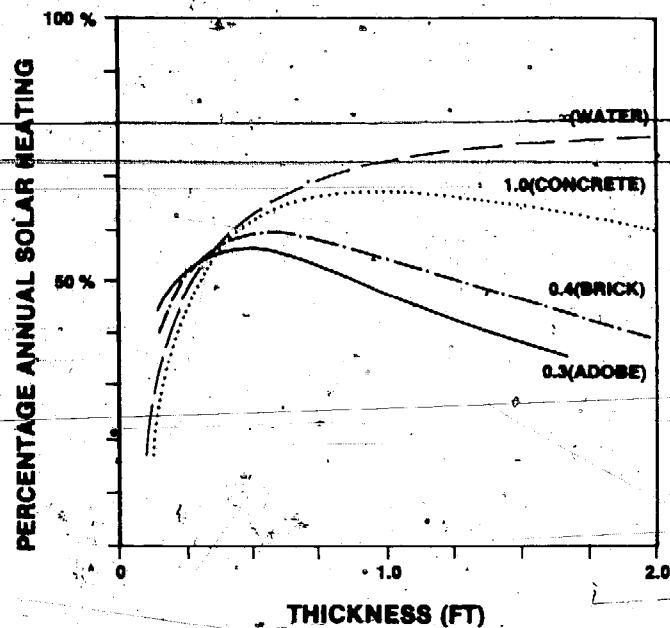


Fig. IV-14b: Yearly performance of a thermal storage wall for various thicknesses and thermal conductivities.

The Passive Solar Energy Book

Alamos, New Mexico, but the following results, according to our analysis, are similar for all locations.

1. *The optimum thickness of a masonry wall increases as the thermal conductivity of the wall increases.* A wall made of a highly conductive material transfers heat rapidly from its collecting surface to its inside face and, therefore, must be thicker to avoid providing too much heat at the wrong time. A wall of low conductivity transfers heat slowly so it should be made thinner to transmit enough heat into a space. Adobe is a good illustration for the application of this principle. Most people, because of traditional construction practices, will make an adobe thermal wall very thick, say 2 feet. Adobe, however, compared to other masonry materials, has a low conductivity (see table IV-11b). A 2-foot-thick adobe wall is roughly 40% less efficient than a 10-inch-thick adobe wall.

2. *The efficiency of the wall increases as the conductivity of the wall increases.* The greater the conductivity, the more heat is transferred through the wall. As the conductivity increases, the optimum wall thickness increases. The thicker wall absorbs and stores more heat, at the end of the day (sunset), for use at night.

3. *For masonry materials there is a range of optimum thicknesses.* For example, a concrete wall has roughly the same efficiency whether it is 12 or 18 inches in thickness.

4. *The efficiency of a water wall increases as the thickness of the wall increases, although after 6 inches the increase in performance is not very pronounced.* A water wall less than 6 inches in thickness becomes too warm during the day (not enough thermal mass) and will overheat a space. Not only will it overheat a space, it will also lose heat out the glass face at a faster rate.

Table IV-14a lists the thermal conductivity and recommended thickness for five commonly used wall materials: The choice of wall thickness, within the range given for each material, will determine the temperature fluctuation in the space over the day.

To understand the impact of wall thickness on indoor air temperature fluctuations it is instructive to look at computer simulations for both south-facing, double-glazed concrete and water thermal storage walls. For example, in Seattle, Washington, at 48°NL, using January clear-day solar radiation and weather data, indoor air temperatures that would occur in a well-insulated space with 0.5 square feet of thermal wall for each one square foot of building

14. Wall Details

floor area (i.e., a 200-square-foot space would have 100 square feet of thermal wall) are represented in figure IV-14c.

Table IV-14a Effect of Wall Thickness on Space Air Temperature Fluctuations


Material	Thermal Conductivity (Btu/hr-ft-°F)	Recommended Thickness (in)	Approximate Indoor Temperature (°F) Fluctuation as a Function of Wall Thickness ¹					
			4 in	8 in	12 in	16 in	20 in	24 in
Adobe	0.30	8-12	...	18°	7°	7°	8°	...
Brick (common)	0.42	10-14	...	24°	11°	7°
Concrete (dense)	1.00	12-18	...	28°	16°	10°	6°	5°
Brick (magnesium additive) ²	2.20	16-24	...	35°	24°	17°	12°	9°
Water ³	6 or more	31°	18°	13°	11°	10°	9°

NOTES: 1. Assumes a double-glazed thermal wall. If additional mass is located in the space, such as masonry walls and/or floors, then temperature fluctuations will be less than those listed. Values given are for winter-clear days.


2. Magnesium is commonly used as an additive to brick to darken its color. It also greatly increases the thermal conductivity of the material.

3. When using water in tubes, cylinders or other types of circular containers, use at least a 9½-inch-diameter container or ½ cubic foot (31.2 lb or 3.74 gal) of water for each one square foot of glazing.

Note that indoor temperature fluctuations over the day are noticeably different for each wall thickness. The space with an 8-inch concrete wall has a temperature fluctuation of 28°F, while the same space with a 20-inch concrete wall has only a 6°F fluctuation. A space with a 12-inch water wall (1 cu ft) fluctuates 13°F, while the same space with an 18-inch water wall (1.5 cu ft) fluctuates only 10°F. Our analysis showed that different latitudes, weather conditions, wall-to-floor-area ratios and space heat losses had only a slight effect on indoor temperature fluctuations. **As a general rule the greater the wall thickness the less the indoor temperature fluctuations.**

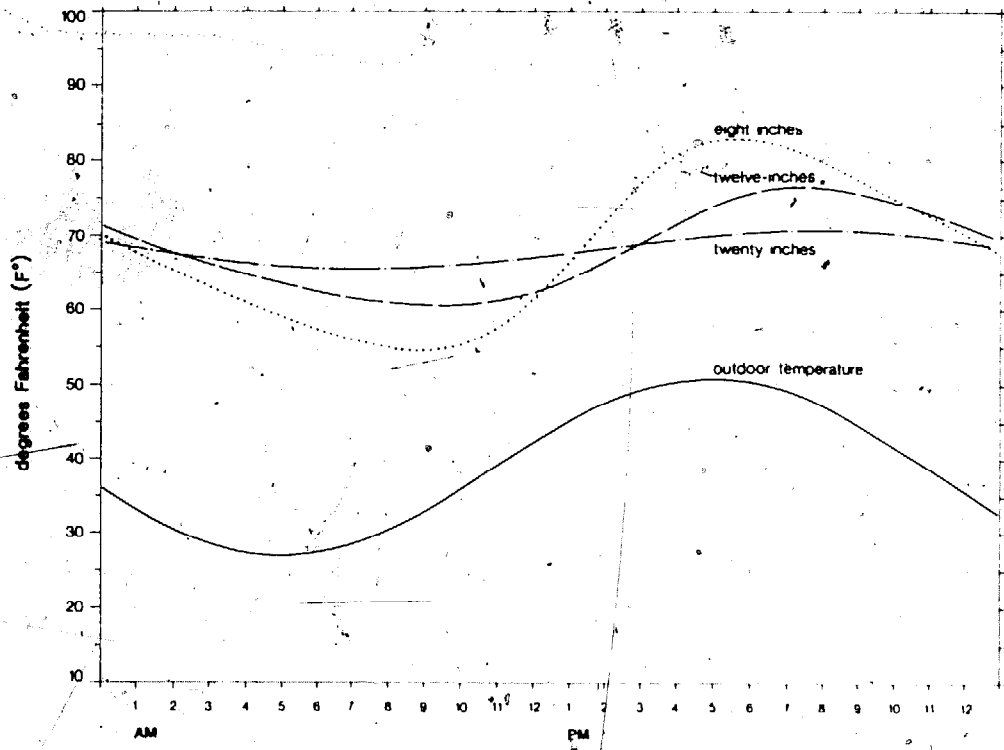

CONCRETE THERMAL STORAGE WALL

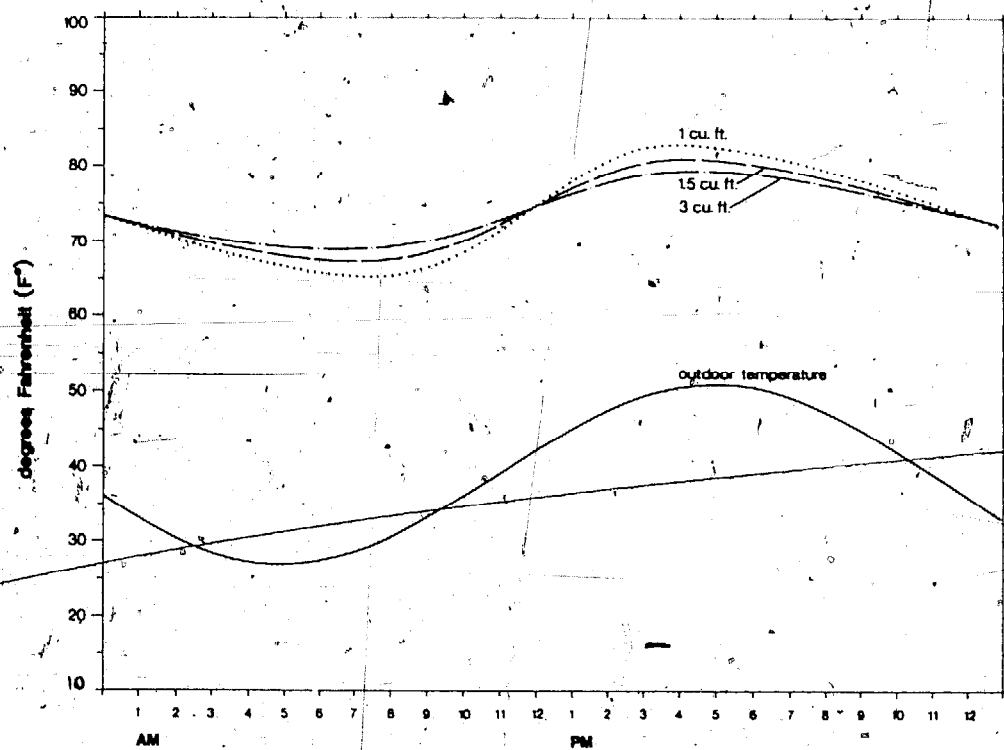

WATER THERMAL STORAGE WALL

Fig. IV-14c: Results of a computer analysis for concrete and water thermal storage wall systems.

Note: Space heat loss is in the range of 6 to 8 Btu/day-sq ft₁₁-°F. (This assumes no heat loss through the thermal wall.)

14. Wall Details

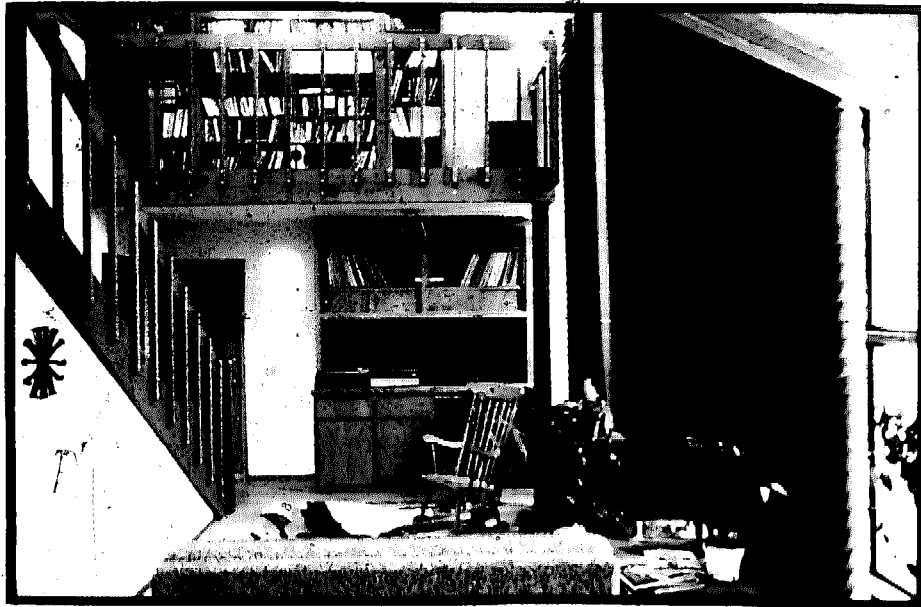


Photo IV-14b: Interior treatment of thermal storage walls.

The Passive Solar Energy Book

A final point. Wall thickness can be used to predict the time of day a space will reach its maximum and minimum temperatures. In general, the thicker the wall, the later the maximum space temperature. Figure 1-6 in Appendix 1 graphs daily maximum and minimum temperatures for various wall materials and thicknesses.

Wall Surface Color

The greater the absorption of solar energy at the outside surface of a thermal wall, the greater will be the transmission of heat through the wall to the interior space. A black-colored surface, with a solar absorption of 95%, is one of the most efficient absorbers. Performance, though, is only one criterion for the selection of wall color. Other colors such as dark blue (solar absorption 85%) also work well. Reducing the solar absorption for both water and masonry walls from 95 to 85% reduces the system's efficiency proportionally. The inside surface of the wall can be made any color.

Thermocirculation Vents (Trombe wall)

On a sunny winter day the temperature of the air in the space between the masonry wall and glazing is very warm ($\pm 140^{\circ}\text{F}$). Locating openings (vents) at the top and bottom of the wall induces the natural (passive) circulation of this warmed air into the building. As warm air rises in the air space, it enters the room through openings at the top of the wall while simultaneously drawing cool air from the room through openings in the bottom of the wall. The natural convection of heated air continues effectively for 2 to 3 hours after sunset when the wall surface becomes too cool to induce a warm airflow.

At night the air in the space between the wall and glazing cools. As air cools it becomes heavier (dense) and settles. This cool air enters the space through the open vents in the bottom of the wall while simultaneously drawing warmed room air through the openings in the top of the wall. To prevent reverse airflow at night, attach an operable panel or damper over the inside face of the upper vents (see fig. IV-14d).

The impact of climate on the performance of an 18-inch concrete wall, with

and without vents, is given in table IV-14b. Three walls were studied for each location:

1. Solid wall —No thermocirculation vents.
2. Trombe wall—Thermocirculation vents with airflow during the daytime only. Reverse thermocirculation that normally occurs at night is prohibited.
3. Trombe wall—Thermocirculation vents with no reverse control. Airflow occurs at night.

Table IV-14b Annual Results for an 18-inch Concrete Thermal Storage Wall¹

City	Annual Percentage of Solar Heating ²		
	SW	TW	TW(A)
Santa Maria, Calif.	98.0	97.9	97.3
Dodge City, Kans.	69.1	71.8	62.8
Bismarck, N. Dak.	41.3	46.4	31.1
Boston, Mass.	49.8	56.8	44.9
Albuquerque, N. Mex.	84.4	84.1	81.1
Fresno, Calif.	82.4	83.3	78.0
Madison, Wis.	35.2	41.6	24.7
Nashville, Tenn.	60.7	65.2	54.1
Medford, Oreg.	53.3	56.1	42.2

NOTES: 1. Building load = 0.5 Btu/hr·°F-sq ft_{sl}

2. SW: Solid wall (no vents)

TW: Trombe wall (no reverse vent flow)

TW(A): Trombe wall with vents open at all times (reverse flow at night)

SOURCE: J. D. Balcomb, J. C. Hedstrom, and R. D. McFarland, *Passive Solar Heating of Buildings* (Los Alamos, N. Mex.: Los Alamos Scientific Laboratory, 1977).

In cold climates the addition of thermocirculation vents in a masonry wall increases the performance of the wall significantly. However, in mild climates, vents are unnecessary since winter daytime temperatures are comfortable and

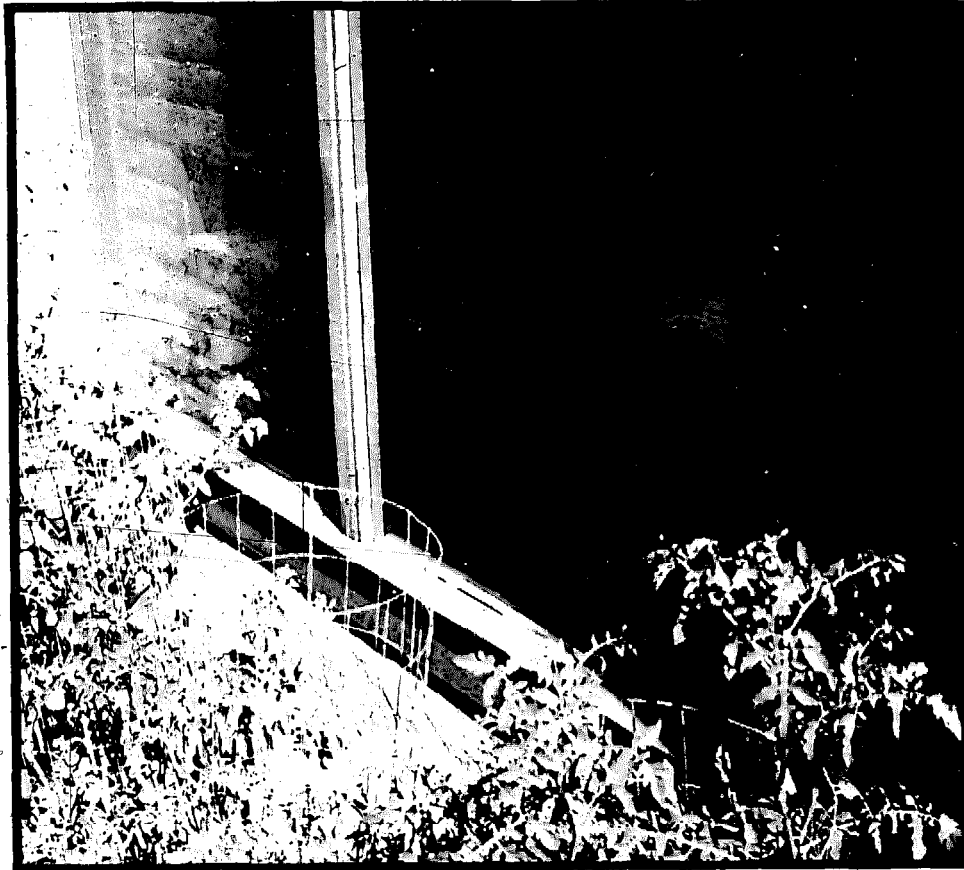


Photo IV-14c: Thermocirculation vents in a masonry wall.

heating is usually not needed at that time. Providing vents without reverse flow control *reduced* the efficiency of the wall in all locations. In most cases, the addition of vents with thermostatic control results in little increase in annual performance. Vents should be equally spaced along the top and bottom of the wall.

Space Temperature Control

If a space becomes too warm, movable insulation (such as curtains, sliding panels) placed over the inside face of a thermal wall turns off the heating system. This is a very simple and effective way to control indoor temperatures. The system can be adjusted by covering all, part or none of the wall. Ventilation is another method of indoor temperature control, though somewhat less efficient. By opening windows or activating an exhaust fan, warm air can be removed from the space.

14. Wall Details

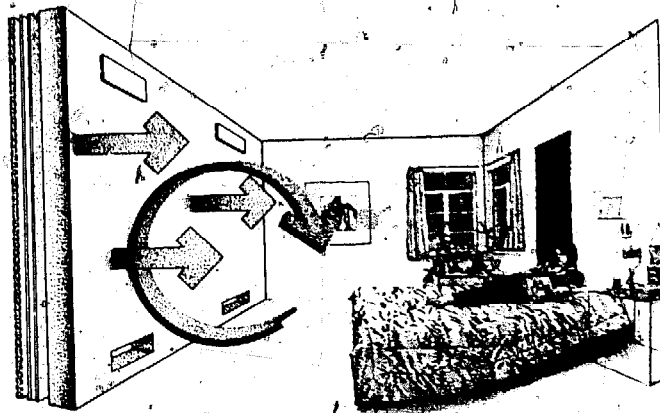
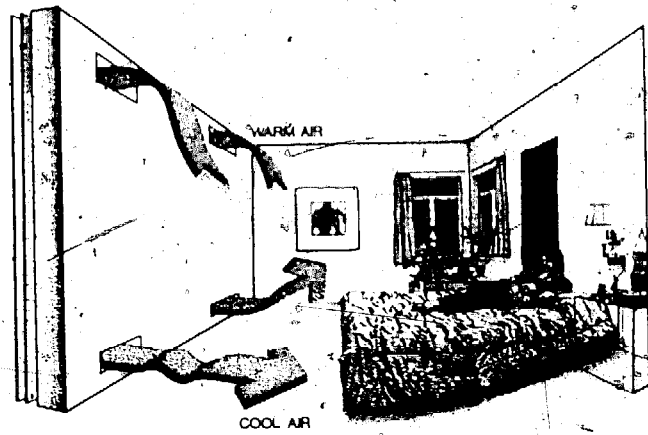
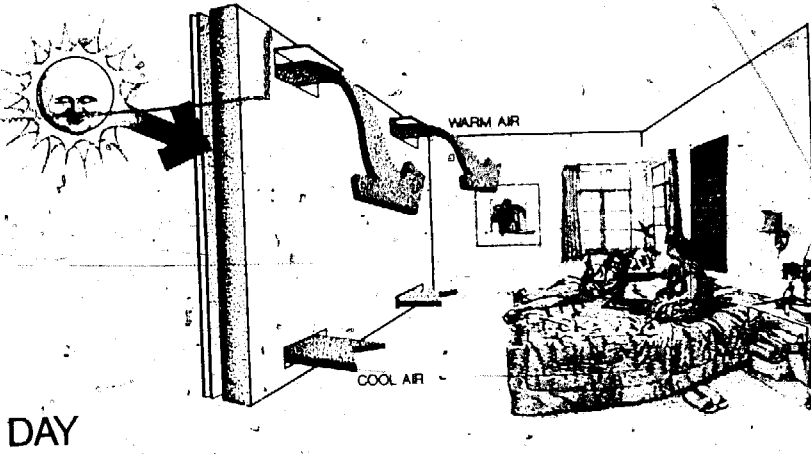


Fig. IV-14d: Trombe wall with thermocirculation vents.

The Passive Solar Energy Book

A Masonry Wall Versus a Water Wall

For the same size wall and heat storage capacity, a water wall is *only slightly more efficient* than a masonry wall. A water wall has the ability to absorb heat quickly enough to keep its surface temperature relatively cool during the daytime, while a masonry wall, which transfers heat to its interior slowly, can reach surface temperatures of 130°F, on sunny days. High surface temperatures reduce the wall's efficiency due to increased heat loss through the glass, to the outside. However, at night the situation is reversed and a water wall maintains the higher surface temperature and thus has a greater heat loss.

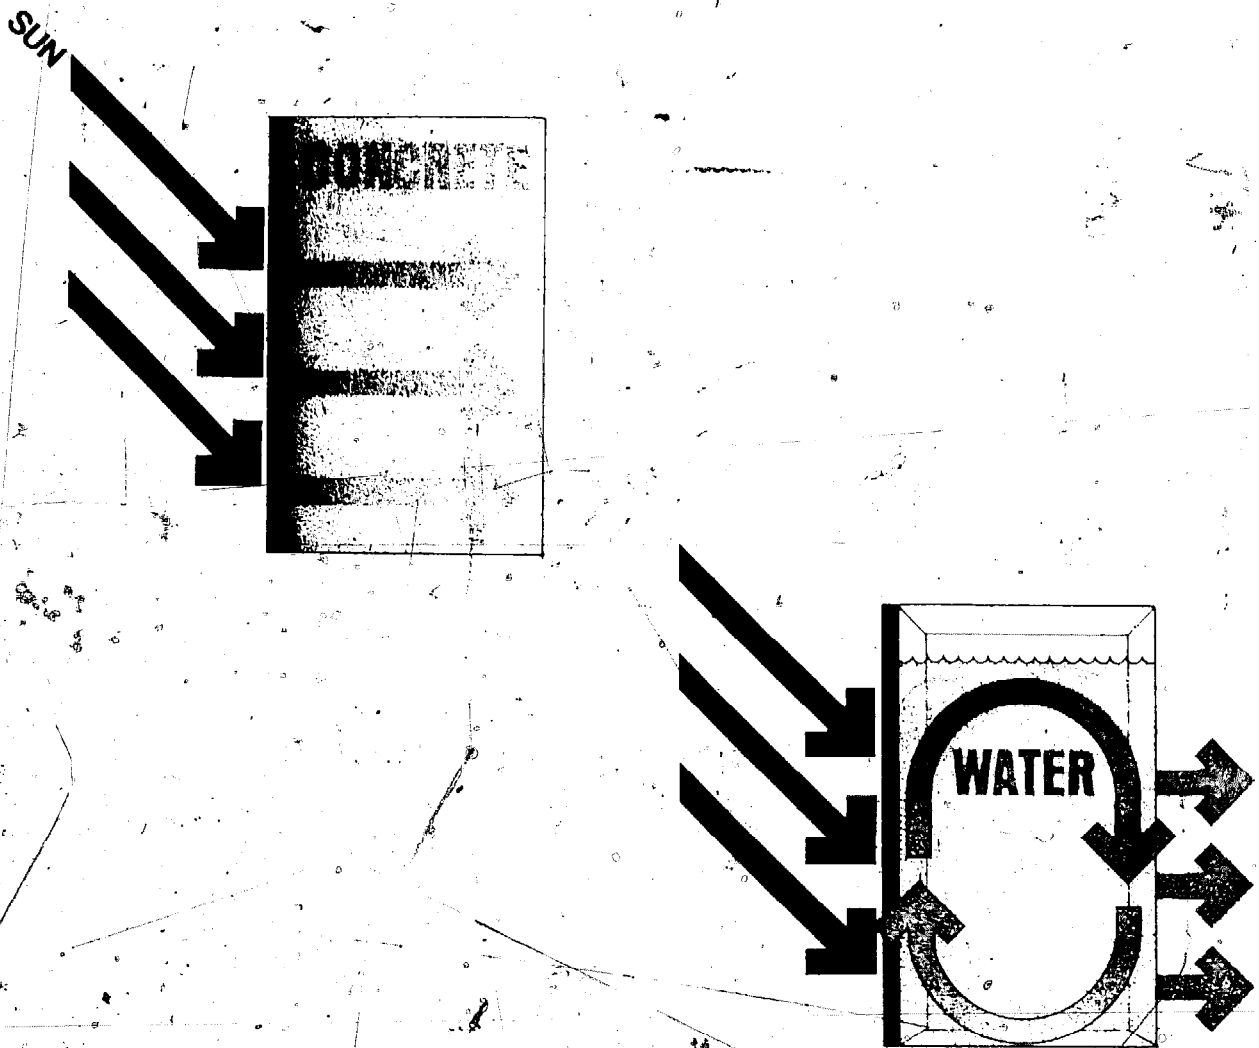


Fig. IV-14e: Heat transfer through a concrete and a water wall.

14. Wall Details

While a water wall is slightly more efficient than a masonry wall, containing the water in an aesthetically pleasing way so that it is acceptable to a large consumer market is a major design consideration. To date, most applications of water walls have been either stacked 55-gallon drums or freestanding metal and plastic cylinders. These clearly have limited appeal. With the manufacture of a variety of wall containers, public acceptance and utilization of water walls should increase.



Attached Greenhouse System

15. Sizing the Greenhouse



Photo IV-15a

15. Sizing the Greenhouse

A building located in the northern portion of a sunny area—BUILDING LOCATION(1)—insures that any additions or projections along its south wall—BUILDING SHAPE AND ORIENTATION(2)—will receive direct sunlight. The solar greenhouse, an efficient and economic way to produce food, will supply heat to a building when attached to its south side—CHOOSING THE SYSTEM(7). This pattern helps size the area of greenhouse glazing necessary for collecting enough solar energy to supply heat for both the greenhouse and the building.



The complicated nature of thermal energy flows between an attached greenhouse and a building makes it difficult to accurately size a greenhouse and to predict its performance as a heating system. When properly sized, the attached greenhouse not only heats itself but heats the spaces adjacent to it. However, the quantity of heating provided depends upon many variables such as latitude, climate, thermal storage mass, and the size and insulating properties of the greenhouse and spaces being heated.

The Recommendation

Extend the greenhouse along the south wall of the building adjoining the spaces you want to heat. In cold climates, use between 0.65 and 1.5 square feet of south-facing double glass (greenhouse) for each one square foot of (adjacent) building floor area. In temperate climates, use 0.33 to 0.9 square feet of glass for each one square foot of building floor area. This area of glazing will collect enough heat during a clear winter day to keep both the greenhouse and adjoining space at an average temperature of 60° to 70°F.

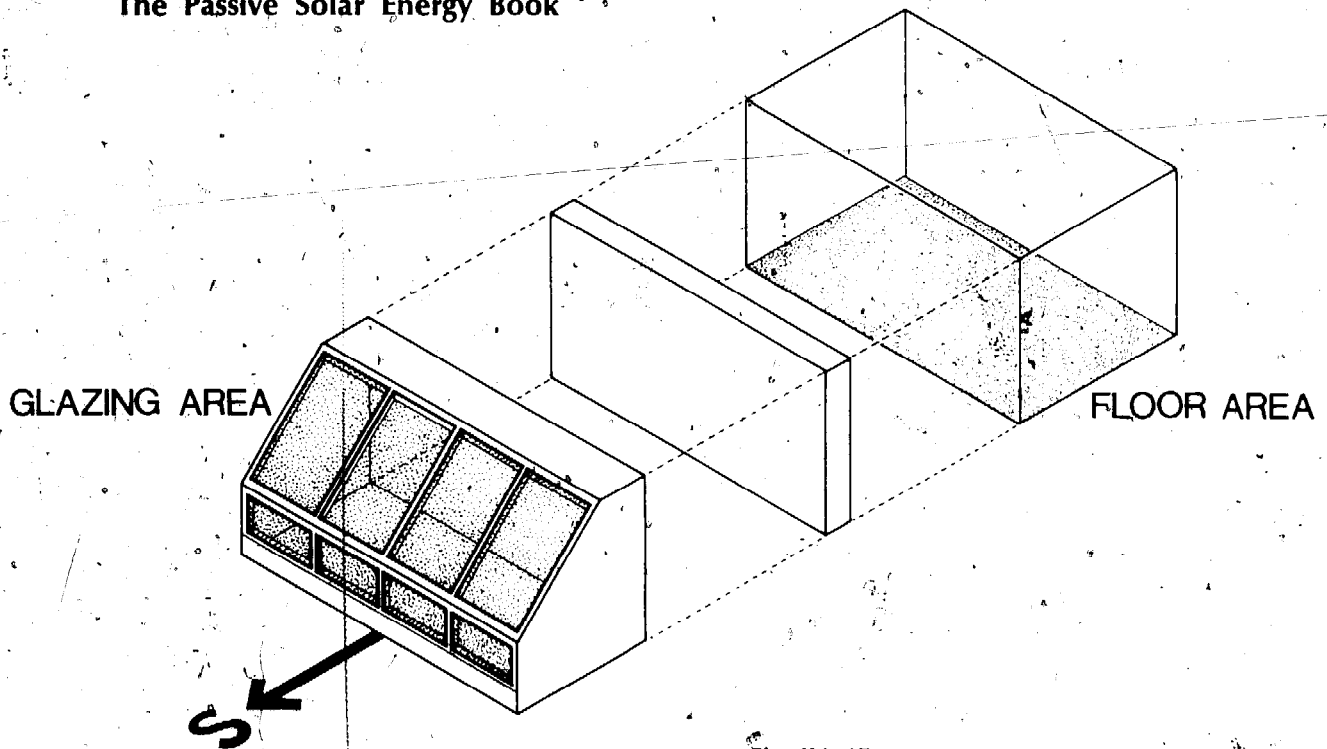


Fig. IV-15a



Locate enough thermal mass in the greenhouse so that it absorbs direct sunlight and dampens interior temperature fluctuations. Construct the mass wall between the greenhouse and building so that it allows for the efficient transfer of heat between the two spaces—GREENHOUSE CONNECTION(16).

The Information

In most climates a well-constructed attached solar greenhouse collects more energy on a clear winter day than it needs for heating. For example, a greenhouse located in New York City needs about 720 Btu's of thermal energy for each square foot of greenhouse glass (double-glazed) to keep it at an average temperature of 65°F over the day. However, the daily solar gain through each square foot of double glass is approximately 1,420 Btu's, or nearly twice the quantity of heat needed by the greenhouse.

A portion of this extra energy can be conducted through the common wall between the greenhouse and the building. In this way, an attached greenhouse

15. Sizing the Greenhouse

has the potential to supply a substantial amount of heat to the space(s) adjoining it.

To study the thermal relationship between a greenhouse and a building, actual interior and exterior conditions were modeled by computer. From simulations, using various climatic conditions and greenhouse/building configurations, rules of thumb for sizing an attached greenhouse were developed. Since a greenhouse is constructed of mostly glass, the quantity of heat collected over the day depends largely on the quantity and orientation of the glass. Table IV-15a lists the area of south-facing greenhouse glass needed to adequately heat one square foot of adjoining building floor area during a winter-clear day. That is, enough heat will be collected by the greenhouse to keep it *and the adjoining space* at an average temperature of 65° to 70°F. Approximate glass areas (double-glazed) for cold and temperate climates are given for greenhouse/building combinations incorporating either a common masonry or water storage wall between the spaces.

Table IV-15a Sizing the Attached Greenhouse for Different Climatic Conditions

Average Winter Outdoor Temperature (°F) (degree-days/mo.) ¹	Square Feet of Greenhouse Glass ² Needed for Each One Square Foot of Floor Area	
	Masonry Wall	Water Wall
Cold Climates		
20° (1,350)	0.9–1.5	0.68–1.27
25° (1,200)	0.78–1.3	0.57–1.05
30° (1,050)	0.65–1.17	0.47–0.82
Temperate Climates		
35° (900)	0.53–0.90	0.38–0.65
40° (750)	0.42–0.69	0.30–0.51
45° (600)	0.33–0.53	0.24–0.38


NOTES: 1. Temperatures and degree-days are listed for December and January, usually the coldest months.

2. Within each range choose a ratio according to your latitude. For southern latitudes, i.e., 35°NL, use the lower glass-to-floor-area ratios; for northern latitudes, i.e., 48°NE, use the higher ratios. For a poorly insulated greenhouse or building, always use slightly more glass.

The Passive Solar Energy Book



Photo IV-15b: Attached greenhouse extends along the south wall of the building—before—and after.

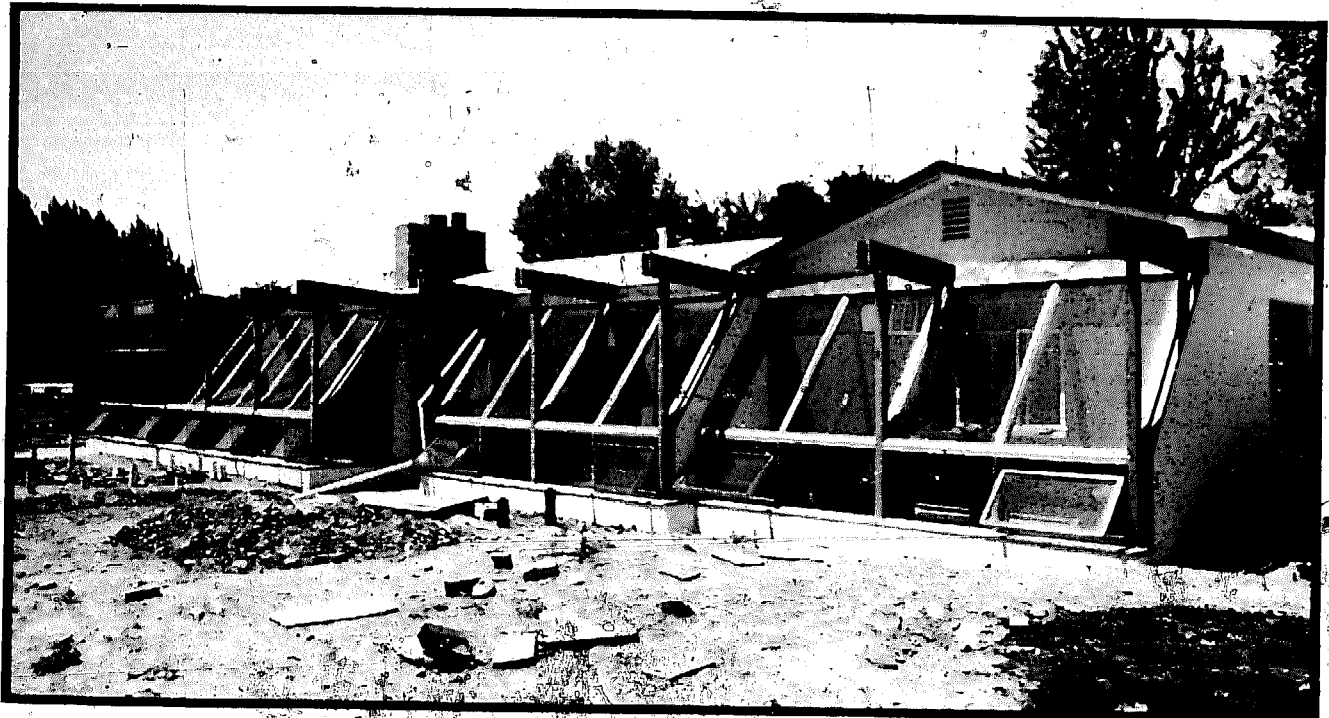

15. Sizing the Greenhouse

For example, in New York City (40° NL, average January temperature 35°F), an attached greenhouse with a common masonry wall will need about 1.2 square feet of greenhouse glazing for each square foot of adjoining building floor area (i.e., a 200-square-foot space needs an attached greenhouse with 240 square feet of south-facing glass).

When using a thermal wall for heat storage and transfer, attach the greenhouse so it extends along the south wall of a building exposing a large surface area of thermal wall to direct sunlight. A greenhouse elongated along the east-west axis is the most efficient shape for solar collection—BUILDING SHAPE AND ORIENTATION(2).

Whenever possible recess the greenhouse into the building so that the east and west walls are also common partitions. This not only reduces greenhouse heat loss but increases the amount of heat transferred to the adjacent spaces.



Photo IV-15c: Building surrounds the greenhouse to reduce the exposed exterior surface area.

The Passive Solar Energy Book

An attached greenhouse with less than the recommended glass area works with the same efficiency. The amount of heat collected through each square foot of glass remains the same, only with less glass, less heat is collected. The area of greenhouse glazing will determine the potential contribution of solar heat supplied to the building over the year.

When a greenhouse is attached to the south wall of a wood frame building (i.e., as in a retrofit), heat is supplied to the building mostly during the daytime and early evening. On a clear winter day, because high temperatures are generated in the greenhouse, heat is conducted through the common wall into the building. The wall, though, has little thermal mass and stores only a

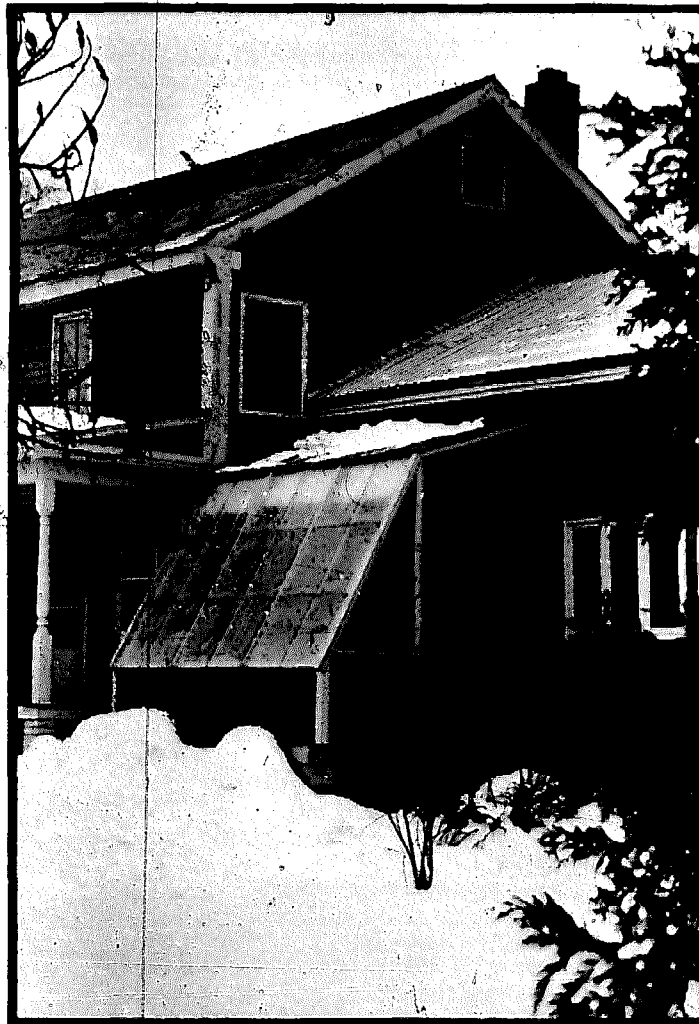


Photo IV-15d: Greenhouse addition.

15. Sizing the Greenhouse

small portion of this heat. At night, as outdoor and greenhouse temperatures drop, the frame wall cools very quickly adding little heat to the adjoining space. Although the common frame wall is not a heat source at night, it is not a heat loss either because attaching the greenhouse to the building protects the wall.

When the primary function of the greenhouse is to heat the building, taking heat from the greenhouse by mechanical means and storing it for use in the building will increase the efficiency of the system. This approach works best when the greenhouse is allowed to drop in temperature to about 40° to 45°F at night. While this system is feasible in temperate and cool climates, in very cold climates most of the heat collected by the greenhouse is needed to keep it from freezing at night.



Attached Greenhouse System

16. Greenhouse Connection

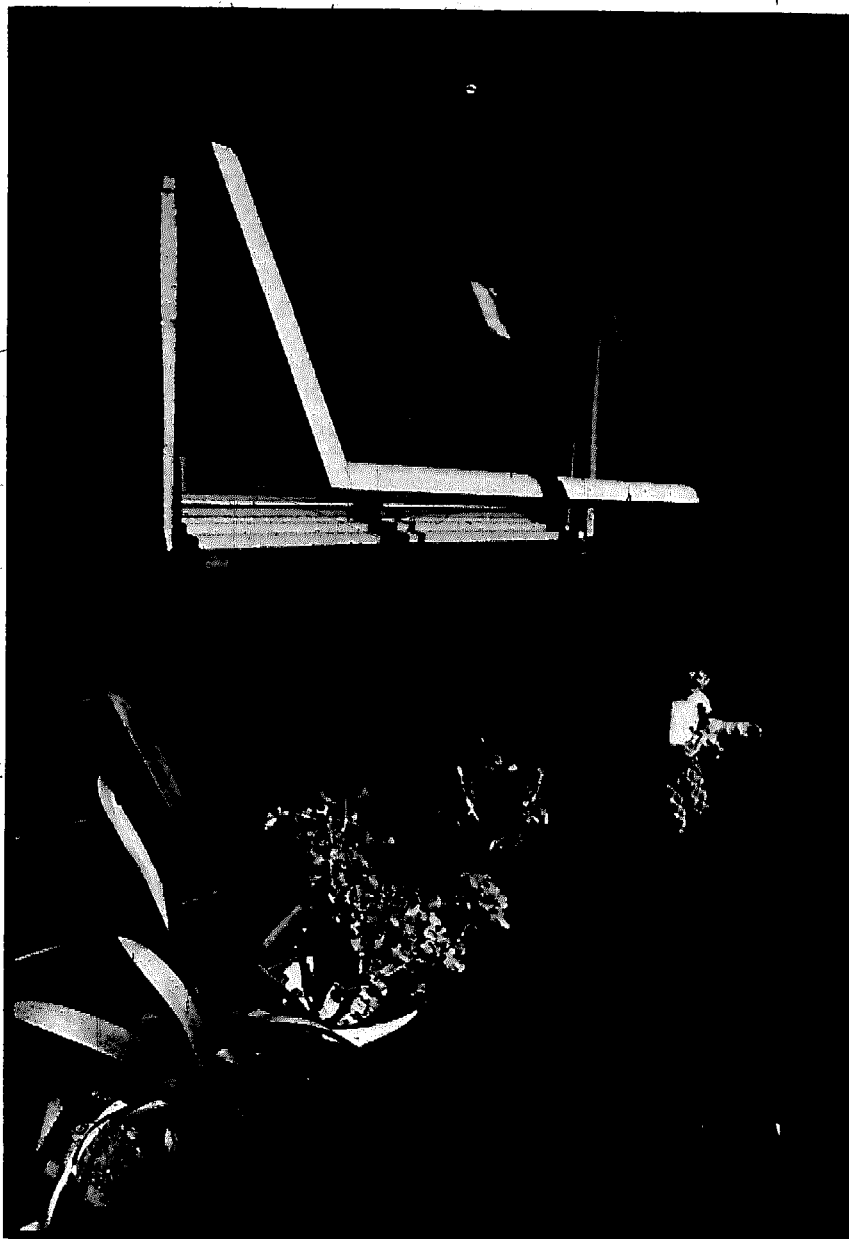


Photo IV-16a

16. Greenhouse Connection

This pattern completes SIZING THE GREENHOUSE(15) by specifying the details necessary for a proper connection between the greenhouse and the building.



The detailing of the thermal connection between the attached greenhouse and the building will determine the effectiveness of the greenhouse as a heat source. For systems that rely on heat transfer through the common wall between the greenhouse and adjacent space(s), the efficiency of the system is largely determined by the surface area of the wall, its thickness, material and surface color.

The Recommendation

When the principal method of heat transfer between the greenhouse and building is a thermal wall, use the following table as a guide for selecting a wall thickness:

Material	Recommended Thickness (in)
Adobe	8-12
Brick (common)	10-14
Concrete (dense)	12-18
Water	8 or more (or 0.67 cu ft for each one sq ft of south-facing glass)

Make the surface of the wall a medium or dark color and be careful not to block direct sunlight from reaching it. In cool and cold climates, locate small vents or operable windows in the wall to allow heat from the greenhouse directly into the building during the daytime.

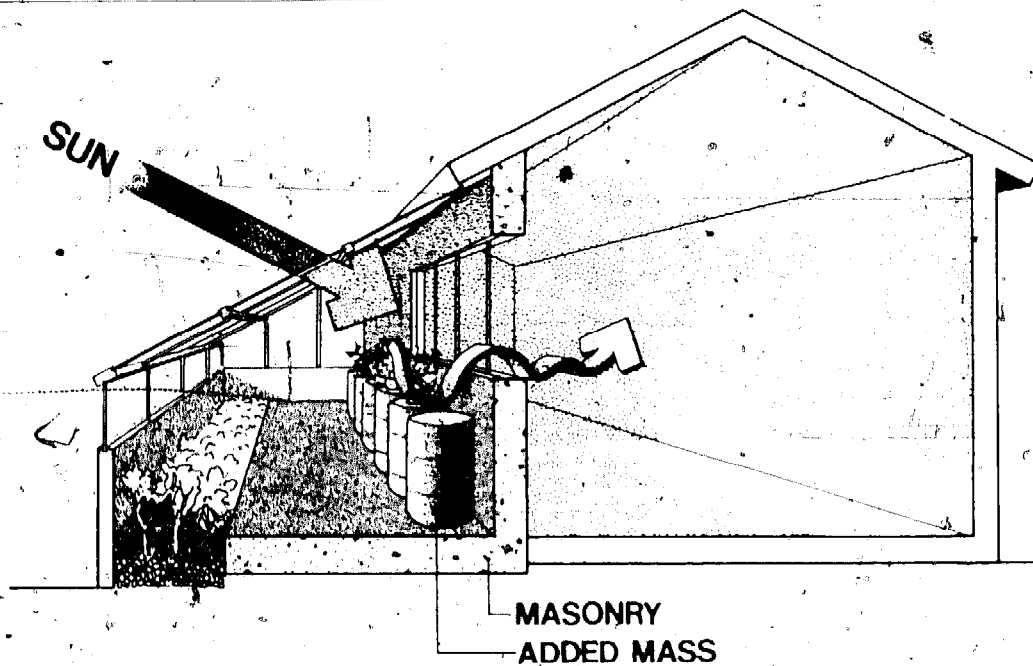


Fig. IV-16a



Provide exterior operable vents and shading devices to prevent a heat buildup in the greenhouse during the summer—GREENHOUSE DETAILS(20)—and add MOVABLE INSULATION(23) and REFLECTORS(24) to make the greenhouse more effective as a heating source.

The Information

In this pattern, two methods of heat transfer from the greenhouse to the building are presented: a common masonry or water thermal wall between



16. Greenhouse Connection

the spaces; or an active rock storage system with passive heat distribution. The active system is mentioned here only because it is so frequently used.

Common Masonry Thermal Wall

When a common masonry wall is the only method of heat storage and transfer between spaces, daily temperatures in the greenhouse will fluctuate 40° to 60°F on a clear winter day. This happens because the masonry alone cannot absorb and store enough heat. In this case, the greenhouse should contain additional thermal mass (water in containers) to help dampen fluctuations—GREENHOUSE DETAILS(20).

The material making up the wall, its thickness and surface color largely determine the amount of heat transferred to the building. The masonry wall functions very much like a Masonry Thermal Storage Wall System. They are so similar, in fact, that the optimum wall thickness and surface color are the same, as are the temperature fluctuations in the adjacent space. See WALL DETAILS(14) for the optimum wall thickness and surface.

Common Water Thermal Wall

When the method of heat transfer between the greenhouse and building is through a common water wall, the volume of water determines the temperature fluctuation in both the greenhouse and the adjacent space. The larger the volume of water the smaller the temperature fluctuations in both spaces. With 0.67 cubic feet of water (or more) for each one square foot of south-facing glazing, no additional mass is needed in the greenhouse. The water wall should expose as much surface area as possible in both the greenhouse and adjacent space for adequate heat absorption and transfer.

Active Rock Storage-Passive Heat Distribution

In temperate and cool climates (average winter temperatures 35° to 45°F), considerably more heat is collected by the greenhouse than it can use for heating. If the greenhouse is used primarily as a heating source, it may be advantageous to actively take heat from the greenhouse during the day and store it in the building for use at night. Heat (warm air) taken from the greenhouse by a fan is stored in a rock bed usually located in the crawl space under the floor of the building. The advantage of this system is that the greenhouse can be constructed of any material and need not contain a thermal wall. This is important when a strong visual connection (large


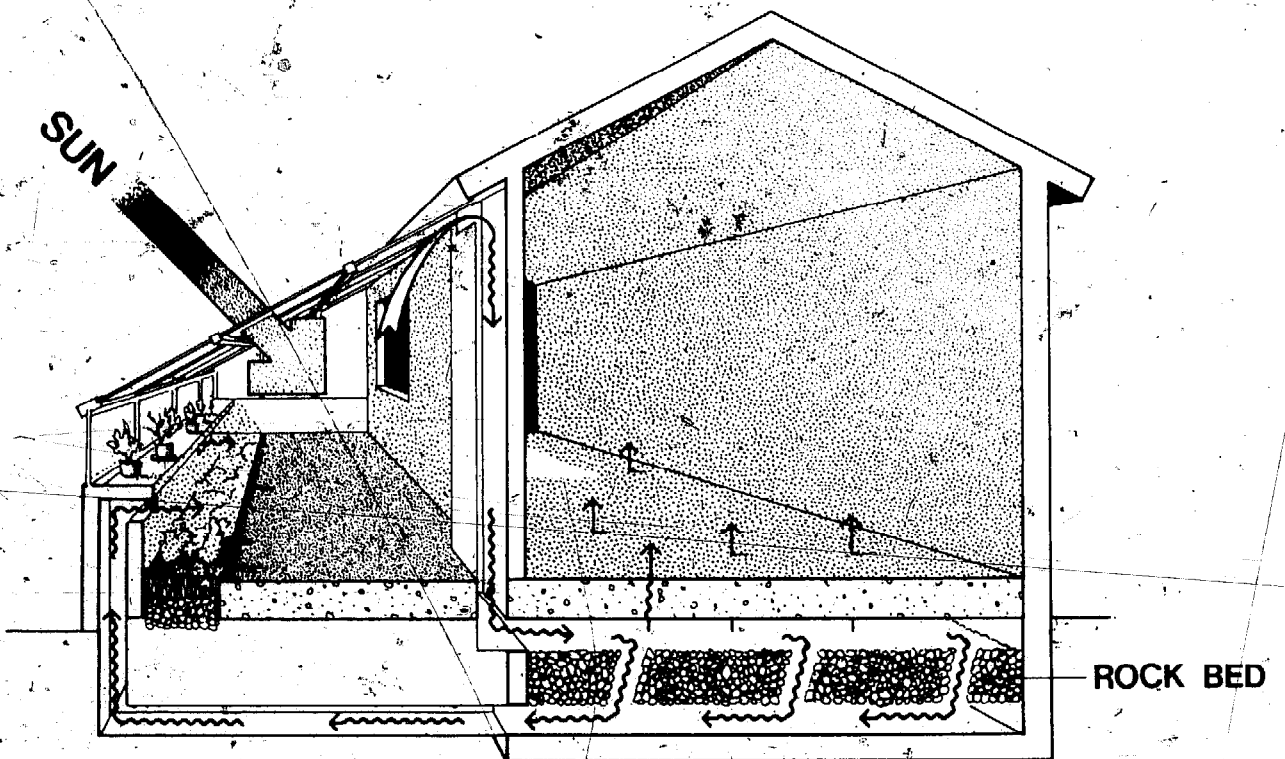


Fig. IV-16b: Fan-forced (active) rock storage.

16. Greenhouse Connection

window) between the building and greenhouse is desirable. In this case, the greenhouse will receive enough heat back from the building at night (through the common wall and glass) to keep it at a temperature roughly midway between indoor and outdoor temperatures. In this case it is important to use operable windows or a door to assure that during periods of extremely cold weather the greenhouse can receive direct heat from the building to keep it from freezing. In cold climates (average winter temperatures below 35°F), in addition to operable windows, some thermal mass should be located in the greenhouse for daytime heat storage. This insures an additional supply of heat to the greenhouse in the evening to keep it above freezing in winter.

For adequate heat transfer (passive) from the rock bed to the space, it is important that a large surface area of the floor act as the heating source. In cold climates this should be about 75 to 100% of the floor's surface area and in temperate winter climates 50 to 75%. This can be accomplished by supplying warm air to the rock bed in the space between the bed and the floor, and returning cool air to the greenhouse from the bottom of the rock bed. In this way, heat is distributed over the entire underside of the floor and then is radiated to the space. In cold climates use roughly $\frac{3}{4}$ to $1\frac{1}{2}$ cubic feet of fist-sized rock or $1\frac{1}{2}$ to 3 cubic feet of rock in temperate climates for each one square foot of south-facing greenhouse glass. There are many types of active rock storage systems, the major variable being the location of the rock bed. For example, another common location is in the wall between the greenhouse and building.

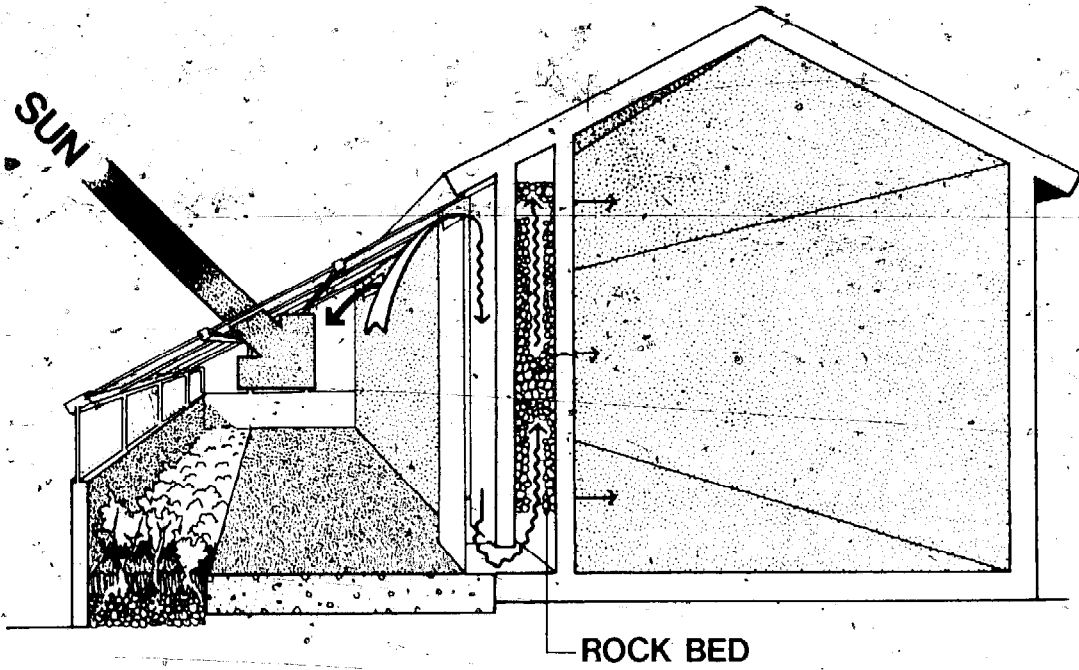

Roof Pond System

17. Sizing the Roof Pond

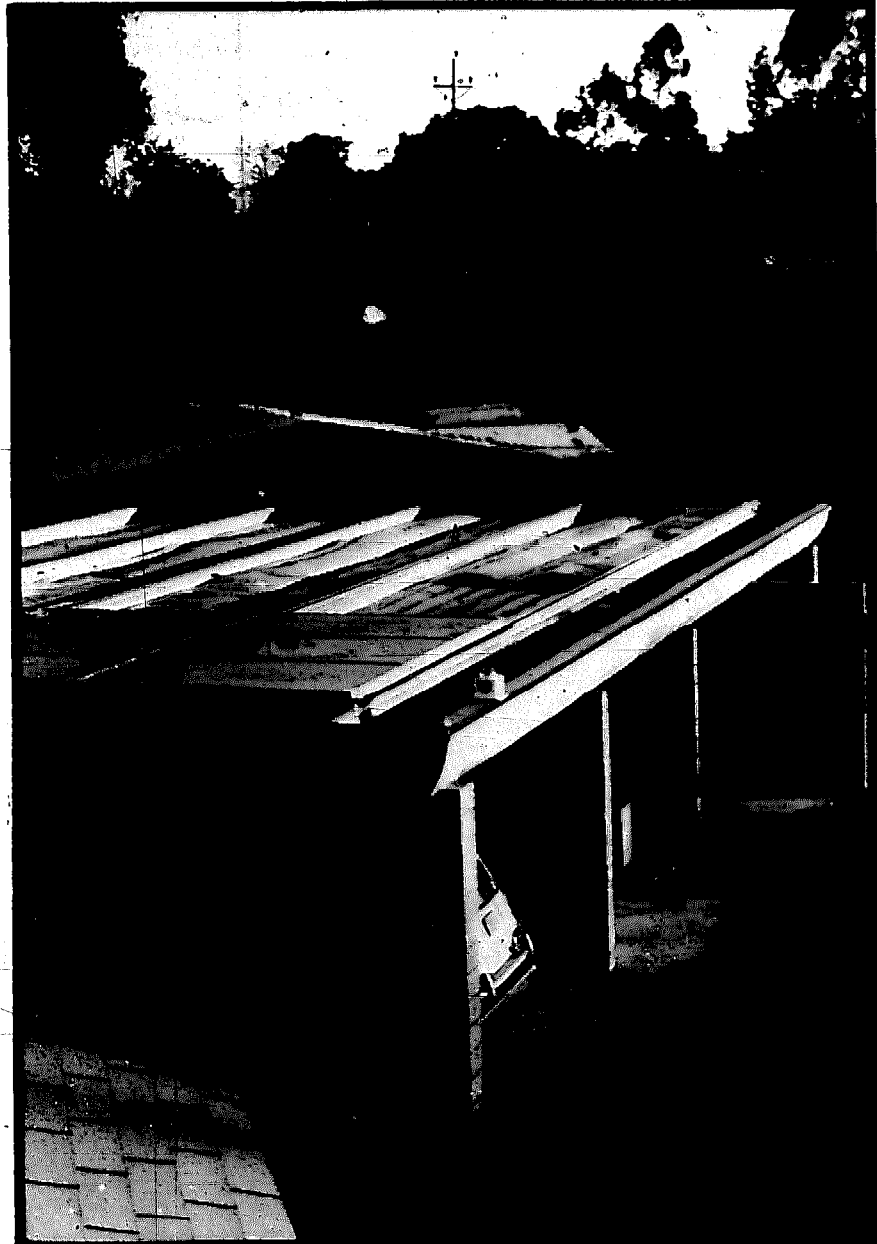


Photo IV-17a

17. Sizing the Roof Pond

After choosing the roof pond as a possible heating or cooling system—CHOOSING THE SYSTEM(7)—this pattern gives a procedure for sizing the variations of this system.



Since roof ponds generally act as combined solar collector, heat dissipator (for summer cooling), storage medium and radiator, the area required varies according to whether the ponds are used for heating or cooling, the type of movable insulation used and the type of glazing as well as climate, latitude and building load.

The Recommendation

For heating, the recommended ratios of roof pond collector area for each one square foot of space floor area are given in the following table:

Average winter outdoor temperature (°F)	15°–25°	25°–35°	35°–45°
Double-glazed ponds [®] w/night insulation	0.85–1.0	0.60–0.90
Single-glazed ponds w/night insulation and reflector	0.33–0.60
Double-glazed pond w/night insulation and reflector	0.50–1.0	0.25–0.45
South-sloping collector cover w/night insulation	0.60–1.0	0.40–0.60	0.20–0.40

The Passive Solar Energy Book

Within each range, choose a ratio according to your latitude. At lower latitudes use the lower ratio and at higher latitudes the higher value. Roof ponds require augmentation by reflectors at latitudes greater than 36°NL.

Recommended ratios of roof pond area to space floor area for cooling are given in the following table. These areas are based on the assumption that the ponds are not blocked from seeing at least three-fourths of the whole skydome.

Type of Pond	Hot-Humid Climate	Hot-Dry Climate
Single-glazed pond	1.0	0.75-1.0
Single-glazed pond augmented by evaporative cooling	0.75-1.0	0.33-0.50

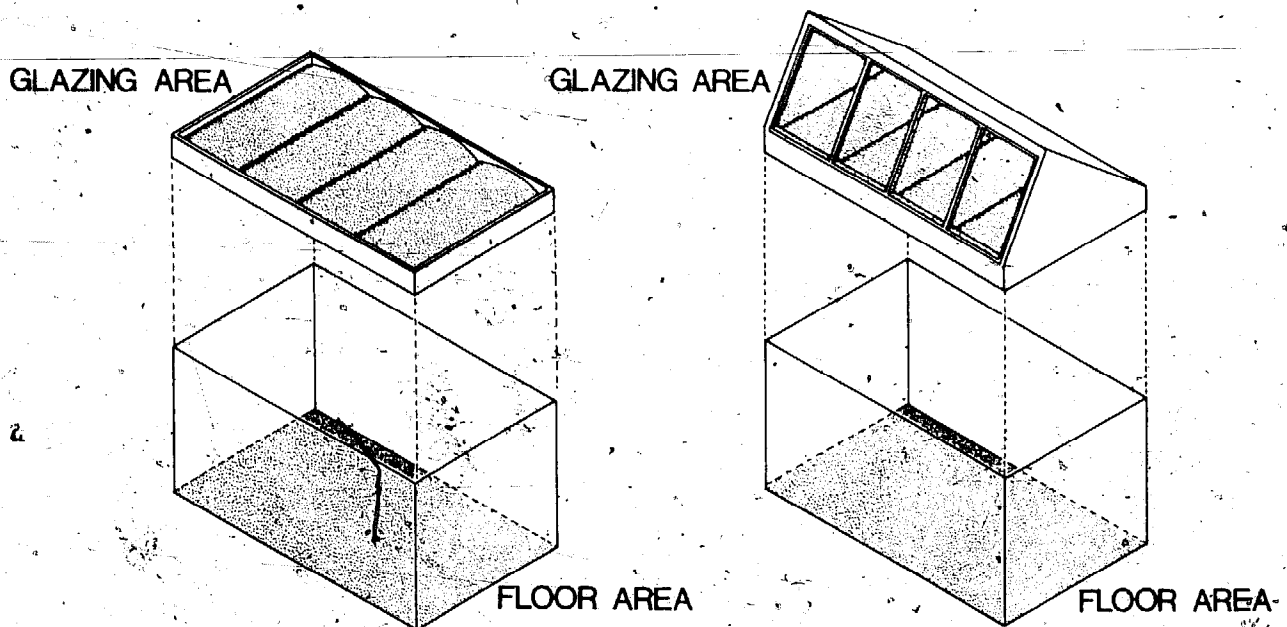


Fig. IV-17a



17. Sizing the Roof Pond

Work out the ROOF POND DETAILS(18) so that the system is simple to build and functions efficiently.

The Information

Besides climate and building heat loss, sizing the roof pond is dependent upon the primary function of the pond (heating or cooling), its relationship to movable insulation and the type of glazing provided. Each of these has the following influence:


Function

The pond size and configuration depend upon whether the emphasis of the system is on heating or cooling, or a balance of both.


Heating—In winter, at lower latitudes (28° to 36° NL), the sun rises to a high enough position in the sky for adequate solar collection. At higher latitudes (40° to 56° NL), since the sun path is lower in the sky, the optimum heating configuration for a solar collector is a south-facing tilt. This is impossible to do with a roof pond since water seeks its own level and a pond at a slope would be prohibitively expensive to contain. To increase the solar gain of a horizontal pond so that it becomes a viable collector, solar gain can be increased by the use of a reflector. This is accomplished by stepping the ponds to the south with the movable insulation folding in half and becoming a reflector in the open position. Another approach is to hinge the reflector/movable insulation and have it act as a large reflective lid opening to the south. In northern climates where heating is paramount and a snow problem exists, a sloping roof can be built over the ponds with the south slope glazed. In this case, movable insulation can be hinged in such a way as to reflect low angle sun onto the flat roof pond.

Cooling—In contrast to heating, the optimal cooling configuration is a flat pond that is exposed to the entire hemisphere of the nightsky. Up to 20 to 30 Btu's per square foot of pond surface per hour can be dissipated under very clear skies with low humidity and cool nighttime temperatures. If greater cooling is needed and/or climatic conditions are not optimum, the outside surface of the enclosed ponds can be sprayed with water or flooded to increase cooling by evaporation as well as by nocturnal radiation and convection. About 4 times as much heat can be dissipated from the roof pond by evaporation as by radiation.


DAY
WINTER

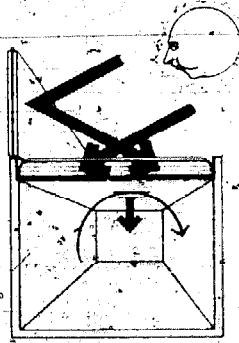


NIGHT



DAY
SUMMER




NIGHT

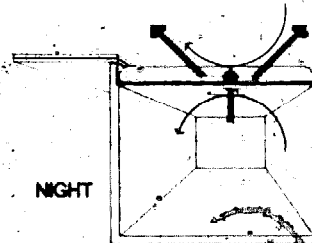


ROOF POND - MILD CLIMATES


DAY
WINTER

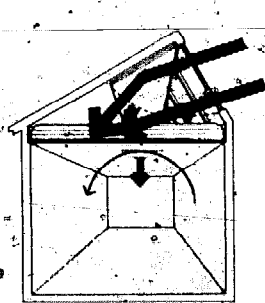


NIGHT



DAY
SUMMER

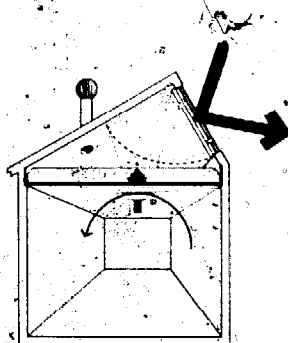

NIGHT

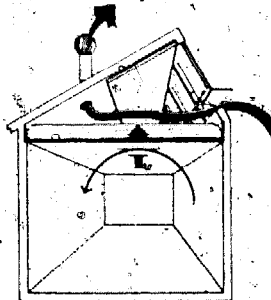

ROOF POND - COLD CLIMATES

Fig. IV-17b: Roof pond variations.

17. Sizing the Roof Pond

Relationship to Movable Insulation

Movable insulation can act as a reflector when in the open position, increasing the heating capability of the roof pond. However, unless carefully designed, it can decrease the cooling capability of the system by obscuring some of the nightsky and protecting the ponds from desirable airflow in cases where lower outside night temperatures would help cool the ponds by natural convection. The optimum angle of the reflector to the pond is about 80° to 90° in winter.

Glazing

The efficiency of a roof pond is greatly increased with double glazing. Due to the large surface area exposed to convective losses, single-glazed roof



Photo IV-17b: Winter daytime position of reflector/insulating panel.

The Passive Solar Energy Book

ponds are generally not applicable to regions with average monthly temperatures lower than 50°F unless enhanced by reflectors as mentioned above. The most economic method of providing double glazing for roof ponds is by inflating an air cell over the pond as part of the plastic bag containing the water. This inflated air cell is easily removed for more effective summer cooling by merely deflating the cell. Single-glazed ponds are twice as effective as double-glazed ponds for cooling, so this flexible characteristic is valuable.



Roof Pond System

18. Roof Pond Details



Photo IV-18a

18. Roof Pond Details

Once a clear idea for the size and shape of the roof pond—SIZING THE ROOF POND(17)—is established, it is necessary to detail the system so that it functions efficiently.



Due to the integral nature of roof ponds and architecture, especially with regard to structure, roof and ceiling, there are many details that need careful consideration. Although roof ponds are simple in concept and potentially inexpensive, major problems have been caused by failure to adequately work out the numerous small details that make up the system. Generally the details fall into three categories: the roof, the ponds and the insulating panels.

The Recommendation

The Roof

Support the ponds on a waterproofed metal or thin concrete deck. Paint the underside of the roof deck (any color) and leave it exposed to the space below for optimum heat transfer from the ponds.

The Ponds

Enclose the water pond (6 to 12 inches in depth) in transparent plastic bags or in waterproof structural metal or fiberglass tanks that form the roof and finished ceiling of the space below. Make the top of the container transparent and the inside a dark color to minimize heat stratification in the pond.

The Insulating Panels

For a flat roof pond with horizontal sliding panels, make the panels as large as possible to reduce the amount and cost of hardware (such as tracks, seals).

18. Roof Pond Details

Construct the tracks for the panels to withstand deflection and make sure that the panels seal tightly over the ponds when closed. To increase the efficiency of this system, design the insulating panels so they also act as reflectors when in the open position. Use either a bifolding or solid panel hinged along its north edge and construct the surface of the panel with a reflective material.

For a south-sloping collector system make the angle of the south glazing roughly equal to your latitude plus 15° . Use movable insulating panels over the glazing at night and make the surface of the panels, exposed to the ponds when in the open position, a reflective material.

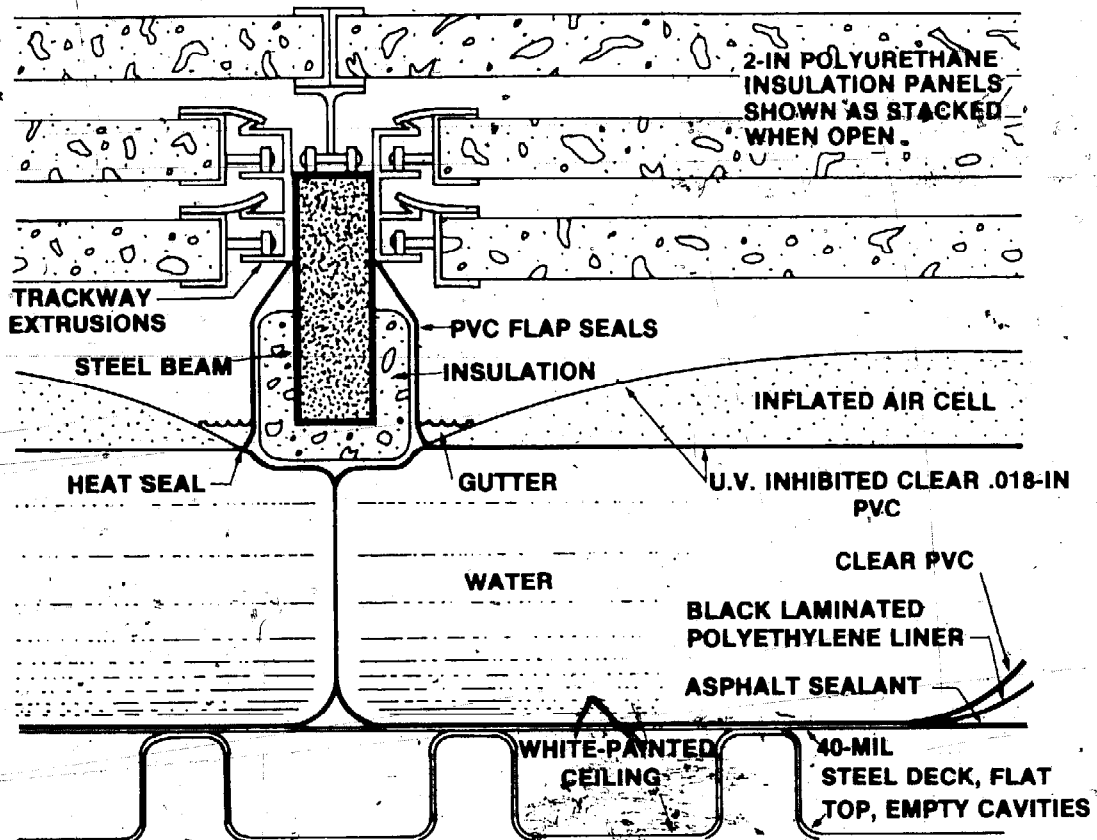


Fig. IV-18a



The Passive Solar Energy Book

When the panels also double as reflectors, optimize the angle of the reflector according to the information given in REFLECTORS(24). Adjust the depth of the pond to provide heat for CLOUDY DAY STORAGE(22).

The Information

The Roof

In a Flat Roof Pond System, the clear span for a metal deck is generally from 10 to 16 feet, depending upon the room layout, type of decking used, and the weight of the roof ponds and insulation. The design of the structural system must be coordinated with the dimensions of the ponds and the insulating panels to assure ease of construction and operation. Because of the complicated relationship of these elements, use the assistance of a reputable consultant familiar with the system's design.

It is essential to keep the transfer of heat from the pond to the metal deck as great as possible. This means it is desirable to waterproof the top of the deck with a thin plastic sheet such as double-laminated polyethylene carefully sealed at the edges or a fiberglass sheet and a thin coat of asphalt emulsion. Hot-mopped asphalt and layers of felt provide too much insulation between the pond and deck and is therefore not desirable. Careful attention should be given to waterproofing the connection between the supports for the insulating panels and the roof deck.

Optimizing the heat transfer between the ponds and the space requires that the underside of the deck also be used as the finished ceiling. It is important to paint the underside of the metal deck since galvanized metal is a poor radiator when bare. Because the ceiling radiates at a relatively low temperature ($\pm 75^{\circ}\text{F}$), it can be painted any color.

If an acoustical ceiling is desired, use a perforated metal acoustical panel in good thermal contact with the deck. A metal deck must be carefully insulated at its perimeter to eliminate heat loss at its edge. If the metal deck extends past the perimeter of the building, for example as a covering for a patio, then insulation must be placed between the interior and exterior deck.

The Ponds

Ponds can be inexpensively constructed by enclosing water, 6 to 12 inches in depth, in plastic bags made of polyethylene, polyvinyl chloride or other forms of inexpensive clear plastic. In this sense the ponds will resemble a water bed. Ponds can also be constructed of metal or fiberglass tanks with rigid transparent plastic covers but these are more expensive. Polyethylene enclosed ponds, using the latest ultra-violet inhibited plastic, are very inexpensive and should last up to 5 years. Polyvinyl chloride (PVC) enclosed ponds cost slightly more but should last as long as 7 to 10 years. However, care must be taken when using PVC for the ponds since some PVC will whiten over a period of a year or so if there is moisture on both sides of the surface (apparently caused by water vapor being absorbed by the plasticizer).

It is very important that temperature stratification in the ponds be kept to a minimum, otherwise hot water at the top of the pond will be conducting its heat to the exterior environment, and the cold water at the bottom will inhibit heat transfer to the interior of the building. Stratification is minimized by providing a clear top and a dark bottom. This allows the sun's rays penetrating through the ponds to be absorbed and thus to warm the water at the bottom. This warmed water will rise, thereby continually stirring the pond. A properly operating roof pond should not have a difference in temperature of more than 1°F between top and bottom.

Since the evaporation of water causes excessive heat loss, water drainage from the pond's surface is essential when it rains. Because of the complexity of the drainage problem, refer to Kenneth Haggard et al., "Research Evaluation of a System of Natural Air Conditioning."

The Insulating Panels

The most common movable insulation panels are 2-inch polyurethane foam reinforced with fiberglass strands and sandwiched between aluminum skins. This is a standard item marketed as "metal building insulation." This insulation has been used successfully for up to 4'-0" spans before requiring support by metal channels. In the Flat Roof Pond System, design the metal frames that support the insulation panels so that they do not form a straight heat-conducting path from the ponds to the exterior.

The Passive Solar Energy Book


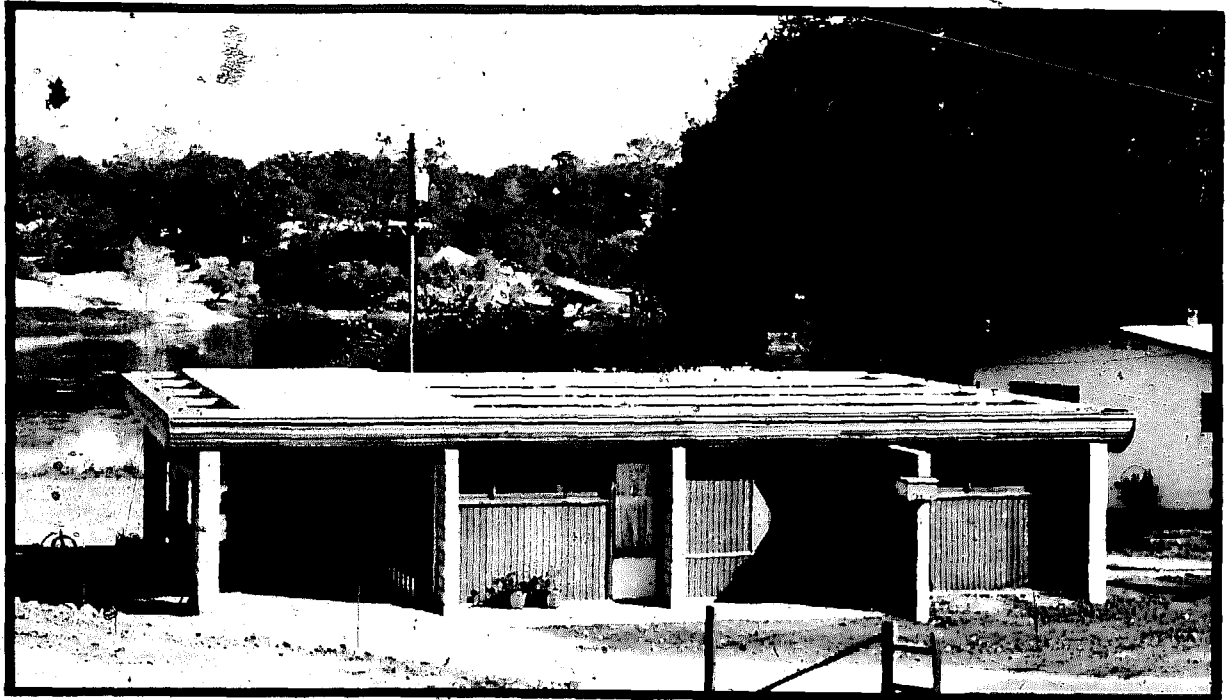


Photo IV-18b: Sliding insulating panels; winter daytime position (open), and winter nighttime position (closed).



18. Roof Pond Details

Panel tracks and supports should be designed so that the panels form as tight an assembly as possible when closed. This requires careful detailing, especially for the sliding panels generally applied to flat roofs. Sometimes the tightness needed may require the use of neoprene curtains and seals which ride along the panels. To illustrate the importance of seals, a study performed in 1973 showed that 24% of the energy striking the ponds on an average winter day was lost back through the insulation at night. Most of this loss was due to air infiltration around the panels, even though neoprene curtains were used. Although the system still provided the house with 100% of its heating and cooling, it is easy to see that greater efficiency could be obtained.

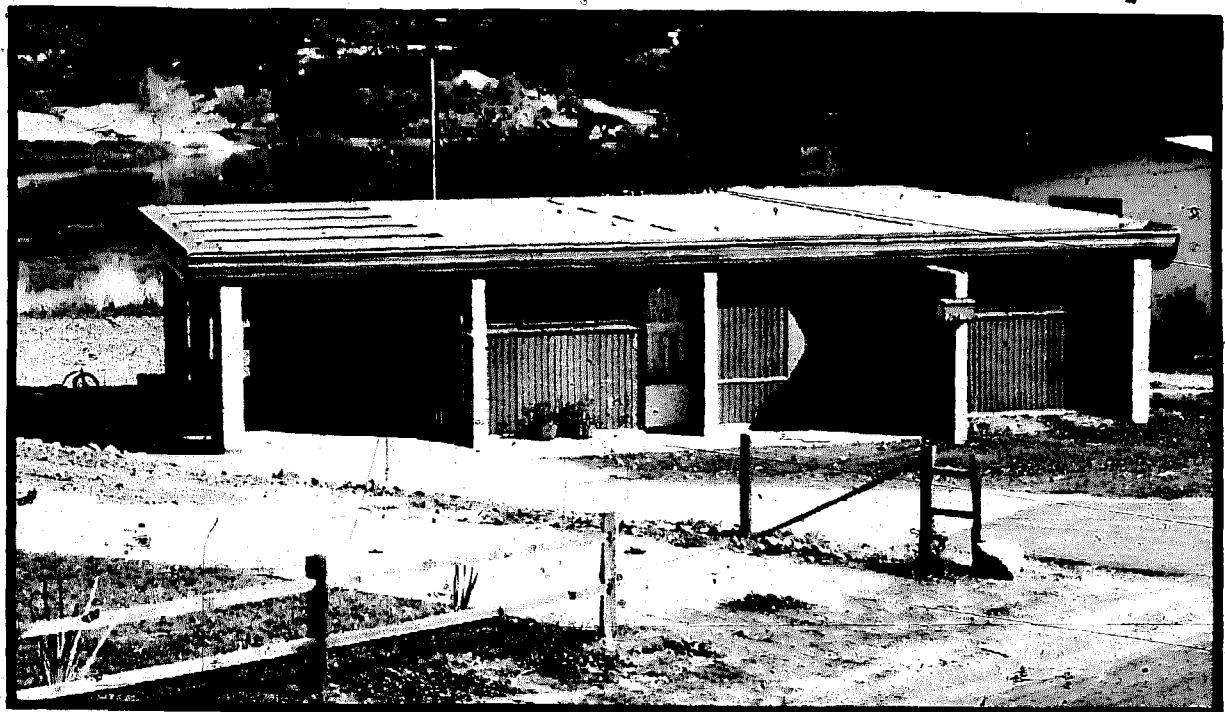

Greenhouse

19. South-Facing Greenhouse (Freestanding)



Photo IV-19a

19. South-Facing Greenhouse (Freestanding)

Once a location for the greenhouse has been selected—BUILDING LOCATION(1)—and a rough shape defined—BUILDING SHAPE AND ORIENTATION(2)—this pattern will help to complete the overall design of the building.



The large surface area of glazing in a traditional greenhouse entails a significant heat loss, requiring the extensive use of costly and energy-consuming conventional heating systems. The classic greenhouse was originally developed for use in the European lowlands. The overcast, mild winter climate dictated a mainly transparent structure which would permit the maximum collection of diffuse sky radiation. These original structures have been copied, with little change, for use in nearly all other climates. In cold, northern climates, for example, the sun is in the southern sky all winter. For this reason, the transparent north wall of a conventional greenhouse, while admitting little solar radiation at this time, contributes significantly to the overall heat loss of the space. It is important that the design of a greenhouse respond to climatic conditions in order to function effectively.

The Recommendation

In cold northern and temperate climates, elongate the greenhouse along the east-west axis and build the north wall of opaque materials, incorporating at least 2 inches of rigid or 3 inches of batt insulation. To prevent one-sided plant growth, make the ceiling and/or upper part of the north wall a light color to reflect backlight onto the plant canopy.

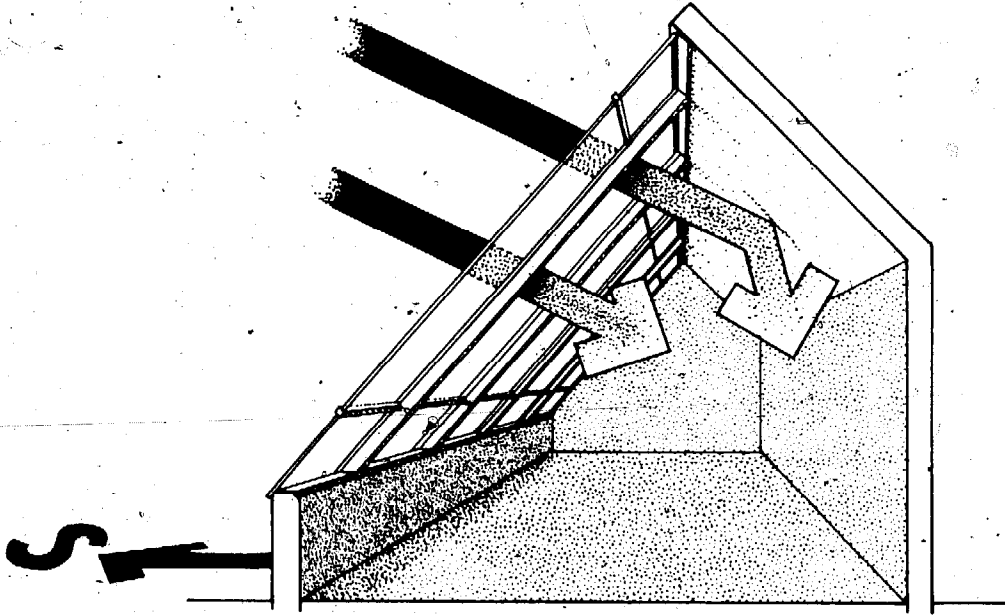


Fig. IV-19a



Add thermal mass to the interior of the greenhouse to store excess heat collected during the daytime for use at night—GREENHOUSE DETAILS(20).

The Information

In 1973, a study was undertaken at Laval University in Quebec City, Canada, to determine the most effective way to reduce the extensive heat losses associated with conventional greenhouses in northern climates. Reports of the study state:

A new design of a greenhouse has been developed for colder regions. The greenhouse is oriented on an east-west axis, the south-facing roof being transparent, and the north-facing wall being insulated with a reflective cover on the interior face. The angles of the transparent roof and the rear, inclined wall are each designed to permit respectively optimum transmittance of solar radiation and maximum reflection of this radiation onto the plant canopy.

19. South-Facing Greenhouse

An experimental unit has been tested at Laval University during one winter. A reduction has been found in the heating requirements of 30 to 40% compared to a standard greenhouse. Results of productivity of tomatoes and lettuce indicate higher yields, possibly due to the increased luminosity in winter.*

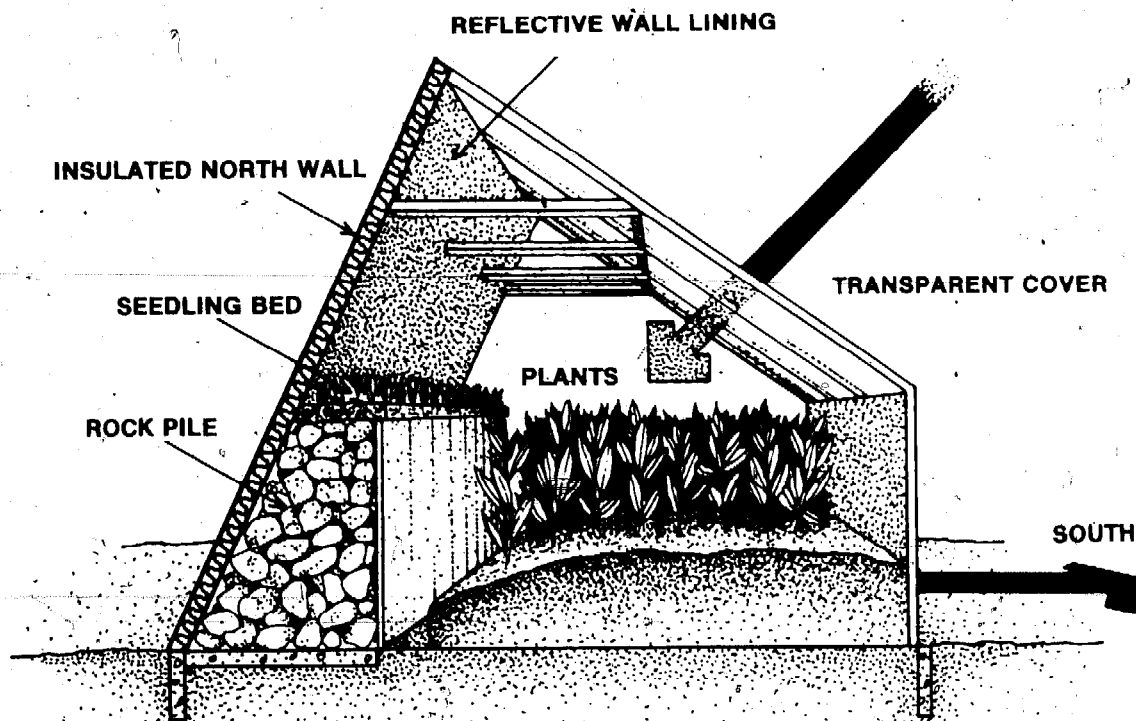


Fig. IV-19b: Laval University greenhouse, Quebec City, Canada.

*T. A. Lawand et al., "The Development and Testing of an Environmentally Designed Greenhouse for Colder Regions," *Solar Energy* 17 (1975): 307-12.



Photo IV-19b: Exterior of Laval University greenhouse.
Quebec City, Canada.

Since there is little solar radiation gain through the north face of a greenhouse in winter, it was determined that a solid, well-insulated north wall substantially reduced heat loss. Naturally, if the north wall is solid, then the entire south face (wall and roof) of the greenhouse should be transparent.

The efficiency of the south glazing as a collector can be increased by tilting it to allow for maximum winter solar transmittance. A tilt angle between 40° to 70° from horizontal is optimum. However, other factors must also be considered in the design of the south facade. For example, applying movable insulation to a tilted, rather than a vertical surface, can be more difficult and expensive. If the tilt of the south wall is too great, there may be problems of adequate interior headroom. Also, in climates characterized by long periods of cloudy winter conditions, large south-facing glass areas, tilted 30° to 40° from horizontal rather than 40° to 70° , are ideal for collecting both diffuse and direct sunlight. All of this suggests that the shape of the greenhouse and design of the south facade will depend upon many factors. Photographs IV-19c illustrate the wide range of appropriate greenhouse configurations applicable for passive solar heating in northern climates (32° to 56° NL).

19. South-Facing Greenhouse

The important concept to remember is that the north wall should be solid and that the south wall and roof mostly transparent.



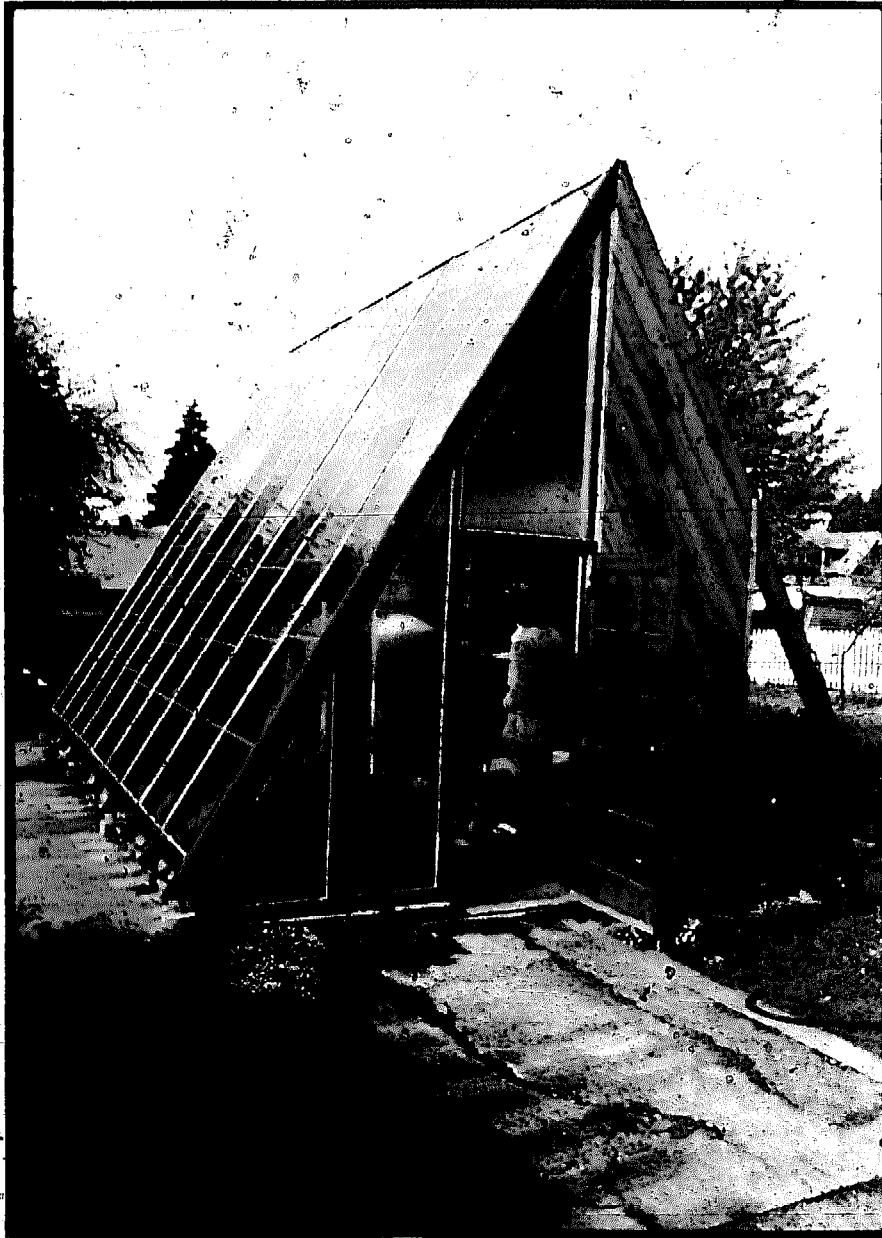


Photo IV-19c: Appropriate greenhouse configurations (here and on next page).

The Passive Solar Energy Book

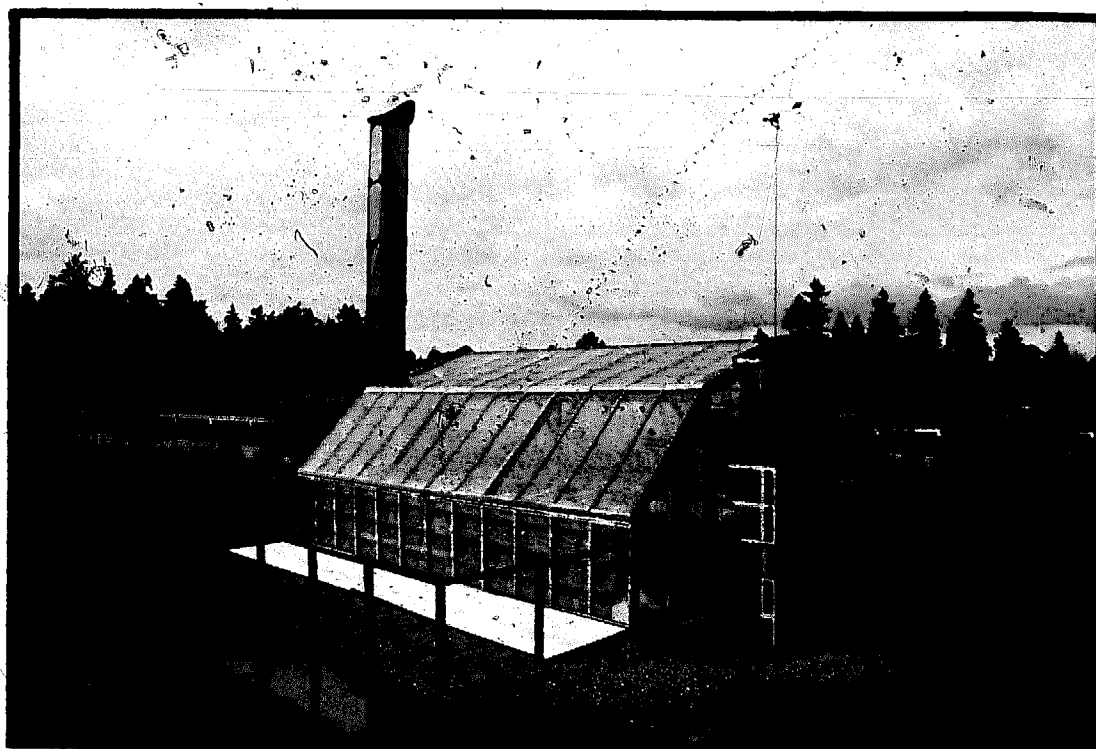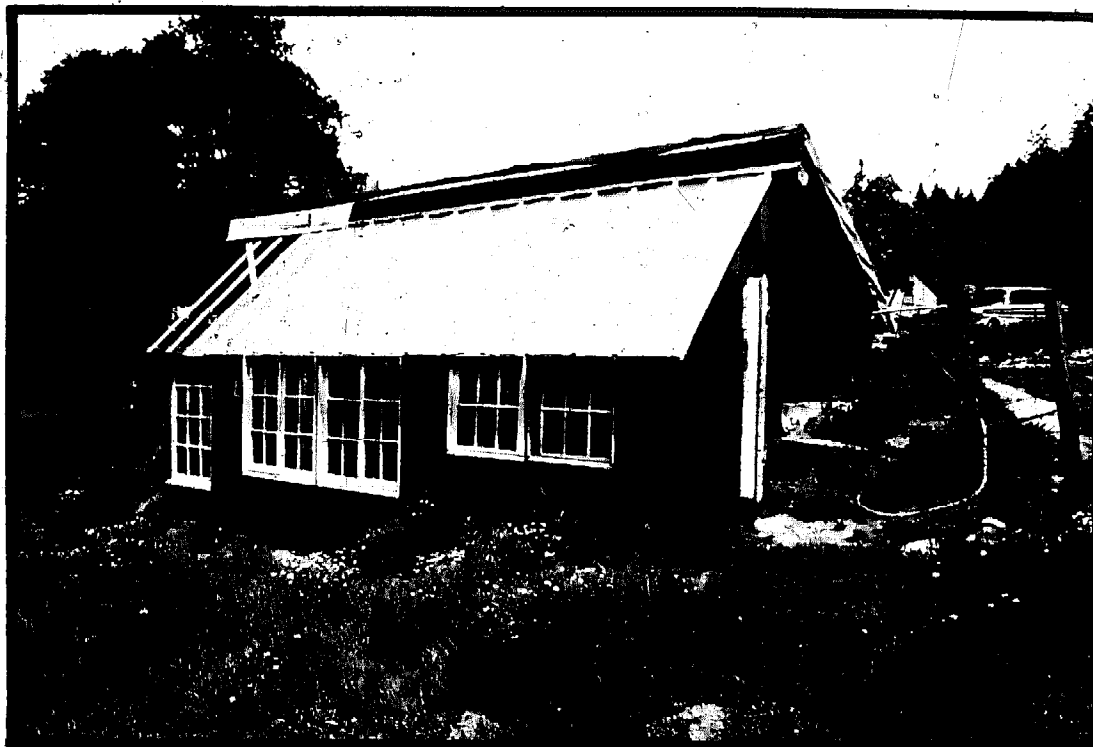

19. South-Facing Greenhouse

To give a rough idea of how well a greenhouse will perform on *sunny winter days*, table IV-19a lists approximate average indoor temperatures for various outdoor conditions. It should be noted that in all climates, a well-constructed, double-glazed, south-facing greenhouse with a solid north wall will collect enough heat on a *sunny day* to heat itself for that 24-hour period, even with daily outdoor temperatures as low as 15°F.

Table IV-19a Clear-Day Average Daily Greenhouse Temperatures

Average Daily Outdoor Temperature (°F)	Average Daily Indoor Temperature (°F)*	
	Single Glazing	Double Glazing
10°	35°-45°	50°-55°
15°	40°-50°	55°-60°
20°	45°-55°	60°-65°
25°	50°-60°	65°-70°
30°	55°-65°	70°-75°
35°	60°-70°	75°-80°
40°	65°-75°	80°-85°
45°	70°-80°	85°-90°

NOTE: *Temperatures are given for locations between 32° and 48°NL. Within each range choose a temperature according to your latitude. For southern latitudes, i.e., 32°NL, use the higher temperatures; for northern latitudes, i.e., 48°NL, use the lower temperatures. The temperatures listed are for a greenhouse with primarily south-facing glazing equal to or greater than its floor area.

It is important to understand that the amount of south glazing and the insulating properties of the greenhouse will determine the average indoor temperature over a given day. The space temperature fluctuations above and below this average are determined by the location, size and surface color of thermal mass in the greenhouse. Even though the average temperature in the greenhouse over the day seems adequate for plant growth, the low nighttime temperature may not be.



Greenhouse

20. Greenhouse Details

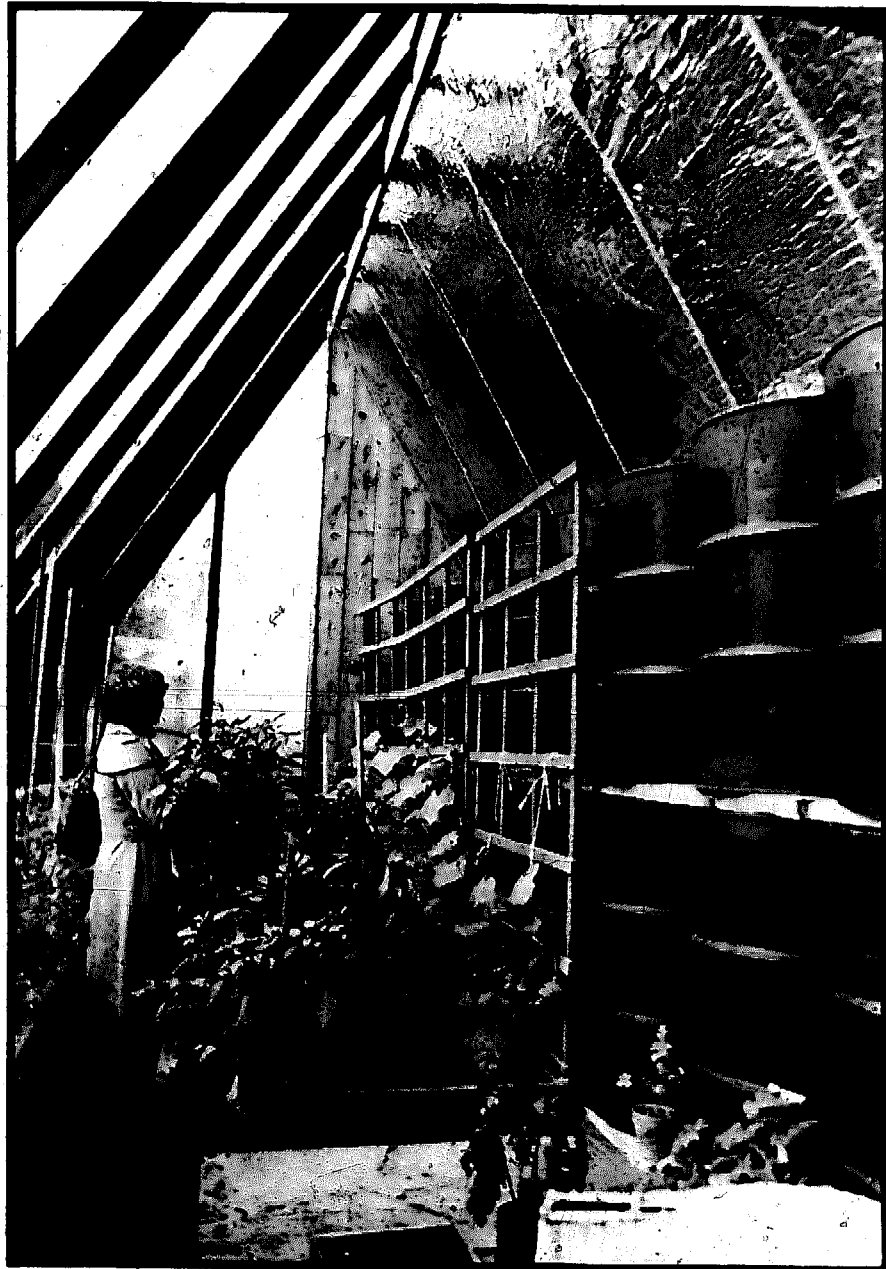


Photo IV-20a

20. Greenhouse Details

This pattern completes SOUTH-FACING GREENHOUSE(19). It describes several ways to provide thermal storage mass in the greenhouse.



Excess solar heat collected during the daytime in a conventional greenhouse is allowed to escape. All greenhouses are in fact solar. In current methods of building greenhouses, however, there are no provisions for storing excess daytime heat for use at night. But it is just this refinement that can make an enormous difference in the way a greenhouse will perform. Without provisions for heat storage, the daily temperature fluctuation in a greenhouse will be excessive.

The Recommendation

Provide enough thermal storage mass in the greenhouse to dampen interior temperature fluctuations by using one of the following methods:

Solid Masonry Construction with Additional Mass

Construct the opaque walls and floor in the greenhouse of solid masonry at least 8 inches in thickness. Masonry alone, however, is not sufficient storage, so fine-tune the greenhouse after construction by adding thermal mass (such as water in containers) until the indoor temperature fluctuations are acceptable. Make the surface of the mass a medium-to-dark color for maximum solar absorption.

Interior Water Wall

Integrate water into the north wall of the greenhouse using roughly 1/2 to 1 cubic foot of water for each one square foot of south-facing glass. Make the surface of the water wall a dark color and be careful not to block direct sunlight from reaching it.

The Passive Solar Energy Book

Active Rock Storage System

Locate a rock bed in the crawl space under the floor, or in the north wall of the greenhouse. Duct the warm air from the top of the greenhouse through the rock bed whenever the greenhouse air temperature is about 10°F warmer than the rock. Use roughly 1½ to 3 cubic feet of rock for each one square foot of south-facing glass.



Make the greenhouse more efficient as a solar-heating system—REFLECTORS (24), MOVABLE INSULATION(23), INSULATION ON THE OUTSIDE(26)—and add additional thickness to the mass for CLOUDY DAY*STORAGE(22).

The Information

Consider that a greenhouse without any means of heat storage or auxiliary heat input will fluctuate in temperature as much as 60° to 100°F over a sunny, but cold winter day. An example of this condition would be a greenhouse that reached a daytime high temperature of 100°F and a nighttime low of 30°F.

The average temperature in the greenhouse over the day would be about 70°F, which is adequate for plant growth, but a fluctuation of 70°F over 24 hours is not a desirable condition. For this reason, a greenhouse must contain enough thermal mass to absorb and to store excess daytime heat for use at night, thus dampening daily interior temperature fluctuations.


Suppose, now, that the greenhouse has enough thermal mass, strategically located, to reduce the daily fluctuation to 30°F. This means that the high for the day would be about 85°F and the low only 55°F. This would be fine for most greenhouse operations.

Various materials used as thermal mass will produce different results. Since there are many ways to include these materials in a greenhouse, the following discussion is limited to three of the most common methods.


Solid Masonry Construction with Additional Mass

The first method is to construct the opaque walls and floor in the greenhouse


20. Greenhouse Details

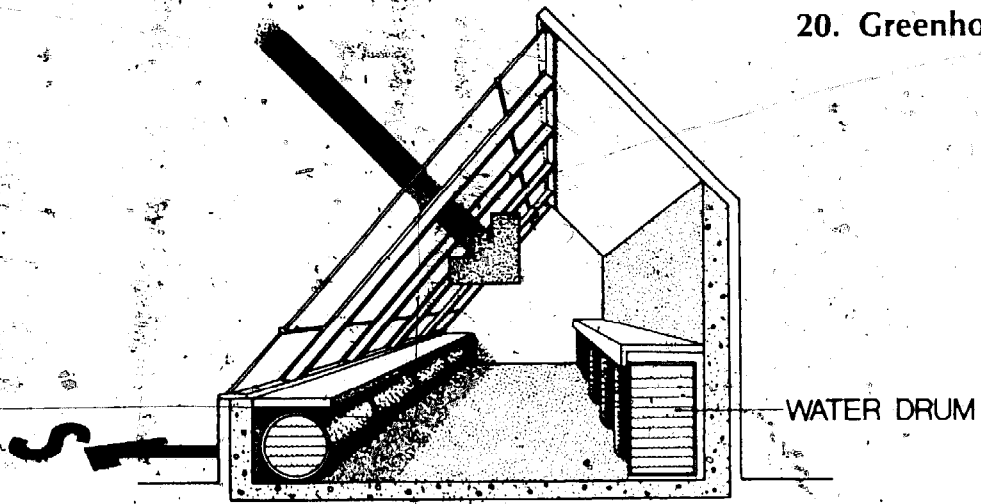

MASONRY- ADDITIONAL MASS

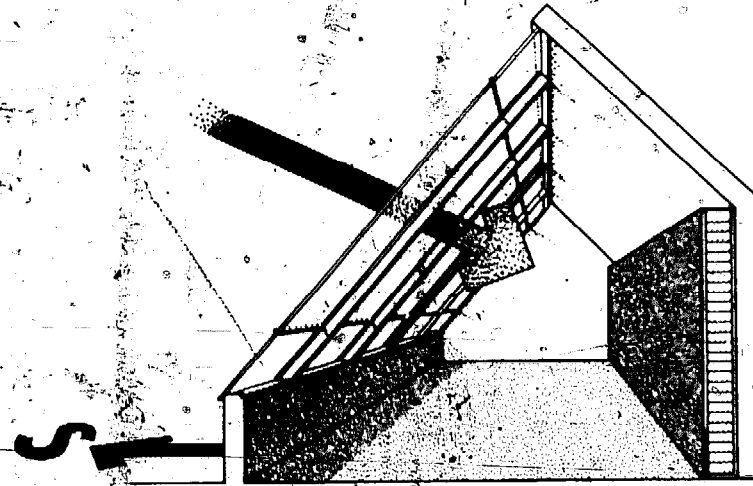

INTERIOR WATER WALL

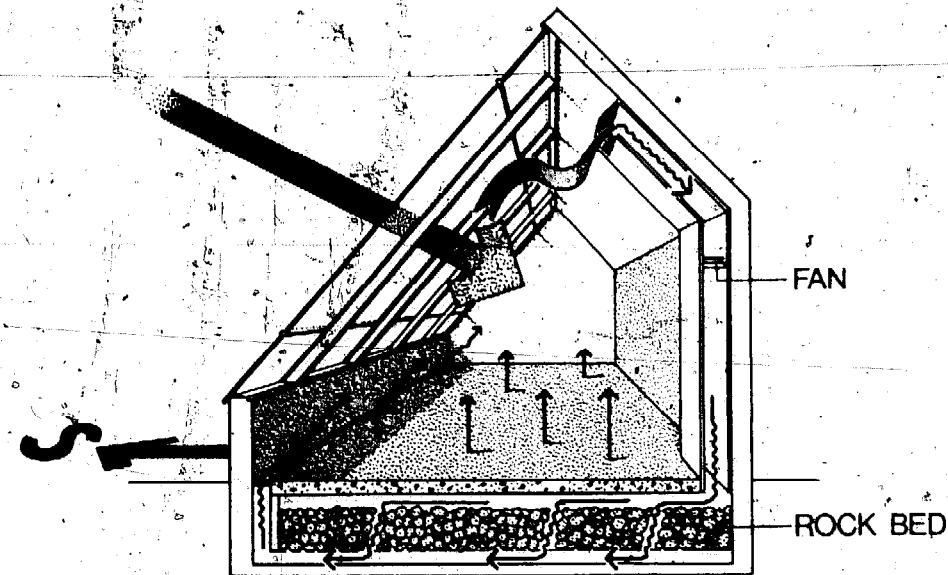

ACTIVE ROCK STORAGE

Fig. IV-20a

The Passive Solar Energy Book

of solid masonry. However, masonry will dampen interior fluctuations only slightly. A greenhouse constructed of masonry will have daily fluctuations on the order of 45° to 70°F. In most instances, this fluctuation is too great for plant life to flourish. This means that additional mass is needed in the greenhouse to further reduce these fluctuations. This is usually accomplished, after the greenhouse has been constructed, by adding containers of water (or any other appropriate substance) in the space until the daily fluctuations are acceptable, 20° to 40°F. Whenever possible, it is desirable to locate this mass in direct sunlight and make its surface a medium or dark color. Fine tuning the greenhouse in this way, however, may lead to problems if enough interior space is not left available for this extra mass. So remember, if this approach is taken, it is important to plan ahead.



Photo IV-20b: Added thermal mass decreases daily greenhouse temperature fluctuations.

Interior Water Wall

Another method of providing thermal mass in a greenhouse is with an interior water wall. Since the north wall of a greenhouse is in a position to catch the most sunlight, it should generally embody the largest percentage of water storage. East and west walls can also provide some area for water storage, but care must be taken not to create undesirable shading patterns, such as shading the north wall for a good part of the day. A greenhouse with a water wall (dark surface color) in direct sunlight will have temperature fluctuations on the order of 20° to 40°F during clear winter days. Table IV-20a gives the expected daily range of fluctuations in a greenhouse with various quantities of water storage for each square foot of south-facing glass.

Table IV-20a Daily Greenhouse Range of Temperature Fluctuations for a Water Storage Wall System

Volume of Water ¹ for Each One Square Foot of South-Facing Glass (cu ft)	Interior Range of Temperature (°F) Fluctuation ²
0.33	30°-41°
0.50	28°-34°
0.67	26°-31°
1.0	24°-29°
1.33	20°-28°

NOTES: 1. One cubic foot of water = 62.4 pounds or 7.48 gallons.


2. Approximately 75% of the sunlight entering the space is assumed to be absorbed by the water wall. If less is absorbed, then fluctuations will be greater than those listed.

Active Rock Storage System

And third, since many greenhouses use a combination of active/passive systems, it seems appropriate to give a sizing procedure for a simple Active Rock Storage System. In this case, warm air is ducted from a high place in the greenhouse and passed through a rock bed. Heat transferred from the air to the rock is stored for use at night or on cloudy days.

The Passive Solar Energy Book

The location and design of the rock bed will vary depending on spatial and functional considerations in the greenhouse. The most common placement, however, is in the foundation crawl space (under the floor) since this is essentially a free container (see fig. IV-20a). A wood floor or concrete slab is then constructed over the rock bed. During the charging cycle, the fan transfers heat from the space to the rock mass. At night, as the greenhouse cools, heat is supplied to the space passively from the floor which essentially functions as a radiant heating panel. If additional heat is needed, warm air from the rock mass can be circulated into the greenhouse.

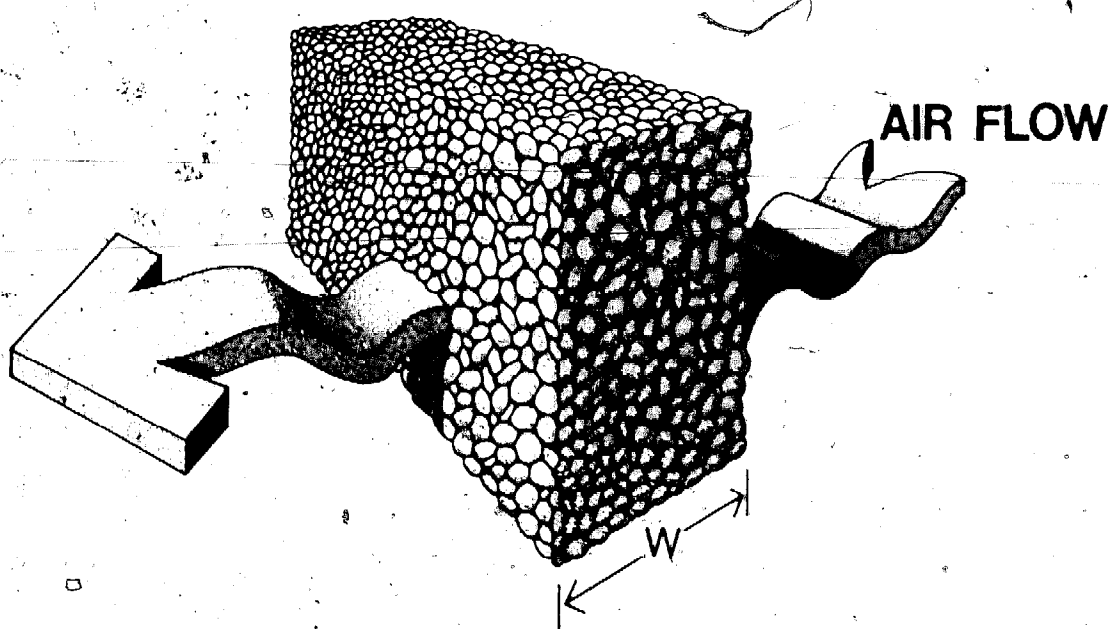

W = 3.5 to 10ft.

Fig. IV-20b: Rock bed dimensions.

A variation of this system is an enclosed, insulated rock bin (container of fist-sized rocks) which uses air as the only heat transfer medium. The bin can be located under a planting bench or under the floor. Again, warm air is circulated through the bin during the day to store heat. At night, however, the system is reversed, and cool greenhouse air, circulated through the bin, is warmed and vented into the space:

Another variation of this system is a rock mass exposed inside the greenhouse. The north wall of the greenhouse is usually the best location for the mass. This system works in the same way as a rock bed, only now the rock wall is

also in a position to absorb sunlight directly. In the Noti greenhouse (see photo IV-20c) wire mesh proved to be a satisfactory method of containing the exposed rock.

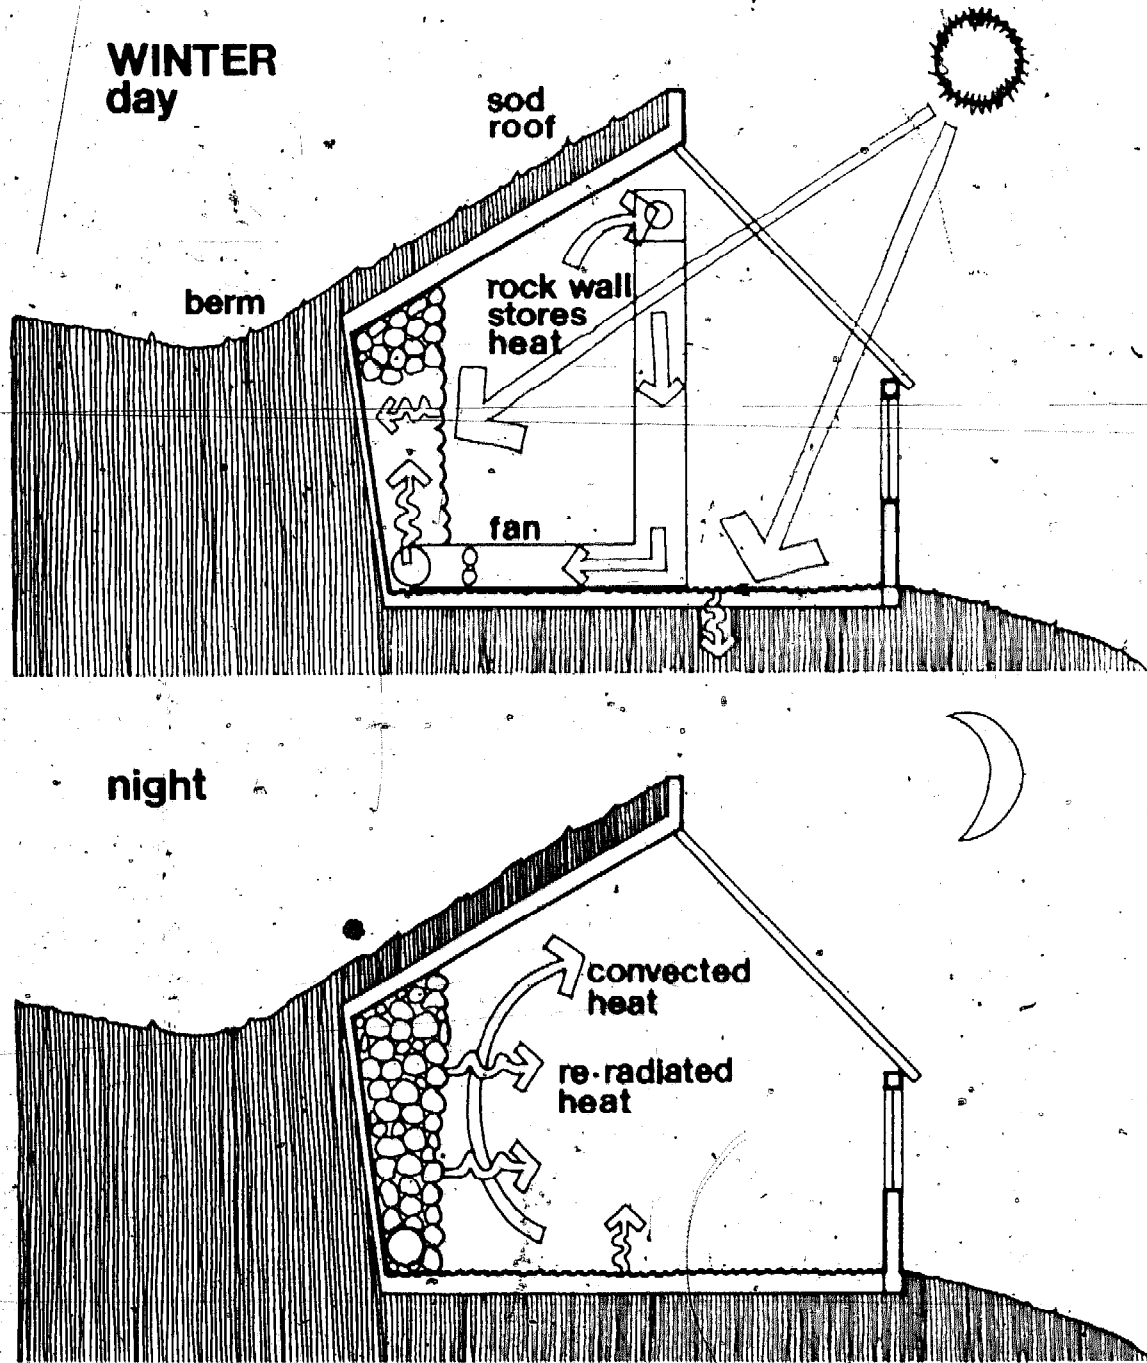


Fig. IV-20c: Daytime and nighttime heat flow.



Photo IV-20c: North wall rock storage.

In all the Active Rock Storage Systems studied, the ability of the mass to dampen greenhouse temperature fluctuations was nearly identical. Temperature fluctuations of 20° to 40°F in the space can be expected during clear winter days. The rate of airflow through the bin and quantity of rock largely determine the fluctuations.

For each one square foot of south-facing greenhouse glass, use about 1½ to 3 cubic feet of rock. As a general rule, 8 to 10 feet is the maximum width of rock needed to circulate the air through, and 3½ to 4 feet is the minimum. Increasing the size of the storage mass beyond 3 cubic feet per square foot of south-facing glass will not increase the performance of the system significantly.

Ventilation in the greenhouse functions not only to control heat buildup on warm days, but also to control humidity and disease by discouraging stagnation and replenishing the plant's carbon dioxide supply which is necessary for photosynthesis. To induce airflow, it is desirable to provide both high and low operable vents or windows (of roughly equal size) in the greenhouse.

20. Greenhouse Details



Photo IV-20d: Operable greenhouse vents.



Photo IV-20e: Louvered shading device.

The Passive Solar Energy Book

To prevent overheating in summer, it is also essential to partially shade the greenhouse. There are several ways to accomplish this, such as using movable louvers or rollable shades, or applying whitewash to the glazing.

And finally, in the case of long spells of cloudy, cold weather, an auxiliary heating system can be installed to maintain adequate greenhouse temperatures. Any standard form of greenhouse heating system can be used; the choice of a unit should be based on local fuel availability and cost. However, if a greenhouse is properly designed, the amount of fuel needed in winter will be minimal.



21. Combining Systems

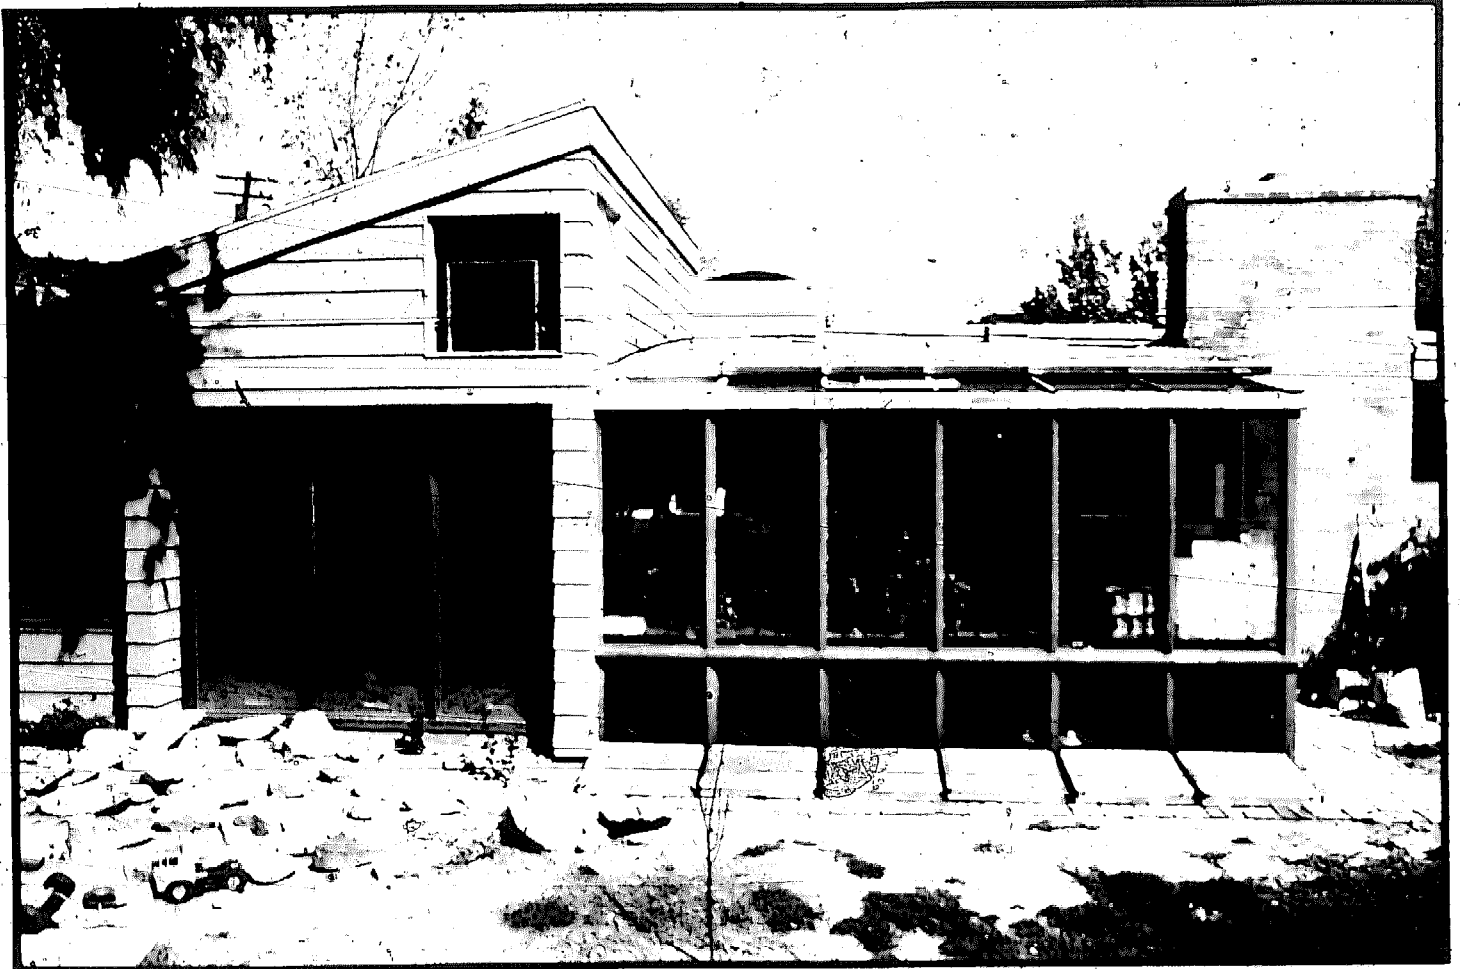


Photo IV-21a

21. Combining Systems

If more than one system is chosen to heat a space—CHOOSING THE SYSTEM(7)—this pattern will help determine the relationship between the sizes of the various systems.



It is very likely that a combination of passive systems will be used to heat a space. However, sizing procedures are usually only given for individual systems. For example, many passive solar heated spaces employing a Thermal Storage Wall or Attached Greenhouse System will also include south-facing windows in the space. In some cases, direct gain windows will be part of the thermal wall. In this and other similar situations, the sizing procedures given in previous patterns must be adjusted.

The Recommendation

When sizing a combination of systems, adjust the procedures given in previous patterns according to the following ratios; for the same amount of heating, each 1 square foot of direct gain glazing equals 2 square feet of thermal storage wall or equals 3 square feet of greenhouse common wall area.



Treat the details of each system as if it were the only system, and slightly over-size collector areas and thermal mass when heat storage for cloudy days is needed—CLOUDY DAY STORAGE(22).

The Information

When most of the glazing normally used in a space also doubles as the

21. Combining Systems

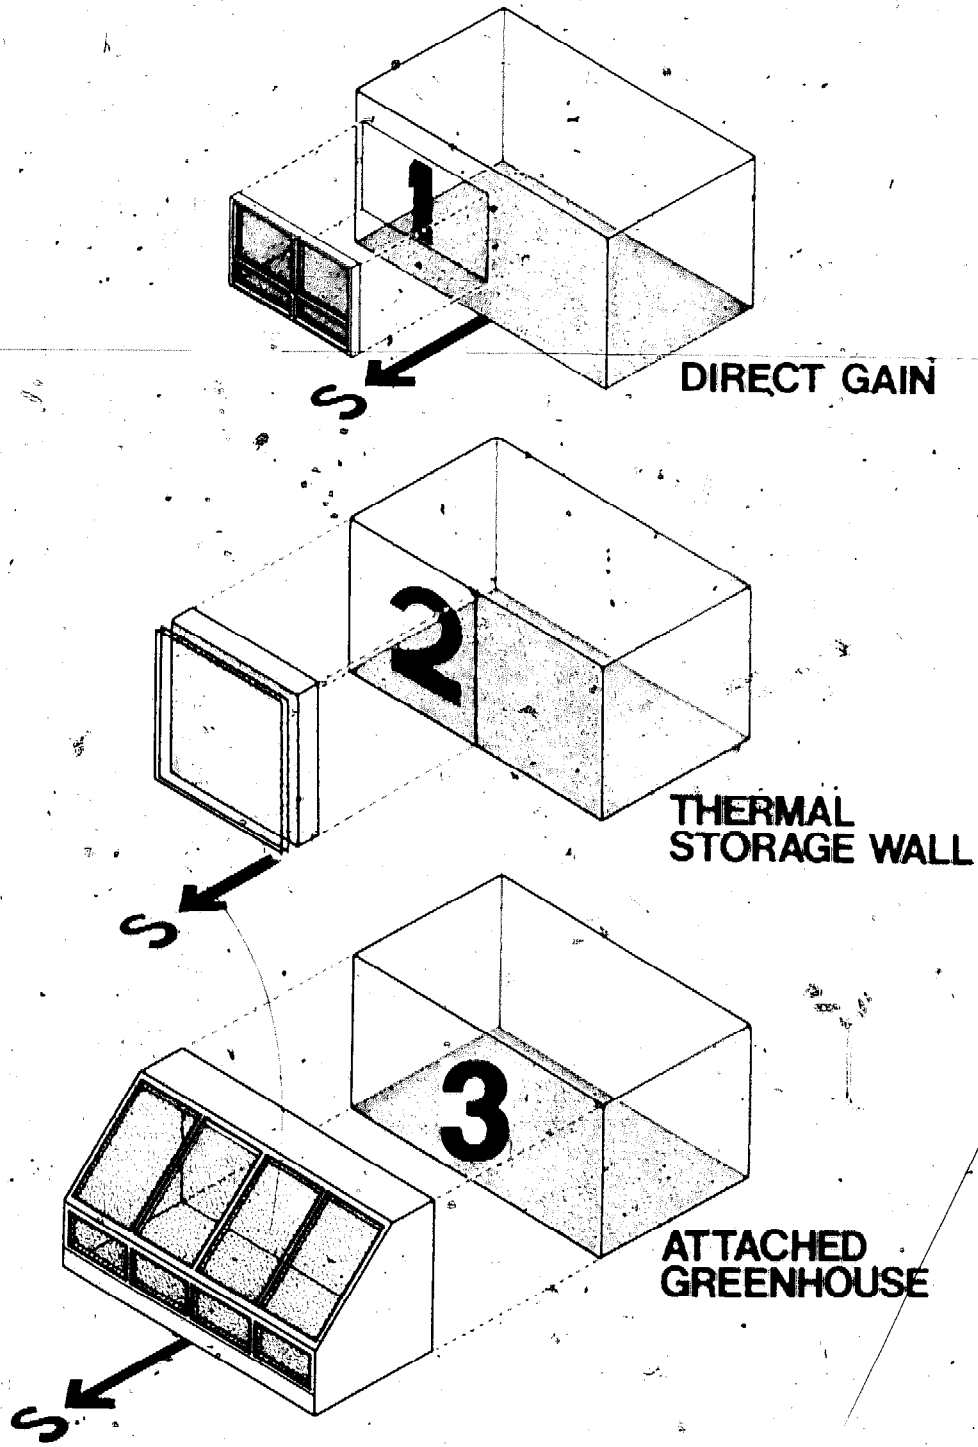


Fig. IV-21a

The Passive Solar Energy Book

collector area (south-facing glazing), then a Direct Gain System will utilize approximately 60 to 75% of the energy incident on the collector (south-facing glazing) for space heating. These percentages are largely determined by reflective and absorptive radiation losses through the glazing.

A Thermal Storage Wall System will transfer about 30 to 45% of the energy incident on the collector into a space. This system's efficiency is determined not only by reflective and absorptive losses through glazing, but also by heat lost from the wall's exterior surface because of the high temperatures generated—WALL DETAILS(14).


The Attached Greenhouse is essentially a Thermal Storage Wall System. However, the percentage of incident energy (on the collector) transferred through the common wall between the greenhouse and building is less than a Thermal Storage Wall, or only 15 to 30%. The reason is simply that a greenhouse has more surface area and consequently more heat loss than glass placed only a few inches in front of a wall. This does not imply that this system is inefficient. On the contrary, the energy collected by the greenhouse that is not transferred into the building is used to heat the greenhouse itself.

All of this suggests that a ratio of 1 (Direct Gain) to 2 (Thermal Storage Wall) to 3 (Attached Greenhouse) exists between the systems. (If the collector glazing in a Direct Gain System is additional to the amount that would normally be used in a space, then double the amount of collector area needed.) This means that each 1 square foot of collector area (glazing) in a Direct Gain System supplies roughly the same quantity of heat to a space as 2 square feet of thermal storage wall, or 3 square feet of attached greenhouse wall area. According to these ratios then, 50 square feet of direct gain glazing will produce roughly the same amount of solar heating as the combination of 25 square feet of direct gain glazing and 50 square feet of thermal storage wall, or 25 square feet of direct gain glazing and 75 square feet of attached greenhouse common wall area.

When heat is actively taken from the attached greenhouse and stored in the building—GREENHOUSE CONNECTION(16)—the percentage of incident energy supplied to a space increases. In this case, the ratio of direct gain to attached greenhouse collector area is, roughly, 1 to 2.



Photo IV-21b:
Direct gain windows
and a masonry thermal
storage wall.

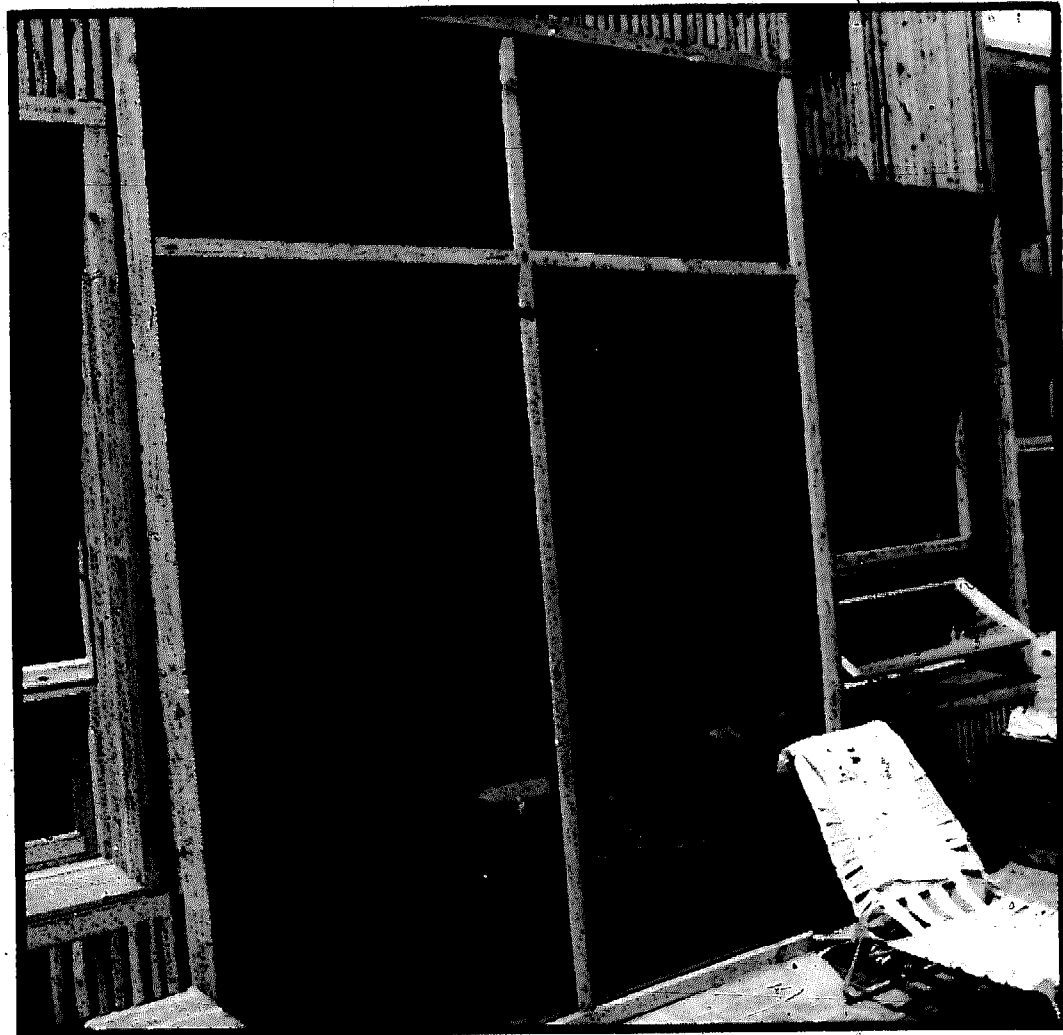

The Passive Solar Energy Book

Because of the many roof pond configurations, it is difficult to give one rule of thumb for combining the pond with other systems. However, for the same amount of heating, the ratio of roof pond collector area to the collector area of other systems can be determined from the sizing procedures given in the patterns SOLAR WINDOWS(9), SIZING THE WALL(13), SIZING THE GREENHOUSE(15) and SIZING THE ROOF POND(17).



22. Cloudy Day Storage

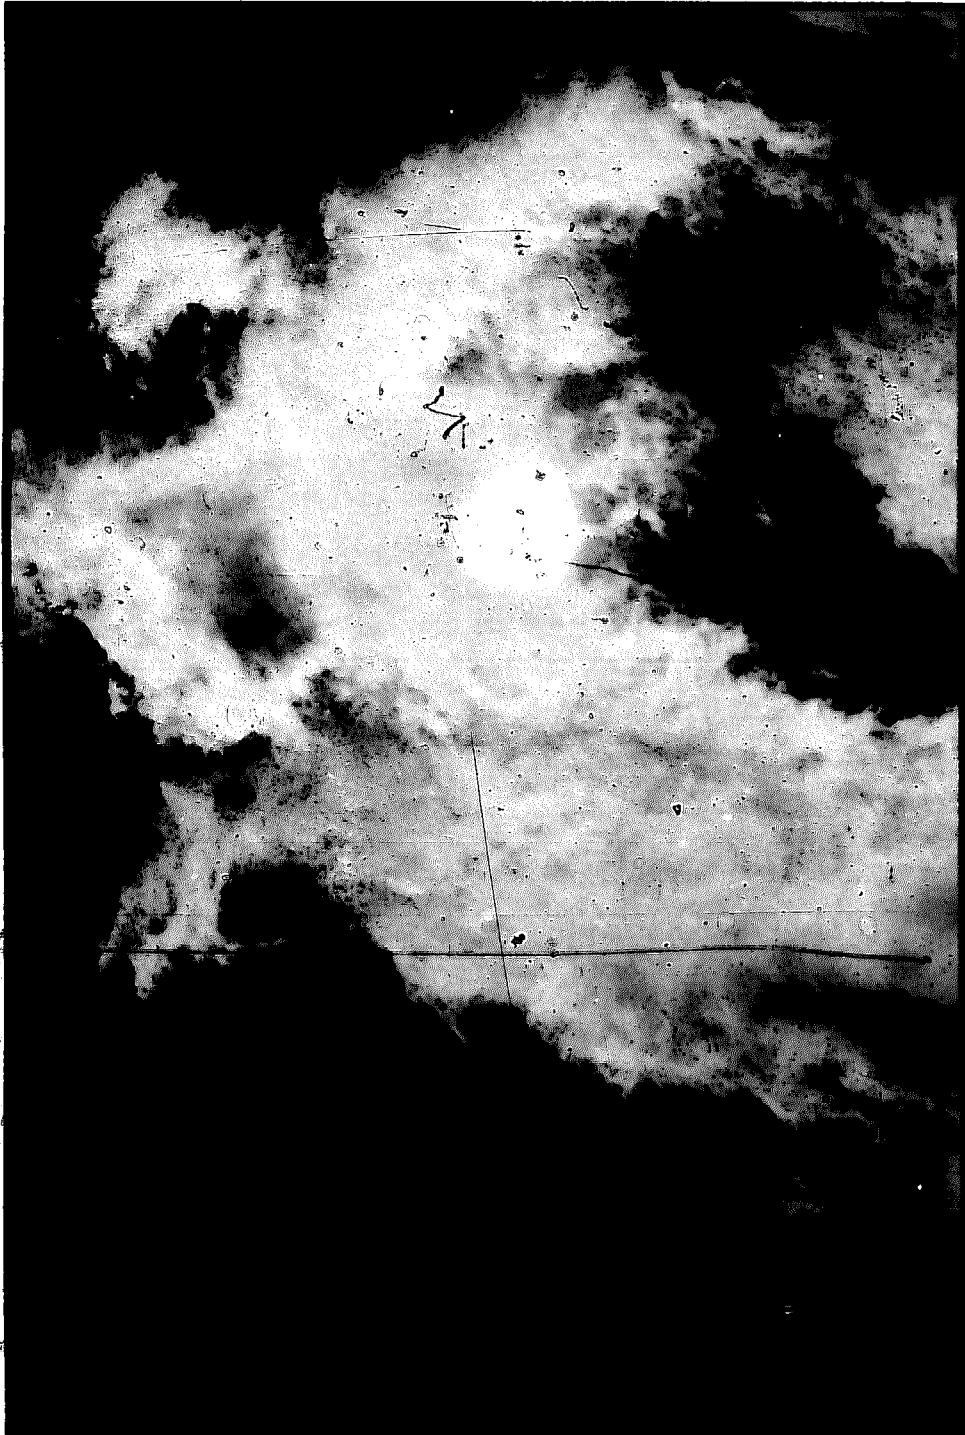


Photo IV-22a

22. Cloudy Day Storage

This pattern completes all the sizing patterns—SOLAR WINDOWS(9), MASONRY HEAT STORAGE(11) and INTERIOR WATER WALL(12); SIZING THE WALL(13) and WALL DETAILS(14); SIZING THE GREENHOUSE(15) and GREENHOUSE CONNECTION(16); SIZING THE ROOF POND(17) and ROOF POND DETAILS(18). In all of them, the size of the collector area and thermal mass can be adjusted to provide heating during periods of cloudy weather.



In a passively heated building where thermal mass is part of the living spaces, any additional heat collected will affect the average temperature in the space. The patterns give rules of thumb for sizing a system to maintain an average space temperature of 70°F during clear winter days. To store heat for cloudy days, the collector area and storage mass must be increased. However, as the system becomes larger and the average temperature in the space increases, overheating on sunny days may occur.

The Recommendation

Direct Gain Systems

As a general rule, to provide heat storage for one or two cloudy days, increase the south glazing (collector area) by 10 to 20% and:

- construct interior walls and floors of solid masonry 8 inches or more in thickness, or
- use 2 to 3 cubic feet of interior water wall for each one square foot of south glazing.

Indirect Gain Systems

To provide heat storage for one or two cloudy days, increase the collector area by 10 to 20% and use:

- a thick masonry thermal storage wall of greater conductivity.

22. Cloudy Day Storage

- one cubic foot or more of water wall for each one square foot of collector area or
- 6 to 8 inches of roof pond depth; 8 to 12 inches for two or three days heat storage.



Slow the rate of space heat loss on cloudy days by applying MOVABLE INSULATION(23) over the south glazing at night. In climates with hot-dry summers, cool the thermal mass at night to provide for SUMMER COOLING (27) in the daytime.

The Information

- After a period of one to three days of similar weather conditions, a passively heated space will stabilize as a system. This means that the heat input into the space will equal the heat output, and the average interior temperature will remain approximately the same from day to day as long as these conditions exist.

The patterns give rules of thumb for designing a space that will maintain an average temperature of approximately 70°F during periods of sunny winter weather conditions. With the arrival of cloudy weather, it can be expected that the average temperature in a space will drop lower than 70°F with each consecutive cloudy day. This, of course, assumes that no auxiliary heat is supplied to the space. The rate at which the average temperature drops is largely dependent upon the quantity of heat stored in the thermal mass at the beginning of the cloudy period. Since this quantity is dependent upon many variables such as climate, latitude, collector area, rate of space heat loss, mass thickness and mass surface color, the following suggestions are general and will change slightly as the situation changes.

Direct Gain

In a Direct Gain System, the thicker the thermal mass, the more heat it can store at a given temperature. The more mass a space contains, the longer it will take to become fully charged with heat. And conversely, after the space

The Passive Solar Energy Book

stabilizes as a system (is fully charged), the more mass it contains, the longer it will take to cool down.

For these reasons, in climates where consecutive sunny days are common in winter, the storage of heat for cloudy days is accomplished by slightly oversizing solar windows and thermal mass. With larger south glazing, it can be expected that the average temperature in a space will be warmer than 70°F on sunny winter days. And, because of the additional mass, the space will cool slowly during periods of cloudy weather, a few degrees each day. An example of this situation is a space with slightly oversized solar windows and mass that maintains an average temperature of 74°F during sunny weather. If the average temperature in the space drops 4°F each cloudy day, it will not be until the second or third day that auxiliary heating is needed.

In climates where cloudy or foggy winter weather conditions prevail, designing for cloudy day storage is *not recommended*, since it takes a period of consecutive sunny days to build up temperature in a large (thick) thermal mass. In cloudy climates use the glazing areas and minimum mass thickness recommended in SOLAR WINDOWS(9), MASONRY HEAT STORAGE(11) and INTERIOR WATER WALL(12). This does not mean that the system is not working on cloudy days. On the contrary, passive systems are always working. They collect and use all the energy that passes through the glazing. On cloudy days, however, a space does not collect enough diffuse sunlight to keep interior temperatures at 70°F, and, therefore, some auxiliary heat input is necessary.

Indirect Gain

(Thermal Storage Wall, Attached Greenhouse and Roof Ponds)

Sizing adjustments for cloudy day storage are different for masonry and water heat storage.

Depending upon its thermal properties—WALL DETAILS(14), GREENHOUSE CONNECTION(16)—a masonry thermal storage wall or common masonry wall between a greenhouse and building has an optimum range of thicknesses. If the wall is made too thick, then little heat is transferred through the wall and the system is inefficient. Therefore, to store heat for cloudy days, the surface area of the wall (of a given material), and not its thickness, should be increased. By increasing the wall area, the daily average temperature in a space will also rise above 70°F. For a day or two of cloudy weather then, the average space temperature will remain in the comfort range, dropping a few

22. Cloudy Day Storage

degrees each cloudy day. The rate at which the space cools is largely a function of the quantity of heat stored in the wall at the beginning of the cloudy period. From the recommendations for wall thickness it can be seen that the higher the conductivity of a material the greater its optimum thickness. In general, after a period of sunny days, thicker walls of higher conductivity will be charged with more heat than thinner walls with lower conductivity and, therefore, will cool at a slower rate.

By making the surface area of a water wall or roof pond larger than that recommended in SIZING THE WALL (13) and SIZING THE ROOF POND (17), the average temperature in a space will be greater than 70°F on sunny winter days. Since a water wall is an excellent conductor of heat (because of water thermocirculation) it can be made any thickness (volume). Using a large volume of water per square foot of south glazing causes a space to cool at a very slow rate during cloudy weather. However, increasing the volume of water wall also implies that it will take a period of two or more consecutive sunny days to fully charge it with heat. Therefore, in cloudy climates with few sunny winter days, increasing the volume of water above that needed to dampen interior temperature fluctuations is *not recommended*. Again, this does not imply that a water wall or roof pond does not work well in cloudy climates; they are in fact always working.

By oversizing a system for cloudy day storage, space overheating will occur during sunny winter weather, possibly causing discomfort. In a Direct Gain System heat can be ventilated from a space, by opening windows, to lower interior temperatures. In an Indirect Gain System ventilation is also possible; however, placing an insulating panel or curtain over the inside face of the wall will effectively control overheating.



23. Movable Insulation



Photo IV-23a

23. Movable Insulation

Once the solar system for each living space has been determined—**CHOOSING THE SYSTEM(7)**—and the glass areas for each space located—**WINDOW LOCATION(6)**—the building can be made more efficient as a solar collector by the use of movable insulation.



Although glass and clear or translucent plastics have the potential to admit large amounts of solar radiation and natural light into a space during the daytime, their poor insulating properties allow a large percentage of this energy to be lost back out through the glazing, mostly at night. In a well-insulated building, glazed openings (windows, skylights and clerestories) can be one of the largest sources of building heat loss. Approximately two-thirds of this heat loss which occurs at night can be greatly reduced by the use of movable insulation.

The Recommendation

If possible, use movable insulation over all glazed openings to prevent the heat gained during the daytime from escaping rapidly at night. When using single glazing in cold northern climates, always use movable insulation. To be effective the insulation must make a tight and well-sealed cover for the glazed opening.



Control the amount of sunlight entering a space at different times of the year by detailing movable insulation so it doubles as **SHADING DEVICES(25)**. When using exterior insulating shutters or panels, design them so that they

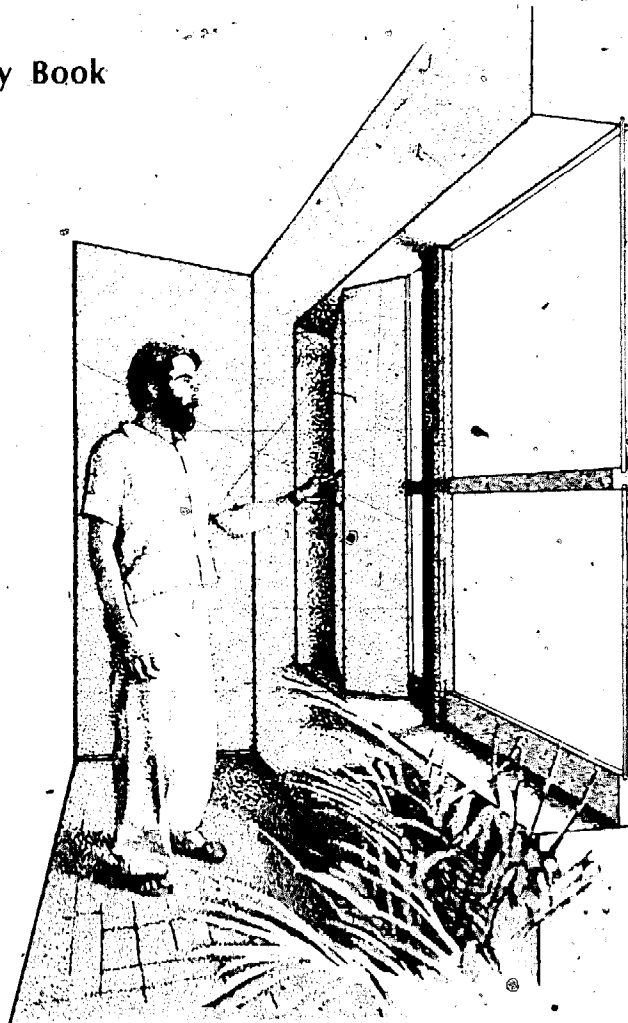


Fig. IV-23a

also serve as REFLECTORS(24) to increase the solar gain through each square foot of glazing.

The Information

Heat is transferred through glazed openings by two methods, either by conduction through the glass (or plastic) from the interior surface of the glazing to the exterior or by infiltration, the exchange of warmed indoor air with cold outdoor air through tiny cracks around window frames.

The purpose of movable insulation is to reduce heat losses when they are greatest. In winter, the major heat loss through glass occurs at night. For example, in Boston, during an average January day, 65% of the total conduction heat loss through single or double glazing occurred at this time (see table IV-23a). (Note that single glazing with night insulation performs more effectively than double glazing without insulation.) However, the use of insulating shutters (with an R value of 10) can reduce this heat loss by approximately 80 to 90%.

Table IV-23a Conduction Losses through Single and Double Glazing with and without Shutters for Boston

	Heat Loss (Btu/sq ft)			
	Single Glazing ²	Double Glazing ³	Single Glazing (w/shutters [R-10] at night)	Double Glazing (w/shutters [R-10] at night)
Daytime (9 hours)	368	211	368	211
Nighttime (15 hours)	<u>679</u>	<u>390</u>	<u>51</u>	<u>48</u>
Total heat loss	1,047	601	419	259

NOTES: 1. Average January clear daytime temperature 33.8°F; average January nighttime temperature 29.9°F; indoor temperature 70°F.

2. Single glass $U = 1.13 \text{ Btu/hr-sq ft-}^\circ\text{F}$.

3. Double glass $U = .65 \text{ Btu/hr-sq ft-}^\circ\text{F}$.

A well-sealed insulating shutter will also dramatically reduce the infiltration of cold air around window edges by creating a dead air space between the window and shutter. This can be difficult to achieve, however, since an effective seal is hard to design, and poorly fitted shutters allow a convective airflow between the insulation and glazing, thus increasing the transfer of heat through the glazing.

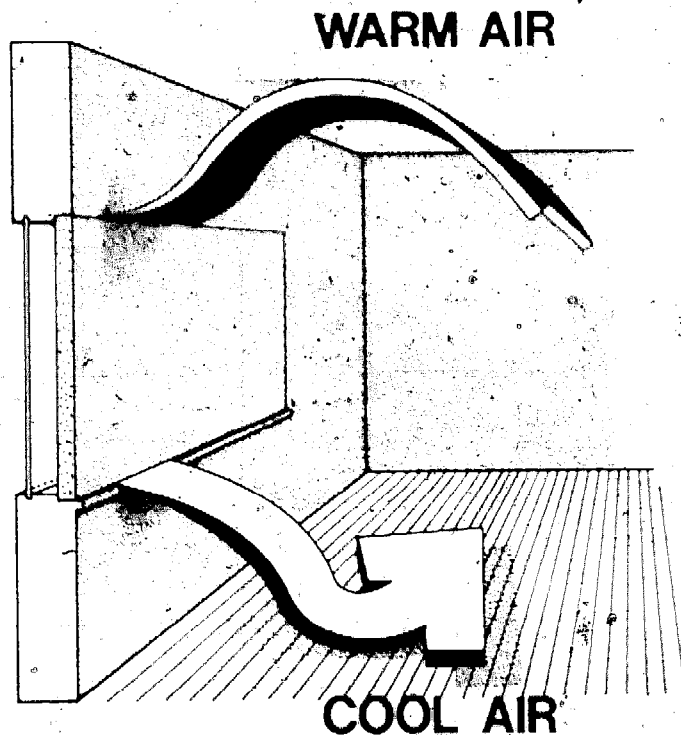


Fig. IV-23b: Poorly fitted shutter.



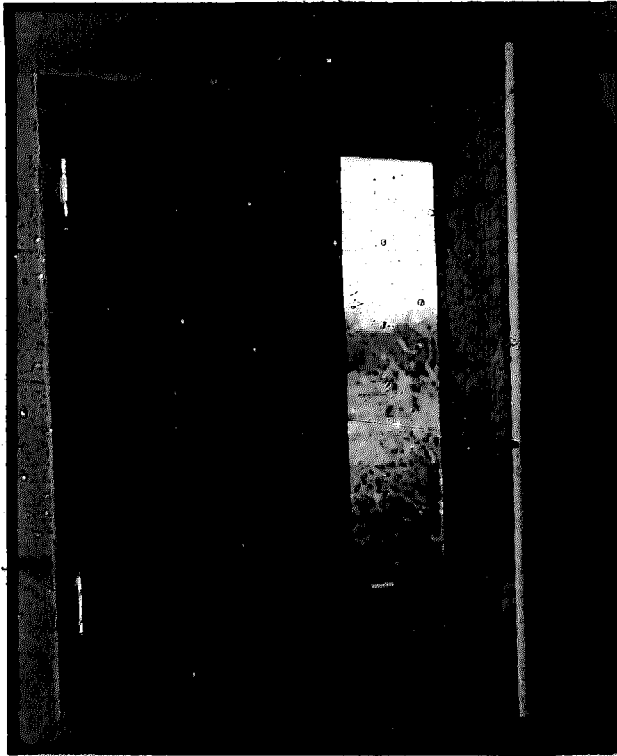


Photo IV-23b: Hand-operated devices (here and facing page).

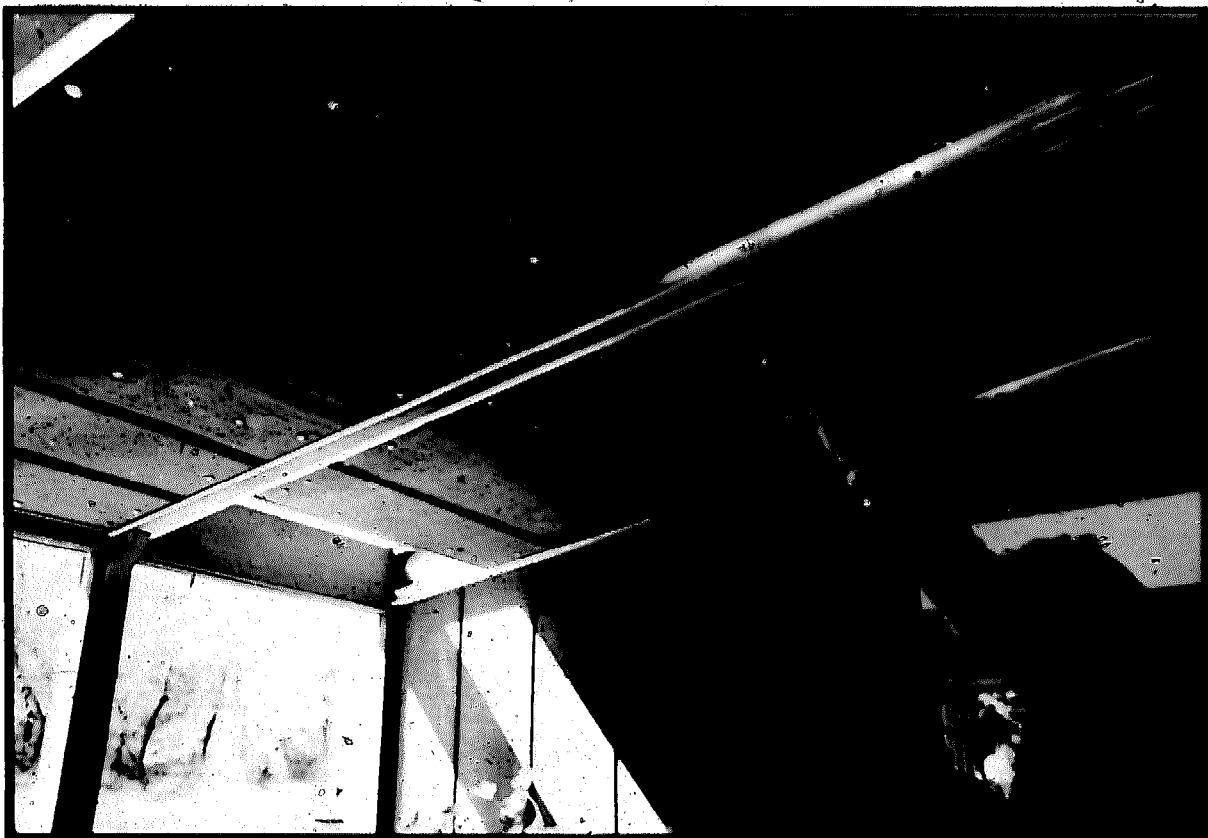

23. Movable Insulation

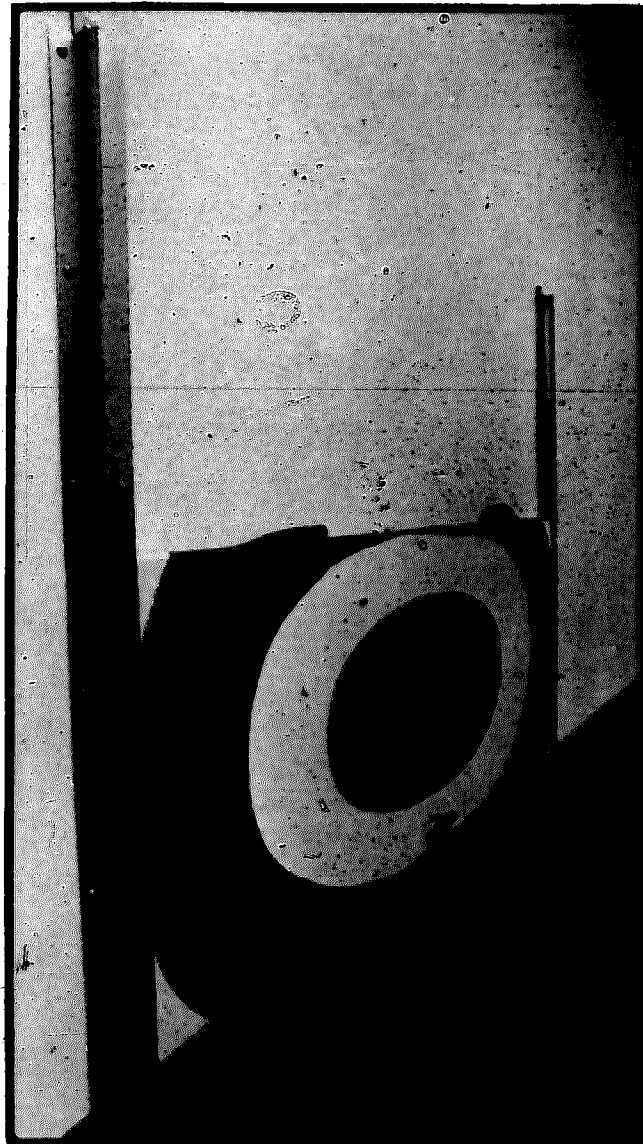

Stephen Baer who has been studying this problem for many years observes:

The great problem with movable insulation is cracks. . . . If you are likely to have cracks, plan to torture any air that dares pass through them. This can be done by pressing the insulation panel directly against the glass—any air leak around the edges must then spread out in a thin film in order to warm the glass. Experimenting with smoke introduced in thin films behind glass, you find that once

The Passive Solar Energy Book

this layer (space between glass and panel) is less than 1/16 inch in thickness, it is slowed by enormous resistance and acts almost like syrup. Treat a glass area like a ship—break it into separate compartments so that a leak in one place won't be fatal.*

By using insulation over large south-facing windows or skylights, the solar heat gained during the daytime is prevented from escaping at night. In this way, a large heat-gain area during the day becomes a low heat-loss area at night. Heat gains (or losses) through south-facing glass, with and without movable insulation, are plotted for monthly solar and weather conditions in four locations.

Notice that single glazing with night insulation is nearly as effective as double glazing with night insulation in Seattle, Madison and New York, and in Albuquerque it actually outperforms double glazing with insulation. It seems reasonable to conclude that in most climates, double glazing windows is not necessary with insulating shutters. However, a masonry thermal storage wall, because of the high surface temperatures it generates adjacent to the glass, should be double glazed in all climates to prevent excessive heat loss.

The application of movable insulation can be divided into three categories: (1) hand operated, (2) thermally sensitive and (3) motor driven. Hand-operated devices include sliding panels, hinged shutters and drapes. The initial cost is generally low, and the materials usually pay for themselves in energy savings within a few years. Thermally sensitive devices are activated by heat converted to mechanical movement. Some examples are Skylids † (a Freon-activated movable louver system), heat motors (as used in greenhouse venting systems) and large bimetallic strips. They function automatically and can be placed in areas difficult to reach like skylights and high clerestory windows. These mechanisms use no electricity and are usually more expensive than hand-operated devices. Motor-driven applications can be manually activated or controlled by automatic timers, thermostats or light sensitive devices. Some examples are Beadwall ‡ (foam beads blown between double glazing) and Harold Hay's Skytherm System (motor-driven sliding insulation panels). The

*Stephen C. Baer, "Movable Insulation," *Passive Solar Heating and Cooling Conference and Workshop Proceedings* (Springfield Va.: National Technical Information Service, 1976).

†Skylids are a patented device by Stephen Baer, Zomeworks Corp., Albuquerque, N. Mex.

‡Beadwall is a patented device by David Harrison, Zomeworks Corp., Albuquerque, N. Mex.

23. Movable Insulation




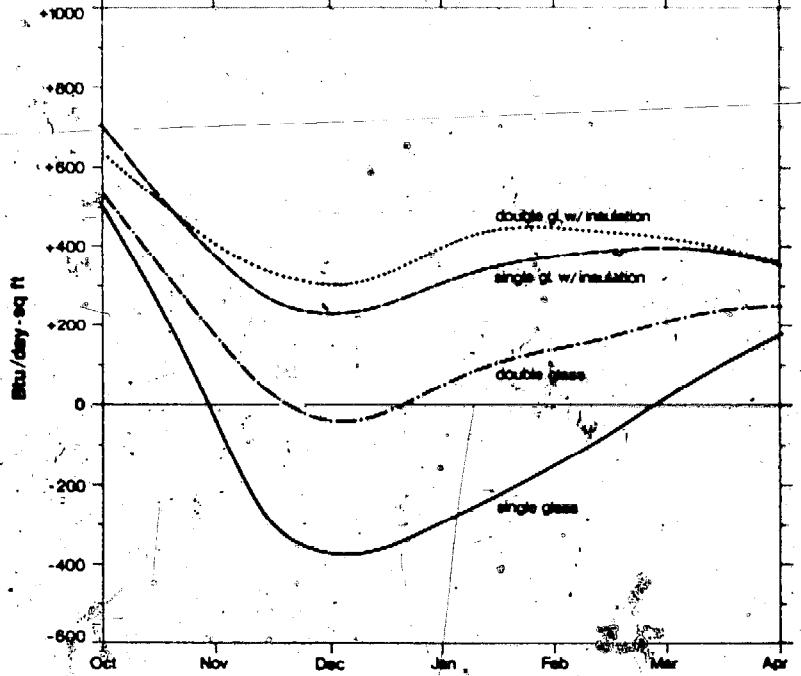


Fig. IV-23c: Glazing performance with and without movable insulation.



Photo IV-23c: Insulating devices: thermally sensitive Skylid (above) and motor-driven Beadwall (facing page).

23. Movable Insulation

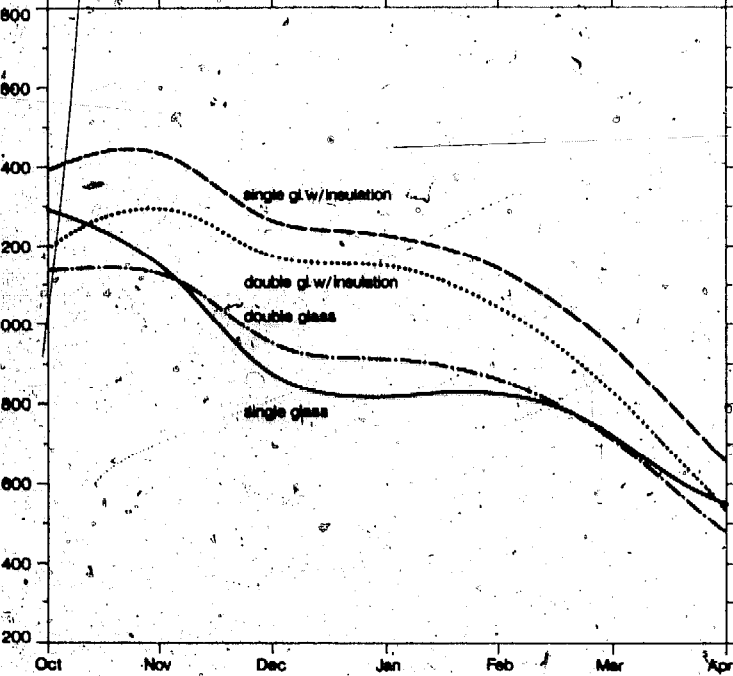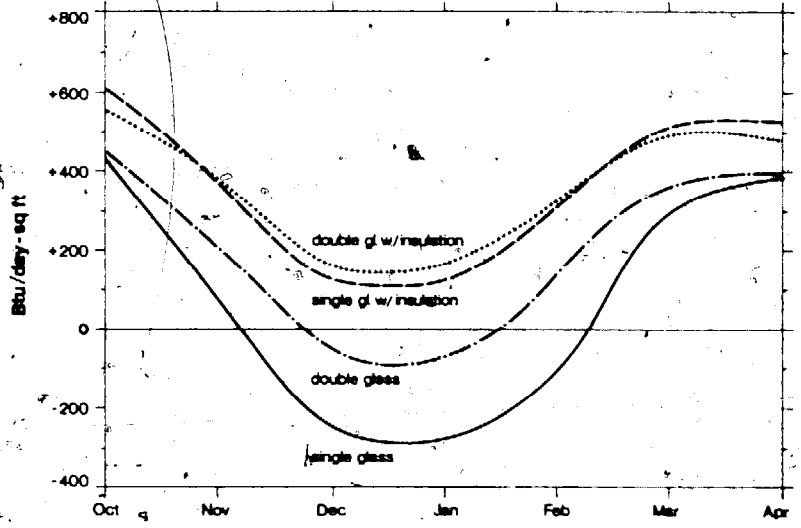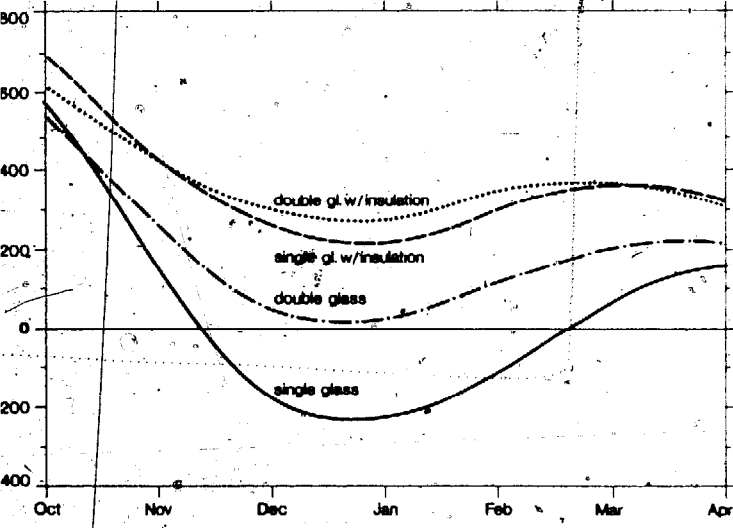

advantages of these devices are possible automatic operation, use in difficult-to-reach areas and the capability to move very large insulating panels. The disadvantages of motor-driven applications would be the use of somewhat more complicated equipment and higher initial and maintenance costs.

Movable insulation offers additional benefits. By reducing nighttime heat loss, less collector area is needed to heat a space.



24. Reflectors


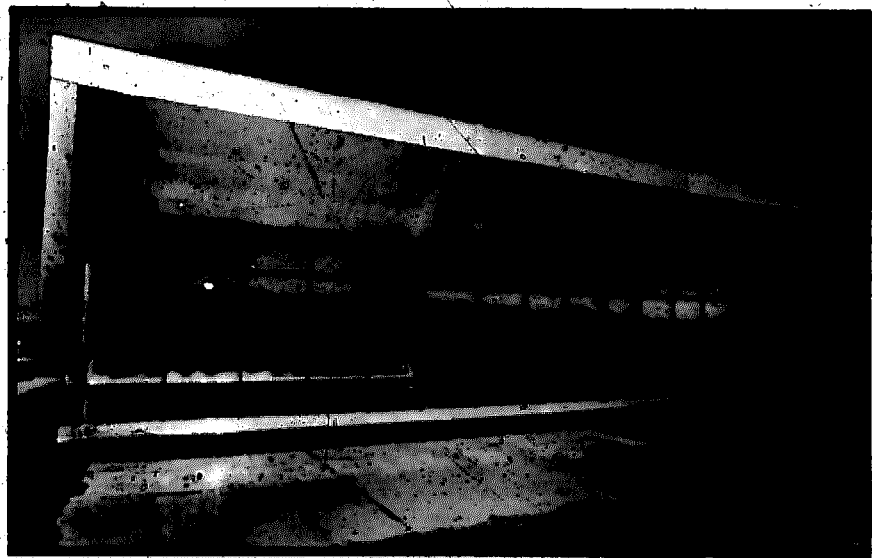


Photo IV-24a



24. Reflectors

After CHOOSING THE SYSTEM(7) for each space, the amount of solar energy incident on a collector can be increased with the addition of a reflector. Reflectors, though, must be integrated into the building's design when sizing and detailing the solar system.

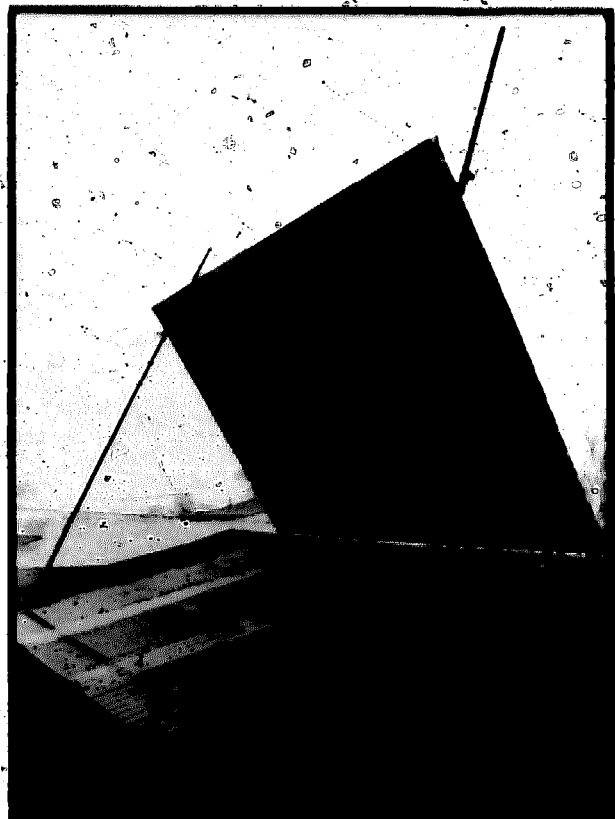

A large amount of collector area (south-facing glass) may not be feasible or desirable in many building situations. In a number of situations, such as partial shading by nearby buildings or vegetation, aesthetic considerations or the limited availability of south wall for solar collection, large south-facing glass areas may not be possible. In addition, since glass is a poor insulator, it makes sense to minimize the area of glazing needed to heat a space. By using exterior reflectors, the amount of solar radiation transmitted through each square foot of glass can be dramatically increased.

The Recommendation

For vertical glazing use a horizontal reflector roughly equal in width and 1 to 2 times the height of the glazed opening in length. For south-sloping skylights locate the reflector above the skylight at a tilt angle of approximately 100°. Make the reflector roughly equal to the length and width of the skylight.



When possible, design reflectors to function as SHADING DEVICES(25) and/or insulating shutters—MOVABLE INSULATION(23).

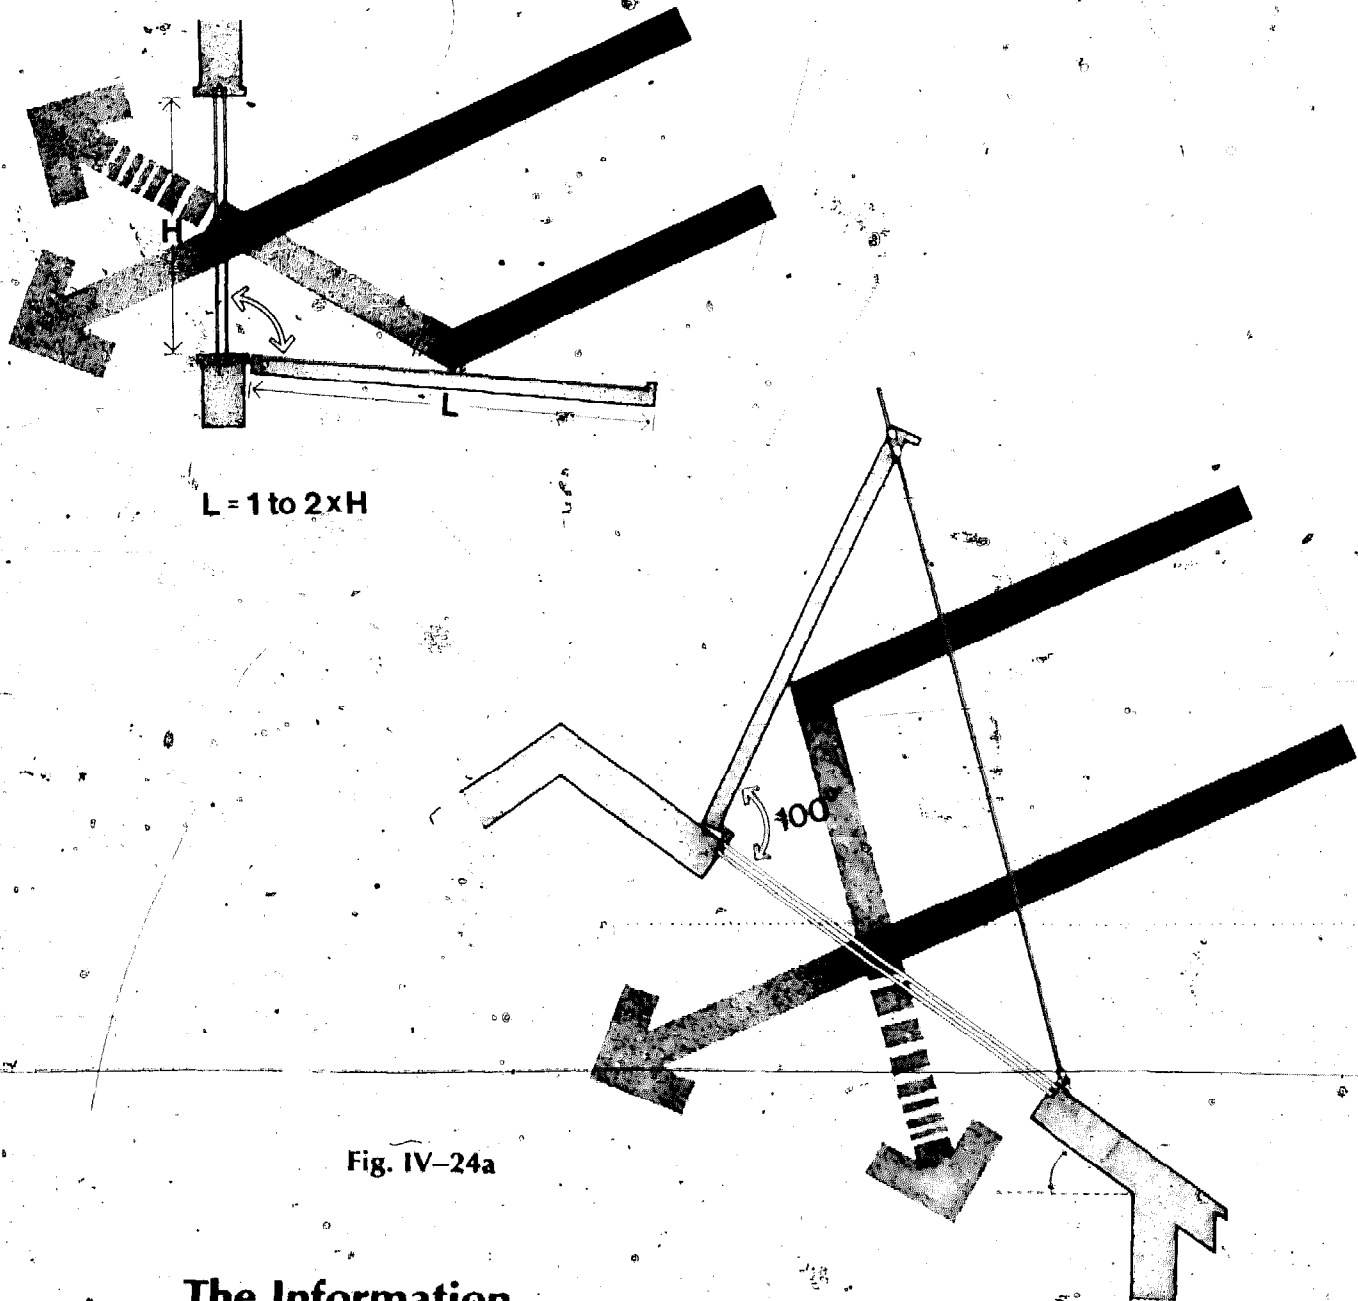


Fig. IV-24a

The Information

There are basically two types of exterior reflector/collector configurations: reflectors coupled with vertical or near vertical glazing, and reflectors coupled with south-sloping and horizontal skylights.

For vertical glazing, a horizontal reflector directly in front of the glazing is best. The winter performance of reflector/collector configurations for various latitudes was studied at the University of Oregon in order to arrive at the

24. Reflectors

optimum geometrical arrangement for reflector/collector tilt angles.* Results for 48°NL indicate that the optimum reflector angle for vertical glazing is about 95°, or a 5° downward sloping reflector. The result of similar calculations, for 35°NL, found the optimum tilt angle to be 85°, or a 5° upward sloping reflector. However, for architectural reasons (such as water drainage), it is convenient to use a slightly downward sloping reflector. It is interesting to note that at 35°NL only a small loss of collected energy (less than 5%) would be incurred by using a downward sloping (5°) reflector.

The practical optimum length of a reflector for vertical glazing was found to be roughly 1 to 2 times the height of the glazed opening. The results for 45°NL during the month of January are presented in figure IV-24b. Notice that the rate of enhancement (percentage of added energy) declines sharply as the reflector length is increased beyond 2 times the height of the collector. The energy gathered with a reflector length of 1½ times the height of the collector is only 7% less than that gathered with a very long reflector. Below 1½ though, the energy collected declines almost linearly with reflector length, but even at 1 an enhancement of 35% is possible. Similar results were obtained for reflector/collector combinations at 35°NL. For maximum flexibility in architectural design, the shortest possible reflector length is usually desirable.

By using reflectors, the average winter solar radiation incident on vertical glazing can be increased by roughly 30 to 40% † during the winter months.

Similar results can be achieved by using a reflector in conjunction with south-sloping skylights (30° to 50° tilt from horizontal) or horizontal skylights. To collect the most winter sun, the reflector should make an angle of approximately 90° to 110° with a south-sloping skylight and 65° to 80° with a horizontal skylight.

This type of reflector configuration, unless adjusted daily, though, does not work well in cloudy climates, such as coastal regions of the Pacific Northwest, because the reflector shades part of the skydome thus reducing the amount of diffuse sky radiation collected by the skylight during the predominantly cloudy weather.

*For a detailed analysis, see S. Baker, D. McDaniels, and E. Kaehn, "Time Integrated Calculation of the Insolation Collected by a Reflector/Collector System."

†These percentages apply to a specular reflector with a surface reflectance of 0.8.

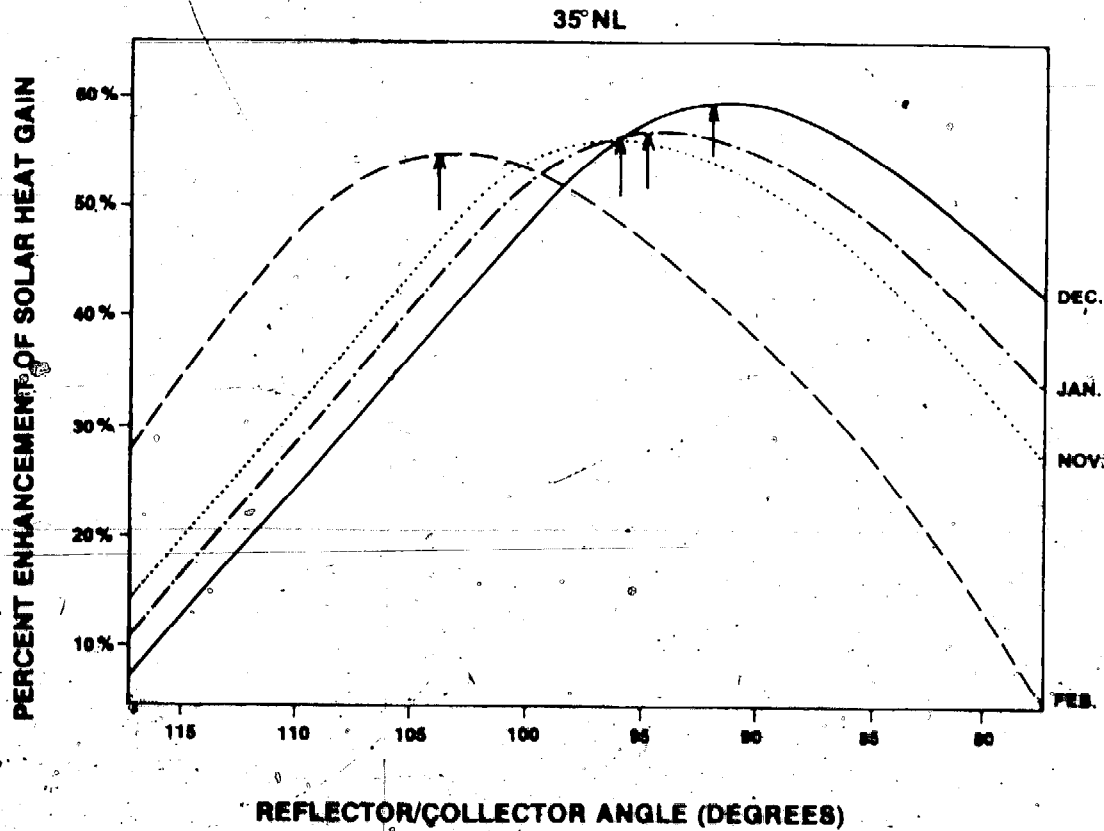


Fig. JV-24b: Percentage of solar energy enhancement for various reflector/collector tilt angles at 35°NL (here) and 45°NL (facing page).

Note: Values plotted are for a reflector with 0.80 reflectance and a reflector/collector ratio of 2.0 (or the reflector is 2 times the height of the collector in length).

Source: S. Baker, D. McDaniels, and E. Kaehn, "Time Integrated Calculation of the Insolation Collected by a Reflector/Collector System."

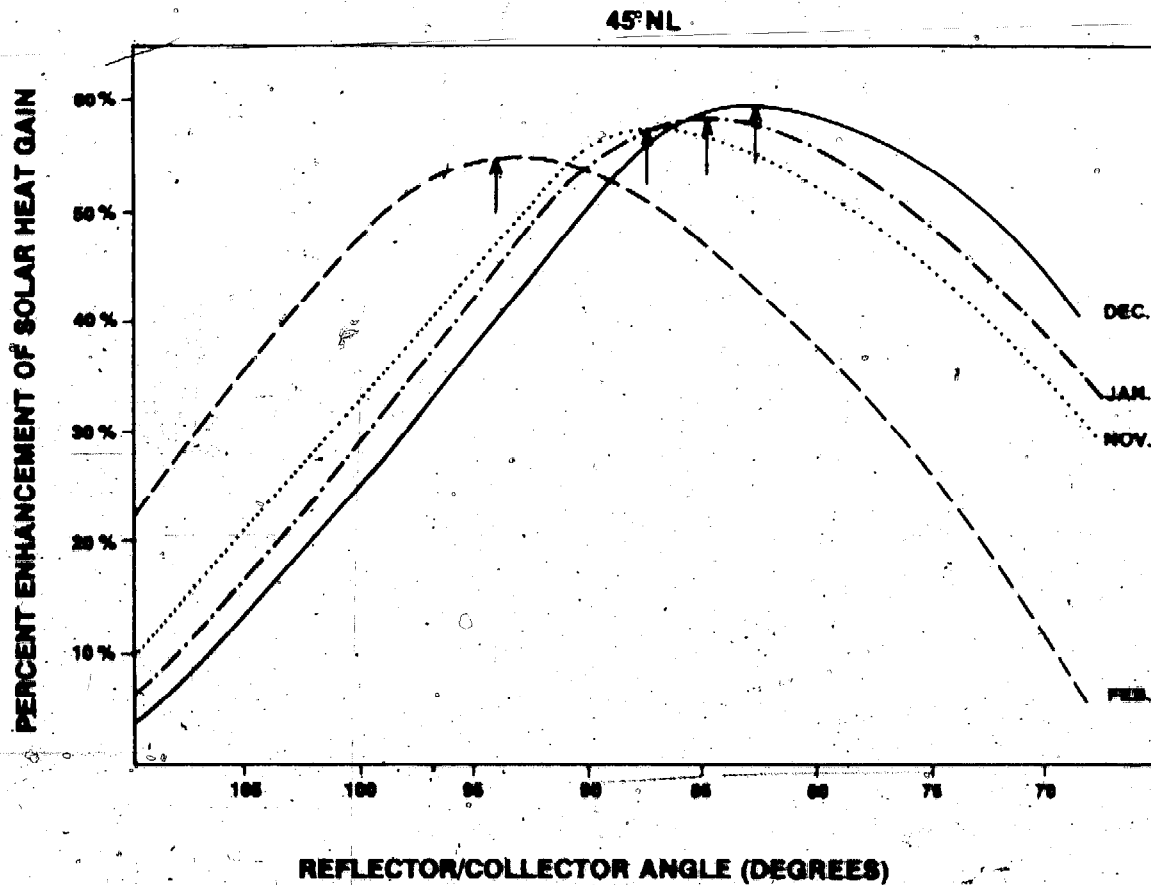


TABLE IV-24a Recommended * Reflector Tilt Angles for South-Facing Skylights

Skylight Slope	* North Latitude			
	36°	42°	48°	54°
horizontal	80°	76°	71°	66°
30°	100°	97°	93°	90°
40°	107°	103°	100°	97°
50°	113°	110°	107°	103°

NOTE: *As more detailed reflector/collector studies become available, recommended reflector tilt angles may change slightly.

Skylight reflectors could be adjusted for the summer months to serve as SHADING DEVICES(25). In winter the reflector would be raised to increase solar collection, and in summer, lowered to shade the skylight. Remember

The Passive Solar Energy Book

that reflectors which protrude out from the face of a building are usually subject to increased wind loads and, therefore, must be of sturdy construction.

Applied inside a building, reflectors can be used to direct sunlight to a particular part of the space, for example, to reflect sunlight onto an interior


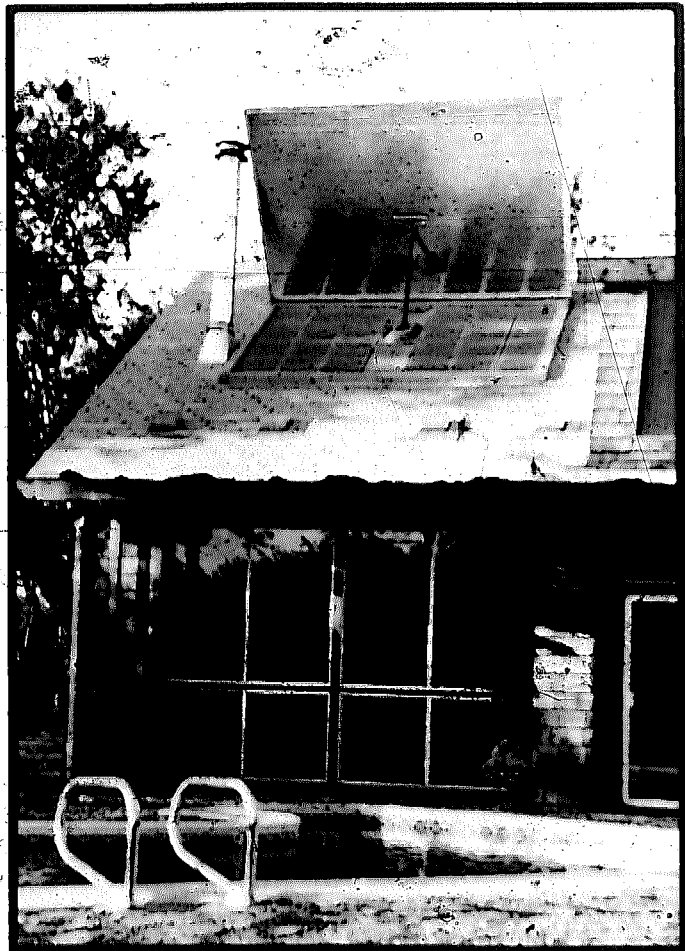


Photo IV-24b:◊

A reflector which also serves as a shading device and an insulating panel, in three positions (here and facing pages).

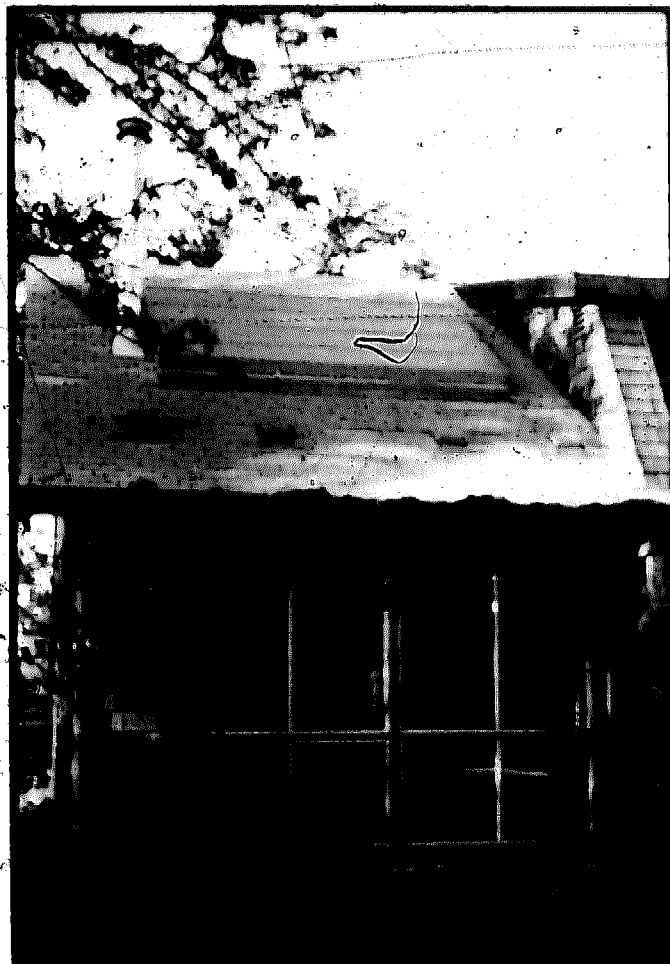

24. Reflectors


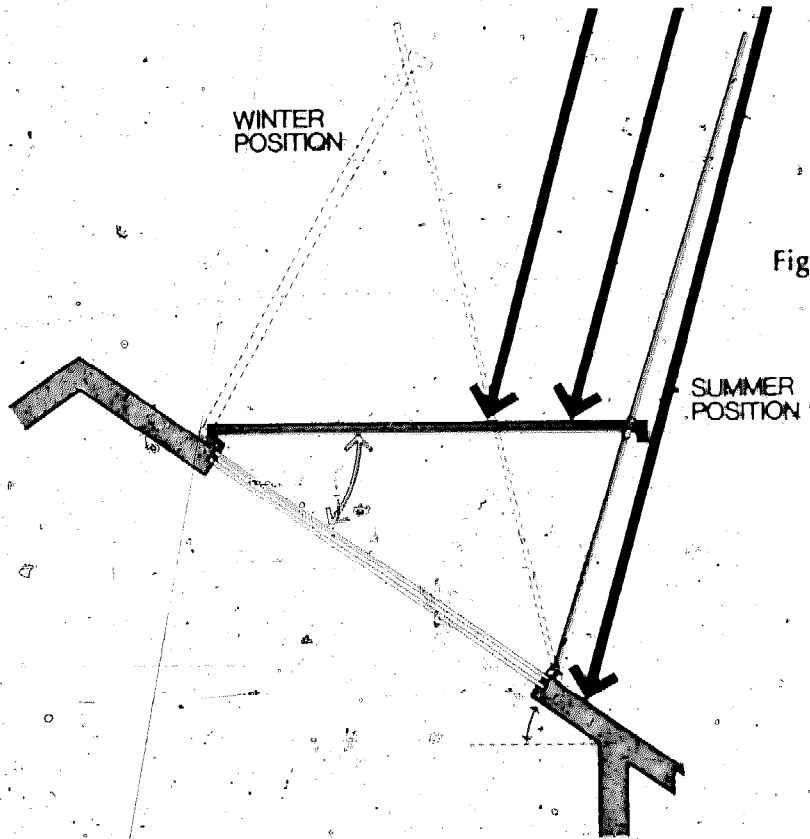


Fig. IV-24c: Adjustable reflector with a south-facing skylight.

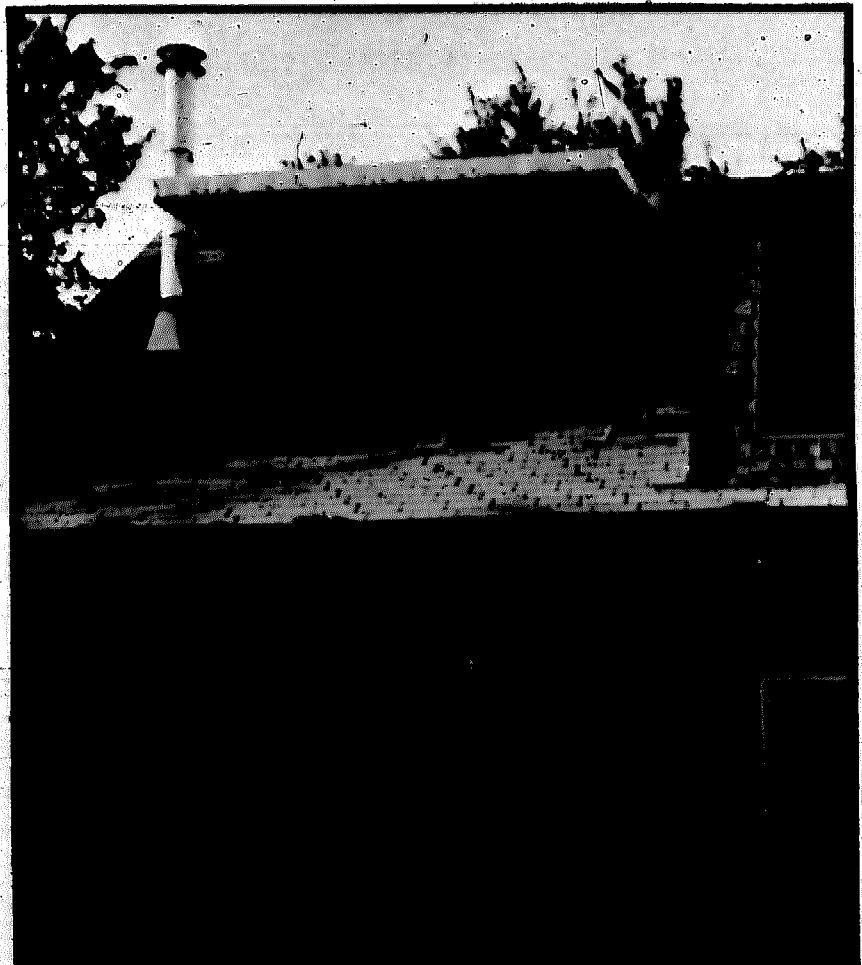

The Passive Solar Energy Book

water wall. Materials suitable for reflectors include shiny metals such as polished aluminum, thin metal foils, and glass or plastic mirrors. White-colored materials can be used but will not perform as well as polished surfaces. Care should be taken when using reflectors with windows because of possible glare.

Table IV-24b Normal Specular Solar Reflectance of Various Surfaces

Surface	Percentage of Specular Reflectance
Electroplated silver, new	0.96
High-purity aluminum, new, clean	0.91
Sputtered aluminum optical reflector	0.89
Brytal processed aluminum, high purity	0.89
Back-silvered water white plate glass, new, clean	0.88
Aluminum, silicon-oxygen coating, clean	0.87
Aluminum foil, 99.5% pure	0.86
Back-aluminized 3M acrylic, new	0.86
Commercial Alzac process aluminum (plastic w/ aluminum surface film)	0.85 *
Back-aluminized 3M acrylic, new	0.85 *
Aluminized Type C Mylar (from Mylar side)	0.76

NOTE: *Exposed to equivalent of 1 year solar radiation.

SOURCE: John A. Duffie and William A. Beckman, *Solar Energy Thermal Processes*.



25. Shading Devices

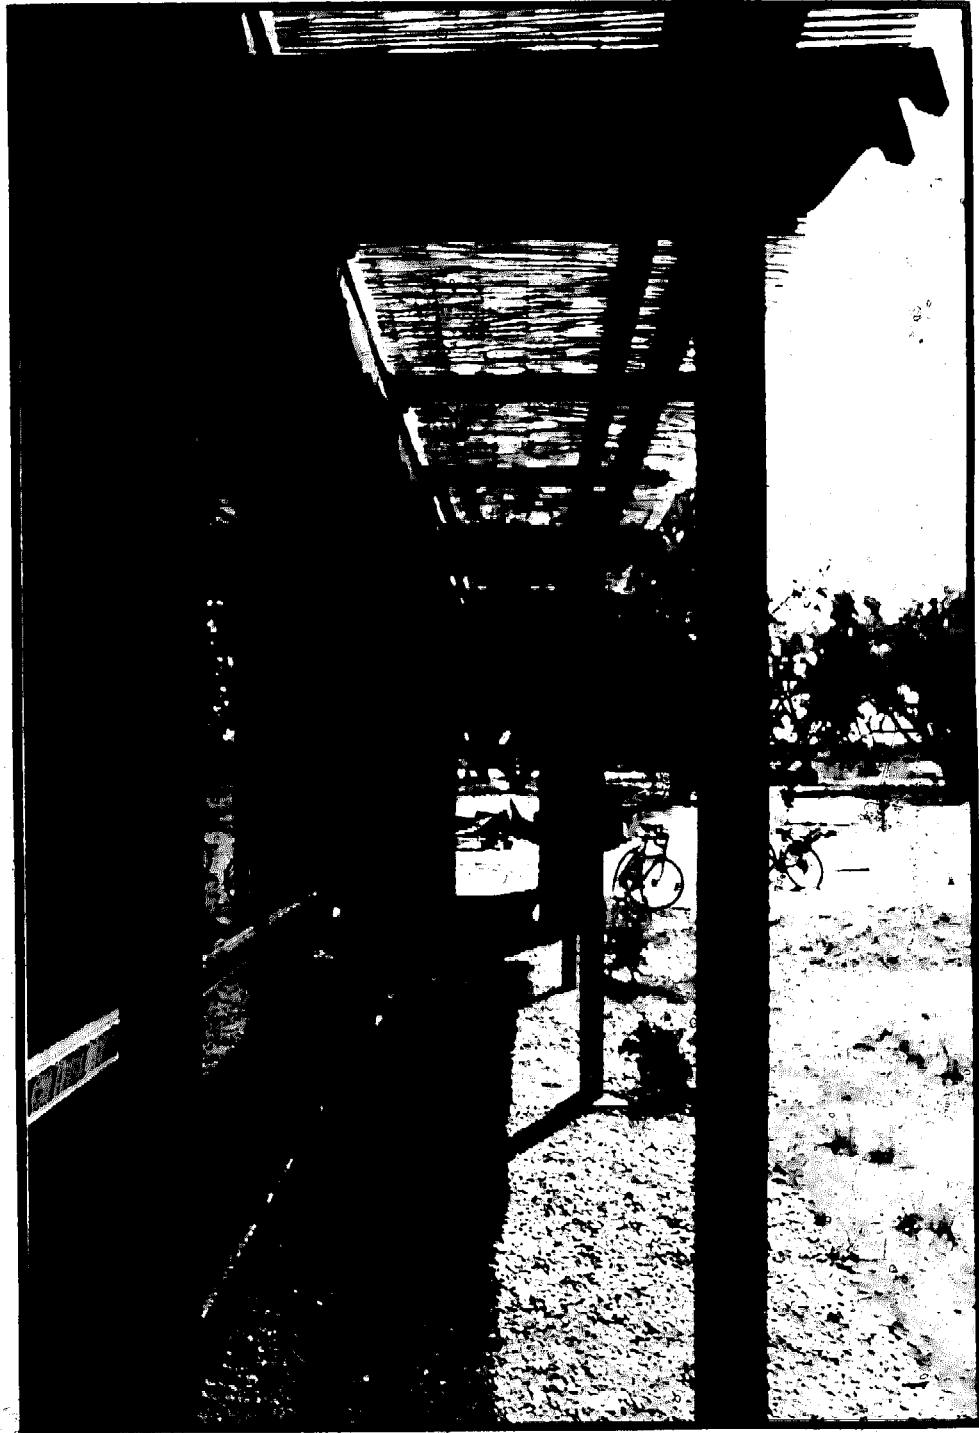


Photo IV-25a

25. Shading Devices

WINDOW LOCATION(6) calls for the major glass areas in the building to be oriented south. This pattern describes specific methods for shading these glass areas in summer.



Large south-facing glass areas, sized to admit maximum solar gain in winter, will also admit solar gain in summer when it is not needed. Although there is less sunlight striking south-facing vertical glass in summer, it is usually enough to cause severe overheating problems. Fortunately, by using an overhang with south glazing, summer sunlight can be effectively controlled. The effectiveness of any shading device, however, depends upon how well it shades the glass in summer without shading it in winter.

The Recommendation

Shade south glazing with a horizontal overhang located above the glazing and equal in length to roughly one-fourth the height of the opening in southern latitudes (36° NL) and one-half the height of the opening in northern latitudes (48° NL).



When possible, design shading devices to act as both REFLECTORS(24) to increase solar gain in winter, and as insulating shutters—MOVABLE INSULATION(23)—to reduce building heat loss.

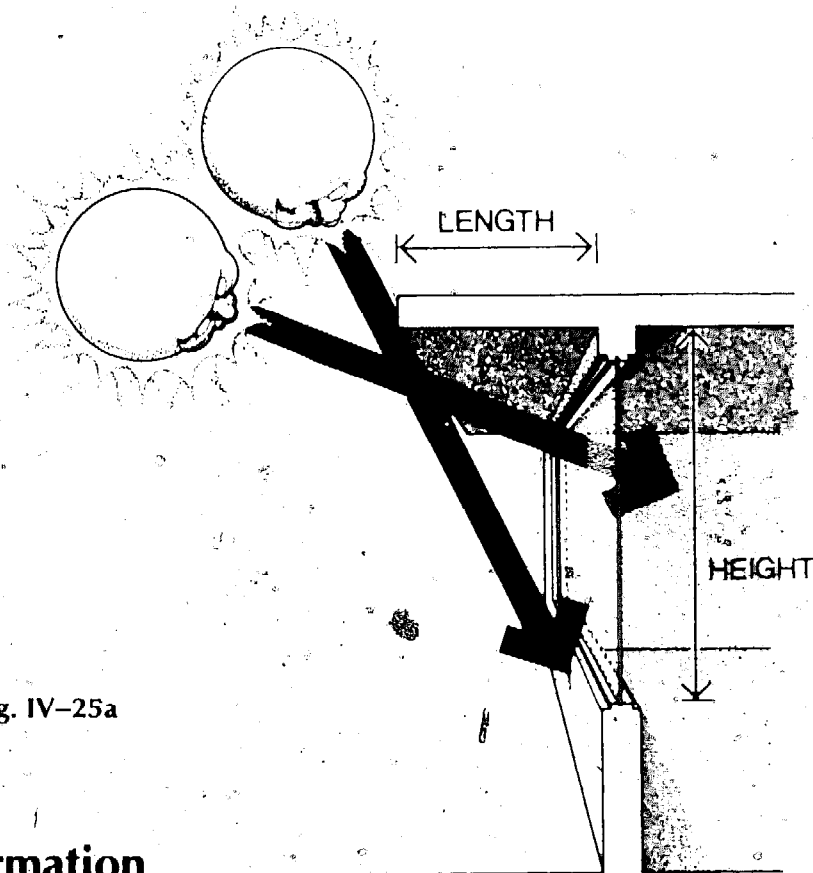


Fig. IV-25a

The Information

The most effective method for shading south-facing glass in summer is with an overhang. This shading device is simply a solid horizontal projection located at the top exterior of a window. The optimum projection of the overhang from the face of the building is dependent upon window height, latitude and climate. For example, the larger the opening (height) the longer the overhang. At southern latitudes (36°NL) the projection should be slightly smaller than at more northerly latitudes (48°NL), because the sun follows a higher path across the summer skydome. An overhang when tilted up will not only function as a shading device in summer, but also as a reflector in winter.

The following equation provides a quick method for determining the projection of a fixed overhang.

$$\text{Projection} = \frac{\text{window opening (height)}}{F}$$

where: F = factor from following table

The Passive Solar Energy Book

North Latitude	F Factor *
28°	5.6-11.1
32°	4.0- 6.3
36°	3.0- 4.5
40°	2.5- 3.4
44°	2.0- 2.7
48°	1.7- 2.2
52°	1.5- 1.8
56°	1.3- 1.5

NOTE: *Select a factor according to your latitude. The higher values will provide 100% shading at noon on June 21, the lower values until August 1.

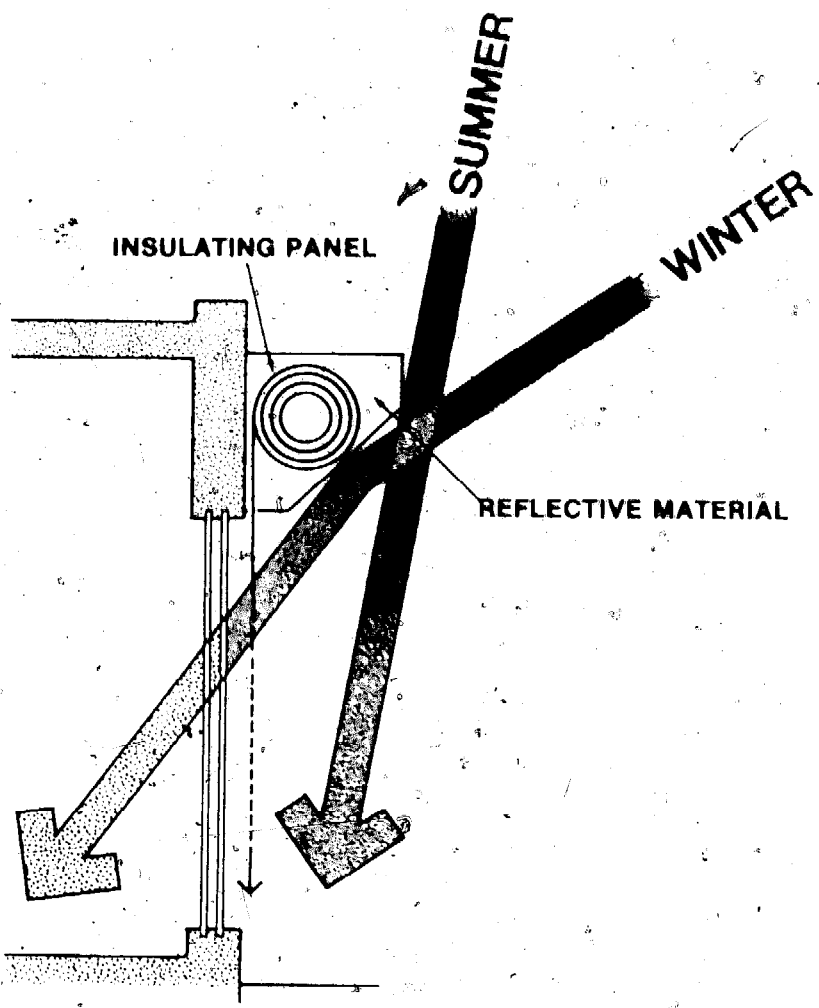


Fig. IV-25b: Overhang/reflector, Ike Williams Community Center in Trenton, New Jersey.

25. Shading Devices

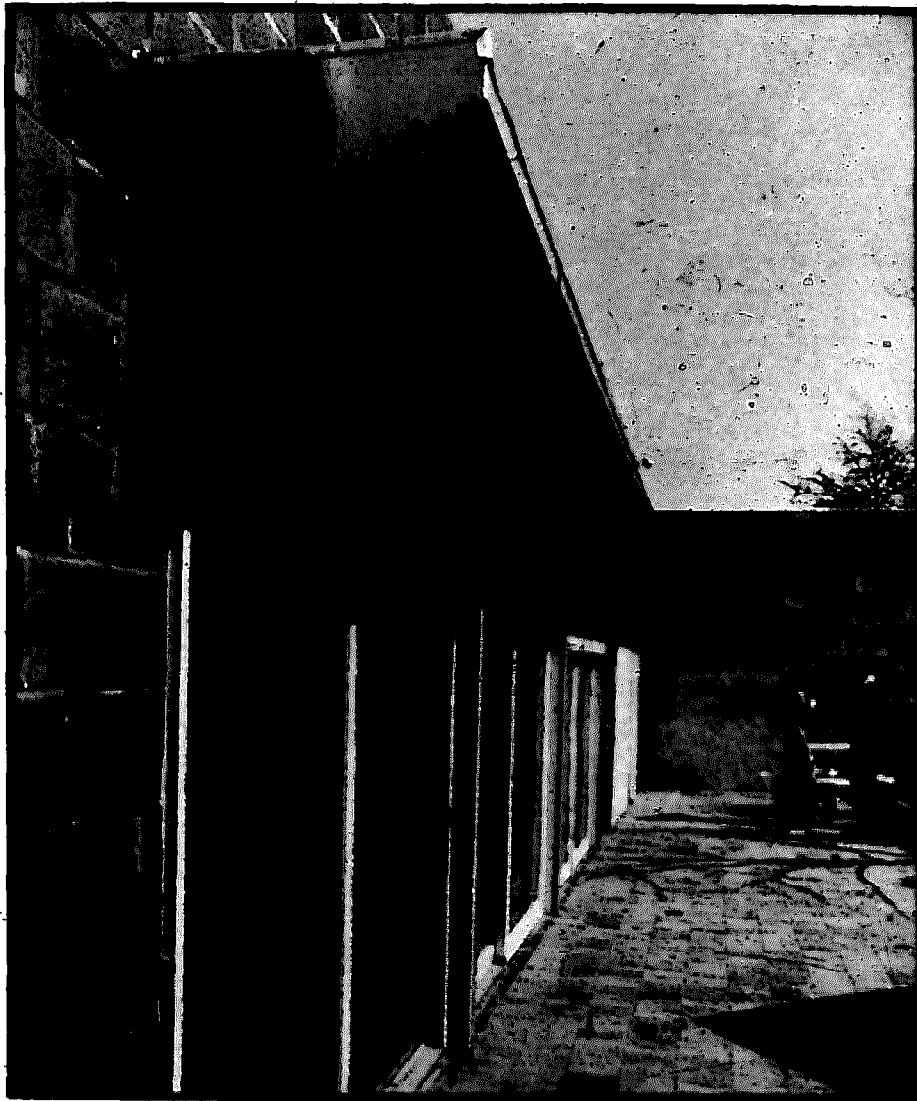


Photo IV-25b: Fixed overhang doubles as a reflector in winter.

A *fixed overhang*, however, is not necessarily the best solution for shading south-facing glass since climatic seasons do not correspond to the sun's movement across the sky. In the Northern Hemisphere, for instance, the middle of the summer climatic season does not coincide with the longest day of the year (June 21), nor the middle of the winter season with the shortest day (December 21). In most regions there is a time lag of at least a month. In addition, a fixed exterior shading device will provide the same shading on September 21, when the weather is warm, and on March 21 when it is cold. This happens because the sun's path across the sky is the same on those days. Adjustable overhangs provide a potentially better


The Passive Solar Energy Book

solution. They can be regulated seasonally, for example, to partially shade a window in September and then adjusted to admit full sunlight in March. However, these devices may be more expensive to build due to additional hardware. Also, they are sometimes difficult to design and maintain, and they require the correct seasonal adjustments to be effective.

Interior shading devices, such as roller shades, venetian blinds, drapes and panels, while not as effective in keeping sunlight from the building, offer ease of operation and maintenance. It should be noted that interior shading devices often eliminate, or severely limit, a view to the outside. A seasonal self-adjusting shading device for south glazing is a vine covered, trellised



Photo IV-25c: Trellised overhang shades in summer (here), but admits sunlight in winter (facing page).

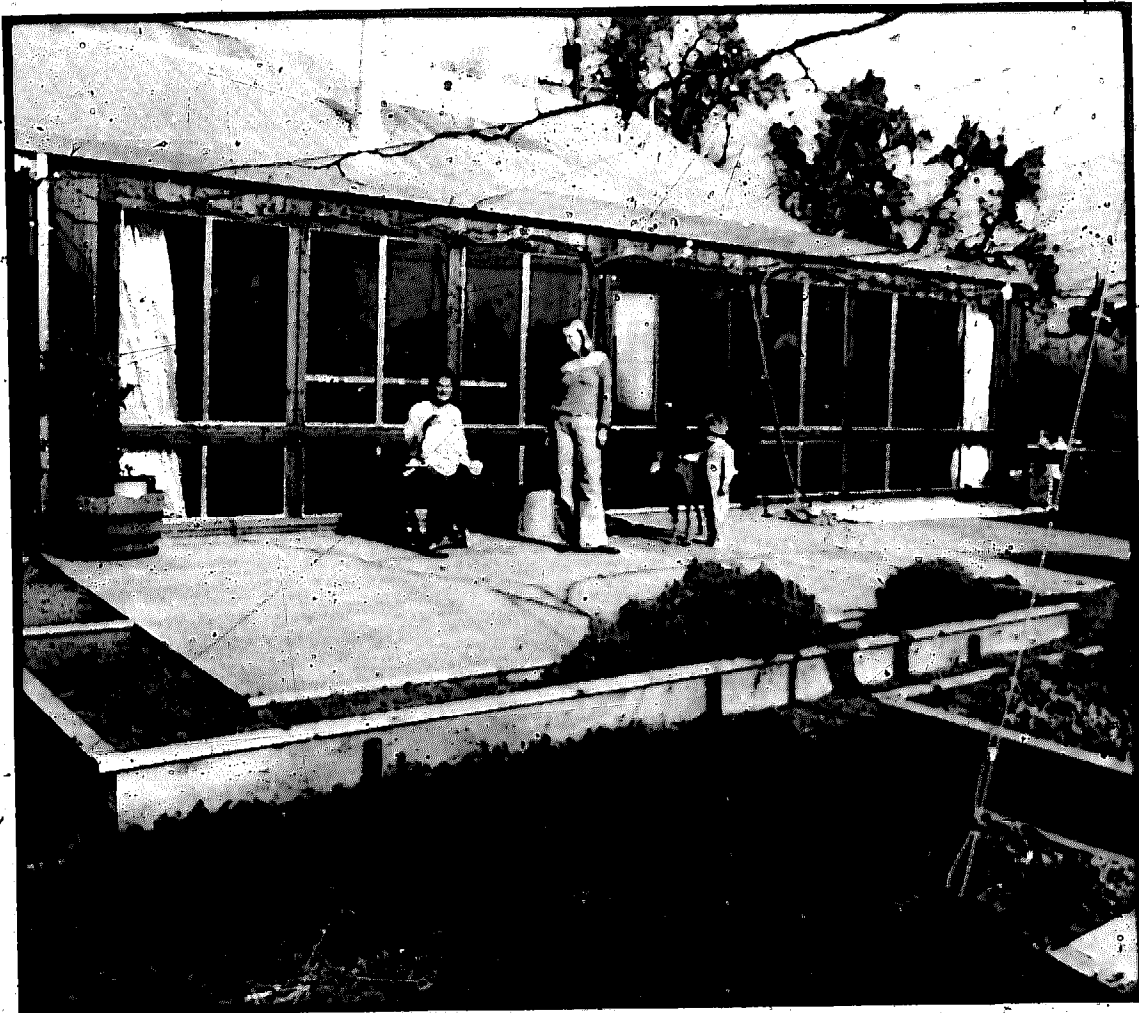

overhang. Since vegetation closely follows climatic rather than solar variations, a vine will be covered with leaves in summer and bare in winter. Care should be taken to periodically thin the vines so they do not grow too thick and shade the glazing in winter.

Overhangs do not provide adequate shading for east- and west-facing glass, whereas trees and tall hedges, when properly located, will block the low morning and late afternoon summer sun.

Adjustable vertical louvers and awnings or retractable exterior curtains are also effective methods of shading east and west glazing. Vertical louvers

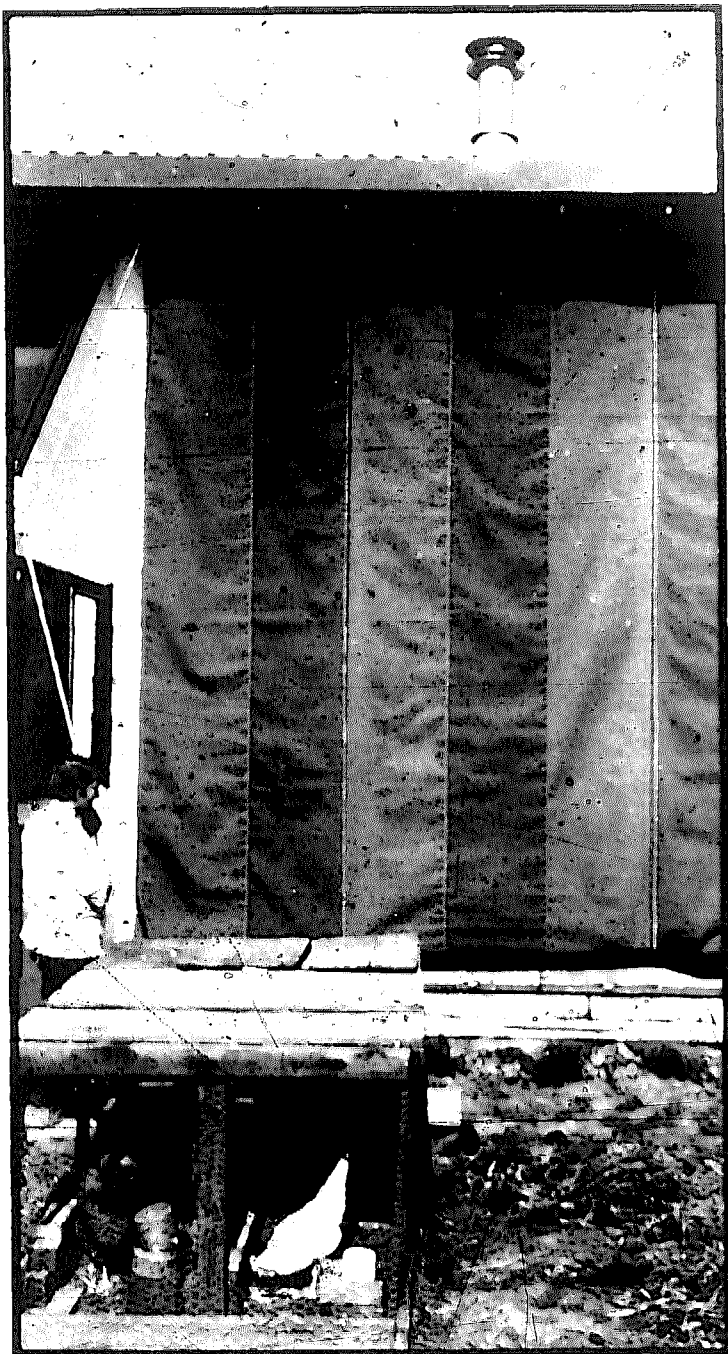


Photo IV-25d: 3
Manually operated system of the house



25. Shading Devices

- adjusted to face south will admit the afternoon winter sun, but when pivoted to face north, they shade the glazing from morning and afternoon summer sun. Perhaps a simpler and less expensive solution is an awning or exterior curtain set in front of the window. For a more complete explanation of shading device calculations, see "The Shading Calculator" in chapter 5.



26. Insulation on the Outside

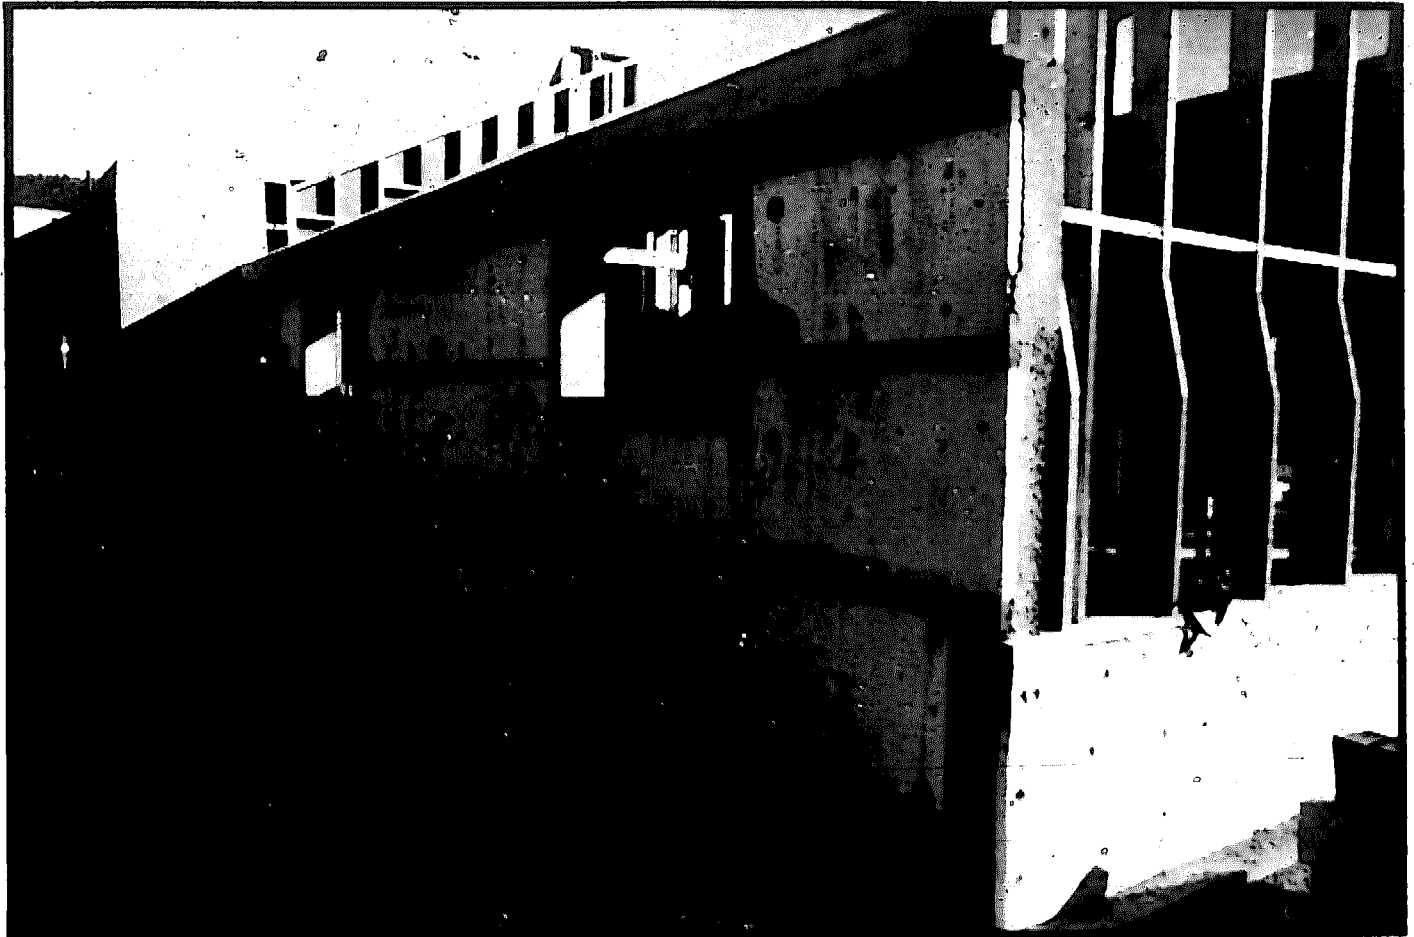


Photo IV-26a

26. Insulation on the Outside

This pattern completes MASONRY HEAT STORAGE(11) and INTERIOR WATER WALL(12). It describes methods for keeping heat stored in an interior thermal mass from escaping rapidly to the outside.



While good at storing heat, a masonry exterior wall used as a heat storage medium within a space will also readily pass this heat to the outside. Masonry materials such as brick, stone, concrete and adobe can store large amounts of heat. A masonry wall by itself, though, does not provide good insulation. For example, 3½ inches of fiberglass insulation has the insulating properties of 12 feet of concrete or 4 feet of adobe. In a Direct Gain System a large portion of the heat stored in an exposed masonry wall will be lost to the exterior.

The Recommendation

- When using a masonry wall (exposed to the exterior) for heat storage, place insulation on the outside of the wall. Also, at the perimeter of foundation walls, apply approximately 1½ to 2 feet of 2-inch rigid waterproof insulation below grade. This will prevent any heat stored in the walls and floor from being conducted rapidly to the outside.



Use locally available insulation made of recycled materials which consume small amounts of energy to manufacture—APPROPRIATE MATERIALS(8).

The Passive Solar Energy Book

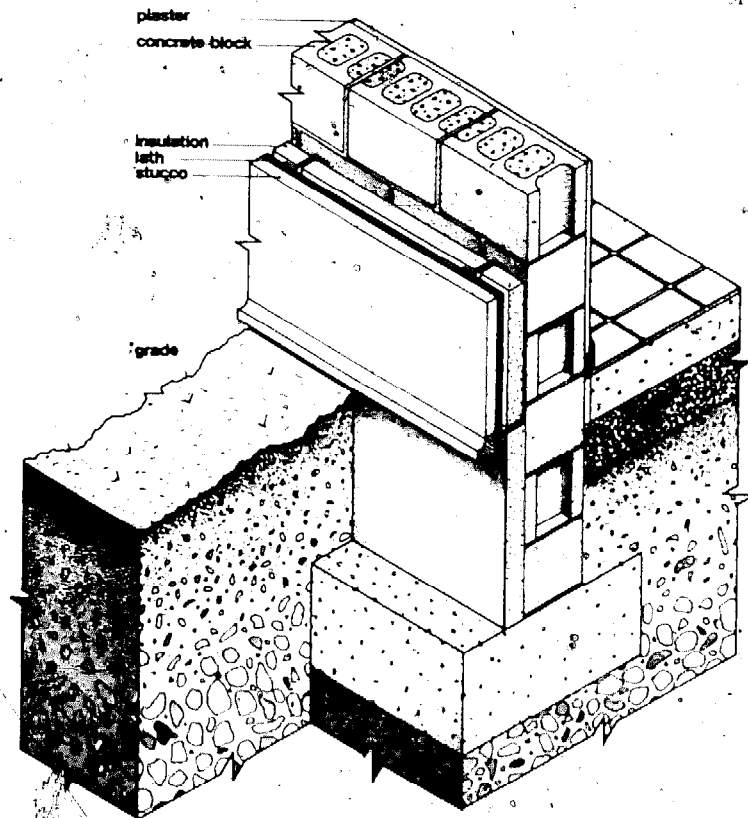


Fig. IV-26a

The Information

When used in standard masonry construction, insulation is customarily placed on the inside face of a wall, directly behind the interior finish, or within the cavity of a wall. However, to be effective for heat storage, masonry should not be insulated from the interior space and room air.

Therefore, when using masonry in an interior wall that also faces the exterior, place the insulation on the outside face of the wall. This keeps any heat stored in the wall *inside* the space. A masonry wall constructed in this way can absorb solar radiation during the day, store it as heat and release it to the space at night when needed.

There is one exception to this rule. In sunny temperate winter climates, south-facing masonry walls with a dark to medium-dark exterior surface color can be left uninsulated, since the south wall absorbs enough sunlight (heat) during the daytime to offset any heat flow out through the wall at night.

Insulation may be in the form of rigid boards applied directly to the wall, or batt insulation fastened between metal or wood studs. When placed on the exterior face of a wall, insulation should be protected from the weather and physical damage by applying stucco or siding.

26. Insulation on the Outside

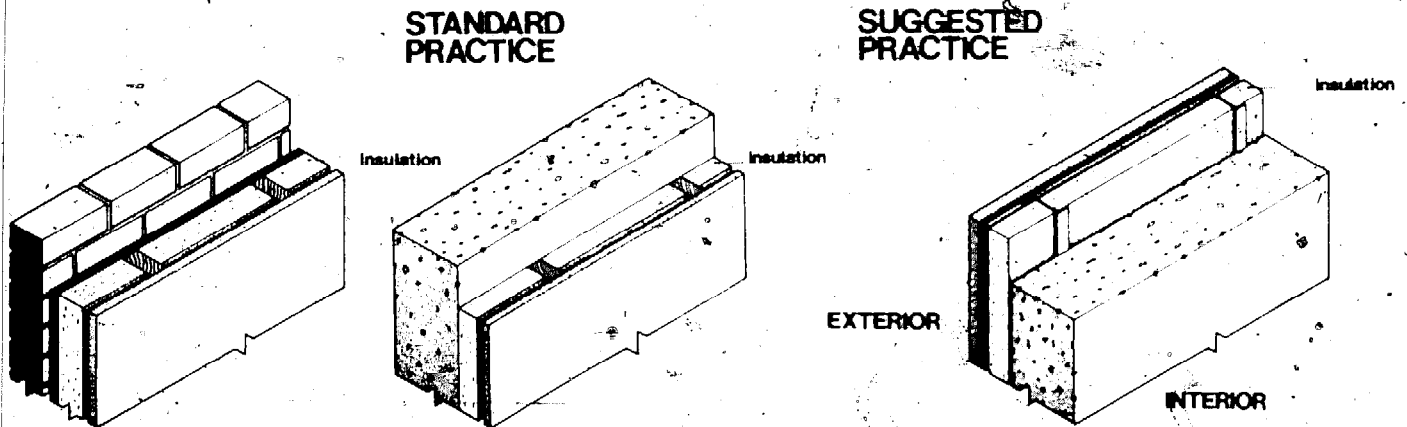


Fig. IV-26b: Insulation applications.

When considering a masonry floor as a heat storage medium, it is necessary to know whether placing insulation beneath the floor and at the perimeter is worthwhile. Dr. Francis C. Wessling, in a paper titled "Temperature Response of a Sunlit Floor and Its Surrounding Soil" concluded:

... calculations show the energy given up by the floor to the room differs by less than 10% regardless of the use of insulation. This indicates that the use of insulation beneath a 2-foot-thick floor is probably not warranted. The perimeter insulation does not affect the energy given up by the floor to the room either. However, the perimeter insulation does decrease the total house heating load.

The placement of perimeter insulation has an effect on the building's performance. According to the study:

The soil floor with 24 inches of perimeter insulation appears to perform better than the 6-inch concrete floor with side and bottom insulation.*

In dry climates, it is apparent that insulation beneath a floor slab is not advantageous, however, insulation beneath a masonry floor in wet climates is probably advantageous.



*Wessling et al., *Passive Solar Heating and Cooling Conference and Workshop Proceedings* (Springfield, Va.: National Technical Information Service, 1976), pp. 73-78.

27. Summer Cooling

While simultaneously deciding on the placement of windows for winter solar heat gain—WINDOW LOCATION(6)—thought must be given to the location of openings for summer breeze penetration.



The opportunity to utilize a passive system for summer cooling is often overlooked since the major emphasis of passive building design is on keeping warm in winter. There are essentially two elements in every passive solar building, south-facing glazing for heat gain and thermal mass for heat storage. These elements, when properly designed, have the potential to provide both heating and cooling in climates with cool or cold winters and warm summers. When design considerations for summer cooling are neglected, the glazing and thermal mass can work to increase heat gain and storage at a time when it is not wanted, causing extremely uncomfortable interior conditions.

The Recommendation

Make the roof a light color or reflective material. In climates with hot-dry summers:

1. Open the building up at night (operable windows or vents) to ventilate and cool interior thermal mass.
2. Arrange large openings of roughly equal size so that inlets face the prevailing nighttime summer breezes and outlets are located on the side of the building directly opposite the inlets or in the low pressure areas on the roof and sides of the building.
3. Close the building up during the daytime to keep the heat out.

In climates with hot-humid summers:

1. Open the building up to the prevailing summer breezes during the day and evening.
2. Arrange inlets and outlets as outlined above, only make the area of the outlets slightly larger than the inlets.

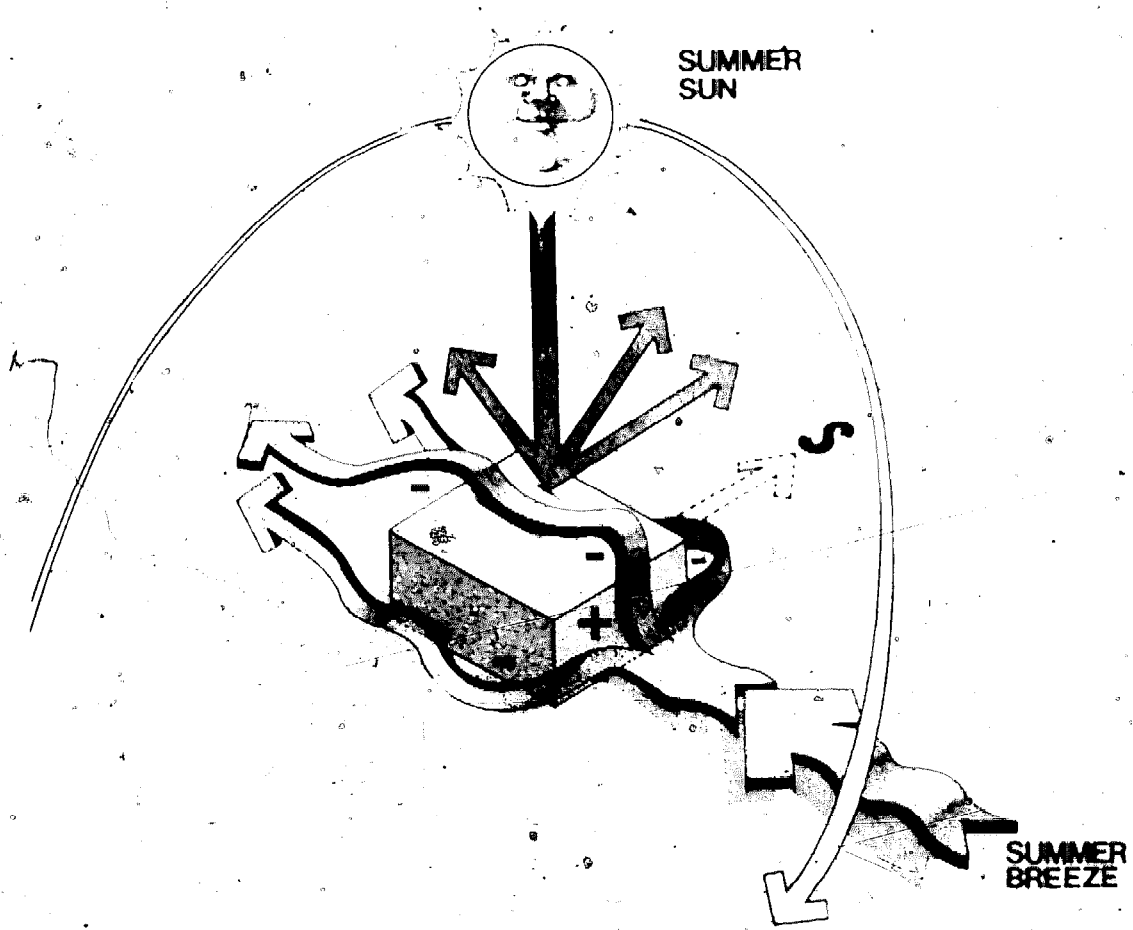


Fig. IV-27a

+ = HIGH PRESSURE (inlet)
 - = LOW PRESSURE (outlet)

Shade all glazed openings in summer—SHADING DEVICES(25)—and selectively plant vegetation for both wind protection in winter and shading in summer.

The Information

Building requirements for summer cooling are dependent on summer climatic conditions. There are essentially two distinct conditions: hot-dry and hot-humid.

Hot-Dry

Design for solar heating and summer cooling in a climate with cold winters and hot-dry summers is compatible. This climate is also characterized by high daytime and low nighttime (comfortable) temperatures in summer. The large daily temperature fluctuation indicates intensive solar radiation during the day and strong outgoing radiation (clear skies) at night. These conditions necessitate shading, reflective surface colors, insulation and masonry construction to reduce and delay solar and convective heat gains during the day, and nighttime cooling of thermal mass by either ventilation or nightsky radiation.

Shading—The first line of heat control begins at the exterior of a building where both trees and SHADING DEVICES(25) are needed to keep out the sun in summer. Trees help to moderate temperatures near the ground under the tree and when properly located are effective in intercepting solar radiation before it reaches east- and west-facing windows and walls. If a building is well shaded in summer then heat gain will be limited primarily to the conduction of heat through the skin of the building.

Surface Color—The next line of heat control lies at the skin of a building. Surfaces which reflect rather than absorb radiation and which readily reradiate the thermal energy that is absorbed will reduce the amount of heat transmitted to the interior. Conflict arises when both dark colors for maximum solar absorption in winter and light colors or polished surfaces for minimum absorption in summer are desired. Architecturally, by taking advantage of the sun's seasonal paths, this conflict can be solved. The south facade, made a medium or dark color, will absorb low south winter sunlight and the roof, made a light color or shiny material, will reflect the high summer sun. To arrive at the most effective surface finish or color for east- and west-facing walls, it is necessary to weigh the length and intensity of each season. For example, long hot summers and mild winters indicate the need for reflective and light-colored finishes, while long cold winters and mild summers indicate medium or dark surface colors.

27. Summer Cooling

Insulation and Masonry Construction—All exterior heat impacts must pass through the skin of a building before affecting indoor temperatures. As heat flows through a material it is both slowed in time from reaching the interior and reduced in intensity. Both these characteristics of materials can be utilized to create comfortable indoor summer conditions.

- First, the transfer of heat through walls and roof can be slowed down so it reaches the interior in the evening when outdoor air temperatures are cool and the building can be kept comfortable by natural or mechanical ventilation. This delay is called the "time lag" property of a material. Materials with large time lags, such as concrete, brick and stone, usually have dense and massive properties. And second, insulating materials placed on the exterior face of masonry construction will insure that only a small portion of the exterior heat impact is conducted through the skin into the building.

It is evident that the requirements for a Direct Gain System with masonry heat storage are essentially the same as those needed for summer cooling. Summer cooling in this climate is also possible with other passive solar heating systems since each has interior thermal mass for heat storage, even those constructed of lightweight materials, i.e., a wood frame building with an interior water wall. In summer, the mass, cooled throughout the evening by either natural or mechanical ventilation, or by night sky radiation (Roof Pond System), absorbs heat and provides cool interior surfaces during the daytime. In essence, the passive system works in reverse. The building is opened up at night, when outdoor temperatures are low, to cool the interior thermal mass, then closed up during the day to keep the heat out and retain cool interior mass surface and air temperatures.

Ventilation—The natural forces for moving air through a building are wind and the temperature difference between indoor and outdoor air or the "stack effect." In considering natural wind forces for summer ventilation, it is essential to know the direction of the prevailing summer breezes, daily variations and possible wind interference by nearby buildings, trees and hills.

When locating openings for night ventilation, place inlet openings (operable windows, vents) on the side of the building facing directly into the prevailing wind, and outlets on the side opposite the wind or in the low pressure areas on the roof and sides of the building. Large openings placed in this manner will give optimum results. The largest airflow per unit area of opening is obtained when inlets and outlets are equal in size. Increasing the area of the

The Passive Solar Energy Book

outlets (relative to the inlets) increases airflow but not in proportion to the additional area.

The temperature difference between warm indoor air and cooler outdoor air will cause a stack effect. Warm air rises out through openings located high in a space while simultaneously drawing in cooler outdoor air through openings located low in the space. The larger the temperature difference between indoor and outdoor air, the greater the height between inlets and outlets, and the larger the openings, the greater will be the flow of air. When natural ventilation is not possible, other methods of inducing airflow include wind-driven and mechanical fan systems.

Hot-Humid

Locations in hot-humid climates are characterized by high daytime and nighttime temperatures. There is very little outdoor temperature fluctuation over the day. Indoor comfort in this climate is largely dependent upon the control of radiant heat gain and air movement. These requirements call for effective shading, light-colored exterior surfaces and reflective materials, and well-insulated construction. Since outdoor air temperatures do not cool down substantially at night, cooling is accomplished by moving a sufficient quantity of air past the body to ensure the rapid evaporation of sweat from the skin. To provide for adequate air movement follow the suggestions for natural ventilation outlined above. The most effective cooling takes place with a high velocity of airflow. This can be accomplished by making the area of outlet openings larger than the inlets.

Since interior thermal mass has little effect on indoor temperatures in this climate, it is necessary to weigh the length and intensity of the various seasons in order to develop a design that makes an integrated solution possible. For example, a Roof Pond System with evaporative cooling can provide both heating in winter and cooling in climates with long hot-humid summers.



V The Tools

The Sun Charts

How the Sun Works


For our purposes, it is convenient to assume that the earth is stationary and the sun is in motion around the earth. Figure V-1 lists the angle (declination) of the sun above (+) or below (-) the equator, on the twentieth of each month, as seen from the earth. From the Northern Hemisphere, you can see that the sun lingers at its highest position in the sky for three months during the summer, then moves very quickly through fall towards winter, where it appears low in the sky for another three months.

In order to understand and be responsive to the effects of the sun on the location and design of places, it is necessary to know, at any given moment, the sun's position in the sky. This information is necessary in order to calculate solar heat gain, and to locate buildings, outdoor spaces, interior room arrangements, windows, shading devices, vegetation and solar collectors.

The Cylindrical Sun Chart

The Cylindrical Sun Chart, which is developed here, provides an easy-to-understand and convenient way to predict the sun's movement across the sky as seen from any point in the world between 28° and 56°NL. The chart is a vertical projection of the sun's path as seen from earth. It could be said, then, that the Sun Chart is an earth-based view of the sun's movement across the skydome.

The Passive Solar Energy Book

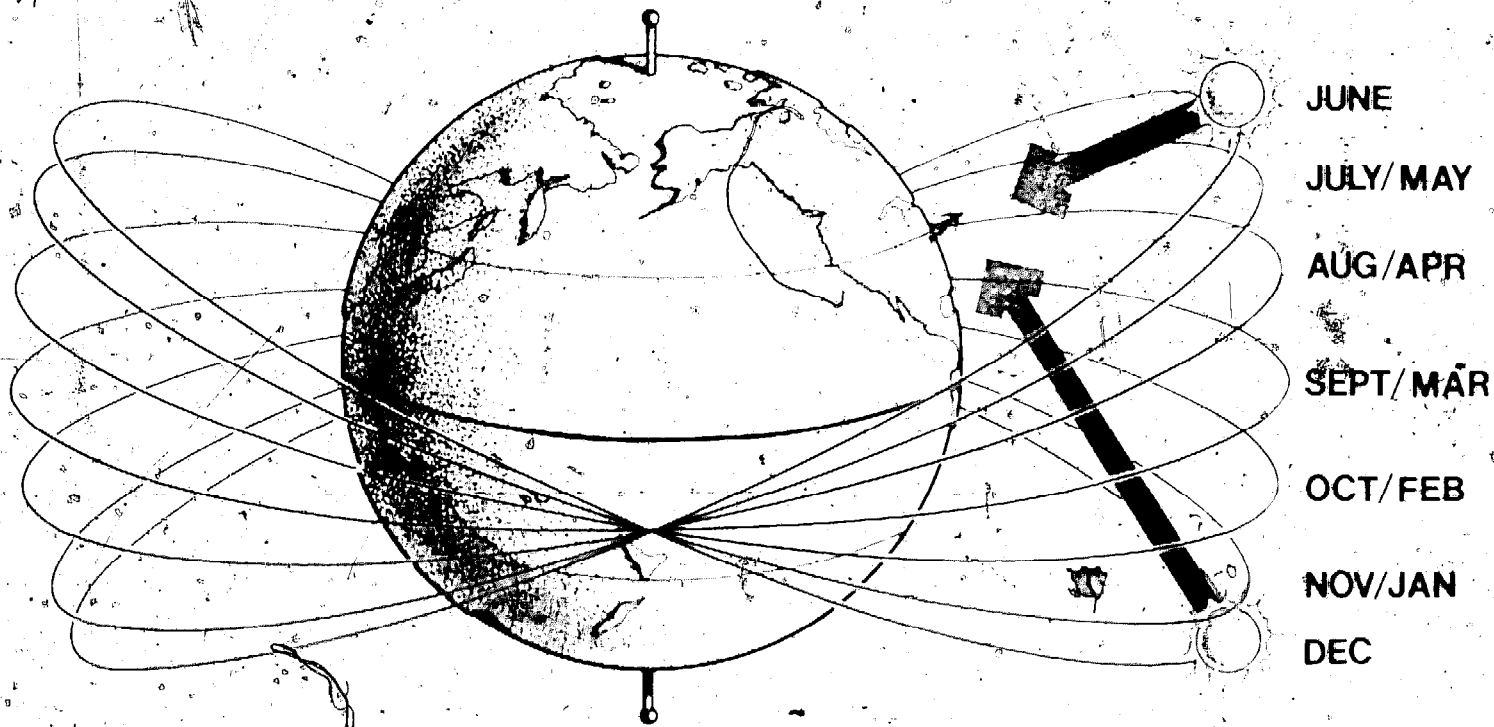

The table below lists approximately how far above or below the equator the sun is on the twentieth day of each month.

20th of	Degrees
Jan.	-20
Feb.	-11
Mar.	0
Apr.	11
May	20
June	23
July	21
Aug.	13
Sept.	1
Oct.	-10
Nov.	-20
Dec.	-23

Fig. V-1: The sun as it appears from earth on the twentieth day of each month.

The Tools

The following sequence is a description of how a sun chart is developed. It is included here to provide you with a visual understanding of the sun's movement across the skydome.

Two coordinates are needed to locate the position of the sun in the sky. They are called the *altitude* and *azimuth* (also called the bearing angle).

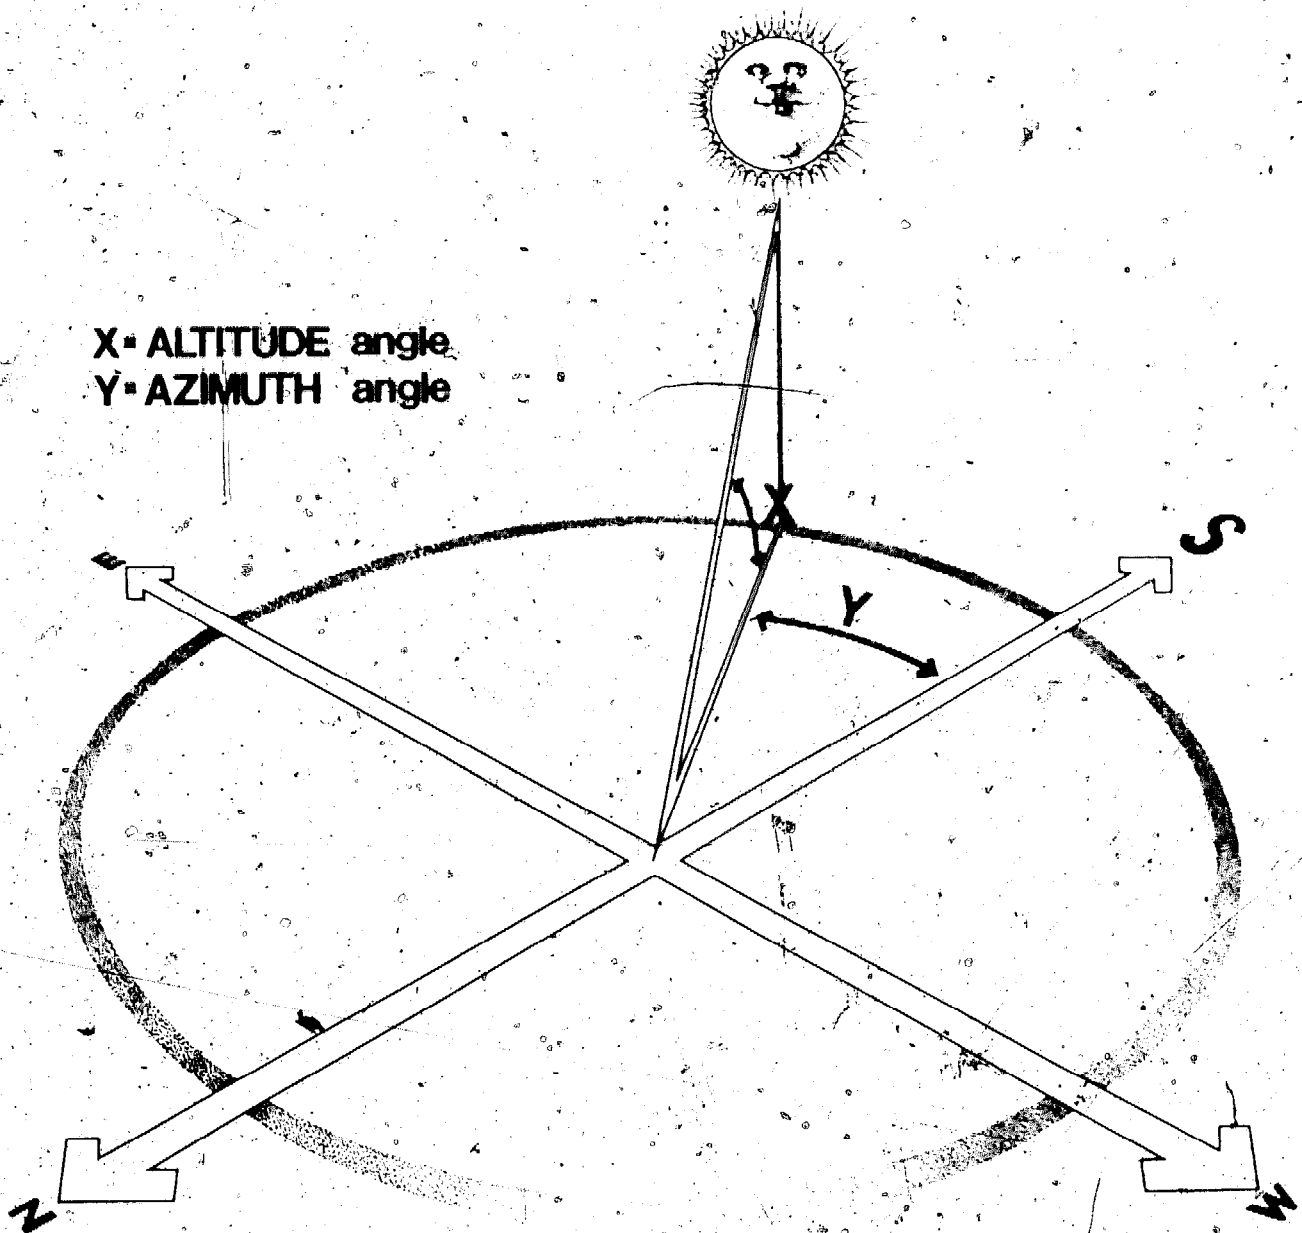


Fig. V-2: Altitude and azimuth angles.

The Passive Solar Energy Book

Altitude

Solar altitude is the angle measured between the horizon and the position of the sun above the horizon. The horizontal lines on the chart represent altitude angles in 10° increments above the horizon.

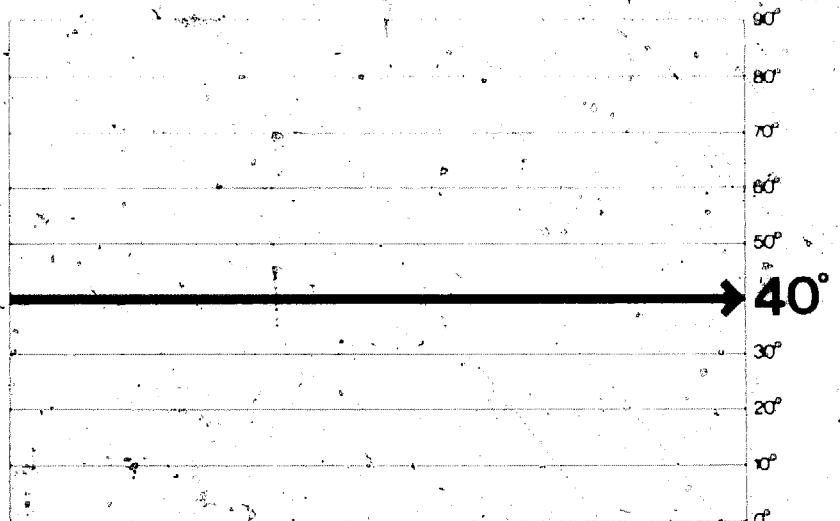
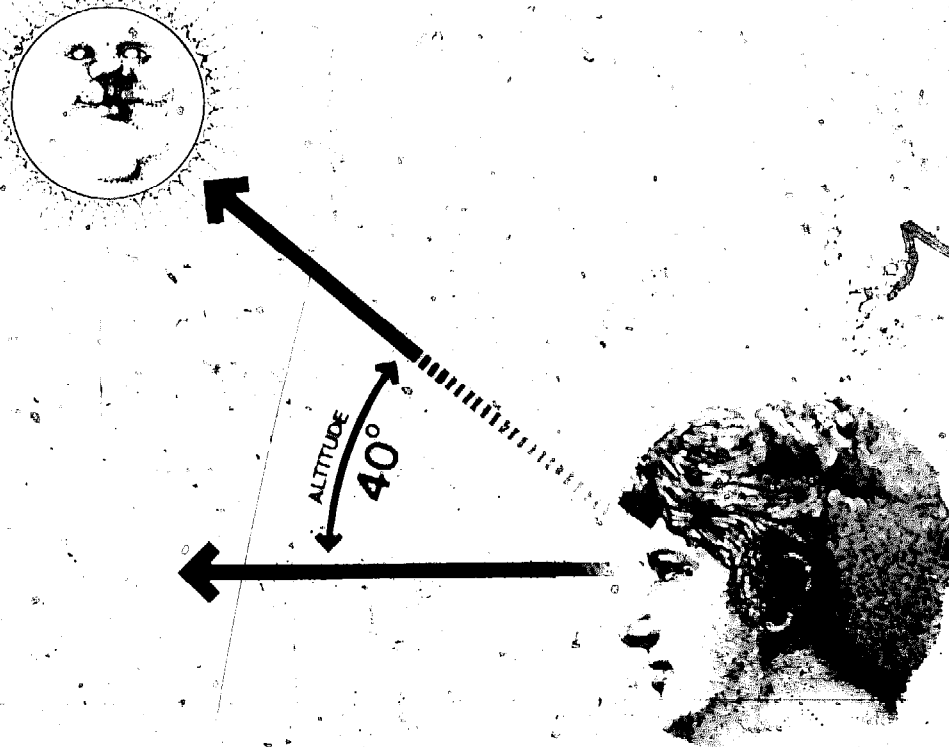


Fig. V-3: Altitude angle.

Azimuth (bearing angle)

Solar azimuth is the angle along the horizon of the position of the sun, measured to the east or west of true south.

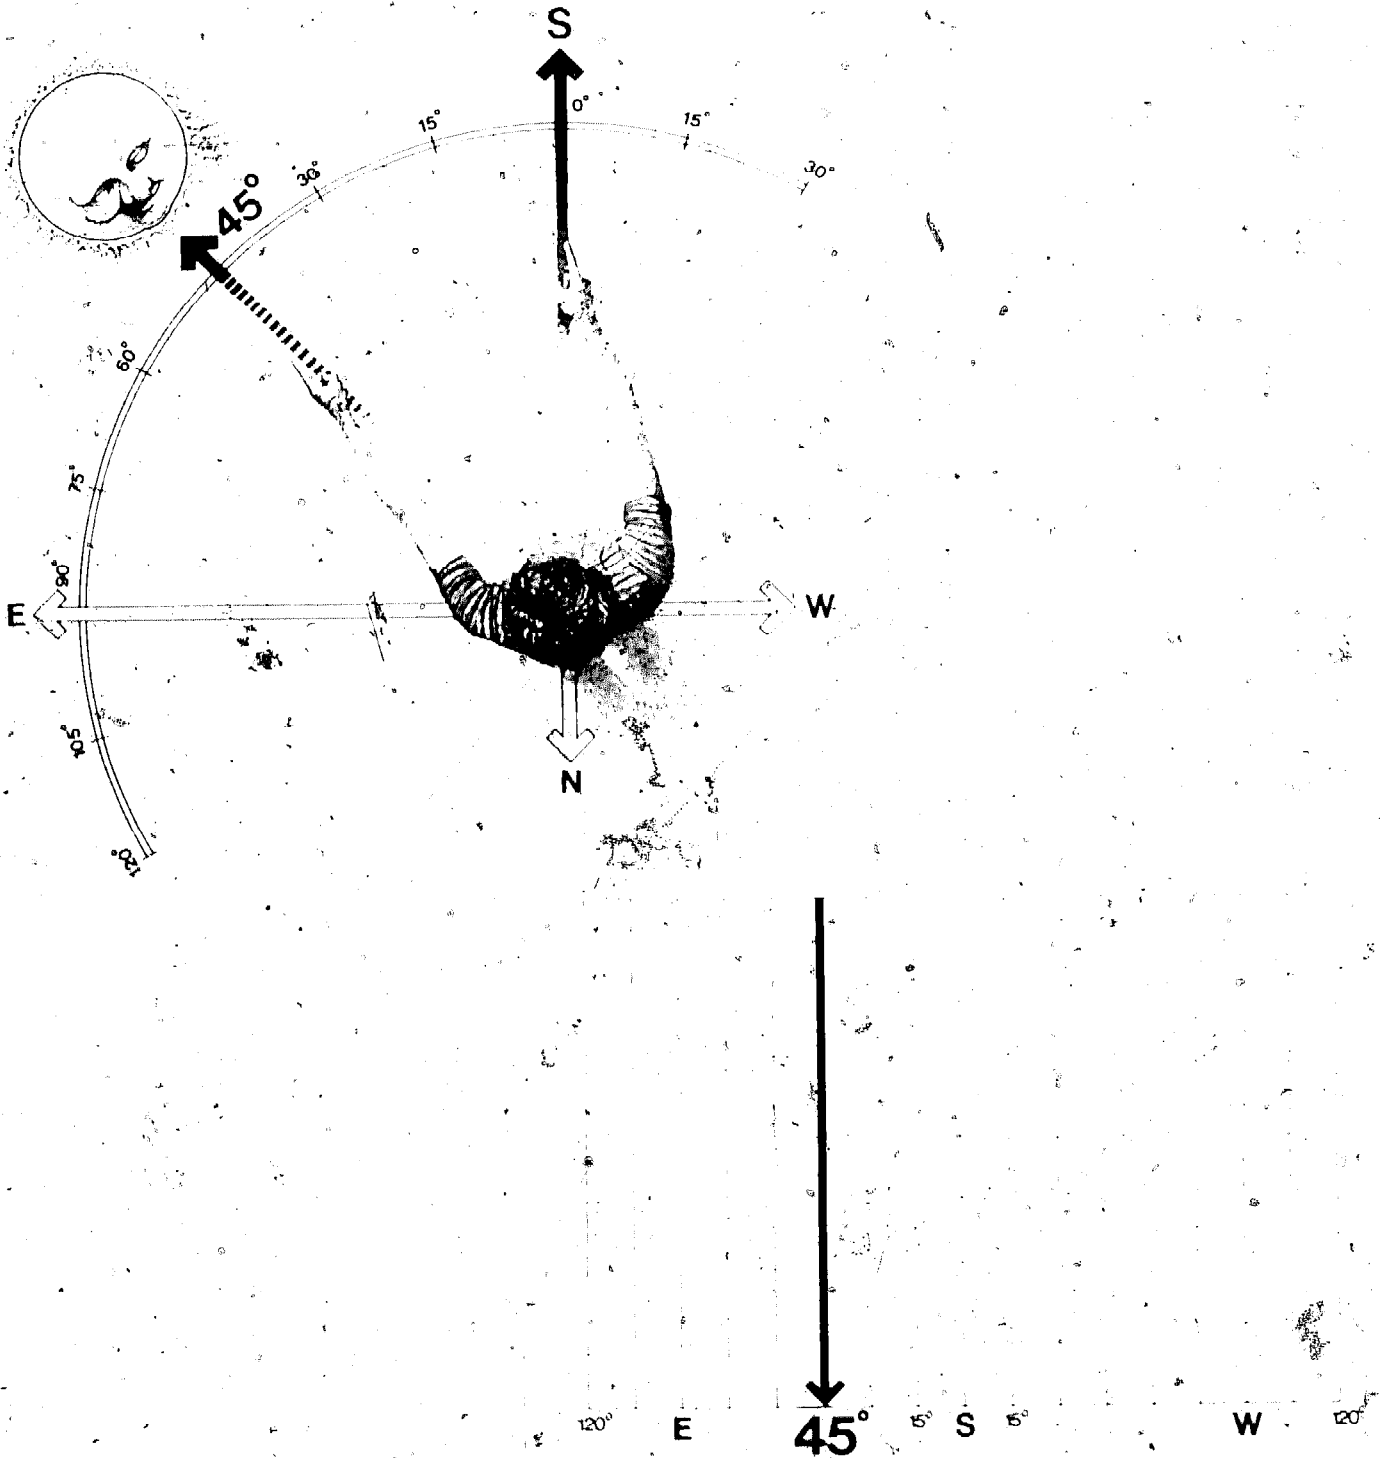


Fig. V-4: Azimuth angle.

The Passive Solar Energy Book

Skydome (sky vault)

The skydome is the visible hemisphere of sky, above the horizon, in all directions. The grid on the chart represents the vertical and horizontal angles of the whole skydome. It is as if there were a clear dome around the observer, and then the chart were peeled off of this dome,* stretched out and laid flat.

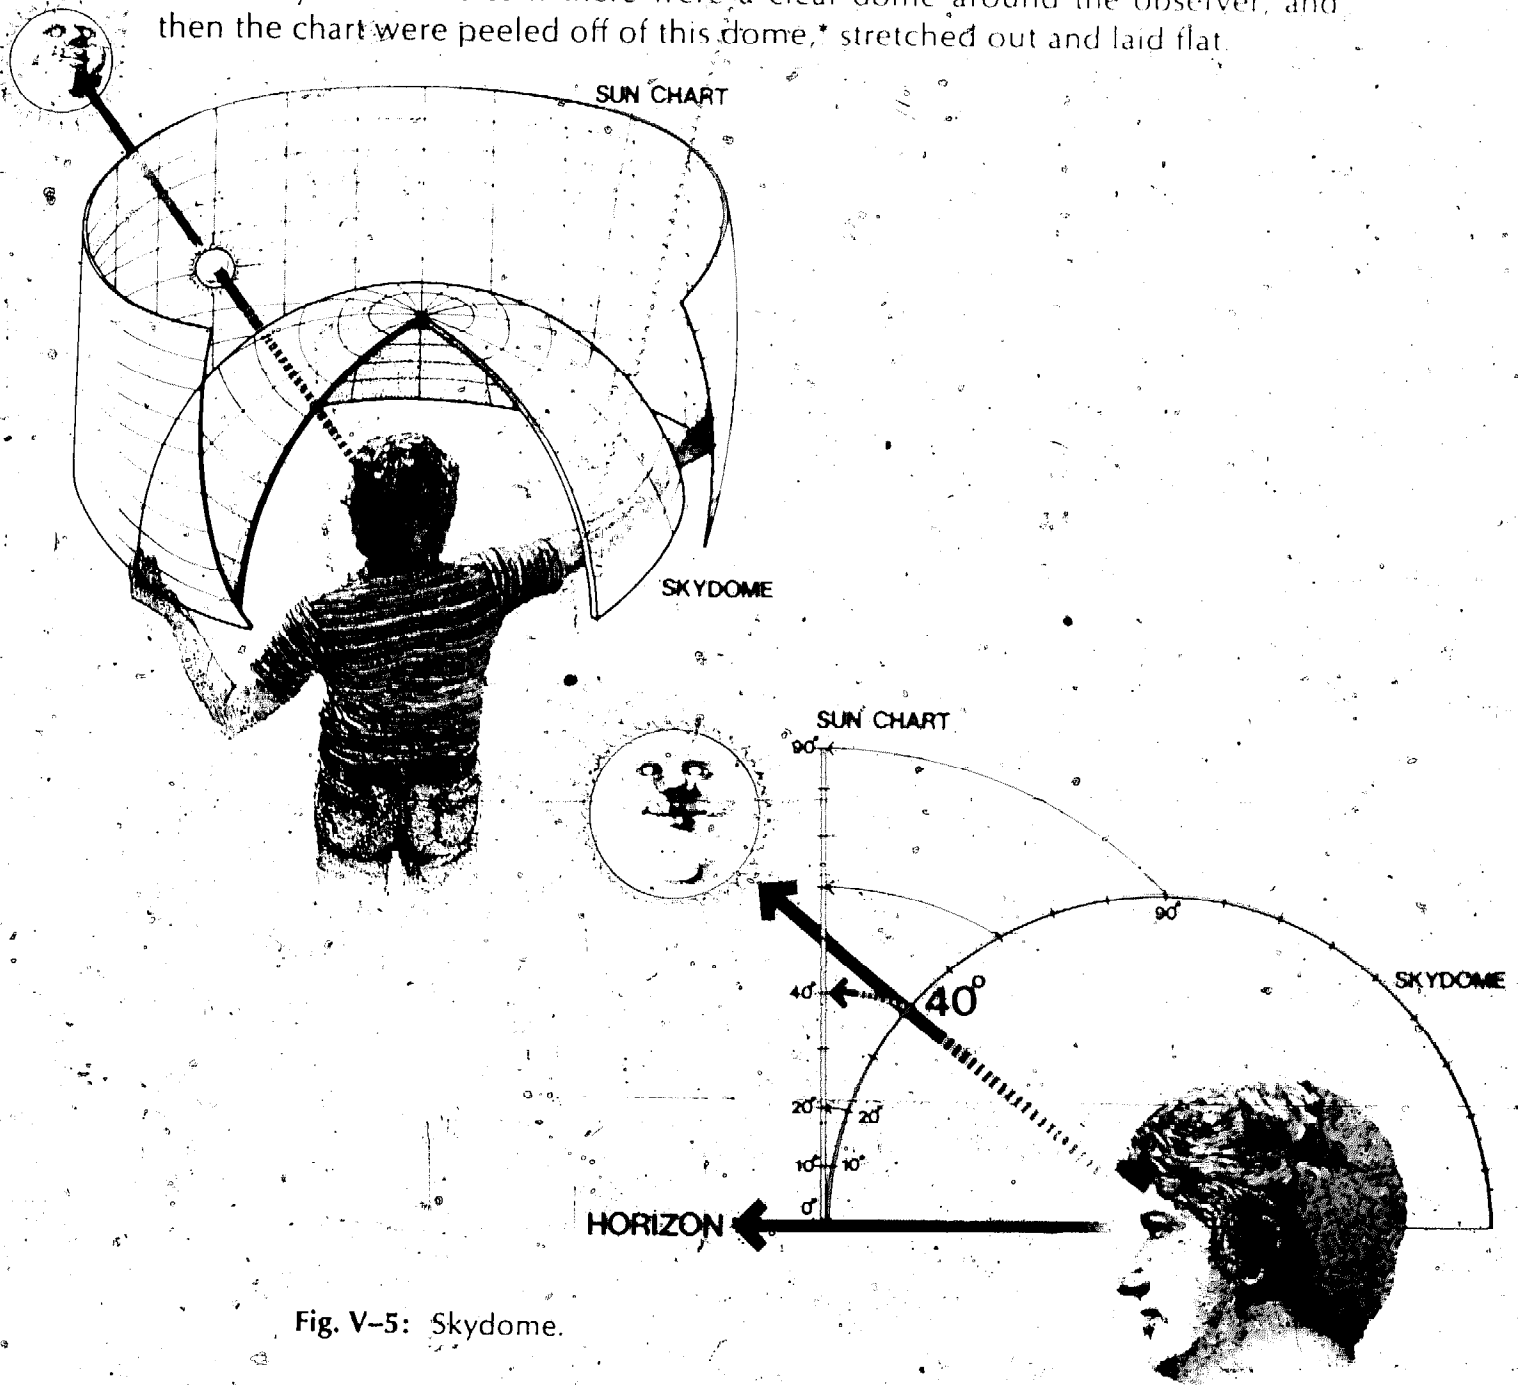


Fig. V-5: Skydome.

*In reality this is not possible. The intention of the illustration is to present you with a visual image of the skydome projected onto a flat sheet.

Sun's Position

Once the altitude and azimuth angles are known, the sun can be located at any position in the sky.

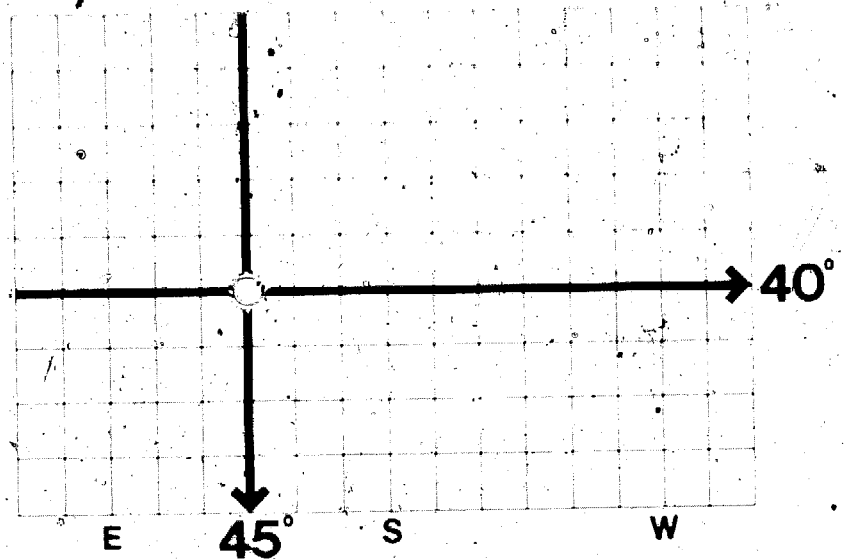
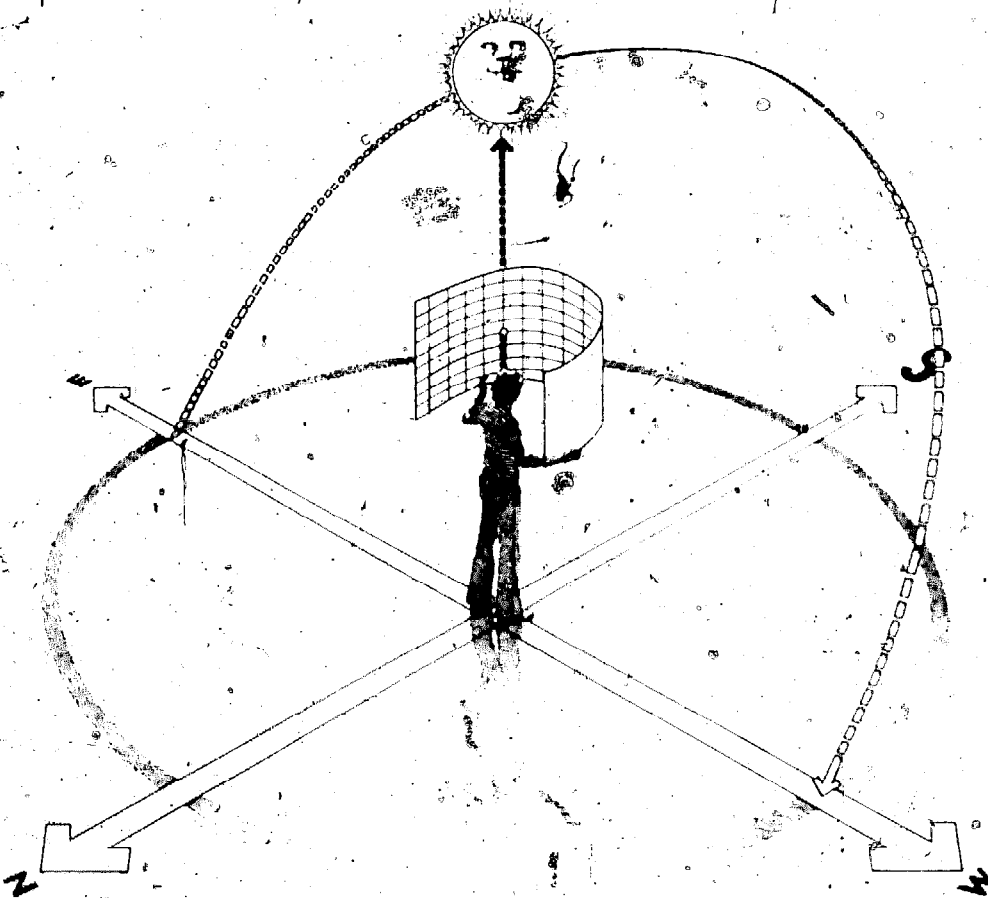


Fig. V-6: Sun's position.

The Passive Solar Energy Book

Sun's Path

By connecting the points of the location of the sun, at different times throughout the day, the sun's path for that day can be drawn.

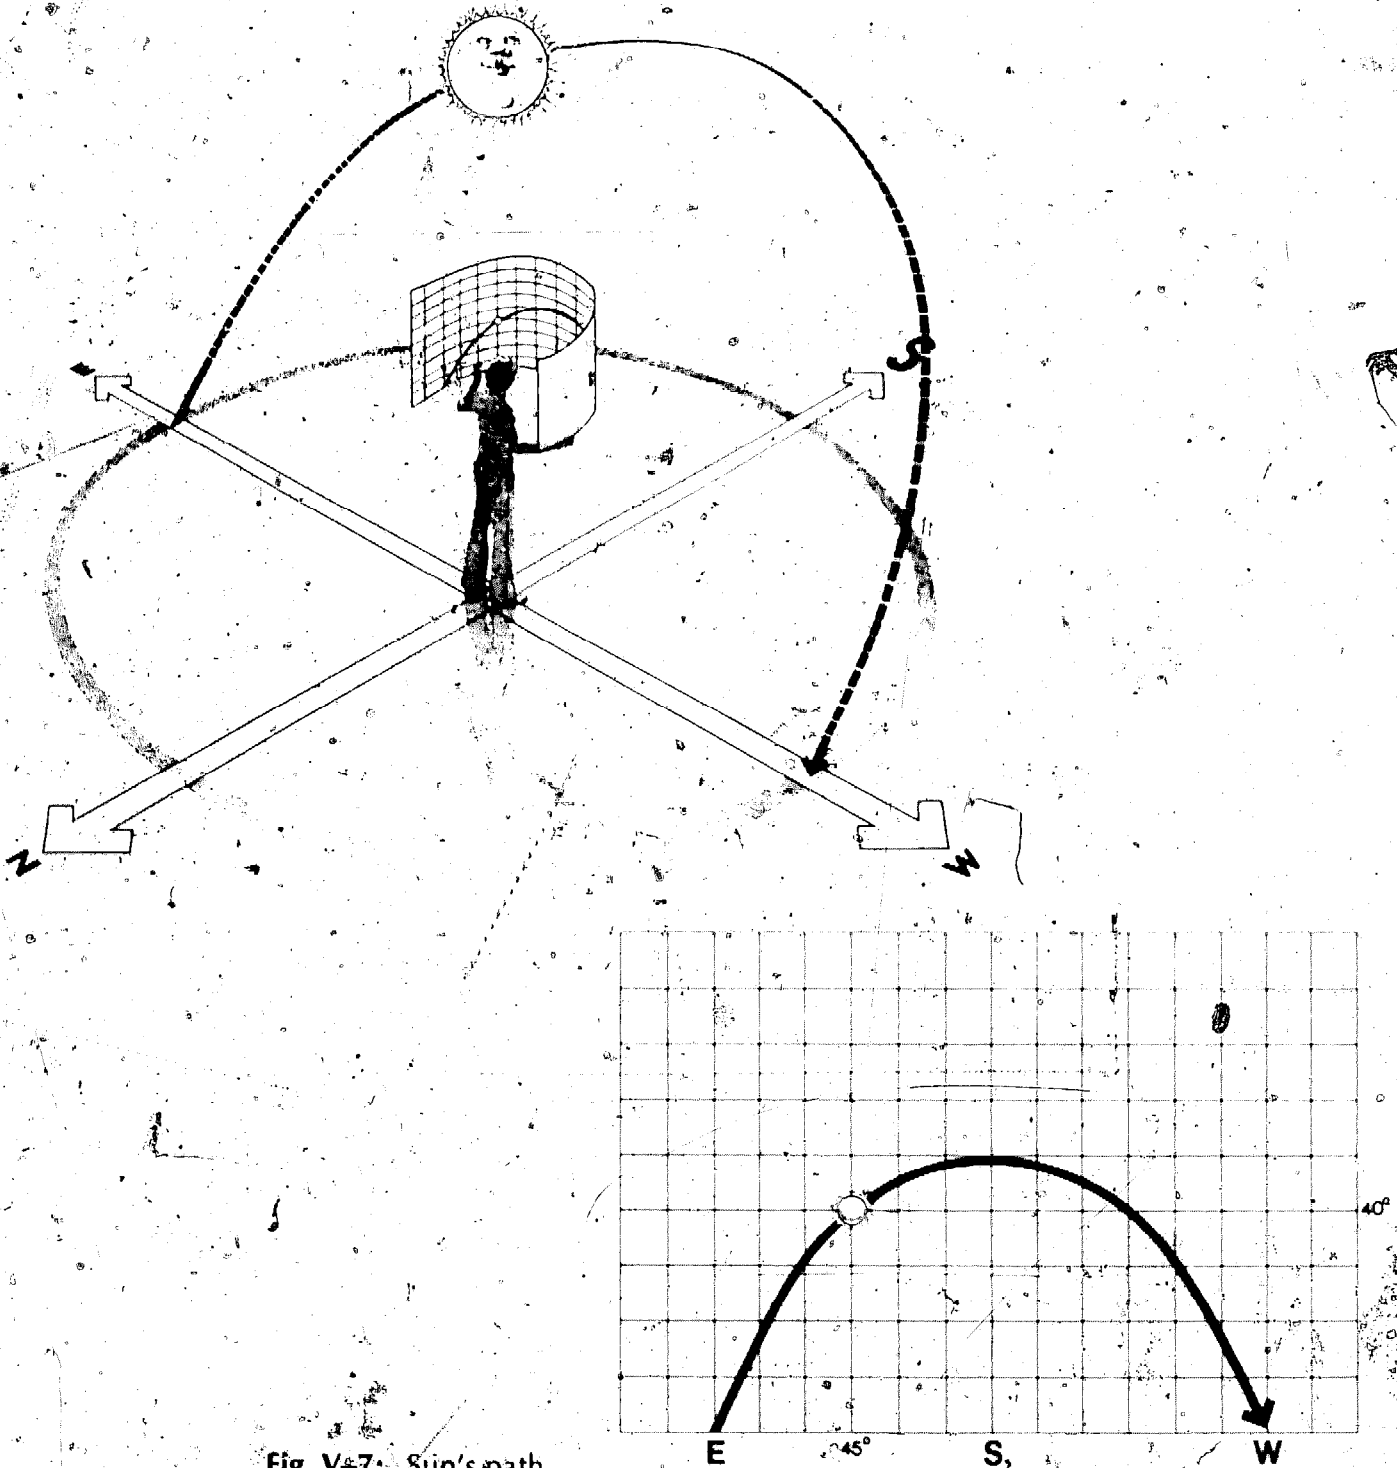


Fig. V-7: Sun's path.

Monthly Paths

Thus, we can plot the sun's path for any day of the year. The lines shown represent the sun's path for the twentieth day of each month. The sun's path is longest during the summer months when it reaches its highest altitude, rising and setting with the widest azimuth angle from true south. During the winter months the sun is much lower in the sky, rising and setting with the narrowest azimuth angles from true south.

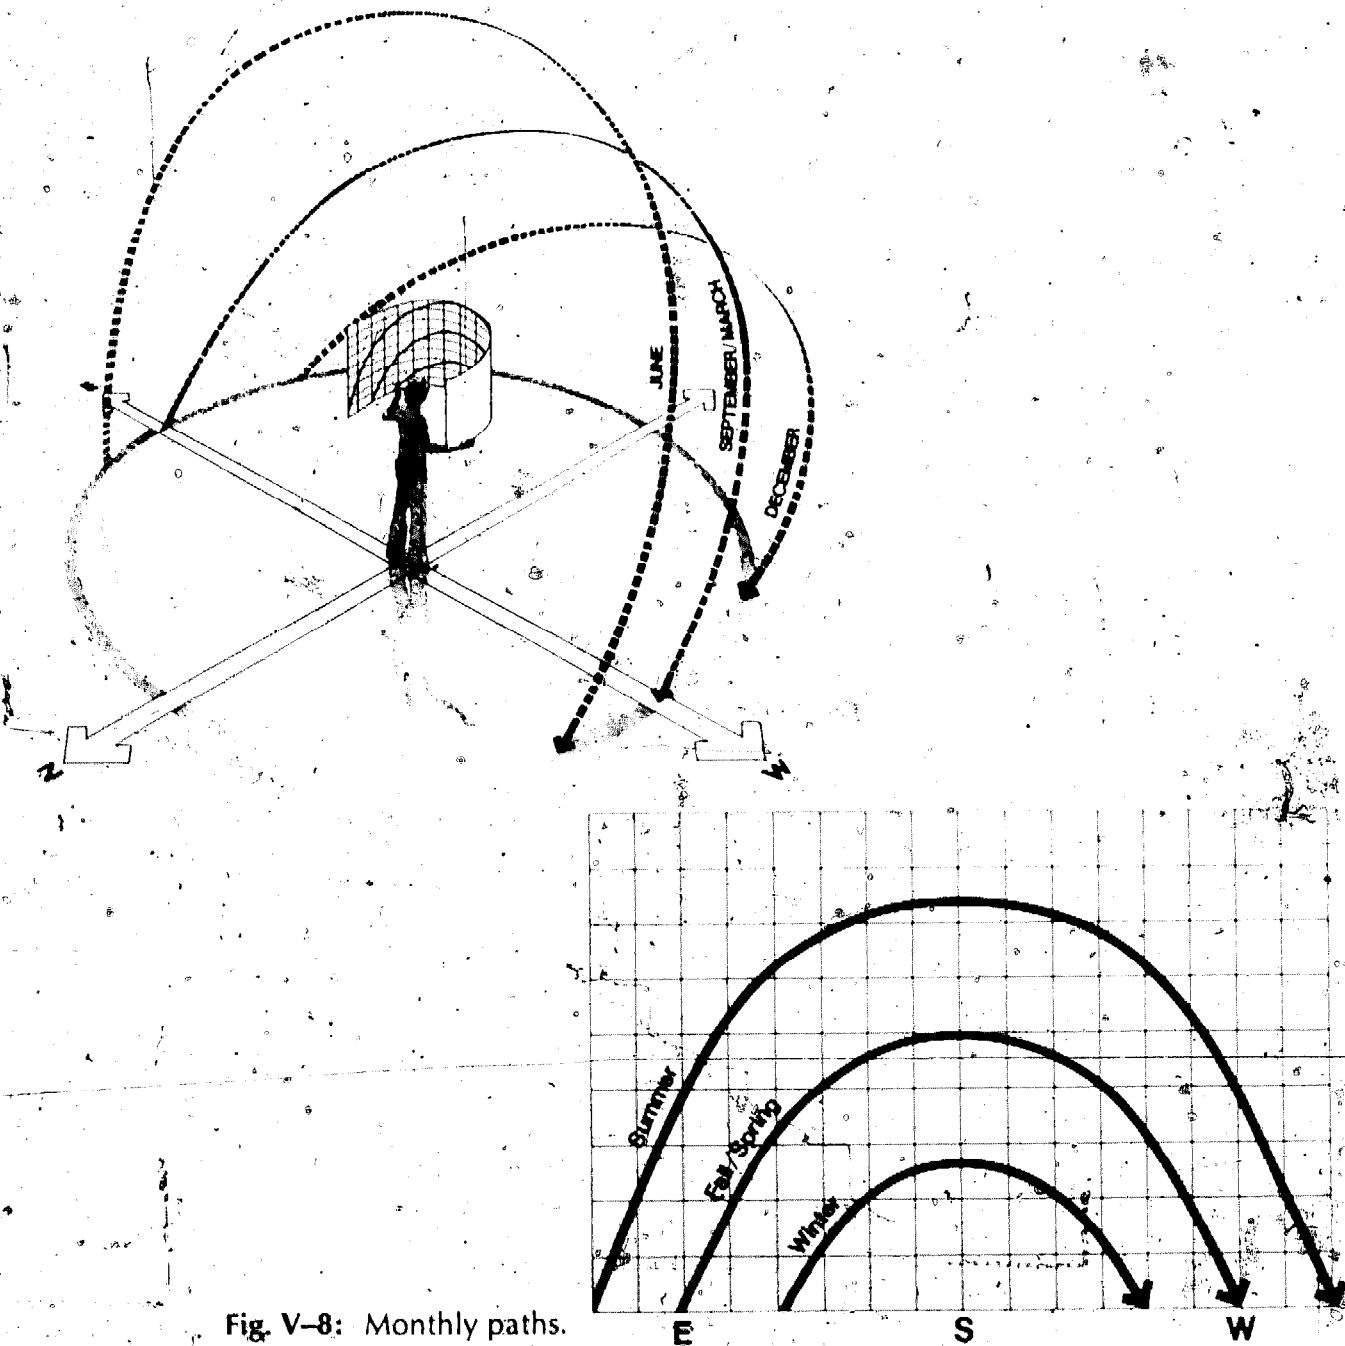


Fig. V-8: Monthly paths.

The Passive Solar Energy Book

Times of Day

Finally, if we connect the times of day on each sun path we get a heavy dotted line which represents the hours of the day. This completes the Cylindrical Sun Chart:

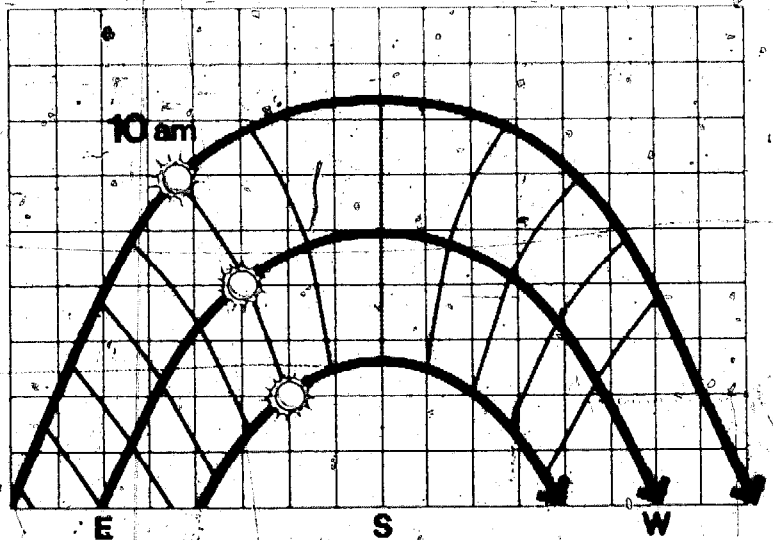
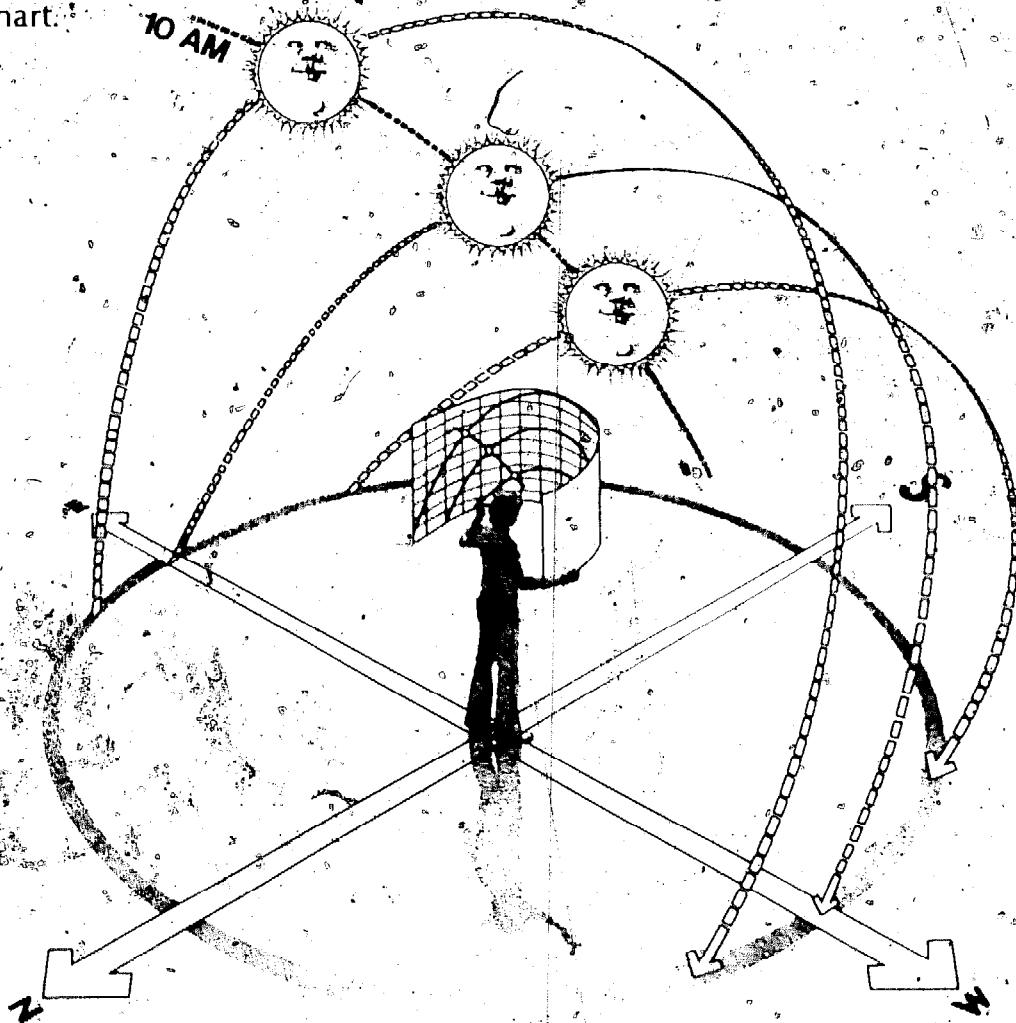


Fig. V-9: Times of day.

Note: The times on the sun chart are for sun time. This may vary from standard time by as much as 75 minutes for different locations and different times of the year. This is fine for most practical uses of the sun chart. It's important to remember to at least use standard time (if daylight savings time is in effect, subtract 1 hour from local time) when using the charts. For very detailed studies, where it is necessary to know the exact relationship between sun time and local time, an explanation of the conversion process is provided later in this chapter.

Latitude and Magnetic Variation

Since the sun's path varies according to the location on earth from which it is being calculated, a different sun chart is required for different latitudes. Sun charts for latitudes in the United States and southern Canada (28° to 56° NL) are provided in this section. The map in figure V-11 will assist you in selecting the sun chart (latitude) closest to your location.

The map also shows magnetic compass variations for your area. Because of the earth's magnetic field, it is necessary to adjust your compass reading by a few degrees east or west to obtain true north (as different from magnetic north). The amount of variation depends upon your location. When true and magnetic north are in the same location, the variation is zero. In the United States a line of zero variation runs from the eastern end of Lake Michigan to the Atlantic coast in northern Georgia. If you are located on the west side of that line, your compass needle will point to the east of true north. This is called an

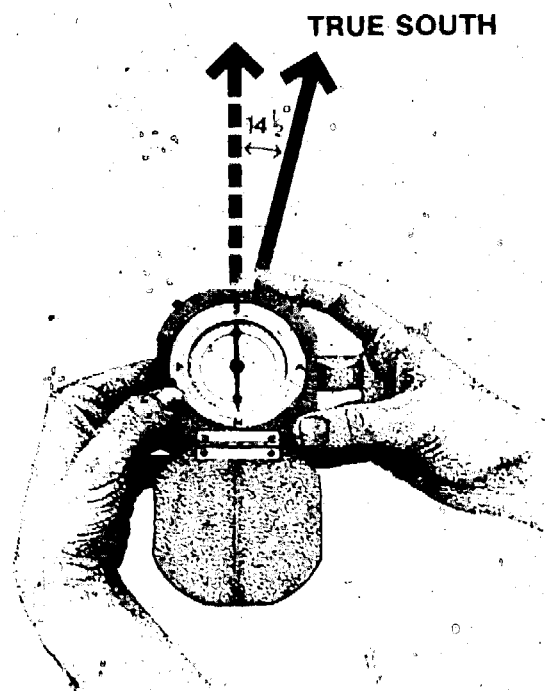


Fig. V-10: A westerly variation.

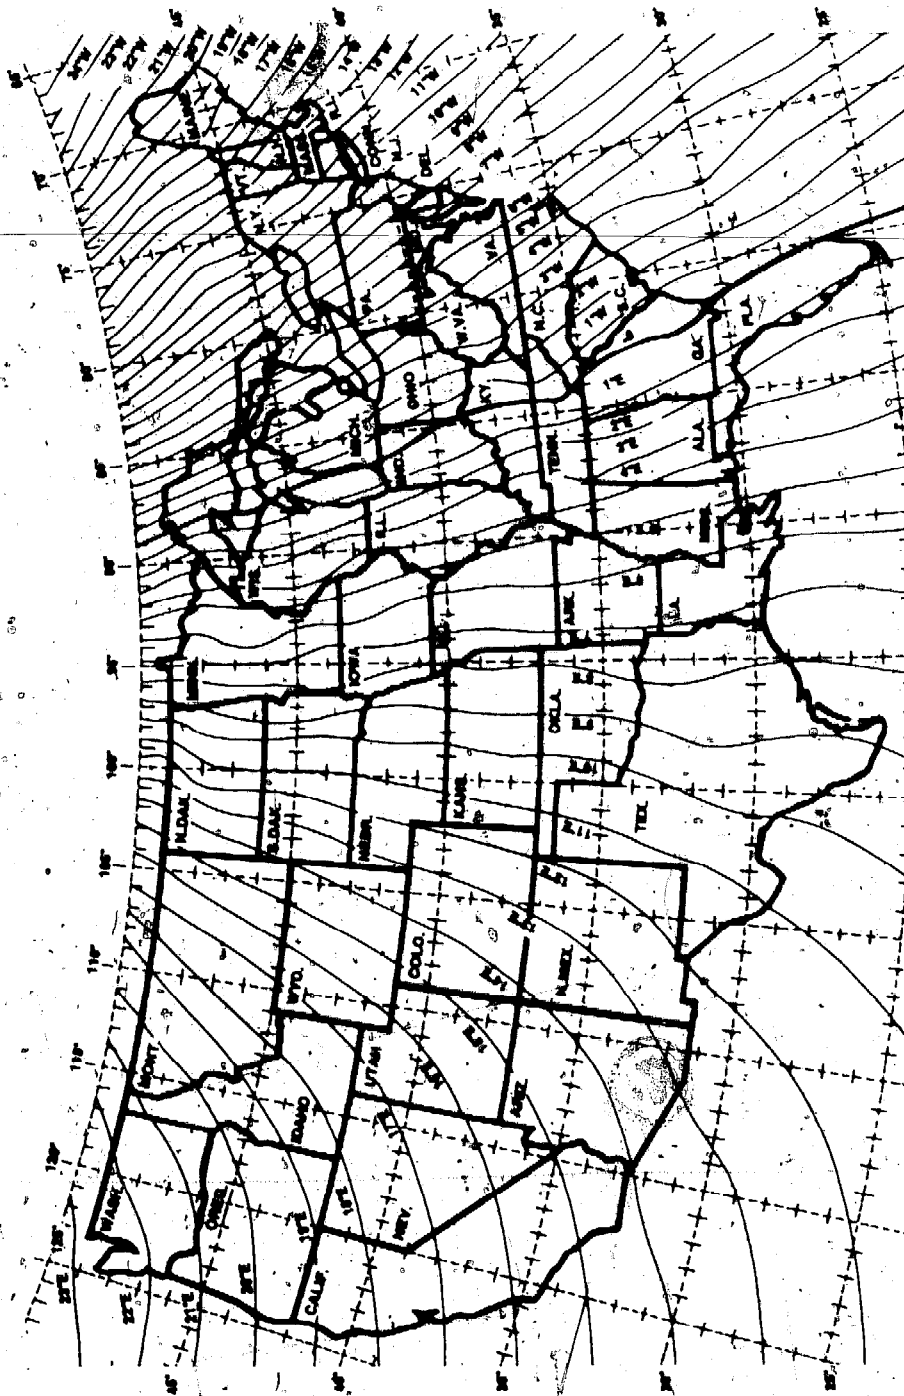


Fig. V-11: Use map to find sun chart (latitude) closest to your location.

Source: Redrawn from the Isogonic Chart of the United States, U.S. Department of Commerce, Coast and Geodetic Survey, 1965.

The Tools

"easterly variation." Similarly, if you are located to the east of the line, your compass needle will point to the west of true north. This is called a "westerly variation." For example, the map shows a deviation of $14\frac{1}{2}^\circ$ west for Boston. This means that the compass is pointing $14\frac{1}{2}^\circ$ to the west of true north, or true north is $14\frac{1}{2}^\circ$ to the east of compass-indicated north (true south is then $14\frac{1}{2}^\circ$ west of compass south). Due to "local attraction," magnetic variation may be slightly different for your locality. The map is accurate for most uses of the sun chart; for more exact information, consult a surveyor.

The sun chart enables you to locate the position of the sun at any time of day, during any month, for any location within the United States (excluding Alaska) and southern Canada.


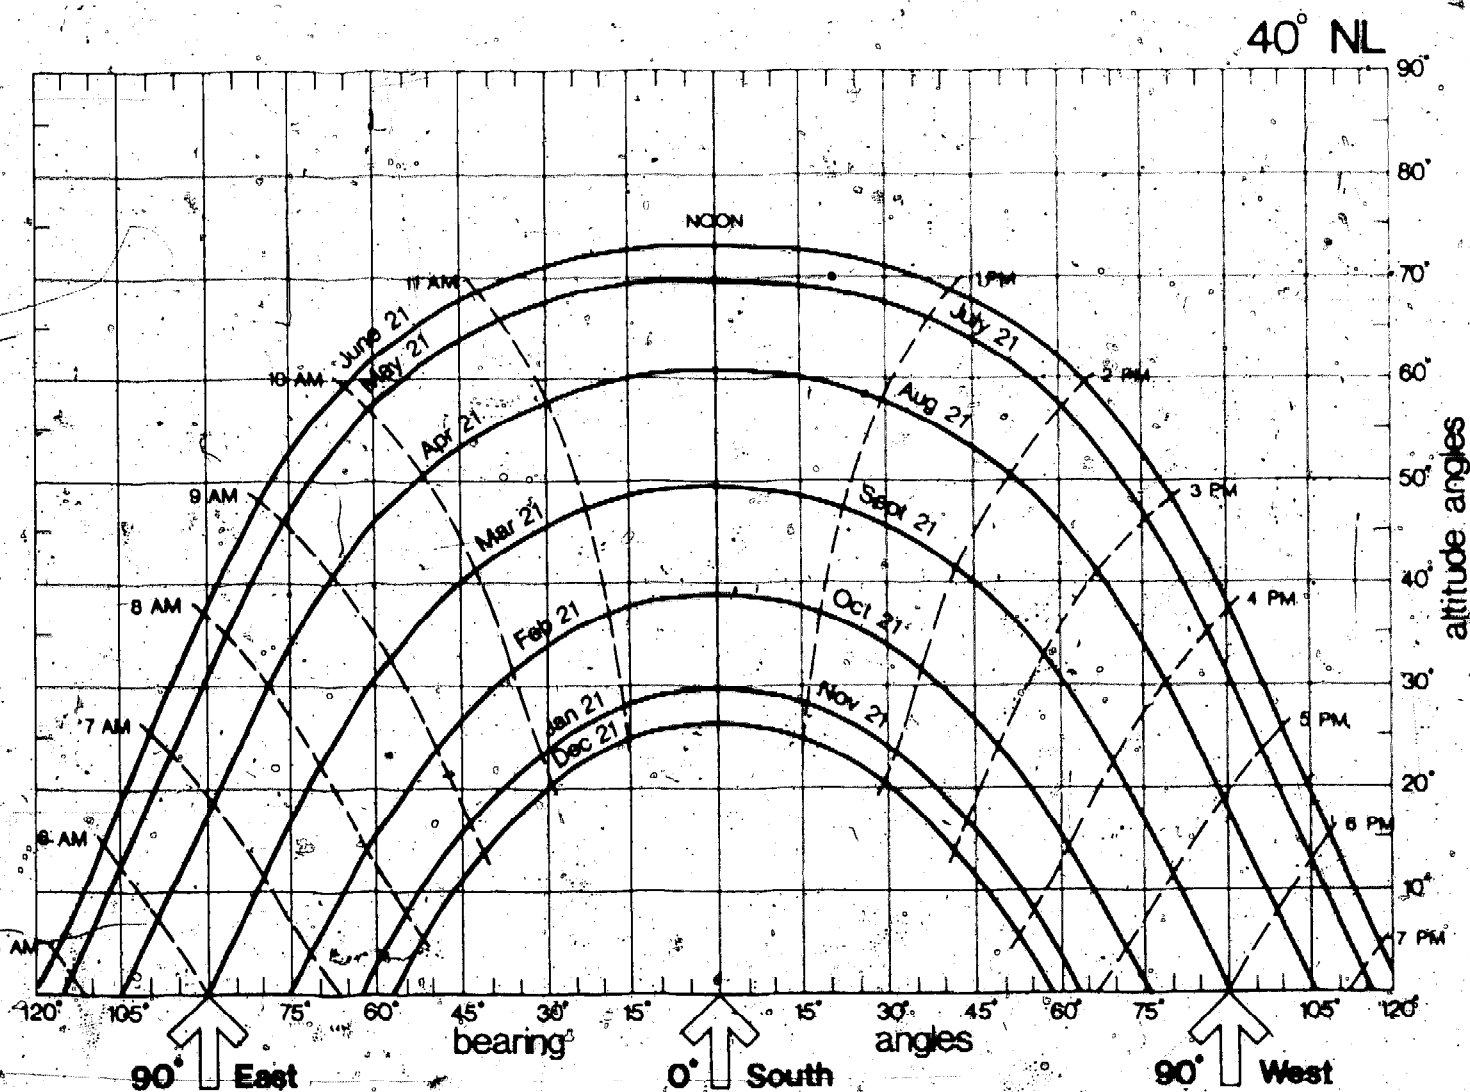



Fig. V-12: Completed sun chart.

Sun Charts

The following sun charts are for all latitudes from 28° to 56° NL at 4° intervals.

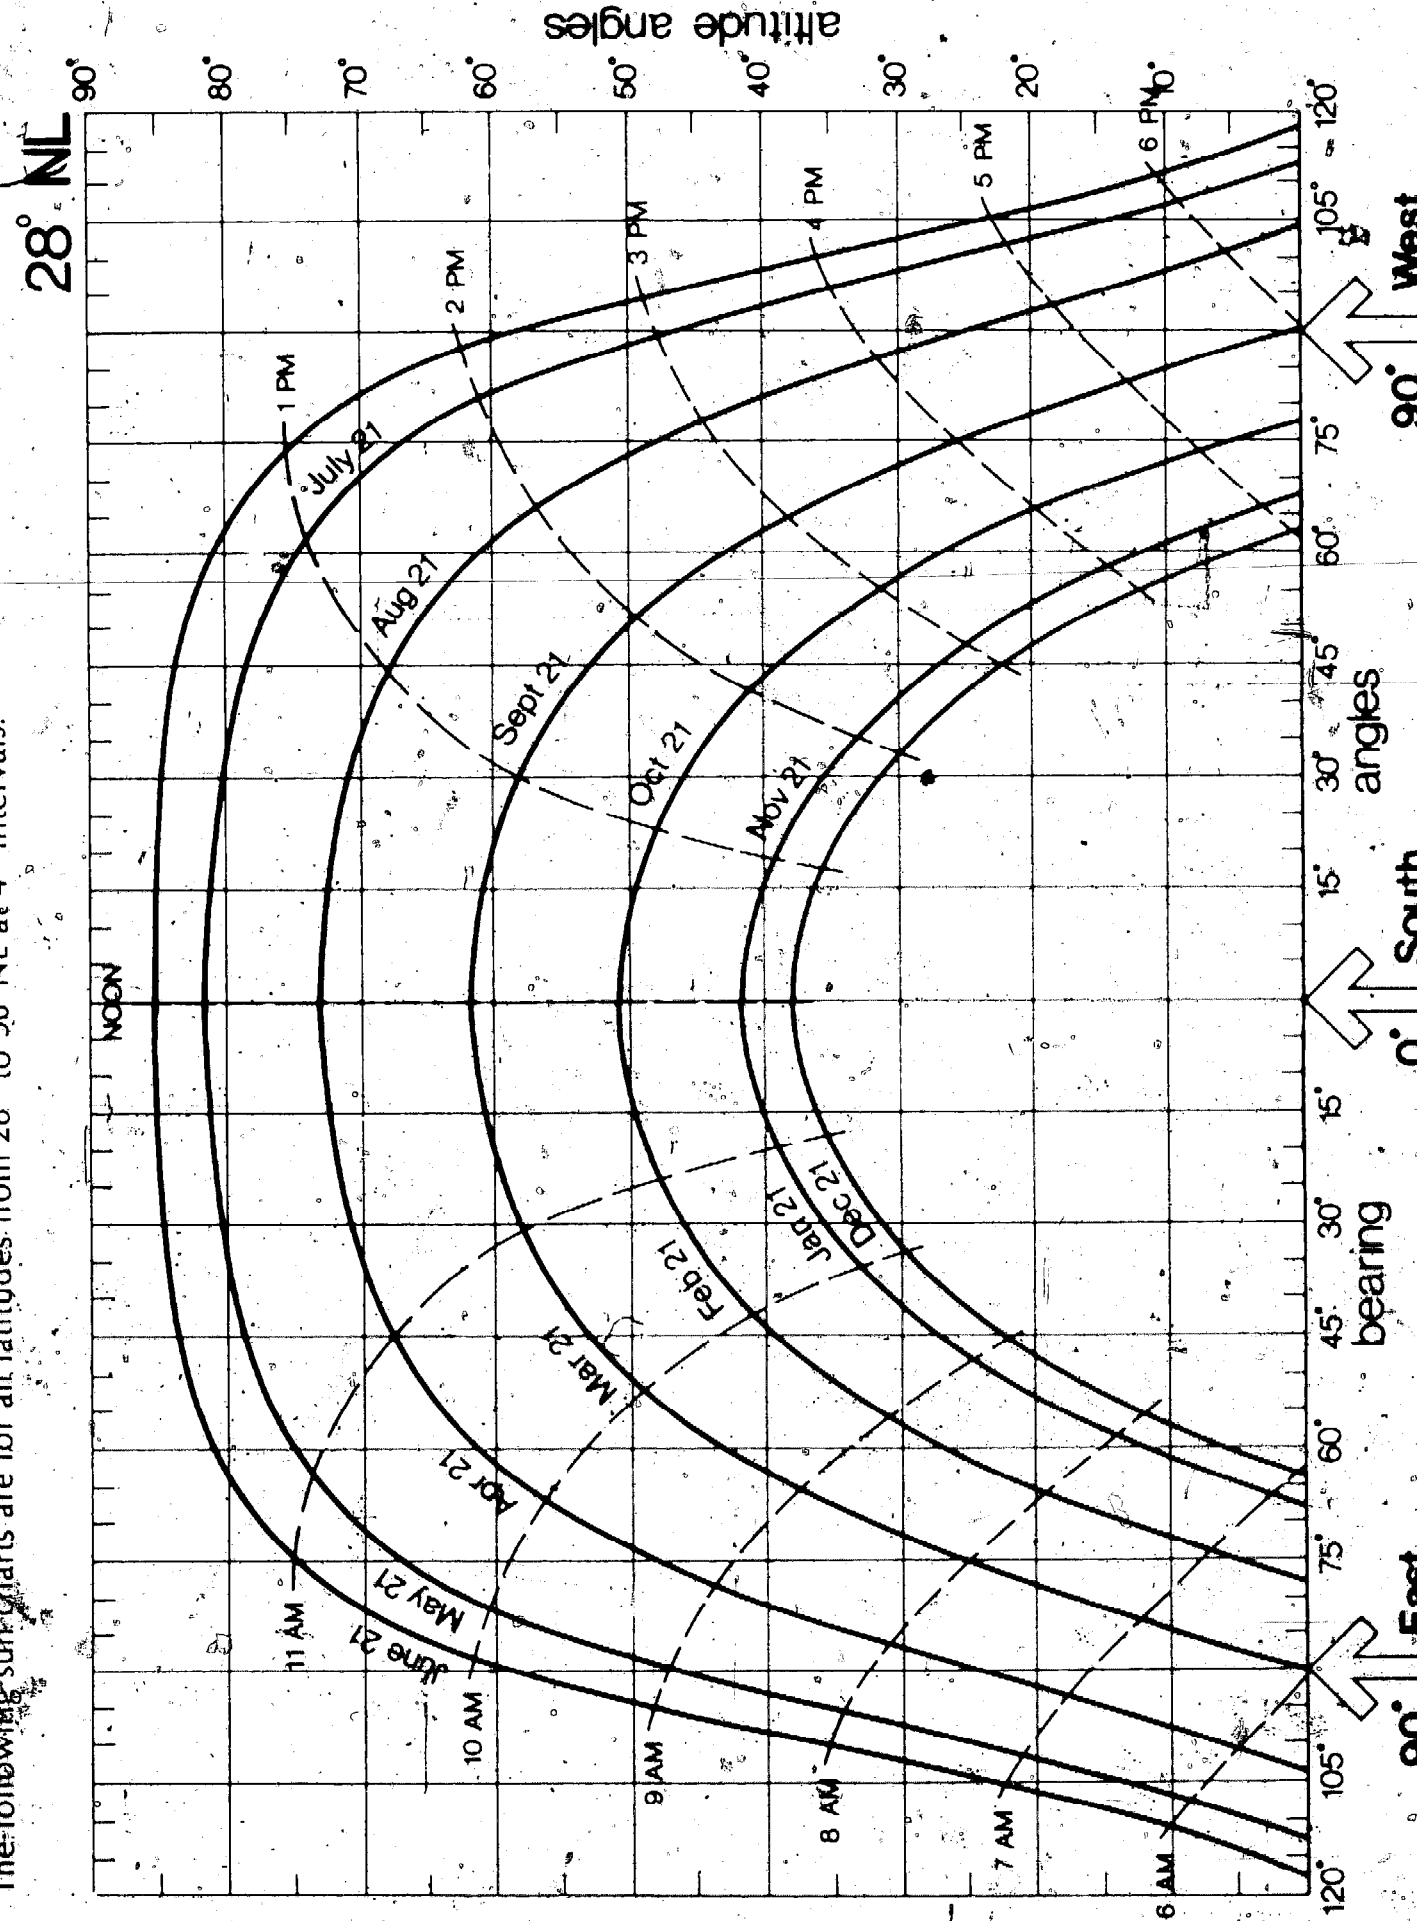


32° NL

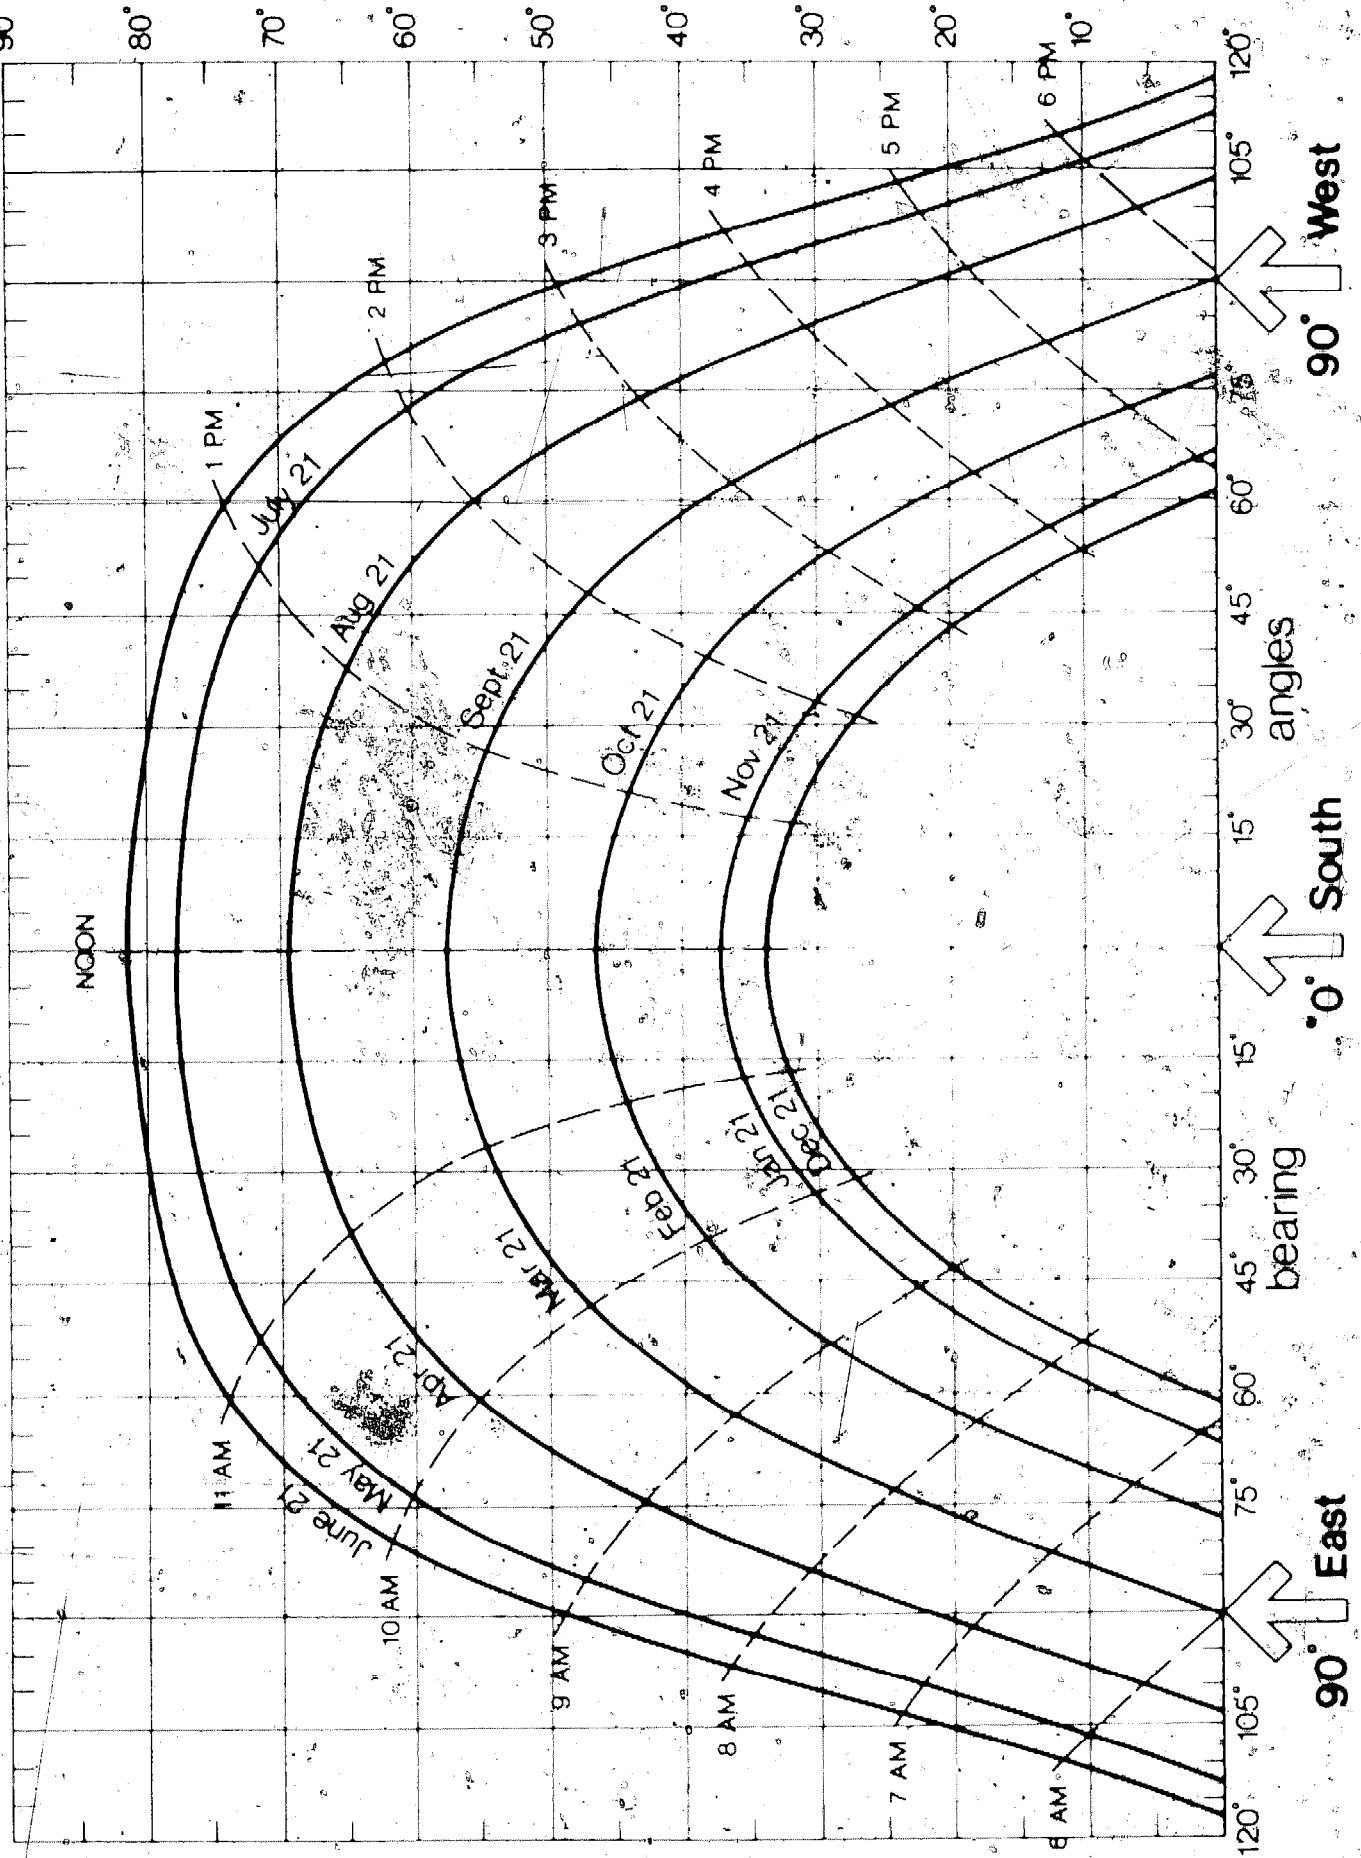

altitude angles

36° NL

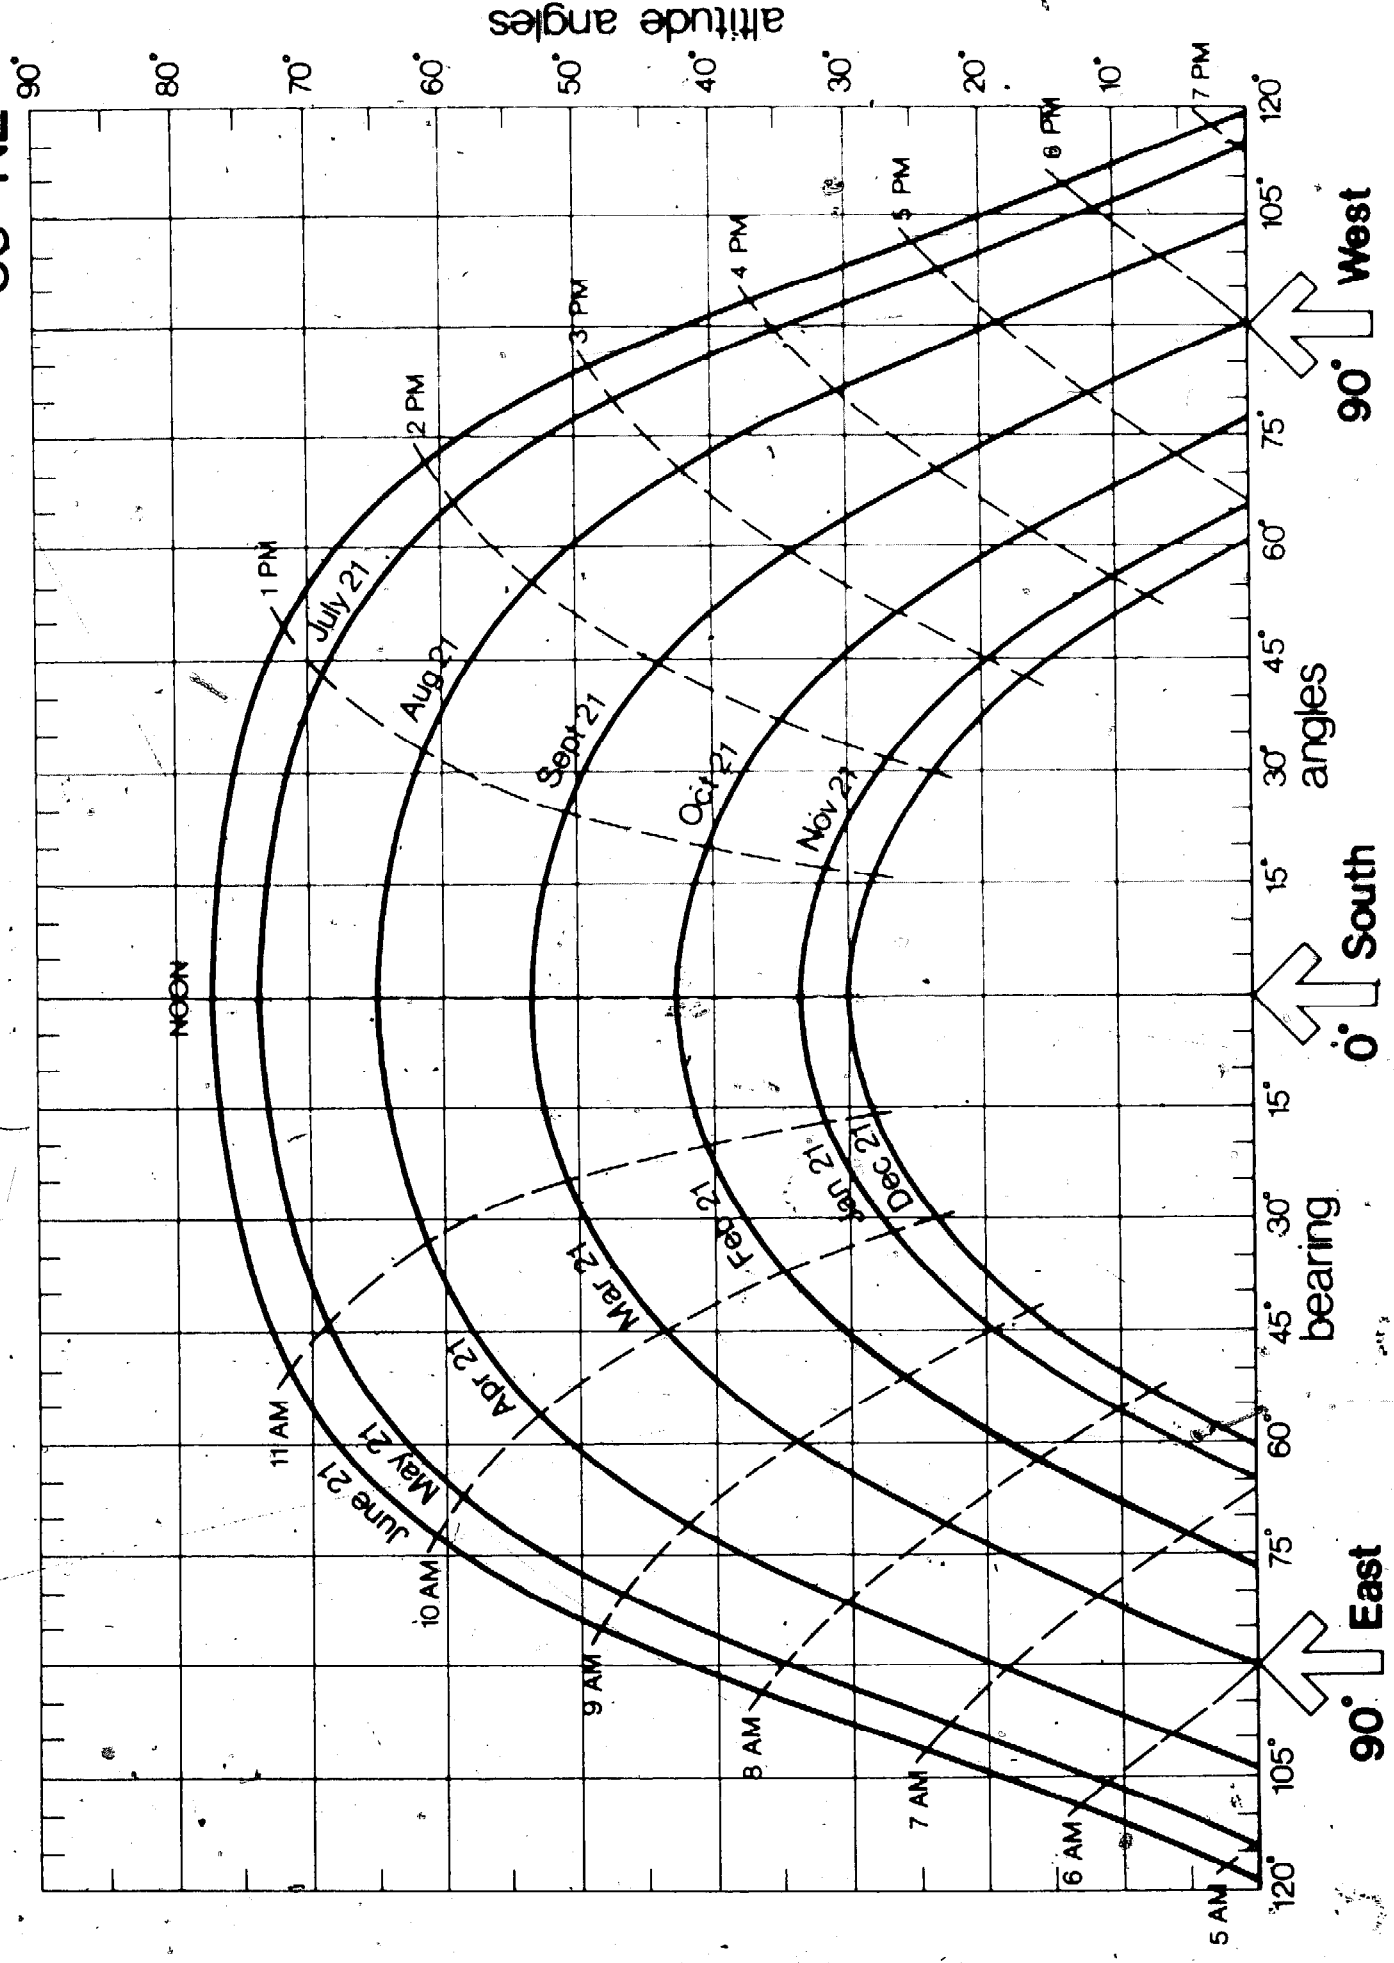

altitude angles

angles


bearing

90° West

0° South


90° East

40° NL

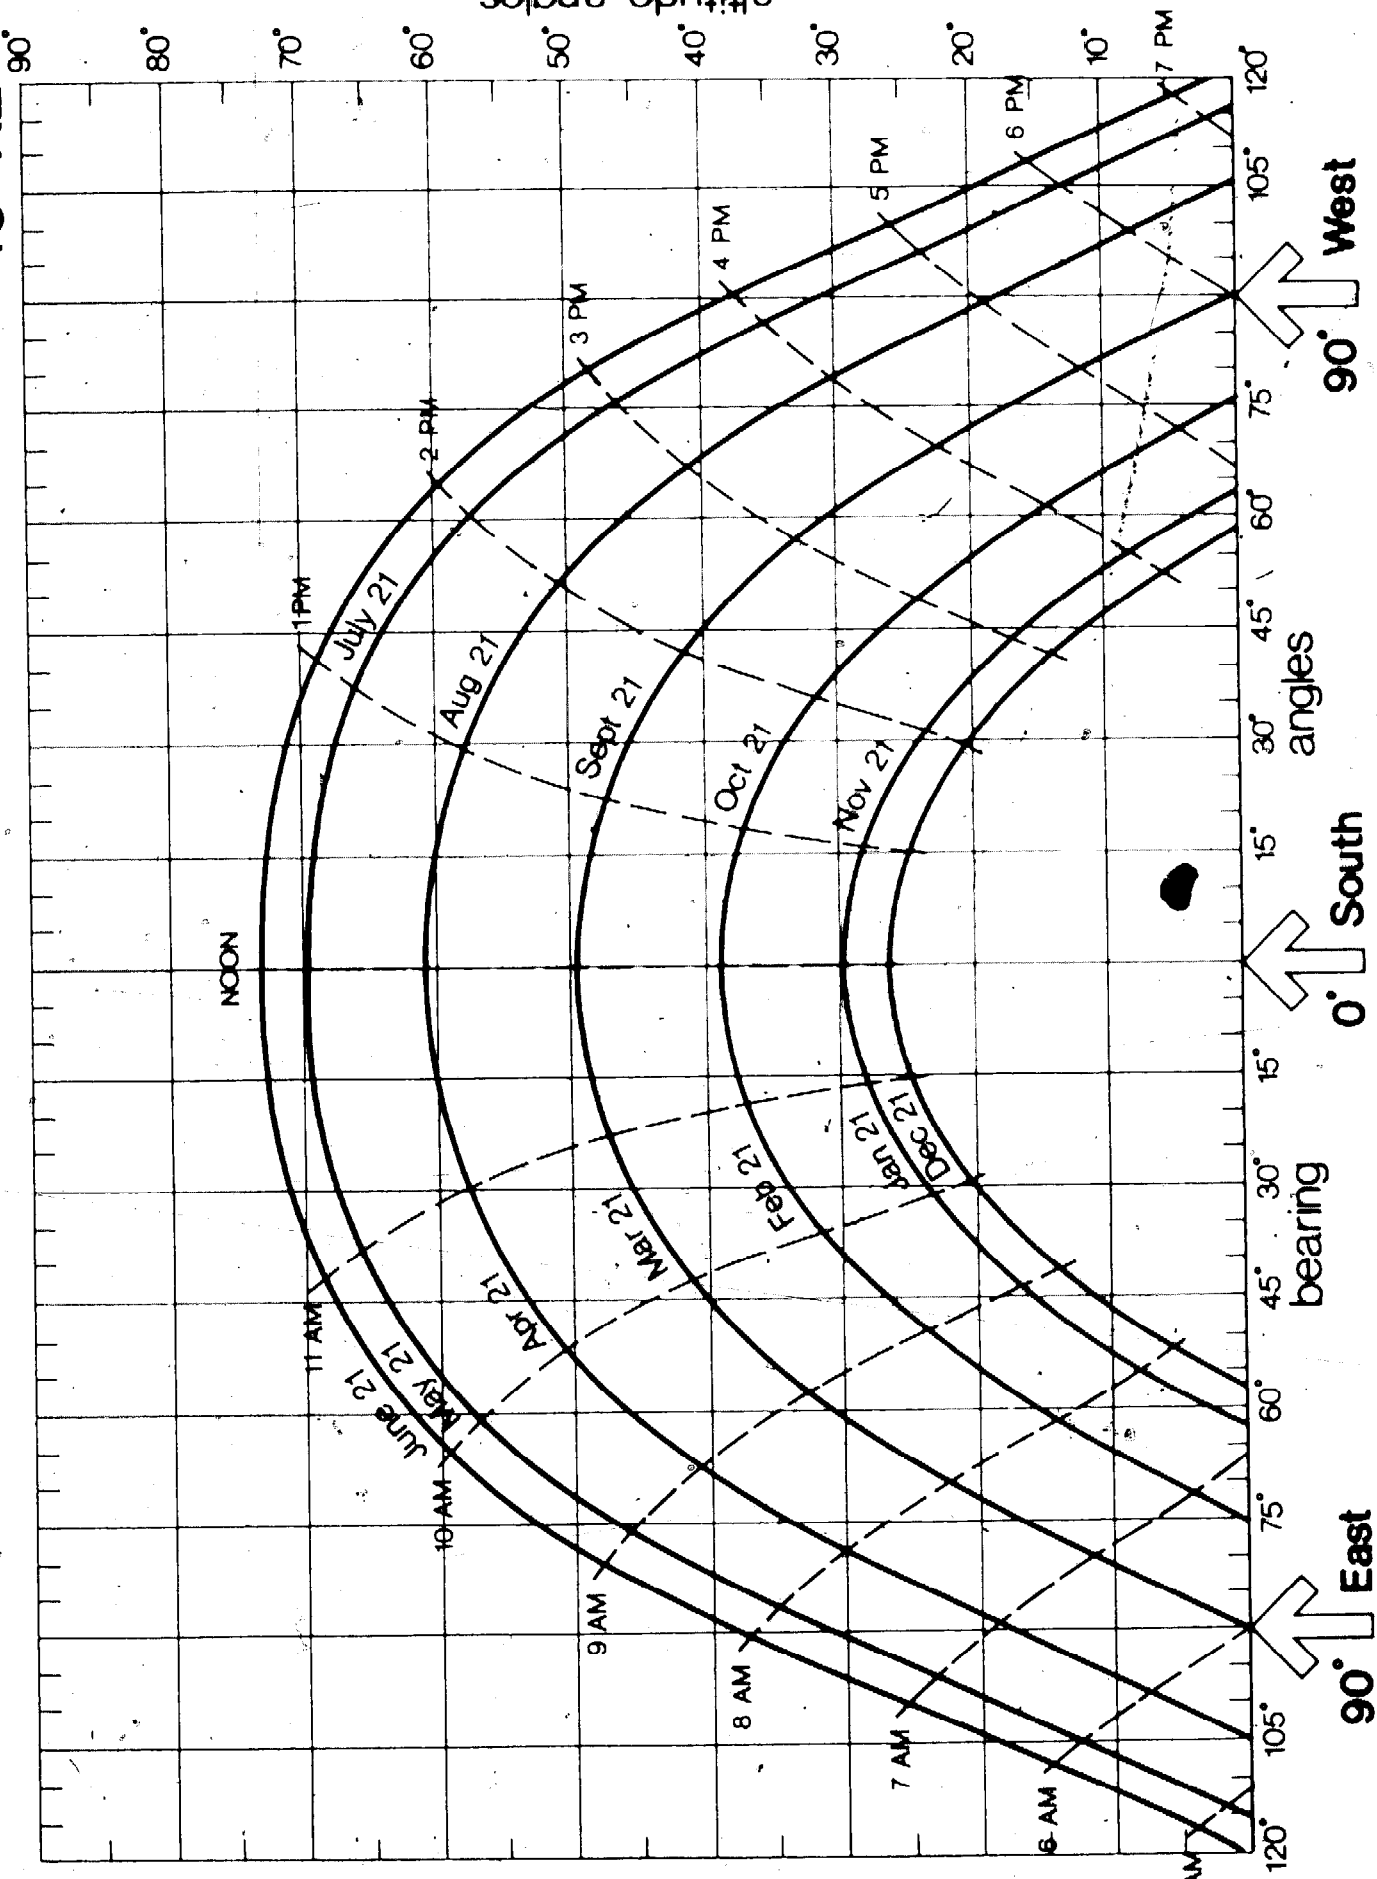


altitude angles

44° NL

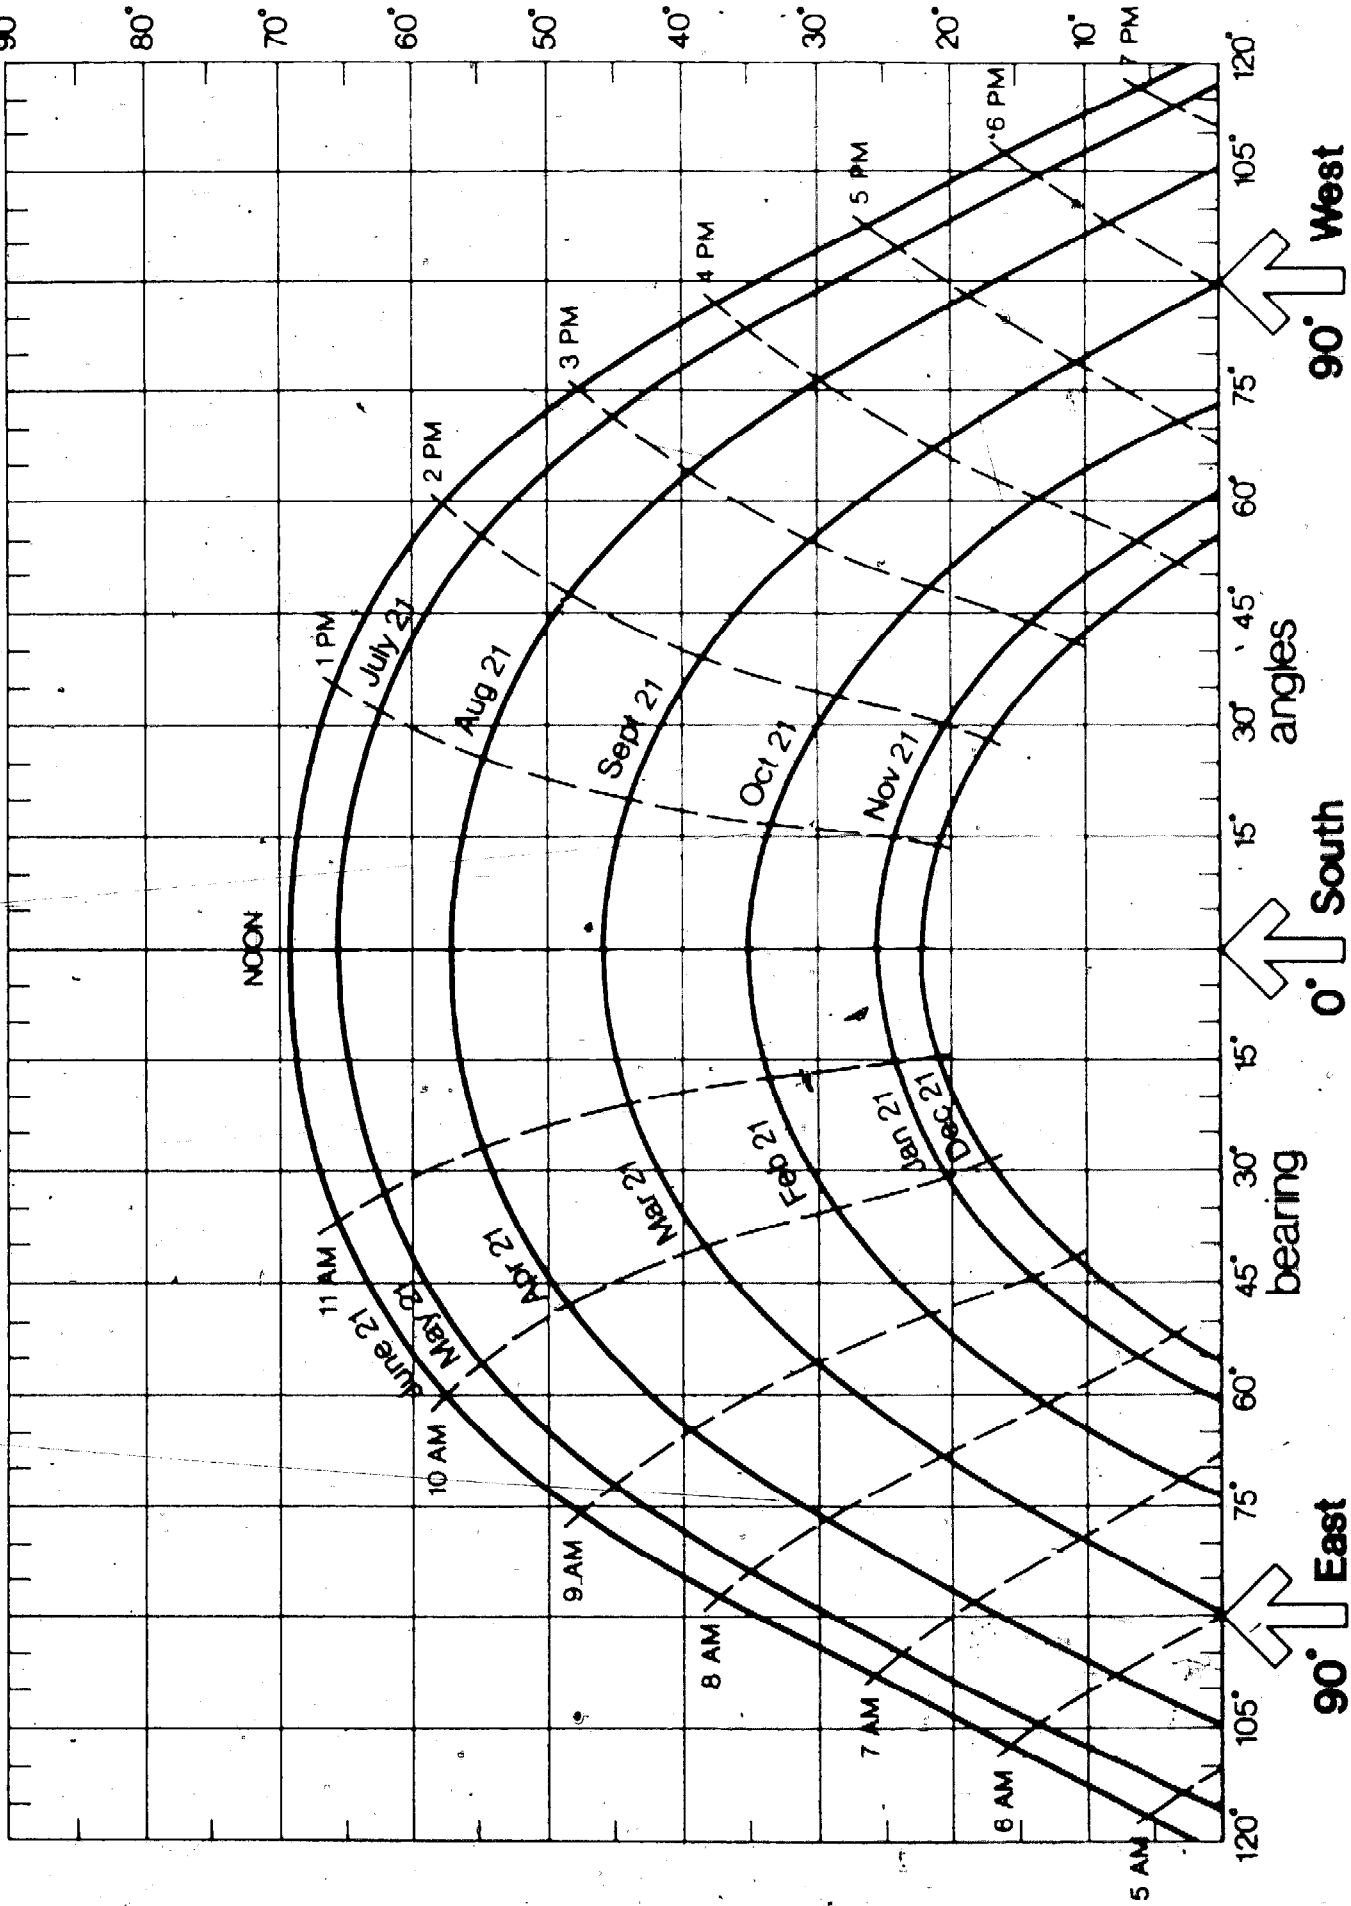

48° NL

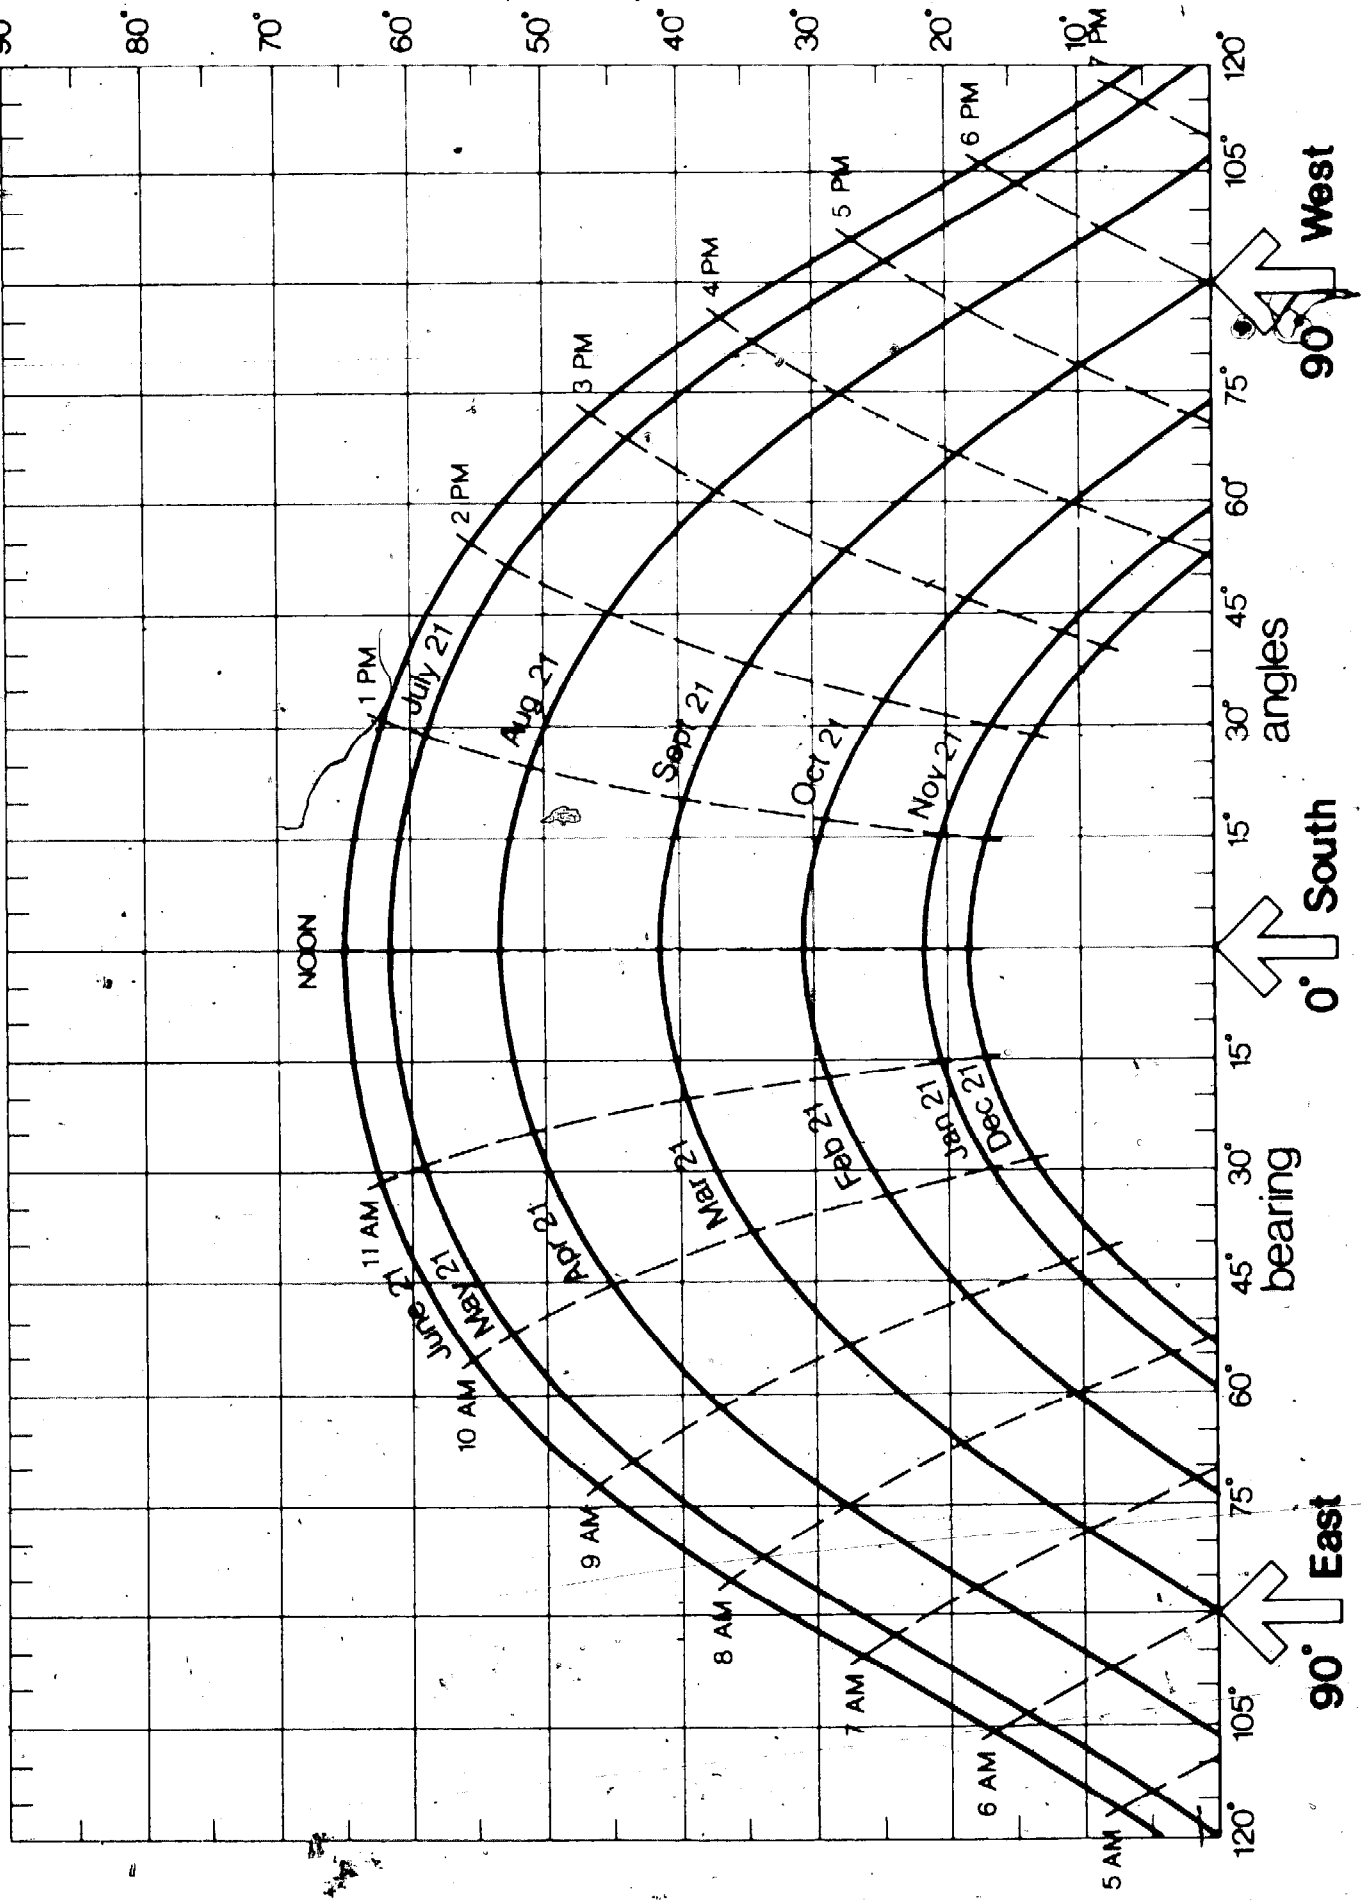


altitude angles


angles

bearing

52° NL

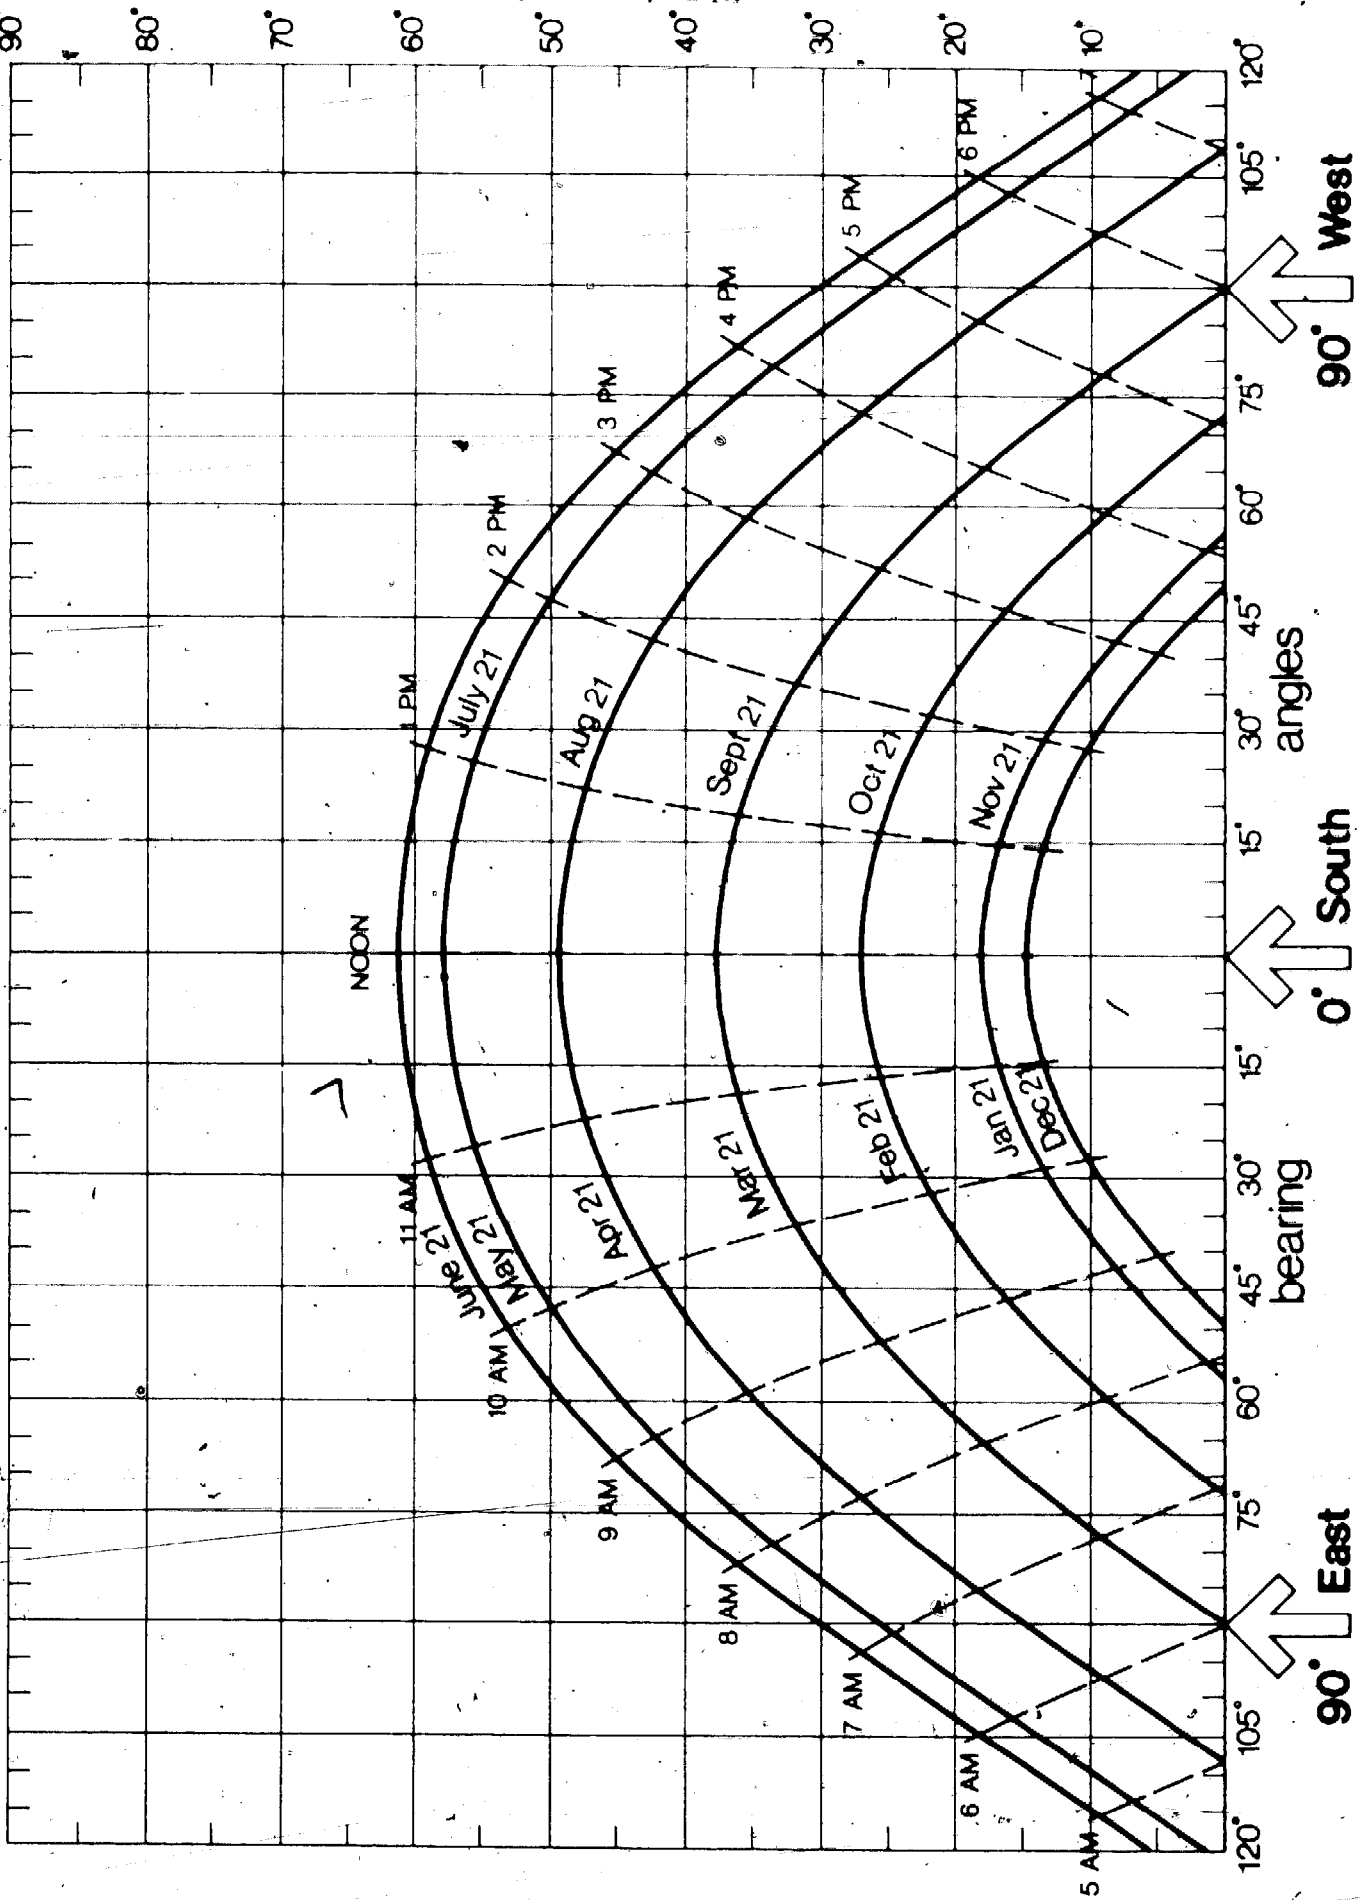

56° NL

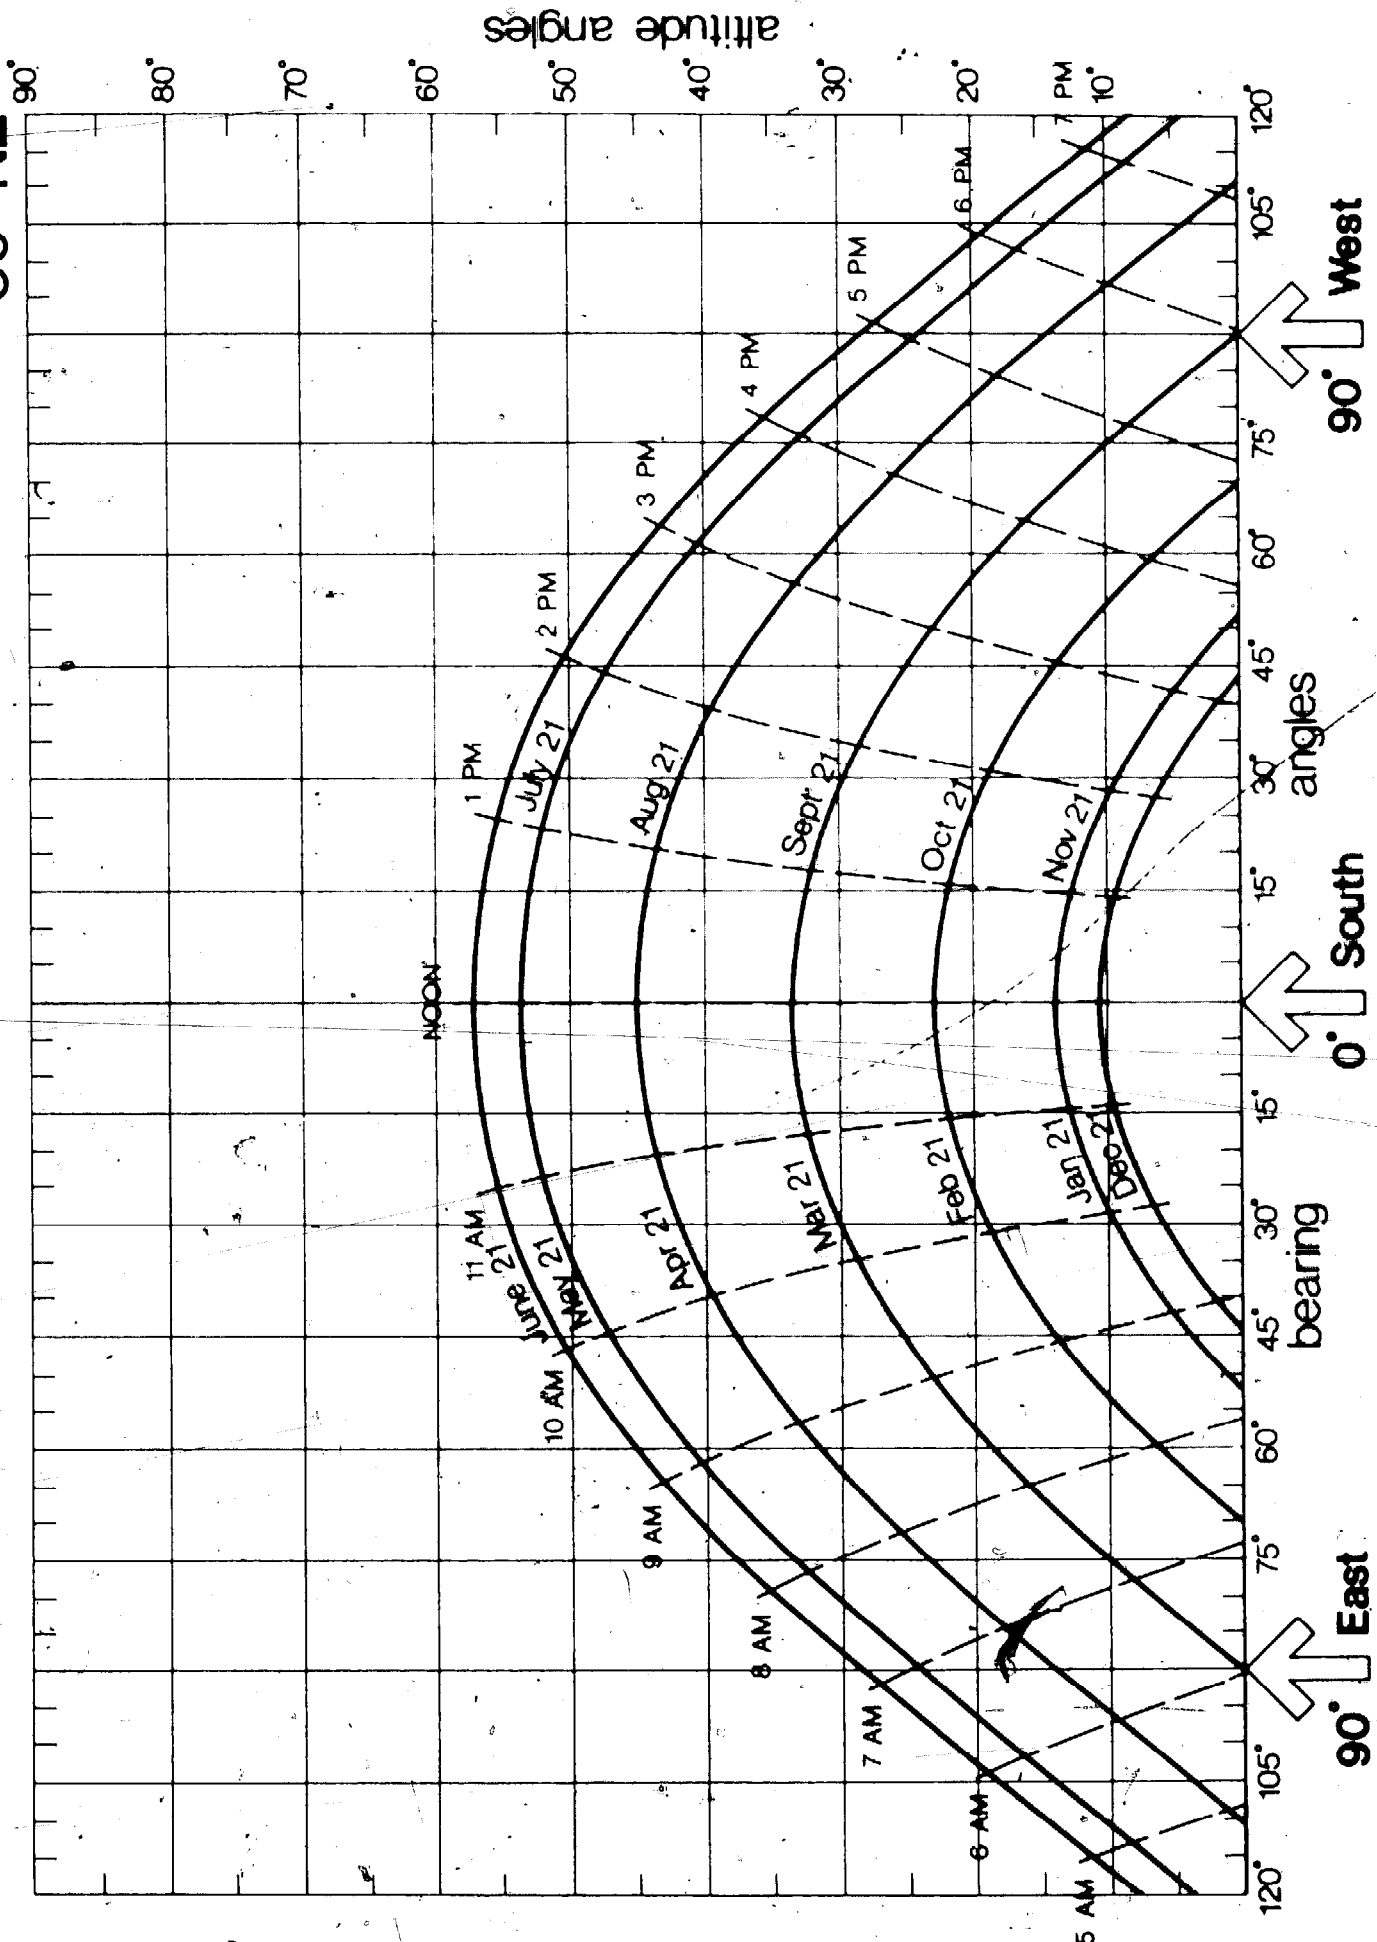

Sun Time

As the earth orbits the sun, its speed varies depending upon its distance from the sun. As we move closer to the sun, the earth slows down, and as we swing away from the sun, we speed up. This difference in the earth's speed is responsible for a variation between sun and earth time, since a man-made clock keeps time uniformly and does not take the earth's speed into account. From the sun chart, you can see that sun time is measured by the position of the sun above the horizon, solar noon corresponding to the sun at its highest position and due south. Figure V-13 gives values for the "equation of time," or the difference between sun time and earth clock time. The upper part of the chart (+) gives values when the sun is ahead of clock time, and the lower part (-) when the sun is behind.

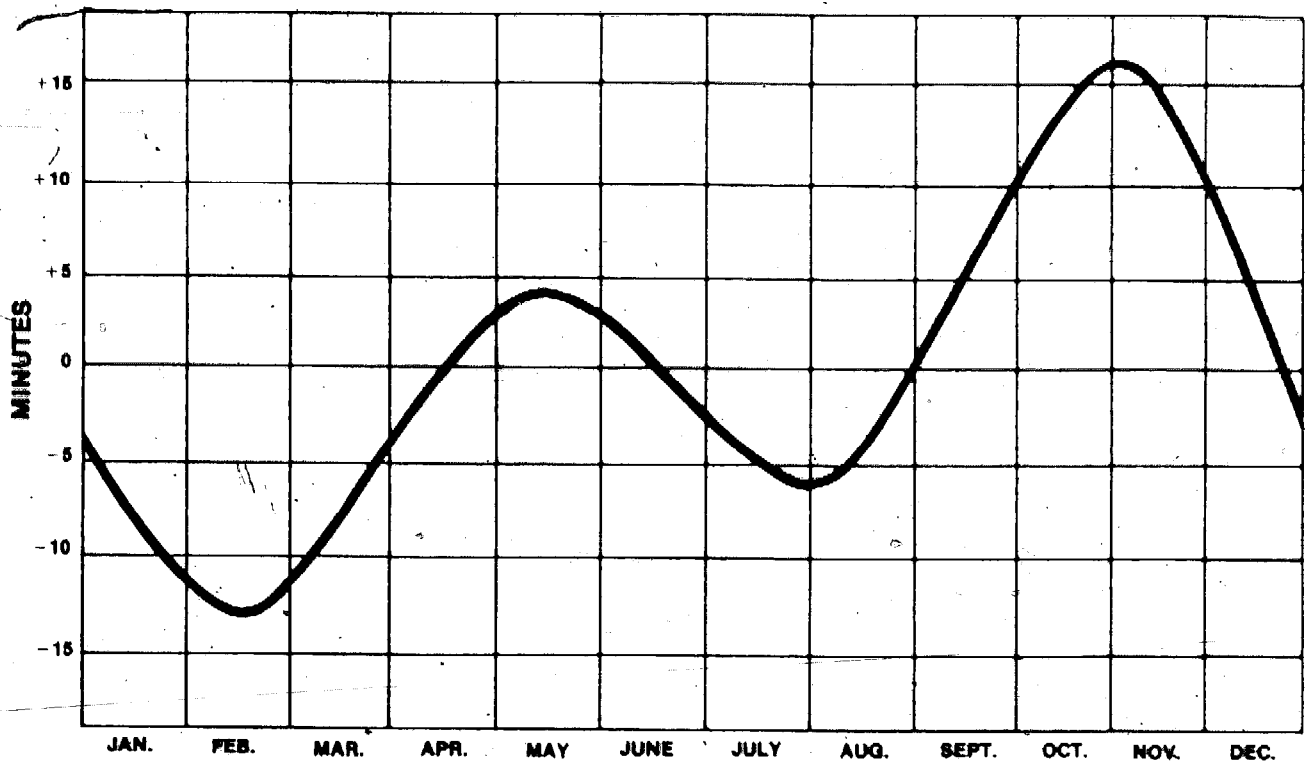


Fig. V-13: Equation of time.

The Tools

For the purpose of telling time, the earth has been divided in 24 time zones (longitudinal segments) of 15° each (a total of 360° , or a complete circle) extending from the North Pole to the South Pole. This corresponds to 24 hours (1 hour for each 15° or 4 minutes for each 1°) for the earth to make one complete revolution about its axis. The time zones that affect the United States and southern Canada are eastern standard time at a longitude of 75° , central standard time at 90° , mountain standard time at 105° and Pacific standard time at 120° .

At any given location within the United States or Canada, sun time is found by starting with local standard time (if daylight savings time is in effect subtract 1 hour from your local time). Since it takes the sun 4 minutes to move 1° longitude, a correction needs to be made between the standard time longitude line and your local longitude. Find your location on the map in figure V-14 and subtract 4 minutes for every degree of longitude your location is west of your standard time longitude line or add 4 minutes for every degree of longitude your location is east of it. The equation of time adjustment is then added to this corrected time to find sun time.

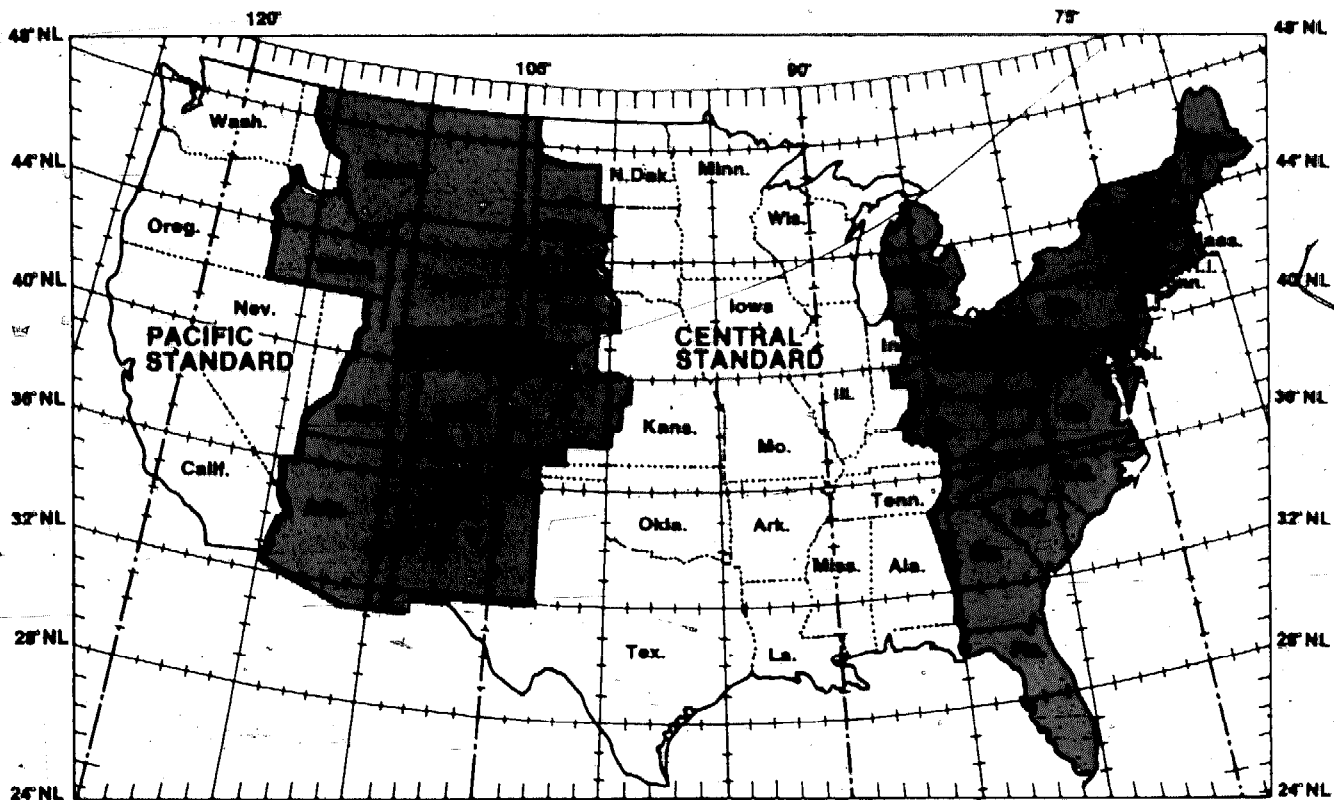


Fig. V-14: Standard time zones of the United States.

The Passive Solar Energy Book

Then use this simplified equation to convert standard time to sun time:

$$\text{sun time} = \text{standard time} + E + 4(L_{st} - L_{loc})$$

where: E = the equation of time, from figure V-13 in minutes
 L_{st} = the standard time longitude line for your local time zone
 L_{loc} = the longitude of your location

For example, what is the sun time corresponding to 11:30 a.m. central standard time on February 15 in Minneapolis?

To find sun time:

1. Locate Minneapolis on the map. Its longitude is 93° which is in the central standard time zone with a standard time longitude of 90° . Since the sun takes 4 minutes to move 1° longitude, the last term in the equation is $4(90 - 93)$ or $4(-3)$ or -12 minutes.
2. To correct for the time variation on February 15, the equation of time or E from figure V-13 is -14 minutes. Subtract another 14 minutes from standard time to obtain sun time.

$$\begin{aligned} \text{sun time} &= \text{standard time} - 14 - 12 \\ \text{sun time} &= 11:30 \text{ a.m.} - 26 \text{ min.} = 11:04 \text{ a.m.} \end{aligned}$$

Plotting the Skyline

To accurately determine the times that direct sun is blocked from reaching any point on a site it is necessary to plot the obstructions as seen from that point. This is done by plotting the "skyline" directly on the sun chart. If the skyline to the south is low with no obstructions such as tall trees, buildings or abruptly rising hills, the following procedure is unnecessary as all points on the site will receive sun during the winter.

To plot the skyline, you will need either a transit or a compass (to find the azimuth angles of the skyline) and a hand level (to find the altitude angle of the skyline), and a copy of the sun chart for your location.

Next, place yourself at the approximate location on the site where you want to

put the building. Plot the skyline (from that point) on the sun chart as follows:

1. Using the compass or transit, determine which direction is true south (remember magnetic variation; see fig. V-11).
2. Aiming the hand level or transit true south, determine the altitude (angle above the horizon) of the skyline. Plot this point on the sun chart above the azimuth angle 0° (true south).
3. Similarly, determine and record the altitude angle of the skyline for each 15° (azimuth angle) along the horizon, both to the east and west of south, to at least 120° . This is a total of 17 altitude readings. Plot these readings above their respective azimuth angles on the sun chart and connect them with a line.

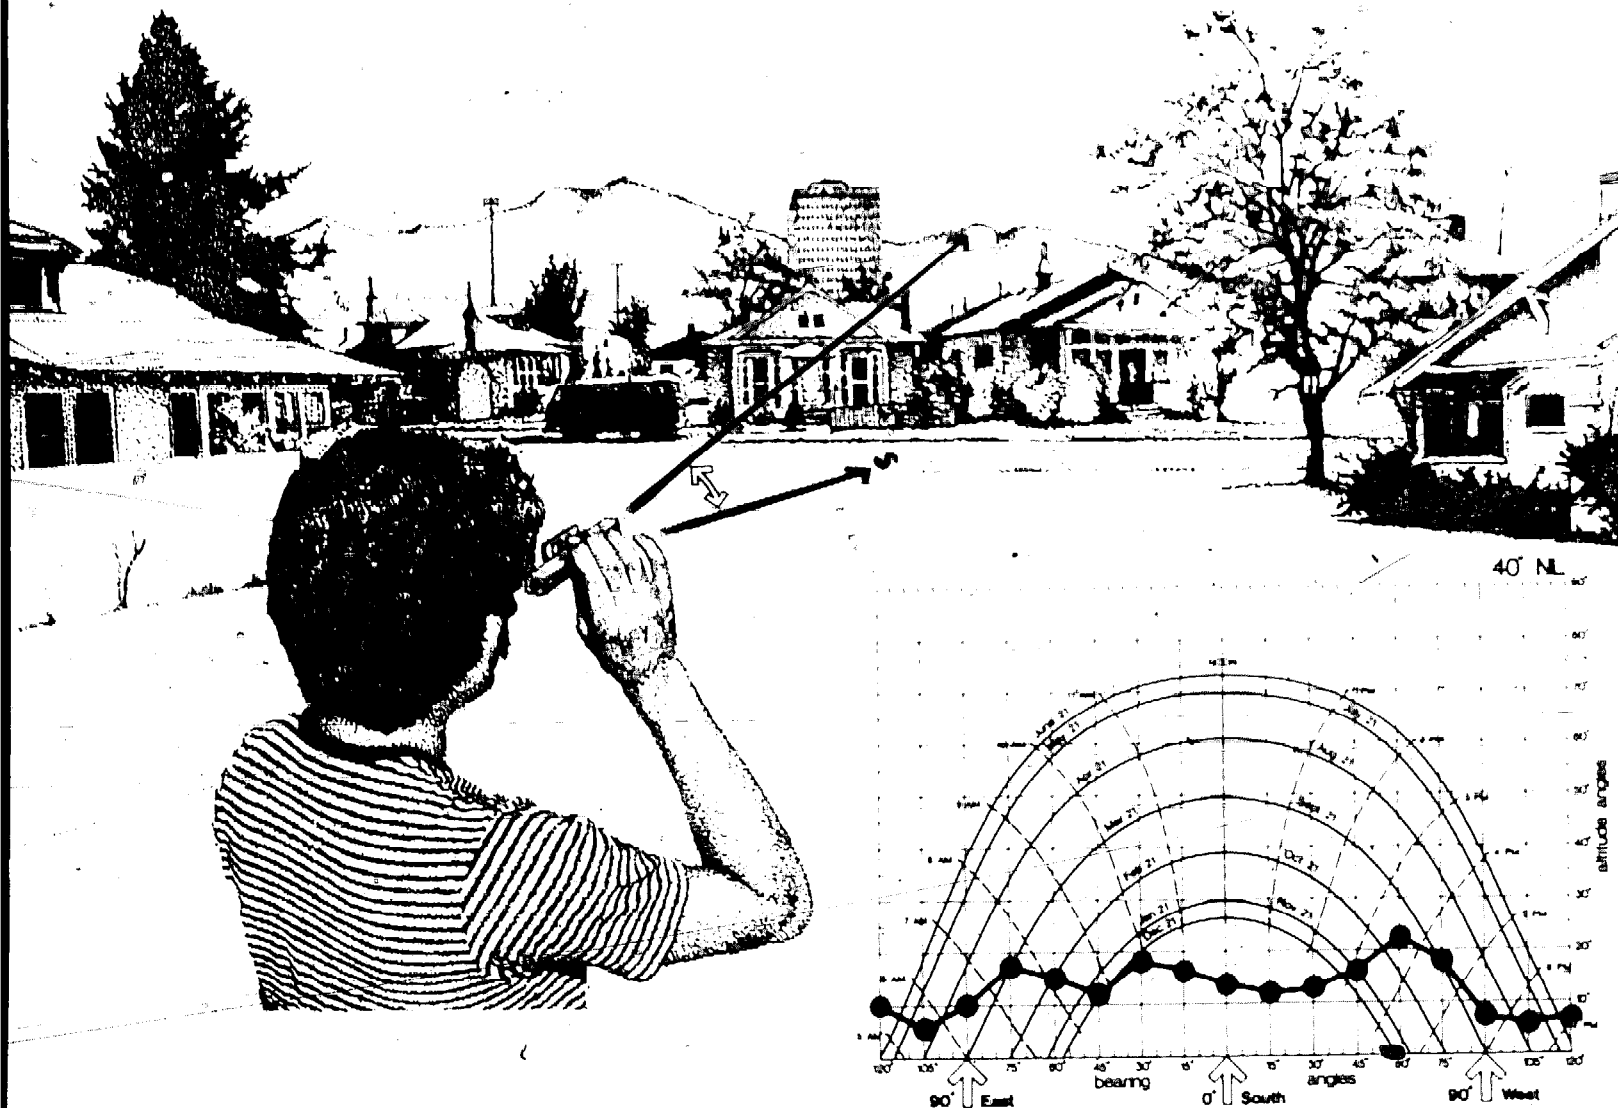


Fig. V-15: Plotting the skyline.

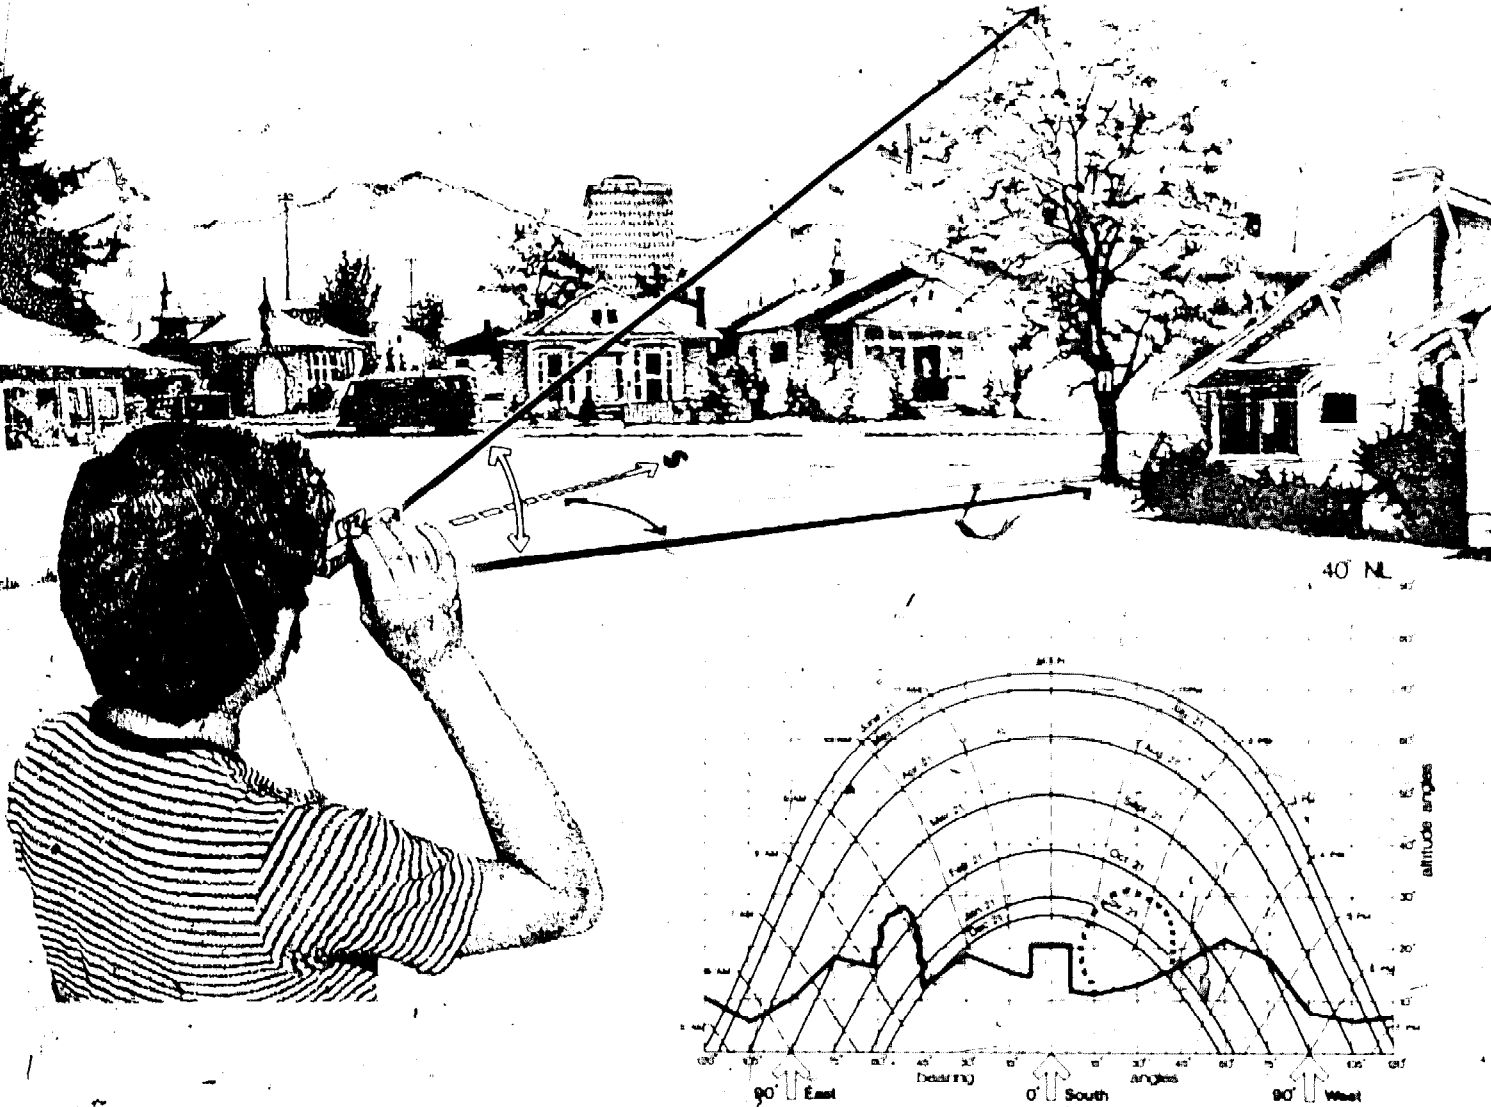


Fig. V-16: Plotting tall permanent objects.

4. For isolated tall objects that block the sun during the winter, such as tall evergreen trees, find both the azimuth and altitude angles for each object and plot them on the chart.
5. Finally, plot the deciduous trees in the skyline with a dotted line. These are of special nature, because by losing their leaves in the winter they let most of the sun pass through as long as they are not densely spaced.

This completes the skyline. The open areas on the sun chart are the times when the sun will reach that point on the site.

The Solar Radiation Calculator

In the design of passive solar heating and cooling systems for buildings, it is important to know the amount of radiation or heat energy that strikes a surface on a winter-clear day, over an entire day, or at some particular hour.

After making some basic assumptions about the nature of the atmosphere and the nature of reflecting surfaces, it is possible to calculate the amount of radiation (sun's heat measured in Btu's) intercepted by a surface, on a clear day, for any position of the sun in relation to that surface. A computer program was developed* to plot all the possible positions of the sun where a square foot of surface would receive a fixed quantity of radiation, such as 50, 75 or 100 Btu's in one hour. The positions of the sun, for each quantity, were connected and drawn as four illustrations, that follow, called solar radiation calculators, to fit and be used with the sun chart.



The solar intensity masks are used to determine the amount of heat energy striking a surface. The lines on the masks represent *winter-clear day*, hourly totals of heat energy (in Btu's) striking a square foot of surface. The mask marked "90°" is for vertical surfaces, mask "60°" for inclined surfaces of 60° (as measured from the horizon), mask "30°" for inclined surfaces of 30° and mask "0°" for horizontal surfaces.

Transfer the mask you choose to transparent material and use the "center axis" and "base line" to align it with the sun chart. In order to find the amount of heat in Btu's per square foot per hour intercepted by a surface facing in any direction, set the base line of the mask directly over the base line of the sun chart. Using a compass, determine the direction that your surface faces to the east or west of true south. Keeping the base lines aligned, shift the pointer of the mask to line up with the number of degrees (azimuth angle) your surface faces to the east or west of true south. You are now ready to determine the solar intensity values for that surface.


Set the pointer on the mask to line up with 45° west on the base line of the sun chart. Be sure the base lines of both sheets are in line. The sun chart and mask are now aligned to read the solar intensity values.

*Computer program was developed by Mark Steven Baker from solar radiation formulas found in the ASHRAE *Handbook of Fundamentals* (1972).


The Passive Solar Energy Book

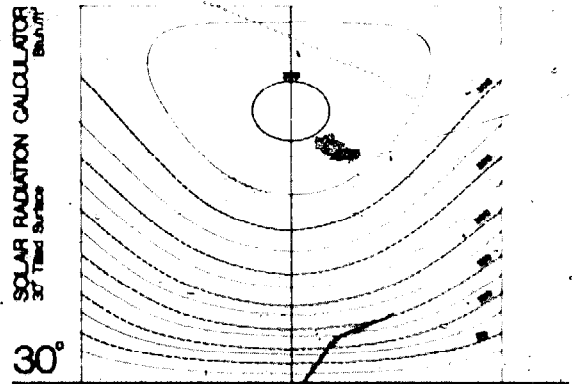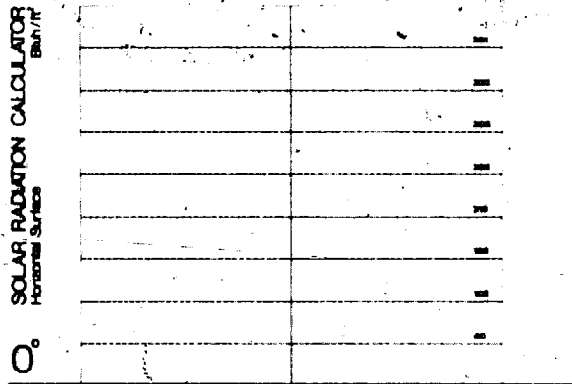

Align Pointer to Direction of Tilted Surface Plane!

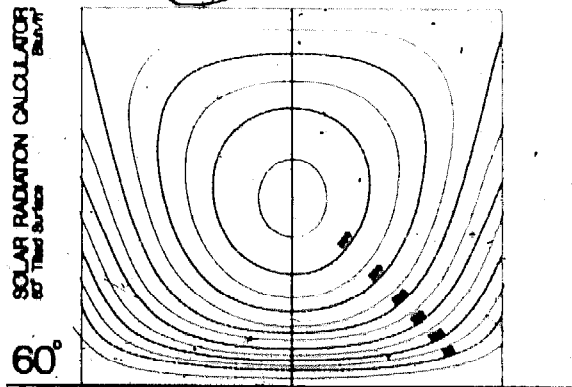

Align Pointer to Direction of Tilted Surface Plane

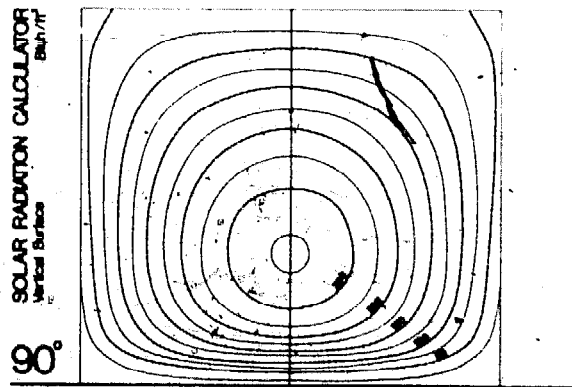

Align Pointer to Direction of Vertical Surface Plane

Fig. V-17: Solar radiation calculators.

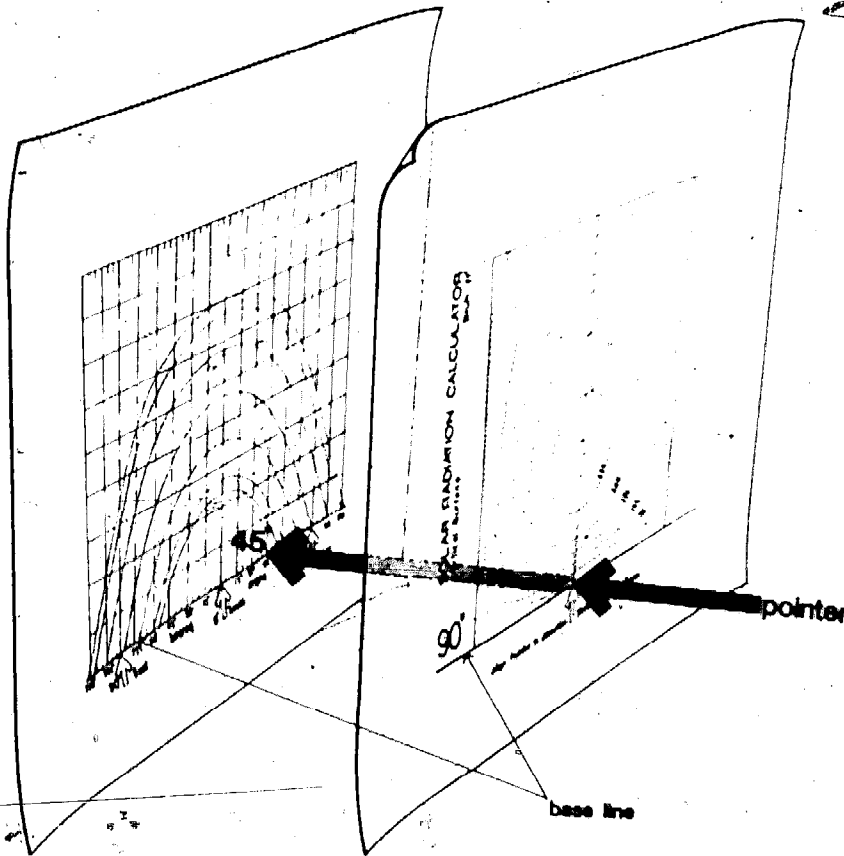


Fig. V-18: Alignment example for a vertical surface facing 45° west of south.

Hourly Radiation Totals

To determine the winter-clear day, hourly totals of heat energy, in Btu's per hour, striking each square foot of surface area:

1. Select the proper mask based on the slope of the surface (horizontal, 30°, 60° and vertical).
2. Select the proper sun chart for the latitude of your location (if your location is in-between latitudes, choose the closest one).
3. Keeping the base lines aligned, set the pointer (center axis) of the mask on the azimuth angle that the surface faces to the east or west of true south.
4. Select the month you want to take the reading and use that sun's path to read the values.
5. Select the hour of the month in which you want the reading: the intersection of the hour line and the sun path will locate the position of

The Passive Solar Energy Book

the sun. Read the number of Btu's for that sun's position from the radiation mask. If the point where you want the reading falls between radiation lines, interpolate to find the value.

Note: Because the value of atmospheric moisture content varies greatly across the United States, the solar intensity numbers need to be adjusted depending upon your location. A correction called the Clearness Factor must be applied to the clear-day values. The map in figure V-19 shows lines of equal clearness for winter conditions. Find the line and corresponding Clearness Factor closest to your area and multiply it by the hourly solar intensity numbers from the mask.

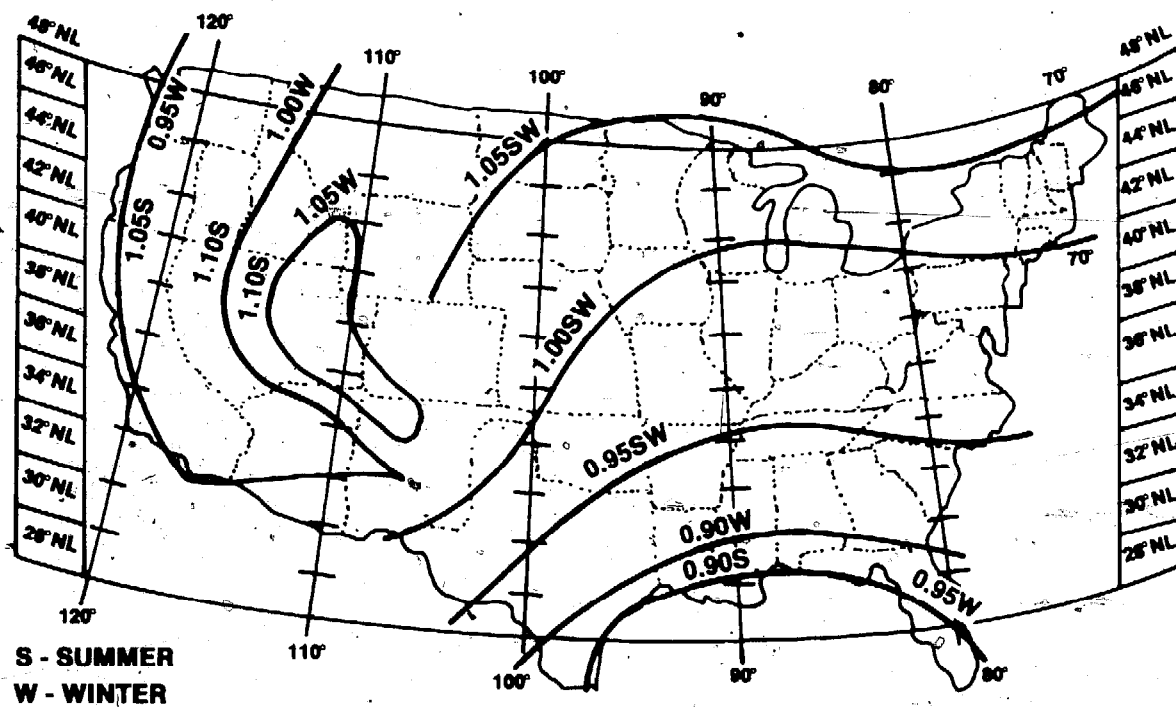


Fig. V-19: Map of clearness adjustment factors.

Source: ASHRAE, *Handbook of Fundamentals*, 1972.

Daily Radiation Totals

To determine the total daily amount of heat energy striking a surface, simply follow the procedure for hourly totals for each hour on the sun chart and total these to get the daily total. If the hourly totals have not been adjusted for your area, then adjust the daily total by multiplying it by the appropriate adjustment factor from the map.

30°


SOLAR RADIATION CALCULATOR

30° Tilted Surface Btuh/ft²

Align Pointer to Direction



Tilted Surface Faces

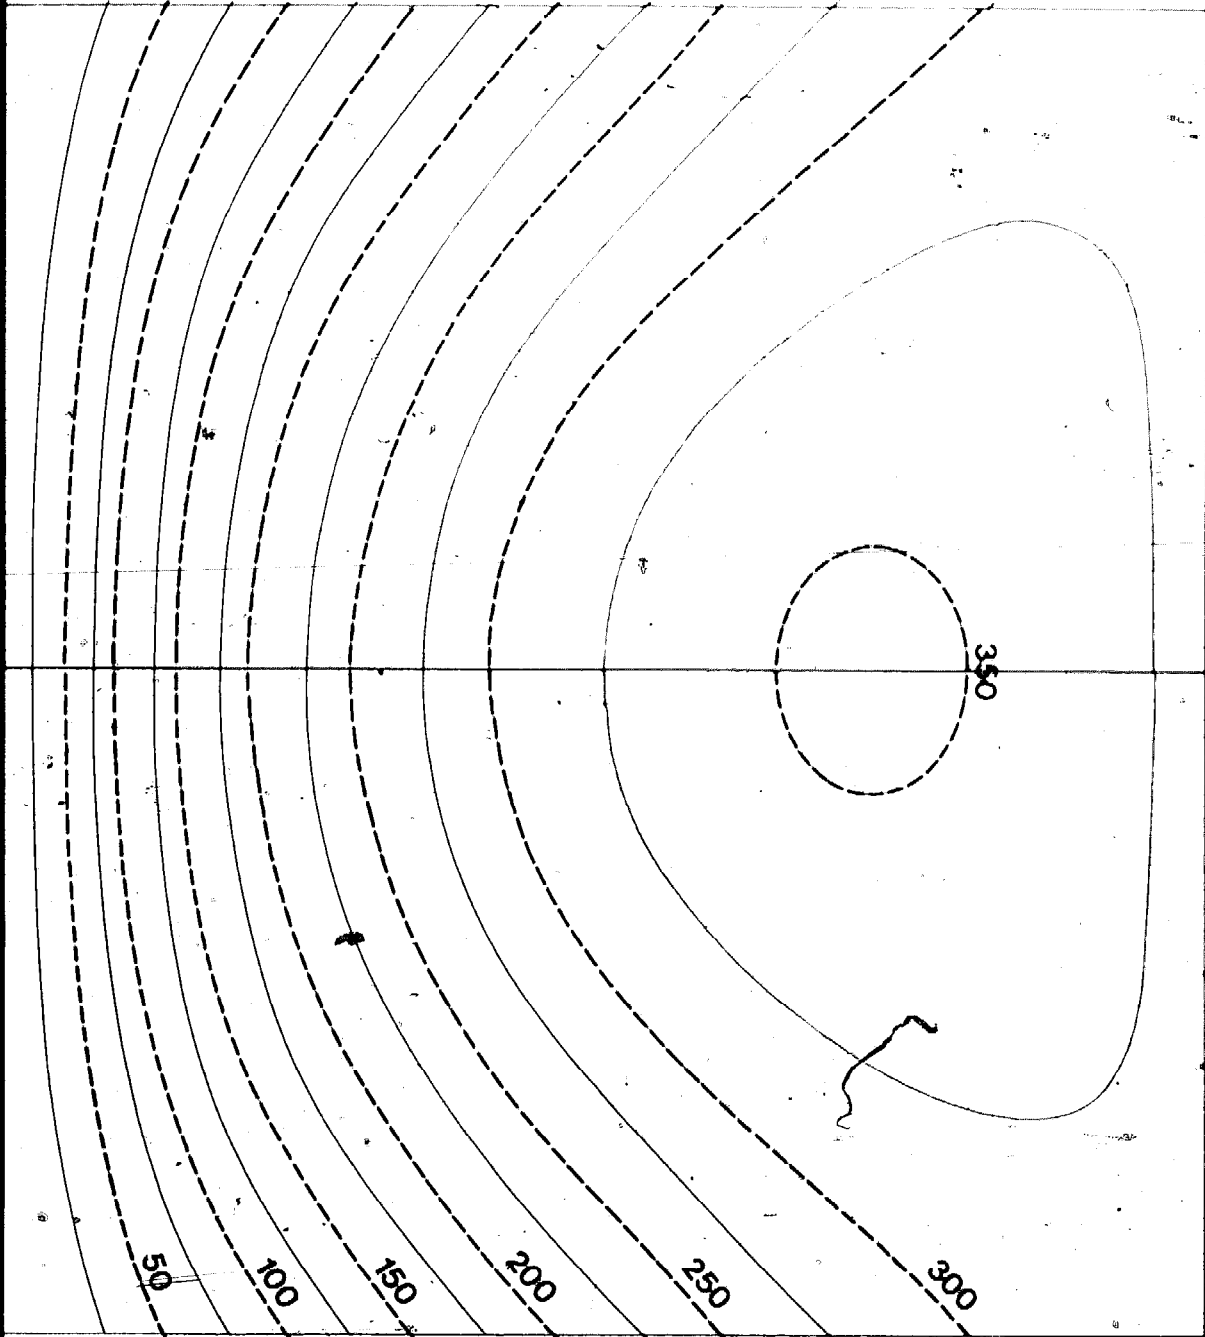



60°

SOLAR RADIATION CALCULATOR

60° Tilted Surface

Btuh/ft²

Align Pointer to Direction of Tilted Surface Faces

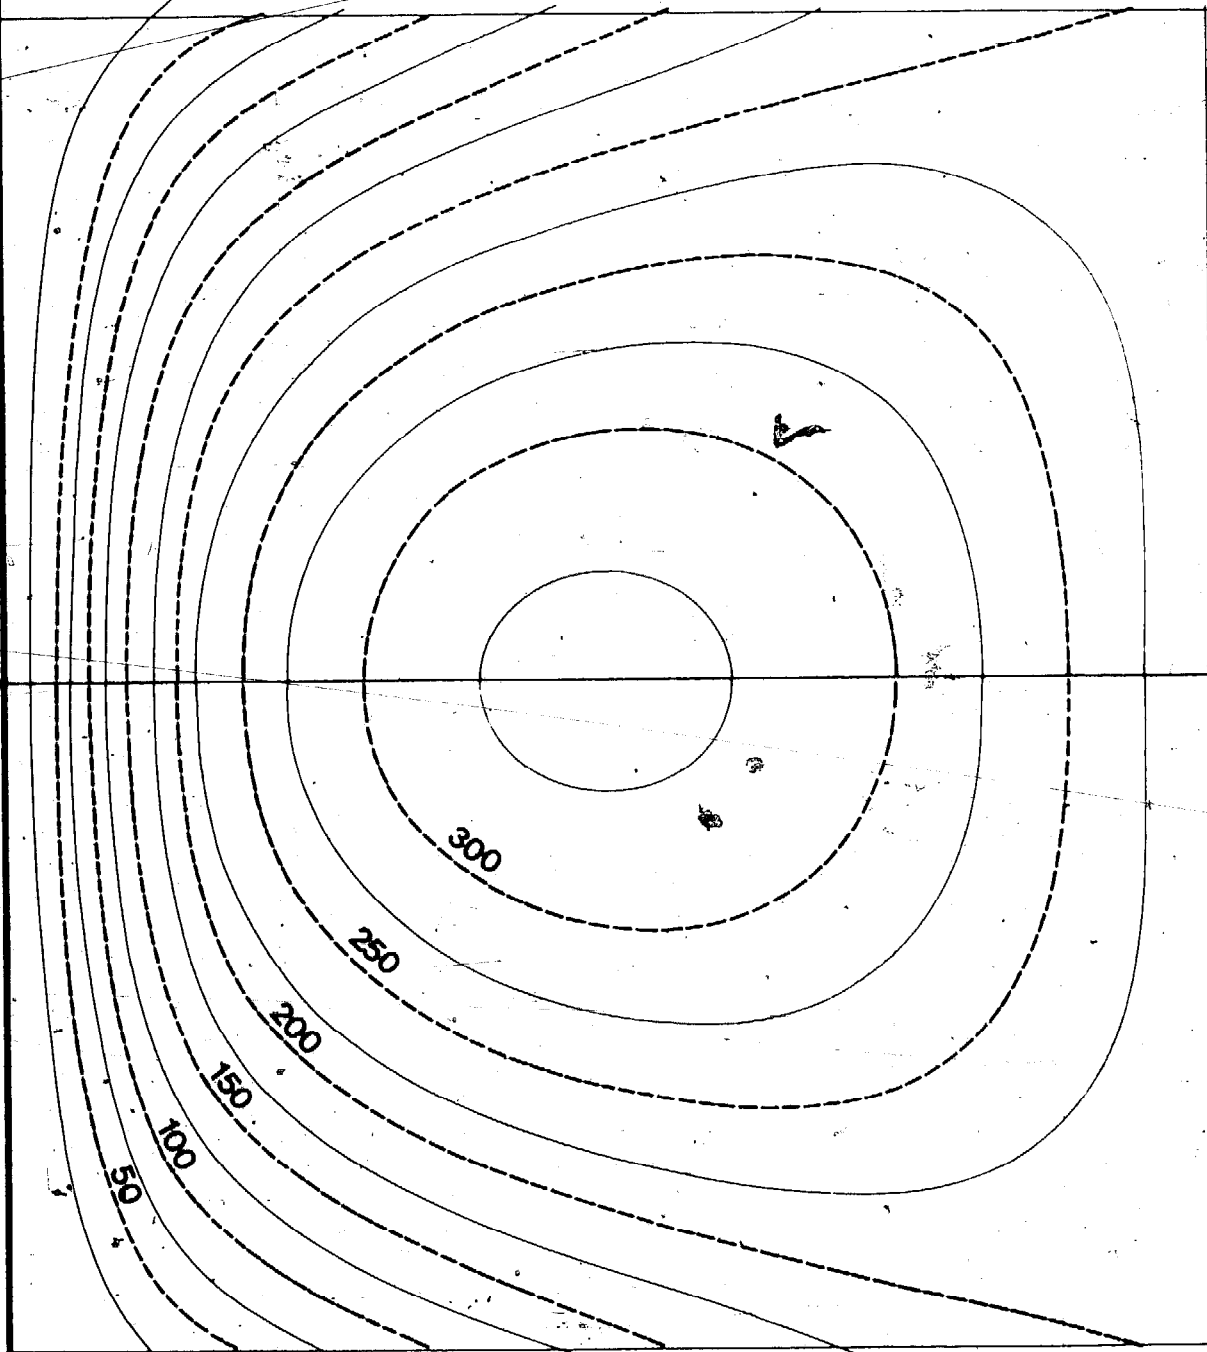


90°

SOLAR RADIATION CALCULATOR

Vertical Surface

Btuh / ft²

Align Pointer to Direction
↓
Vertical Surface Faces

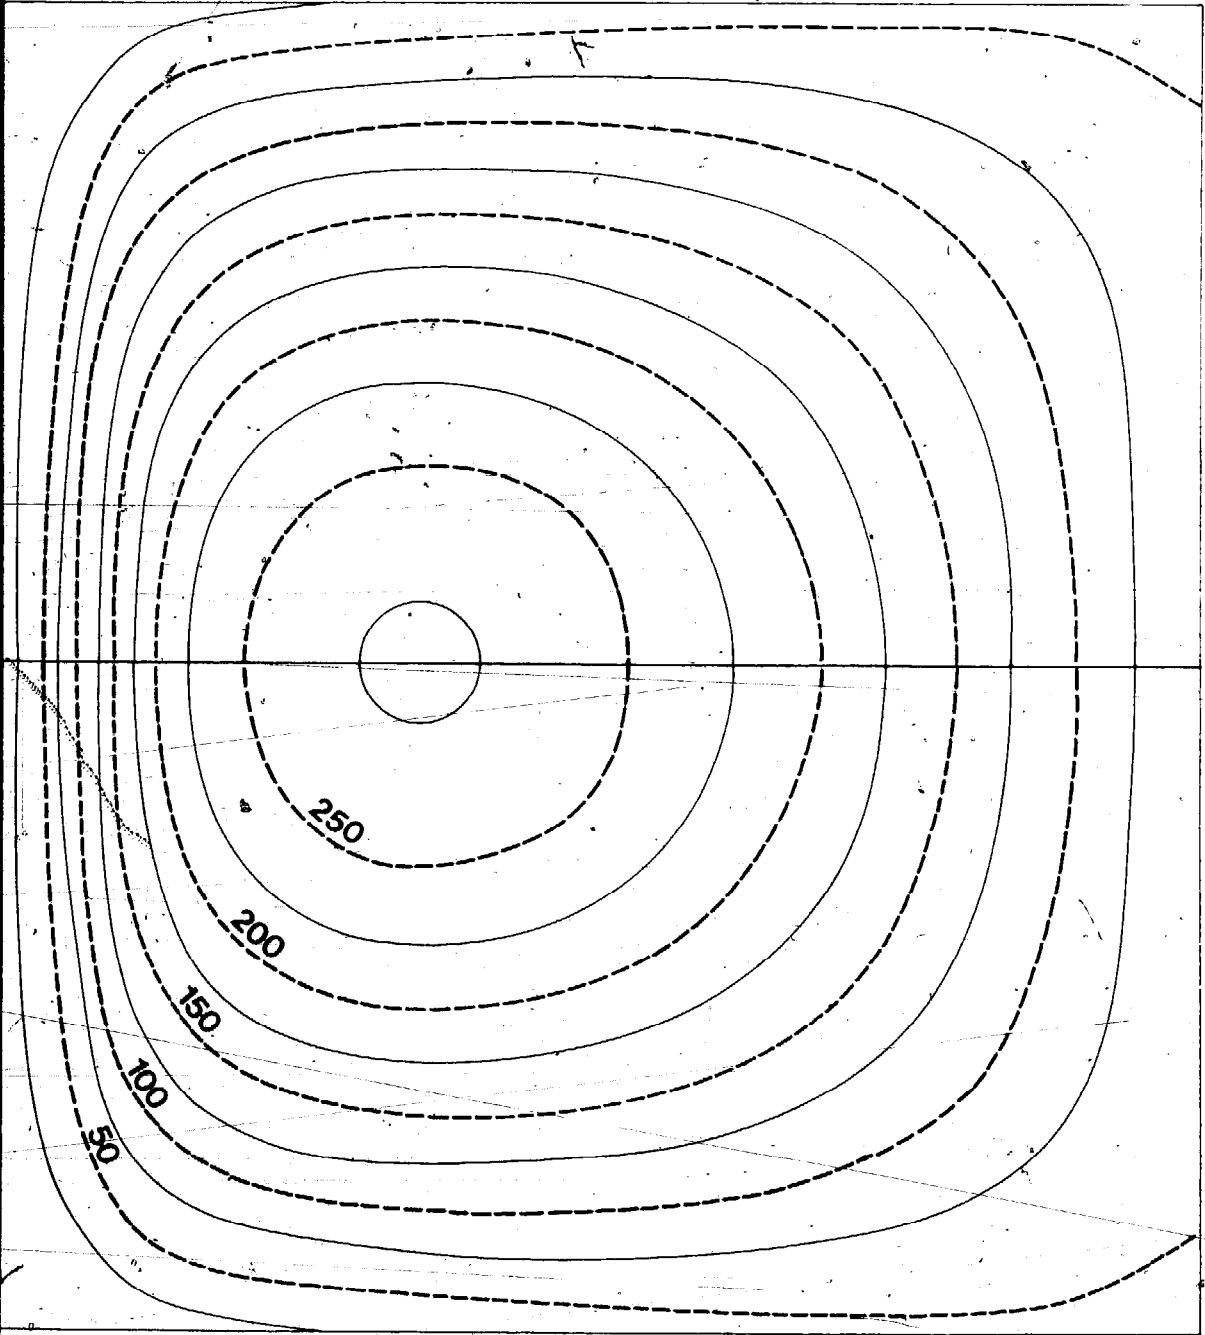

The Shading Calculator

Looking from a window, a shading device or any obstruction for that matter (such as a tree or building) will block part of the skydome from view. To put it another way, the window will be in shade when the sun travels across the obstructed part of the skydome.

For any surface (such as a window or clerestory), skydome obstructions and shading devices can be graphically plotted to construct a *shading mask*. This mask, when superimposed over a sun chart, accurately determines the times that direct sunlight is blocked from reaching that surface. Since the masks are geometric descriptions of the shading characteristics of a particular device or obstruction, they are not dependent on latitude, orientation or time. Once plotted for a particular device, they can be used over any sun chart.

Shading devices can be grouped into three categories: the horizontal overhang, vertical fin, and overhang/fin combination or eggcrate. The horizontal overhang is characterized by a shading mask with a curved shadow line running from one edge of the mask to the other;

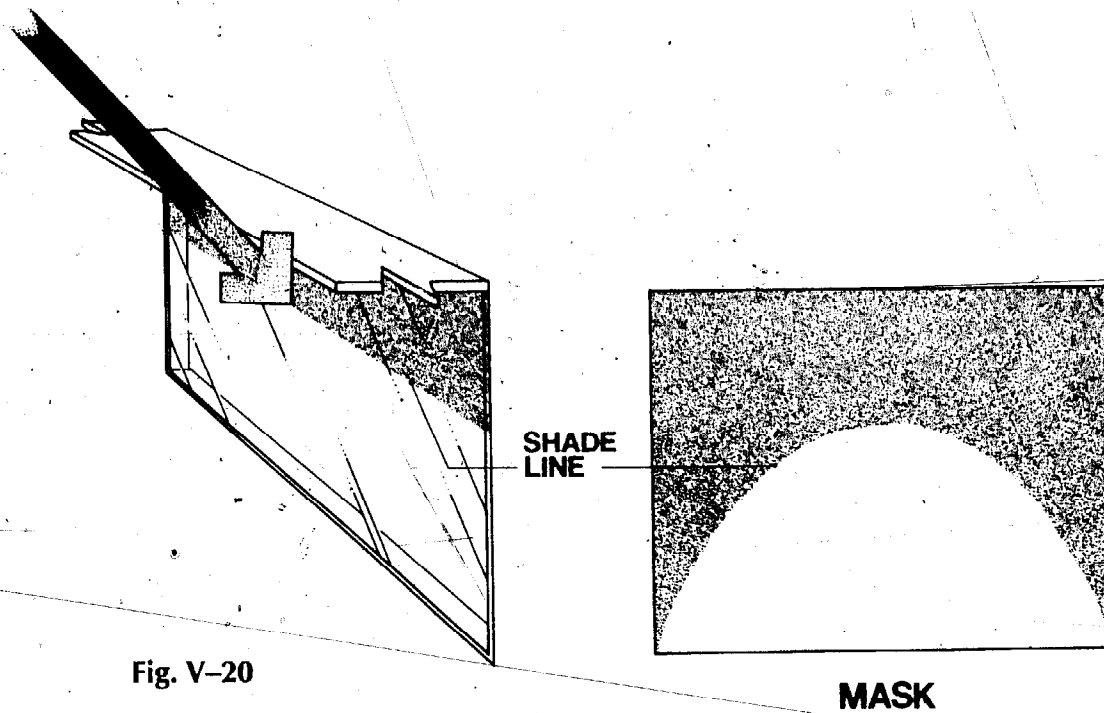


Fig. V-20

the vertical fin is characterized by a shading mask with a vertical shading line;

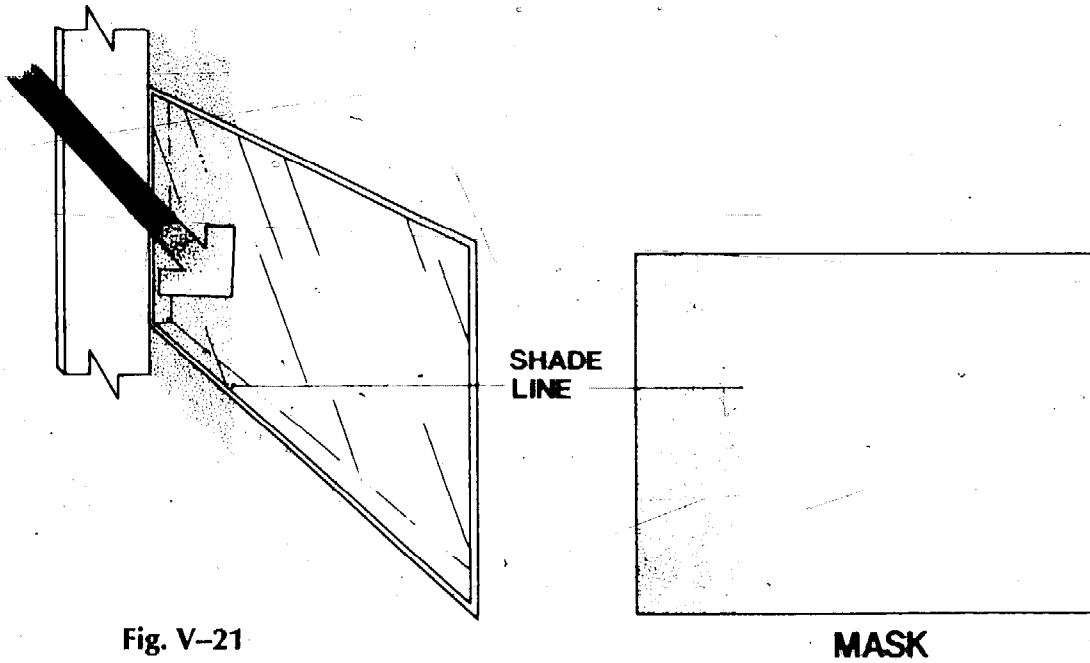


Fig. V-21

and the combination horizontal overhang/vertical fin is characterized by a combination of both curved and vertical shading lines.

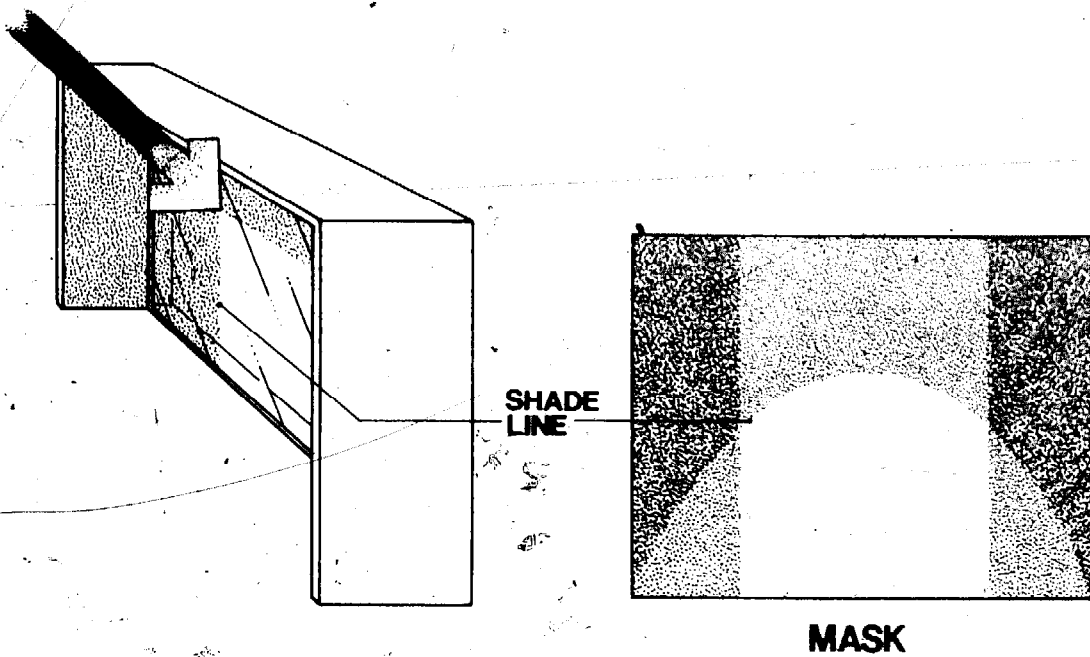


Fig. V-22

SHADING CALCULATOR

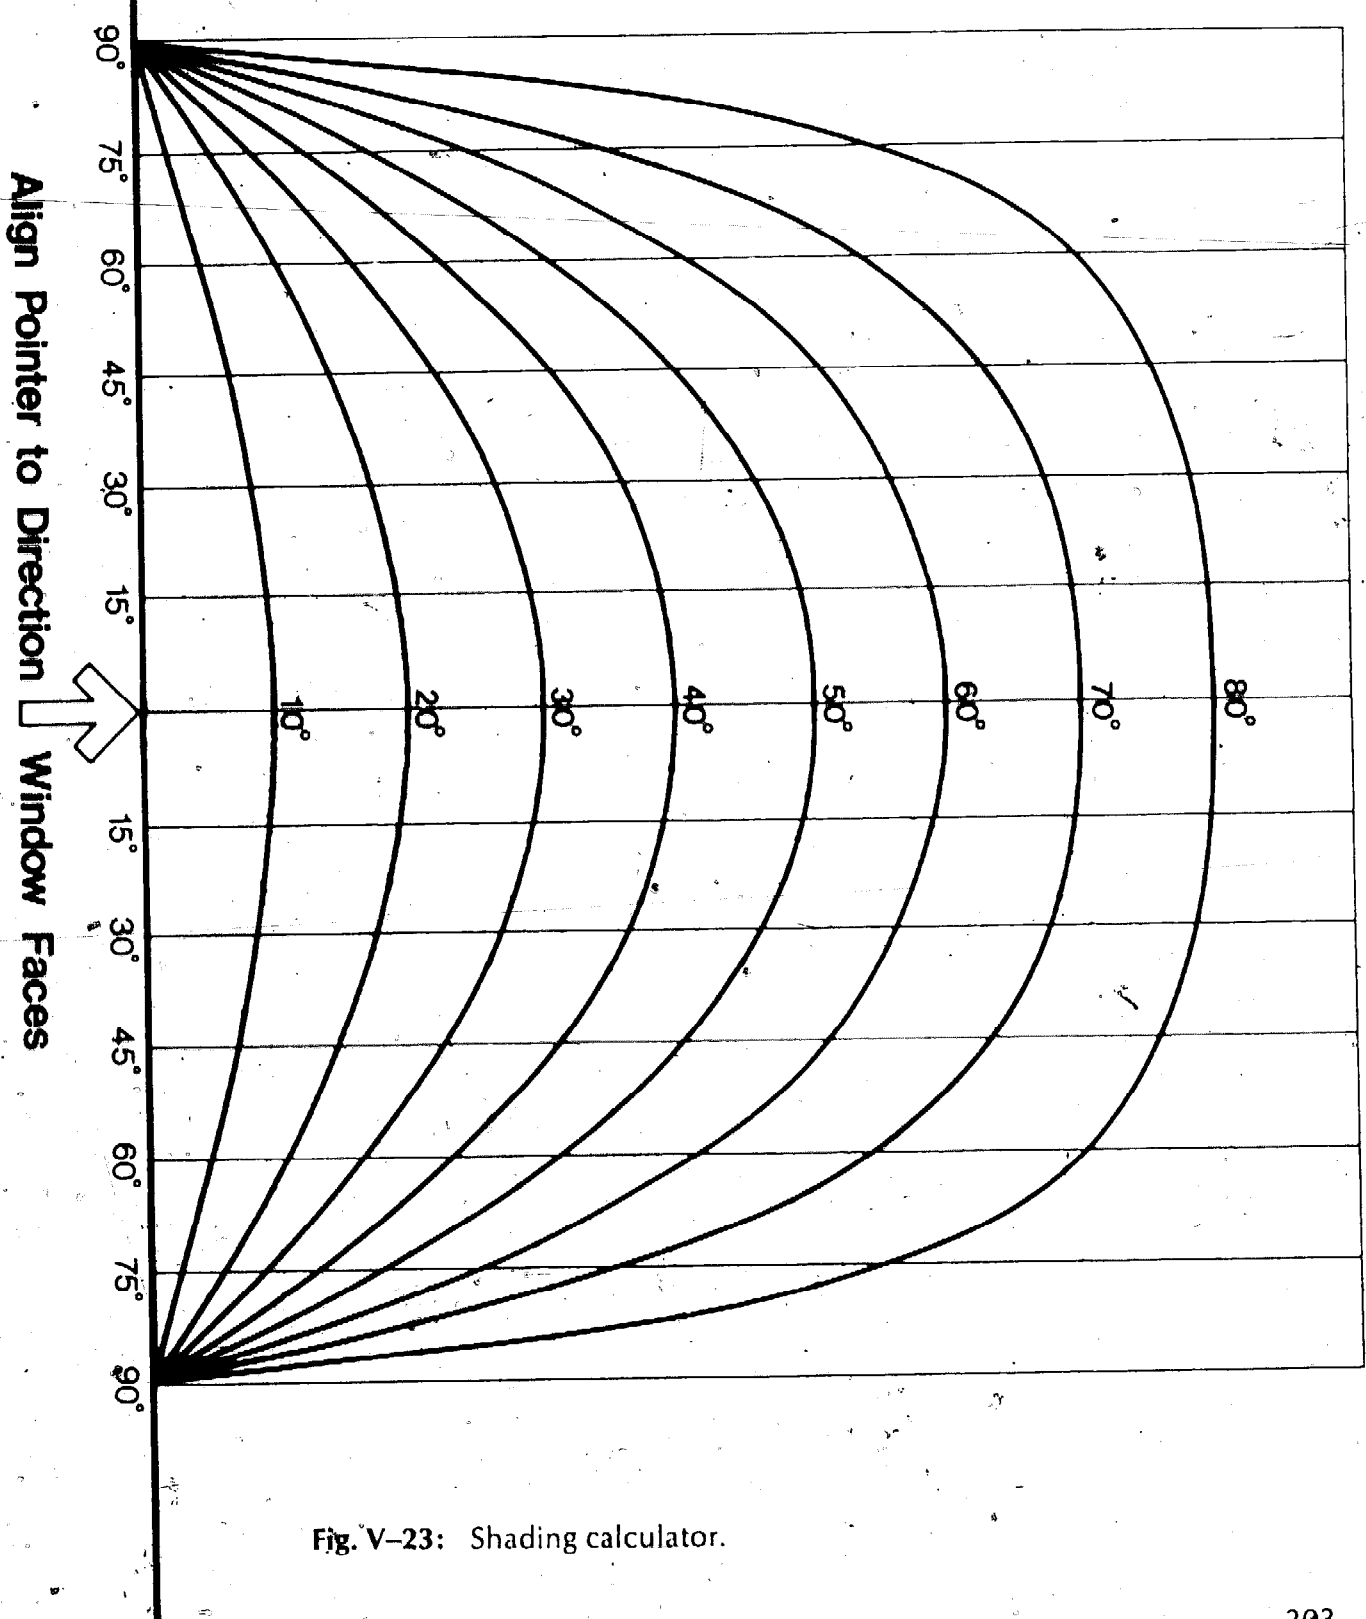


Fig. V-23: Shading calculator.

The Passive Solar Energy Book

The shading masks are independent of the size of a shading device, but instead depend upon the ratios generated by the dimensions of the device and the window. These ratios are expressed as the angle the window makes with the shading device.

The *shading calculator* shown in figure V-23 will assist you in generating a shading mask.

The curved lines that run from the lower right-hand corner of the calculator to the lower left-hand corner are used to plot *horizontal* obstruction lines parallel to a window and the vertical lines on the calculator serve to plot *vertical* obstruction lines parallel to the window.

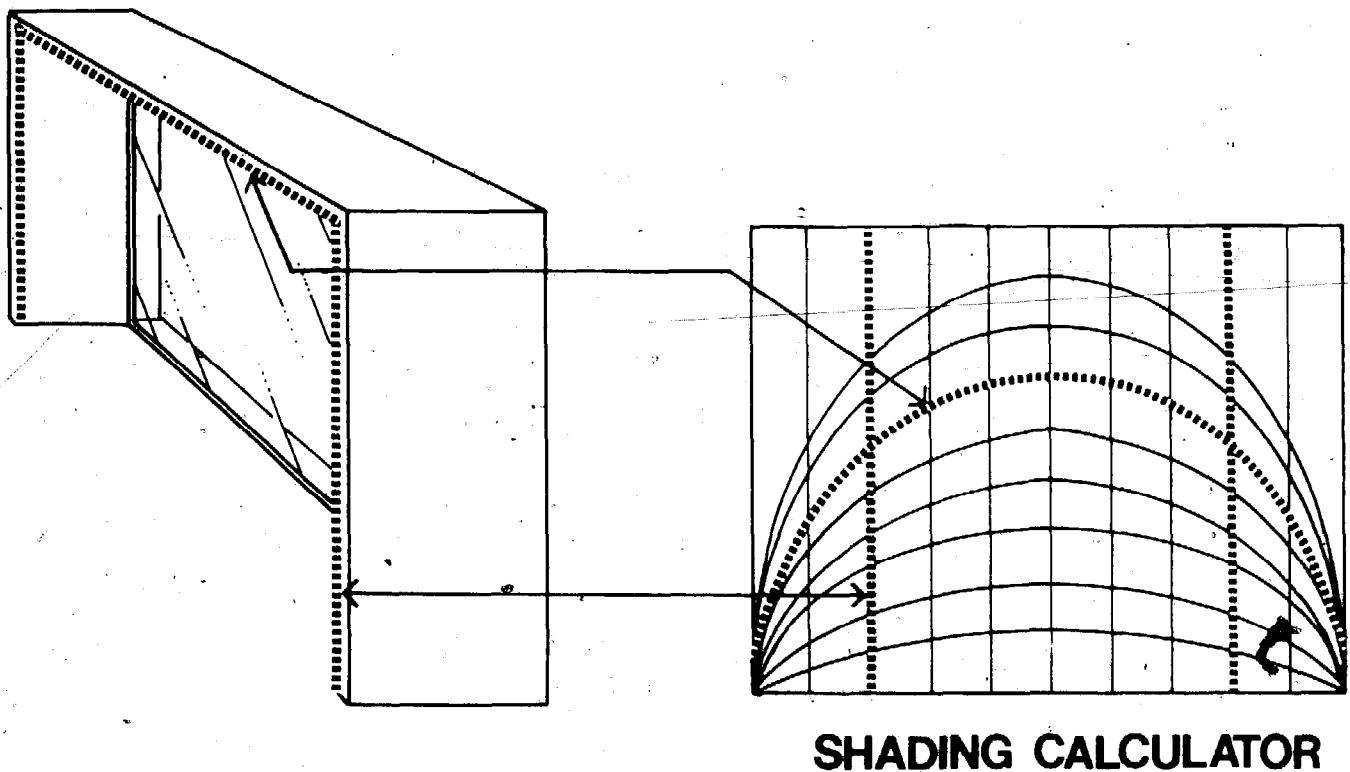


Fig. V-24

Plotting the Shading Mask

Horizontal Overhang

To construct a shading mask for a window with a horizontal overhang, first determine the angle from a line perpendicular to the bottom of the window to the edge of the overhang (angle a), and the angle from the *middle* of the window to the edge of the overhang (angle b). These angles represent 100% and 50% shading of the window. Then, using the shading calculator, draw in the shade lines that represent angle a and angle b .

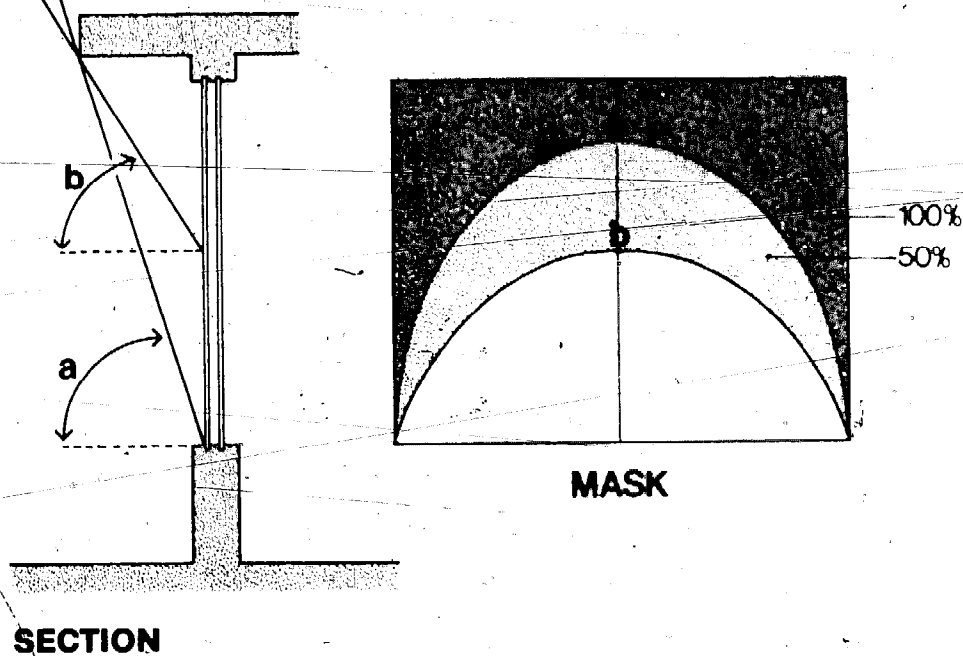


Fig. V-25

This completes the shading mask. The mask has a pointer and a base line for alignment with the sun chart. Select the sun chart for your latitude, then keeping the base line of the mask directly over the base line of the sun chart, shift the pointer of the mask to line up with the number of degrees (azimuth angle) your window faces to the east or west of true south. The window will be completely shaded during the times that the sun is above the 100% shading line, and partially shaded (50%) at the 50% shading line.

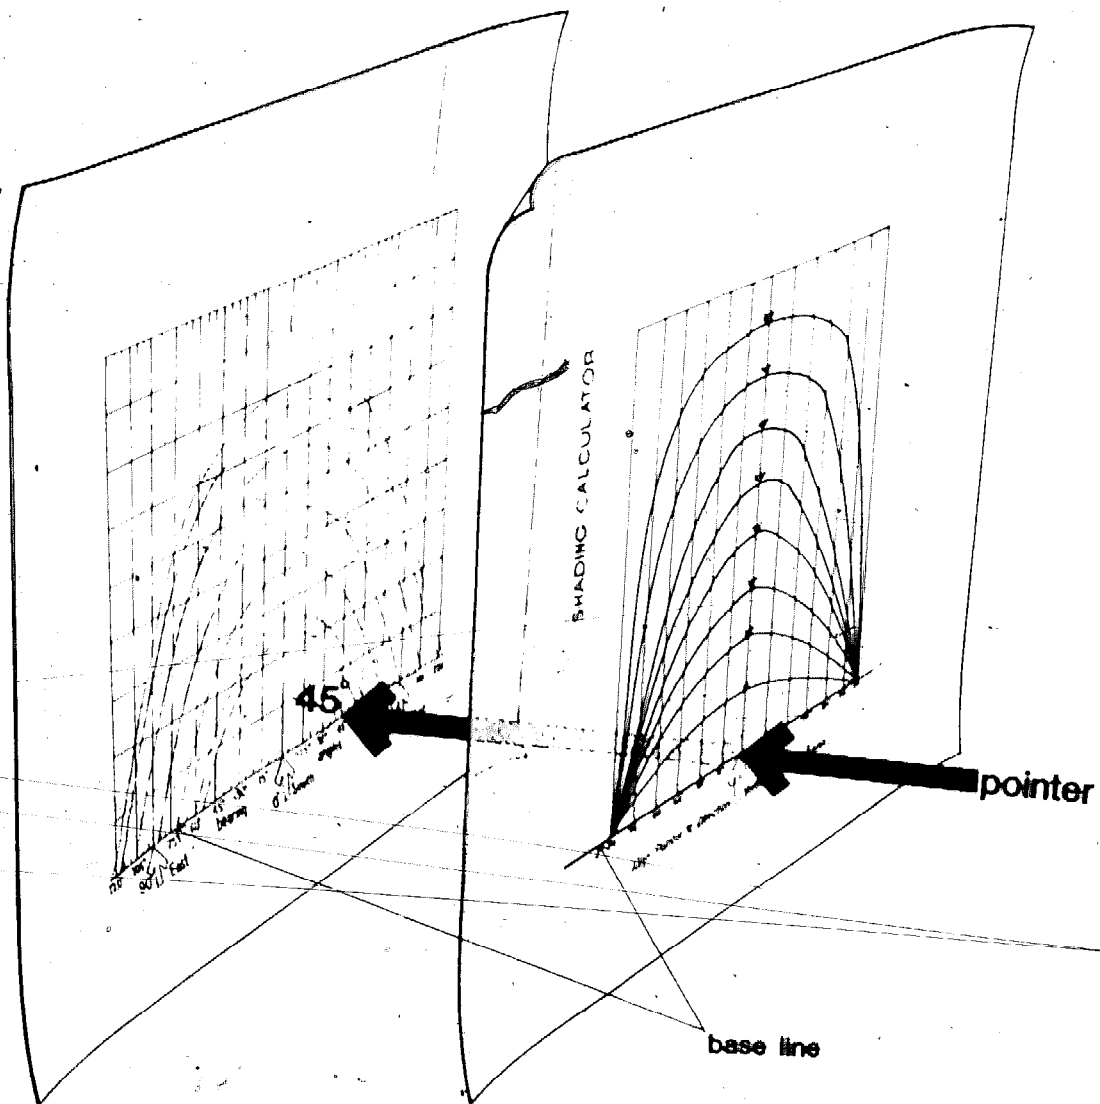


Fig. V-26: Alignment example for a window facing 45° west of south.

Although the mask plots 100% and 50% shading of a window, the procedure can be repeated to generate a more complete mask which includes 25% and 75% shading.

Vertical Fins

There are basically two types of vertical fin shading devices: those that project out perpendicular from the face of the window and those that project out at an angle. To construct a mask for either device:

The Tools

First, determine angles a and b as shown in figure V-27. These angles represent the 100% shading lines. Then determine angles c and d ; these represent the 50% shading lines. From the base line of the shading calculator draw vertical lines that correspond to angles a , b , c and d . This completes the shading mask.

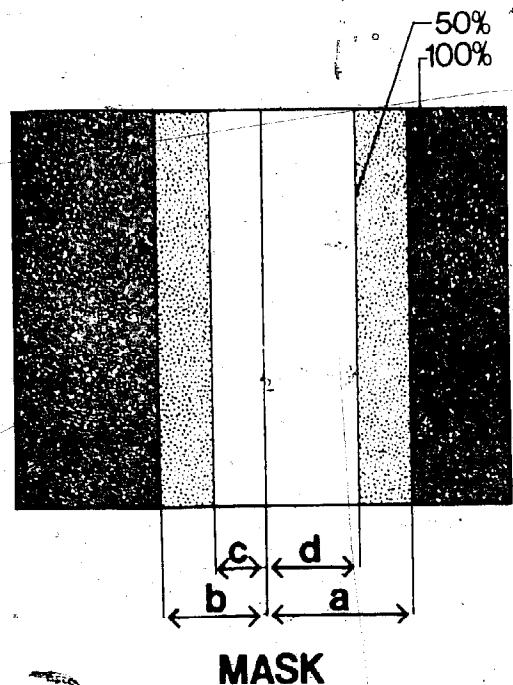
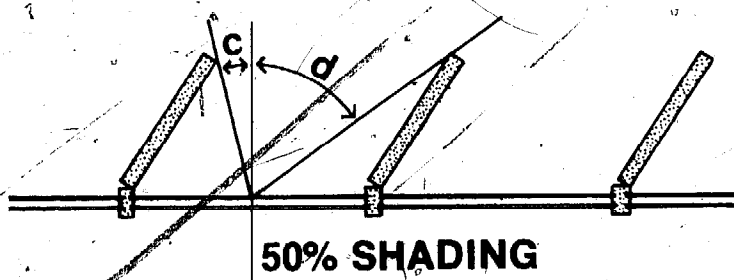
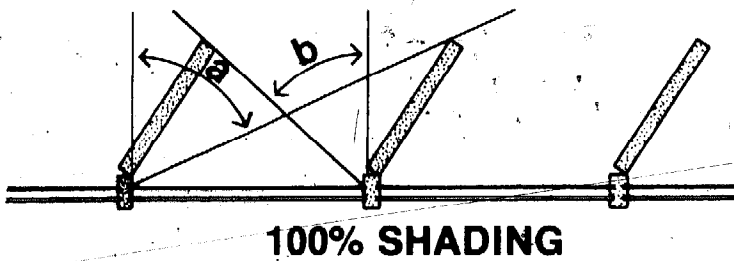
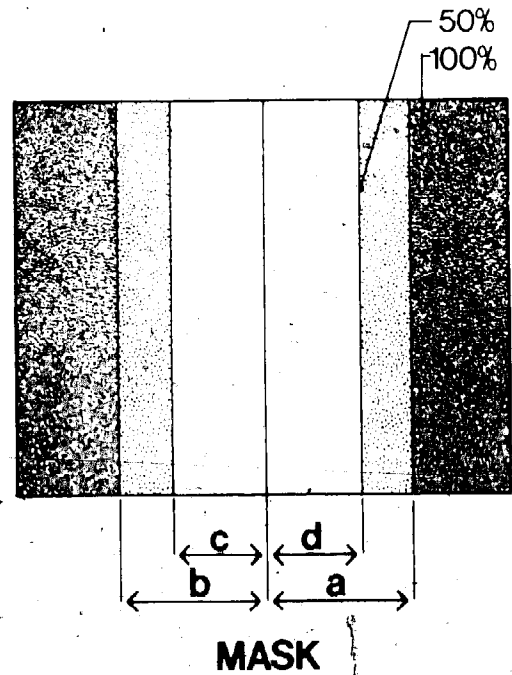
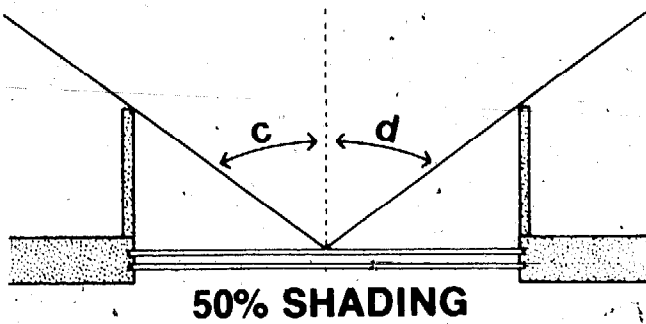
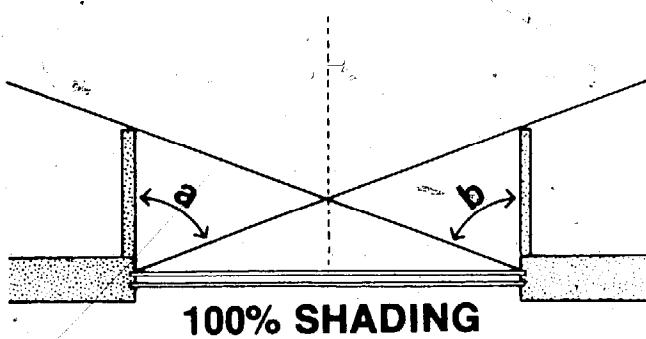


Fig. V-27

The Passive Solar Energy Book

Then align the shading mask over the sun chart to the angle the window faces to the east or west of true south. The window will be completely shaded during the times the sun is outside of the 100% shading lines and partially shaded (50%) at the 50% shading lines.

Combination Horizontal Overhang/Vertical Fin

To construct the shading mask for a combination horizontal overhang/vertical fin, simply combine the shading masks for each device.

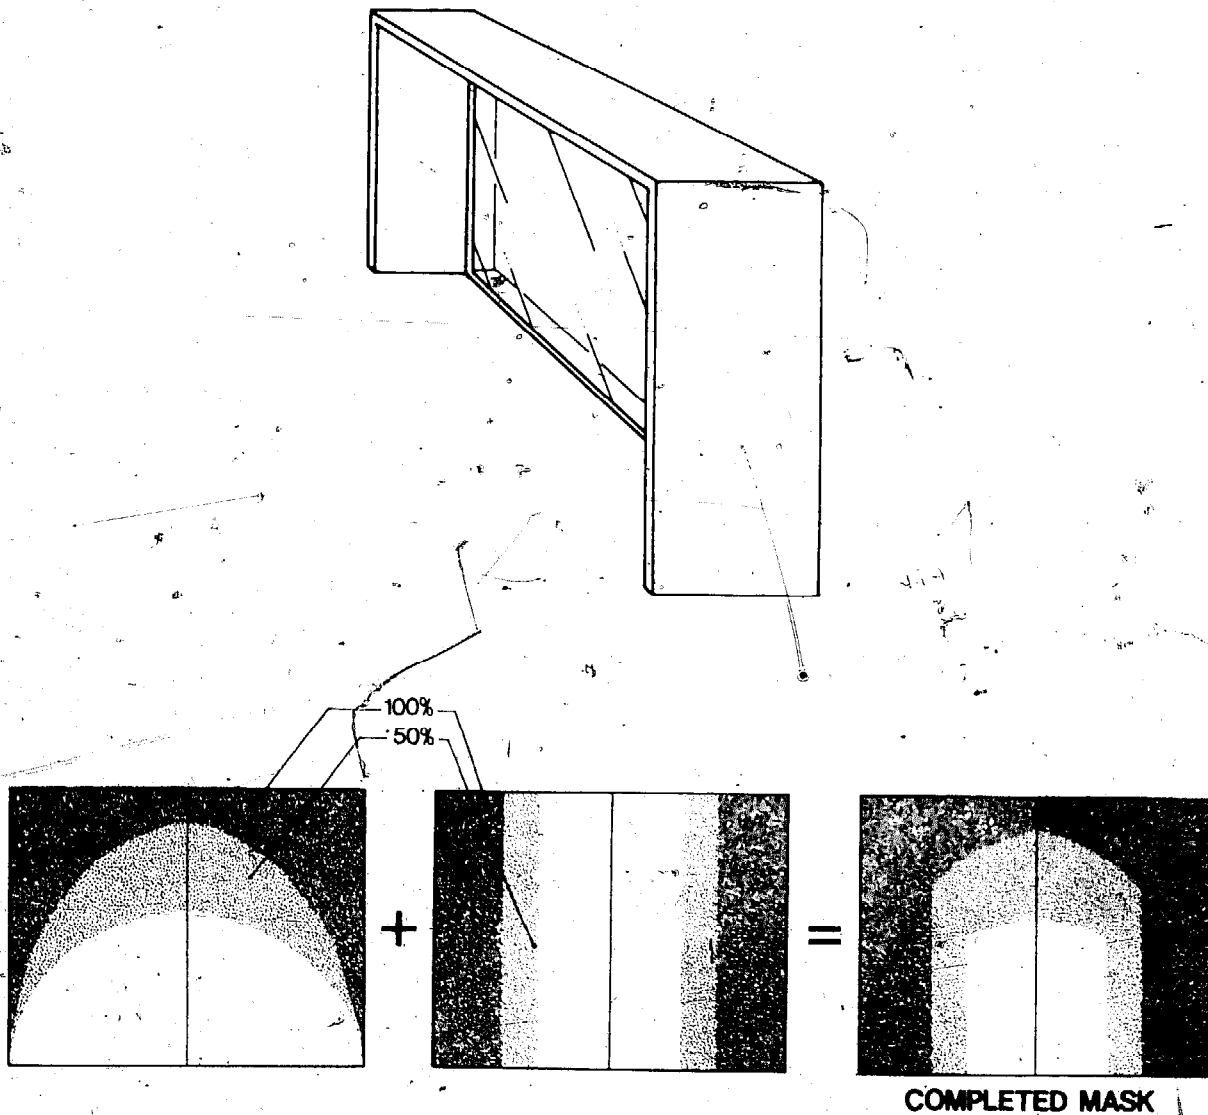


Fig. V-28

1 Appendix

Performance Calculations

So far, general rules of thumb for designing and sizing a passive solar-heating system have been given in the form of patterns. The patterns make it possible to integrate passive solar concepts when designing a building. They give enough detailed information to size a system that will function effectively. After a preliminary design for the building is complete, it is then possible to calculate the thermal performance of each space and make adjustments to the system, if necessary.

The patterns give rules of thumb for sizing a system based on clear-day solar radiation and average outdoor temperatures for the winter months. Essentially, this sizing procedure balances the heat lost from a space (kept at 70°F) over the day with the energy collected from the sun (when shining) that same day. This condition is referred to as the design-day. Because design-day data have been used, it can be expected that the system will not perform as effectively under more severe conditions, although the massive nature of passive buildings tends to moderate the effects of weather extremes. It is reasonable to expect that a sizing procedure for the worst possible winter weather conditions is usually not practical. To do that would result in spaces that are uncomfortably warm during periods of normal sunny weather and would lead to a design that is oversized, and most likely uneconomical to build. For this reason, some form of back-up heating system is desirable in most passive solar heated buildings. Due to the complicated nature of energy flows in a passive building, calculating system performance is a difficult and tedious process, usually requiring the use of a computer. However, by compressing this process into a few relatively simple calculations, it was found that only a small degree of accuracy was sacrificed. Since even the most sophisticated calculation procedures are subject to error due to the large number of unpredictable variables associated with passive systems (such as occupant space use, interior furnishings and surface colors, estimating infiltration rates), this simplified procedure is appropriate for most small-scale applications of passive systems.

The Passive Solar Energy Book

There are six steps involved in calculating a system's performance:

1. Calculating the rate of space heat loss.
2. Calculating space heat gain.
3. Determining the average daily indoor temperature.
4. Determining the daily indoor temperature fluctuation.
5. Calculating the auxiliary space heating requirements.
6. Determining the cost effectiveness of the system.

Step 1. Calculating Space Heat Loss in Winter

The quantity of solar energy needed by a space in winter is dependent upon the hourly rate of heat loss through the exterior skin of the building. Heat is lost through the skin of a building by two methods: heat loss through the walls, floor, roof and windows (conduction losses) and the heat loss through the exchange of warmed indoor air with cold outdoor air (infiltration losses). The total space heat loss is then the sum of the conduction losses plus the infiltration losses. In calculating heat loss, it is necessary to compute the hourly rate for each space in the building separately.

The hourly rate, when divided by the floor area of the space and then multiplied by 24 hours, gives an overall space U value expressed in Btu's per day per square foot of floor area per °F (Btu/day-sq ft_{floor}-°F):

$$U_{sp} = \frac{HL_{total}}{A_{floor}} \times 24 \text{ hours}$$

This is a convenient figure to use when calculating indoor air temperatures and the yearly contribution of solar energy.

It is reasonable to expect that the overall space U value for a well-insulated residence will be between 6 and 12 Btu/day-sq ft_{fl}-°F, and for a greenhouse between 20 and 40 Btu/day-sq ft_{fl}-°F. Table 1-1 is included here to provide you with a quick and easy method of arriving at U_{sp}. The table should be used for estimating purposes only. For a description of detailed heat loss calculations, see the professional edition of *The Passive Solar Energy Book* or the *ASHRAE Handbook of Fundamentals*.

Table 1-1 Short-Cut Heat Loss Estimating

Space ¹	Window Glazing Details	Overall Space Heat Loss ² U _{sp} (Btu/day-sq ft _{rr} °F)			
		Direct Gain System ³	Space w/ a Thermal Storage Wall System ⁴	Space Adjacent to an Attached Greenhouse ⁵	
				1 Exposed Wall	2 or More Exposed Walls
First-floor space w/ heated space above	Single glazing	8.1	12.2	7.2	6.6
	Double glazing or single glazing w/ insulating shutters	5.6	8.9	5.5	4.9
Upper-floor space or one-story-type space	Single glazing	8.9	13.0	8.0	7.4
	Same as above but a 1 1/2-story-high space	12.4	18.1	12.5	11.9
	Double glazing or single glazing w/ insulating shutters	6.4	9.7	6.3	5.7
	Same as above but a 1 1/2-story-high space	9.1	13.7	9.9	9.2

NOTES: 1. Values apply to a well-insulated space with 3 1/2 to 6 inches of insulation in the walls, 6 inches or more in the ceiling, 3 1/2 inches or more under floors above grade or 2 inches of perimeter insulation for a slab on grade.

- 2. Accuracy is believed to be within 15%; this table is recommended for estimates only.
- 3. Area of glazing is roughly 20 to 30% of the space floor area.
- 4. Assumes no heat loss through the thermal wall.
- 5. Assumes no heat loss through the common wall between the space and greenhouse.

Step 2. Calculating Space Heat Gain in Winter

Heat Gain Formulas

• *Direct Solar Heat Gain (HG_{sol})*—All of the sunlight transmitted through a window is collected by a space, as heat. However, the amount transmitted through each square foot of glass depends upon many factors, such as the location or latitude of the building, the orientation of the window, the number and type of window glazing used, and the shading of a window by nearby obstructions, including shading devices.

Appendix 6 lists daily totals of clear-day, solar heat gain (I_t) transmitted through double glass at various latitudes and window orientations. To calculate solar heat gain, first select the proper table for your location. For instance, at 40°NL , if a vertical window is oriented due south, the solar heat gain through a square foot of unshaded

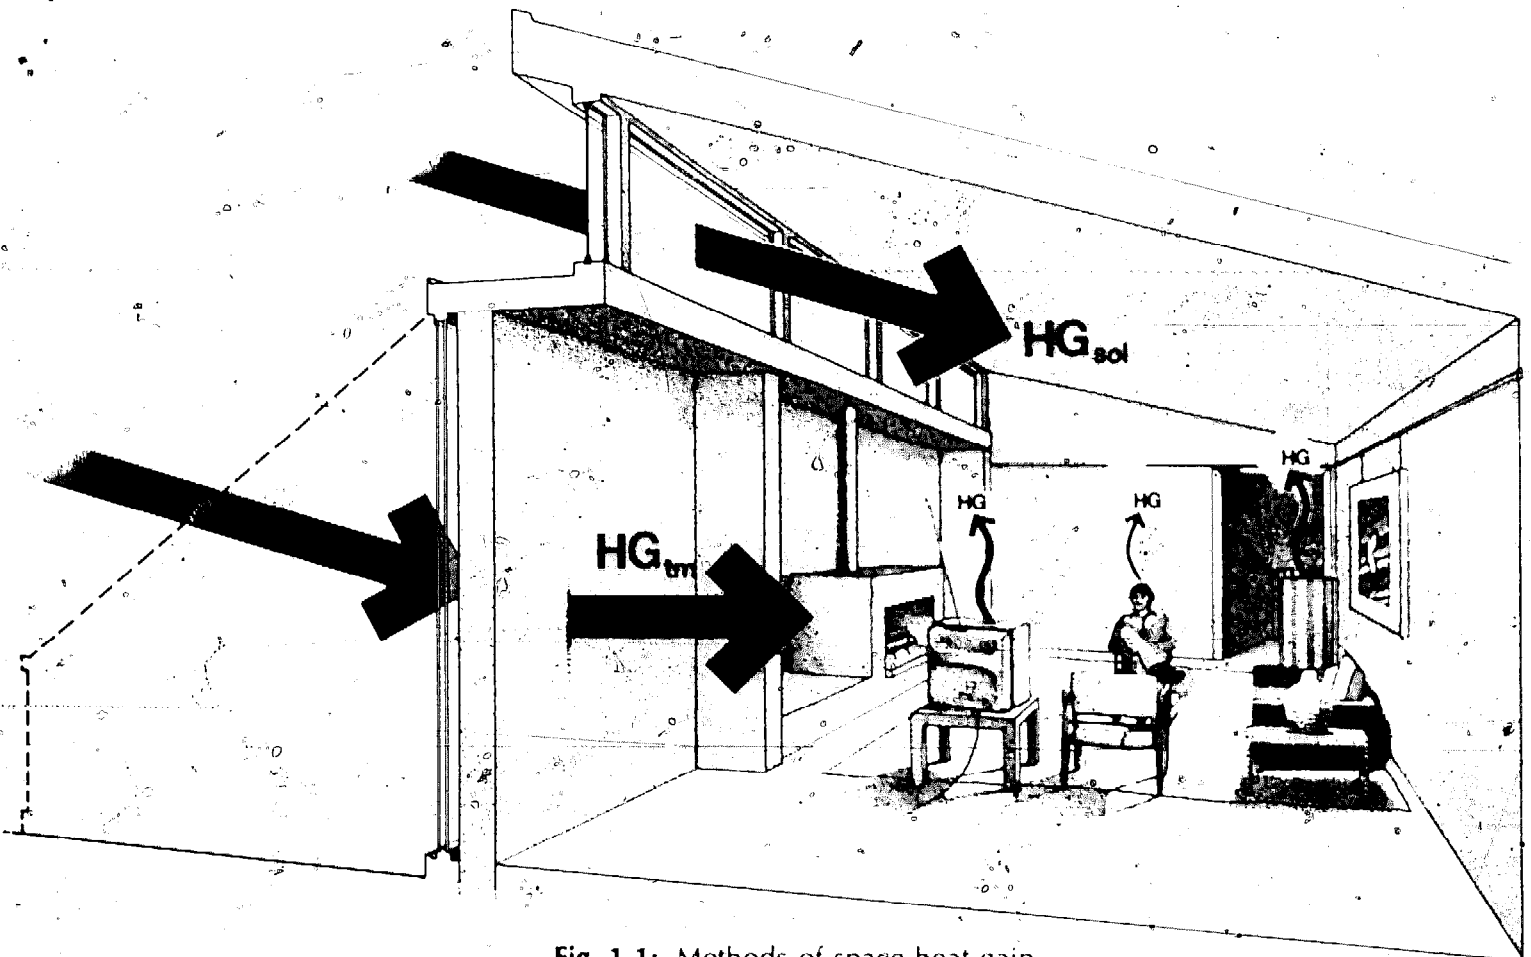


Fig. 1-1: Methods of space heat gain.

double pane glass during the month of January is 1,415 Btu/day or $1,506 \times .94$ (6% absorption loss) = 1,415. Knowing the solar heat gain through one square foot of window, the heat gain through an entire section of window (HC_{sol}) is calculated using the following equation:

$$HC_{sol} = A_{gl} \times I_t$$

where: A_{gl} = surface area of the unshaded portion of the glazing in square feet

I_t = solar heat gain through one square foot of glazing in Btu/day

One important note: This formula is used to calculate the *direct* solar heat gain in a space including greenhouses, attached or freestanding. The solar heat gain for glazing used with a reflector will be greater than the value given for I_t . Appendix 7 gives the percentage of enhancement of solar heat gain for different latitudes and reflector/collector tilt angles.

• *Heat Gain from a Thermal Storage Wall, Roof Pond or Attached Greenhouse (HC_{tm})*—The heat gain into a space from a thermal storage wall, roof pond or attached greenhouse (HC_{tm}) can be calculated using the following formula:


$$HC_{tm} = A_{gl} \times I_t \times P$$

where: A_{gl} = surface area of the unshaded portion of the glazing in square feet


I_t = solar heat gain through one square foot of glazing in Btu/day

P = the percentage of incident energy on the face of a thermal wall or roof pond that is transferred to the space

Values of P for double-glazed thermal storage walls (black exterior wall surface color) and roof ponds are plotted for a variety of conditions in figure 1-2. To find the value of P , first determine the ratio of thermal wall or roof pond area to space floor area. For example, a 200-square-foot space with a 100-square-foot concrete thermal wall has a ratio of 100/200 or 0.50. Then, from .50 on the horizontal scale, follow a vertical line until it intersects the curve for the overall U value (U_{sp}) of the space you calculated in Step 1, Calculating Space Heat Loss in Winter. From this intersection move horizontally to the left and read the percentage of energy transmitted through the wall on the vertical scale. If, for example, the 200-square-foot space had an overall U value of 6 Btu/day-sq ft-°F, then P will equal 35% or 0.35. When using movable insulation over glazing at night, add 5% to the value of P .

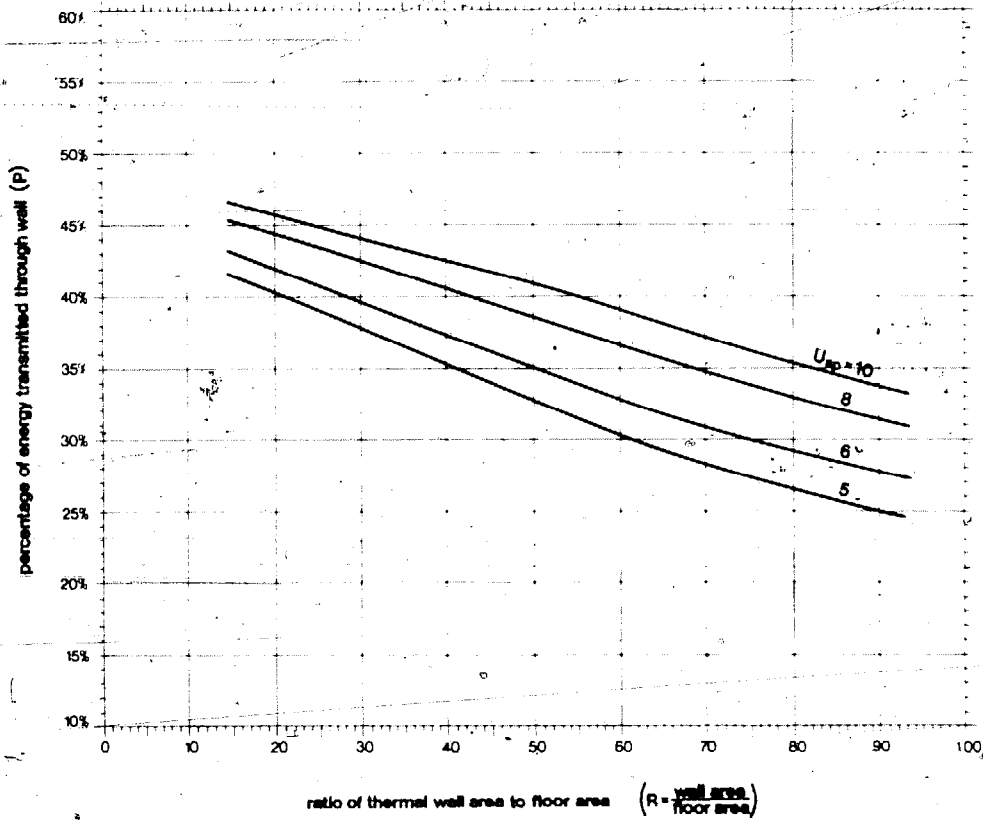

ratio of thermal wall area to floor area ($R = \frac{\text{wall area}}{\text{floor area}}$)
CONCRETE THERMAL STORAGE WALL (1 FT THICK)

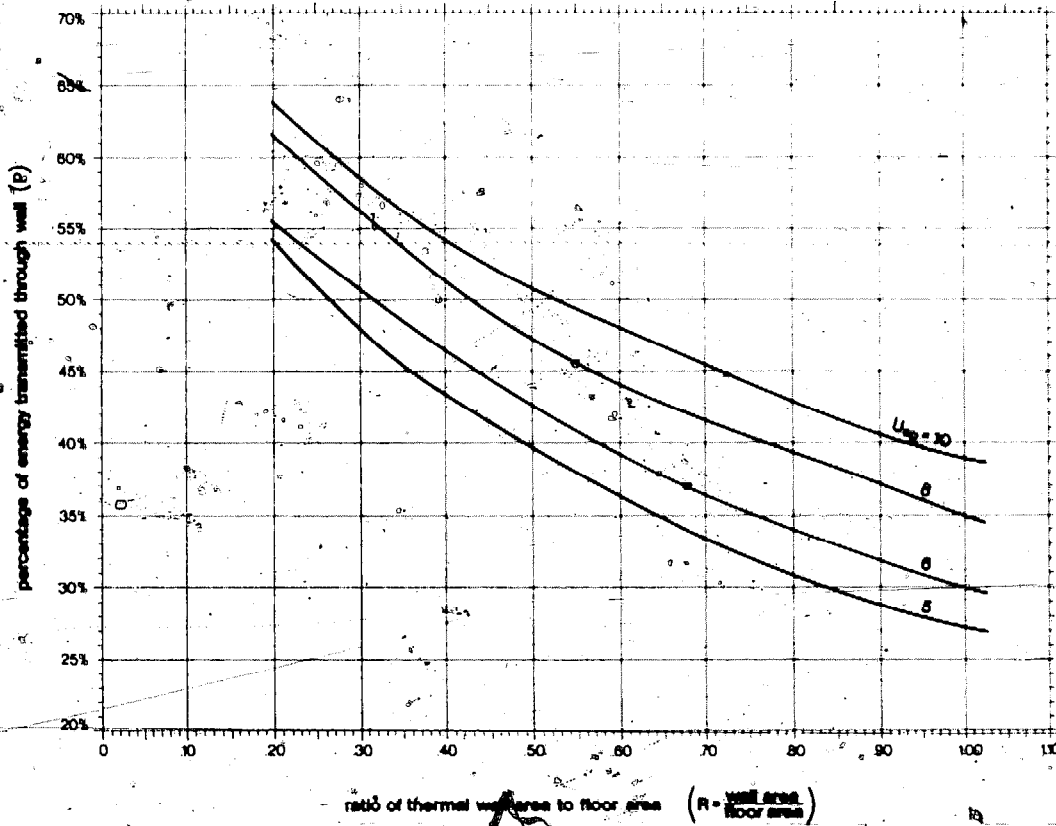

ratio of thermal wall area to floor area ($R = \frac{\text{wall area}}{\text{floor area}}$)
WATER THERMAL STORAGE WALL AND ROOF POND (ANY THICKNESS)

Fig. 1-2: Percentage of incident energy transferred through thermal storage walls and roof ponds.

Note: Graphs are plotted for storage walls with a black exterior surface color.

For a space adjacent to an attached greenhouse, the percentage of energy transferred through the common wall is difficult to predict because of the many variables involved in heat transfer between the spaces. In this case, only a very rough estimate can be given. Table 1-2 lists values of P for common walls constructed of either masonry or water. Select a value based on the overall rate of heat loss (U_{sp}) calculated for the greenhouse in Step 1.

Table 1-2 Percentage* of Energy (P) Transferred through the Common Wall between an Attached Greenhouse and Adjacent Space

Rate of Heat Loss from the Greenhouse U_{sp} (Btu/day-sq ft $_{11}$ -°F)	One-Foot-Thick Concrete Wall	Water Wall (all thicknesses)
24	22%	30%
36	17%	24%
48	14%	21%

NOTE: *For estimating purposes only. These percentages apply to a well-insulated space with a heat loss of 6 to 8 Btu/day-sq ft $_{11}$ -°F, and a thermal wall-to-glass-area ratio of approximately 1 to 1. The greenhouse side of the thermal wall is assumed to be a dark color, and in direct sunlight. If the wall is shaded or not in direct sunlight, the value of P will be considerably less.

Calculating Heat Gain

To find the total daily solar heat gain for each space, first establish the design-day conditions. An average sunny January day is a reasonable condition to illustrate a system's performance. For a Direct Gain System, using clear-day January values for solar heat gain through glass (I_t) from Appendix 6, calculate the heat gain through each unshaded skylight, clerestory and window opening:

$$HG_{sol} = I_t \times A_{gl}$$

The total space heat gain, in Btu's per day, is simply the sum of these values.

And, similarly, calculate the space heat gain, in Btu's per day, from a thermal storage wall, roof pond or wall adjacent to an attached greenhouse.

$$HG_{tm} = I_t \times A_{gl} \times P$$

When more than one system provides heat to a space, add the heat gains from each system to arrive at the total space heat gain.

The Passive Solar Energy Book

To convert the total space heat gain into units that are convenient to use (Btu/day-sq ft_{f1}) simply divide HC_{sol} and HC_{tm} by the floor area of the space:

$$HC_{sp} = \frac{HC_{sol}}{A_{floor}} + \frac{HC_{tm}}{A_{floor}}$$

where: HC_{sp} = total space heat gain per square foot of floor area

Step 3. Determining Average Indoor Temperature

After 1 to 3 days of similar weather conditions (clear or cloudy days in a row) a space will stabilize as a thermal system. This means that temperatures in the space remain roughly the same from day to day. Finding the daily average space temperature for this condition is relatively straightforward.

Using the rate of space heat loss (U_{sp}) and daily heat gain (HC_{sp}) calculated in Steps 1 and 2, the average daily indoor temperature (t_i) is found by dividing HC_{sp} by U_{sp} and adding the result to the average daily outdoor temperature (t_o)* for the design-day.

$$t_i = \frac{HC_{sp}}{U_{sp}} + t_o$$

where: HC_{sp} = rate of space heat gain in Btu/day-sq ft_{f1}

U_{sp} = rate of space heat loss in Btu/day-sq ft_{f1}-°F

t_o = average daily outdoor temperature

Remember that this calculation must be done for each space. The use of January clear-day solar radiation and temperature data is recommended as input, however, average indoor temperatures can be found for any month. Simply use solar heat gain and outdoor temperature data for the month you want to calculate.

Figure 1-3 presents a simple graphic method for calculating the average daily indoor temperature. Knowing the rate of space heat loss (U_{sp}) and daily heat gain (HC_{sp}), the graph can be used to determine the number of degrees the average indoor

*Average daily outdoor temperatures (t_o) for each month are given in Appendix 4.

temperature will be above the average outdoor temperature. Suppose, for example, a space located in New York City (average January temperature, 35°F) has a heat loss of 8 Btu/day-sq ft_{fl}-°F and a daily heat gain in January of 300 Btu/day-sq ft_{fl}. To determine the average indoor temperature for this condition, first follow a vertical line from 300 on the horizontal scale (HG_{sp}) to where it intersects the curve that represents the overall U value of the space (U_{sp} = 8). From this intersection draw a straight line to the scale on the left and read the number of degrees the average indoor air temperature will be above the average outdoor temperature; +38°F or, simply, the average indoor temperature is 35°F + 38°F or 73°F.

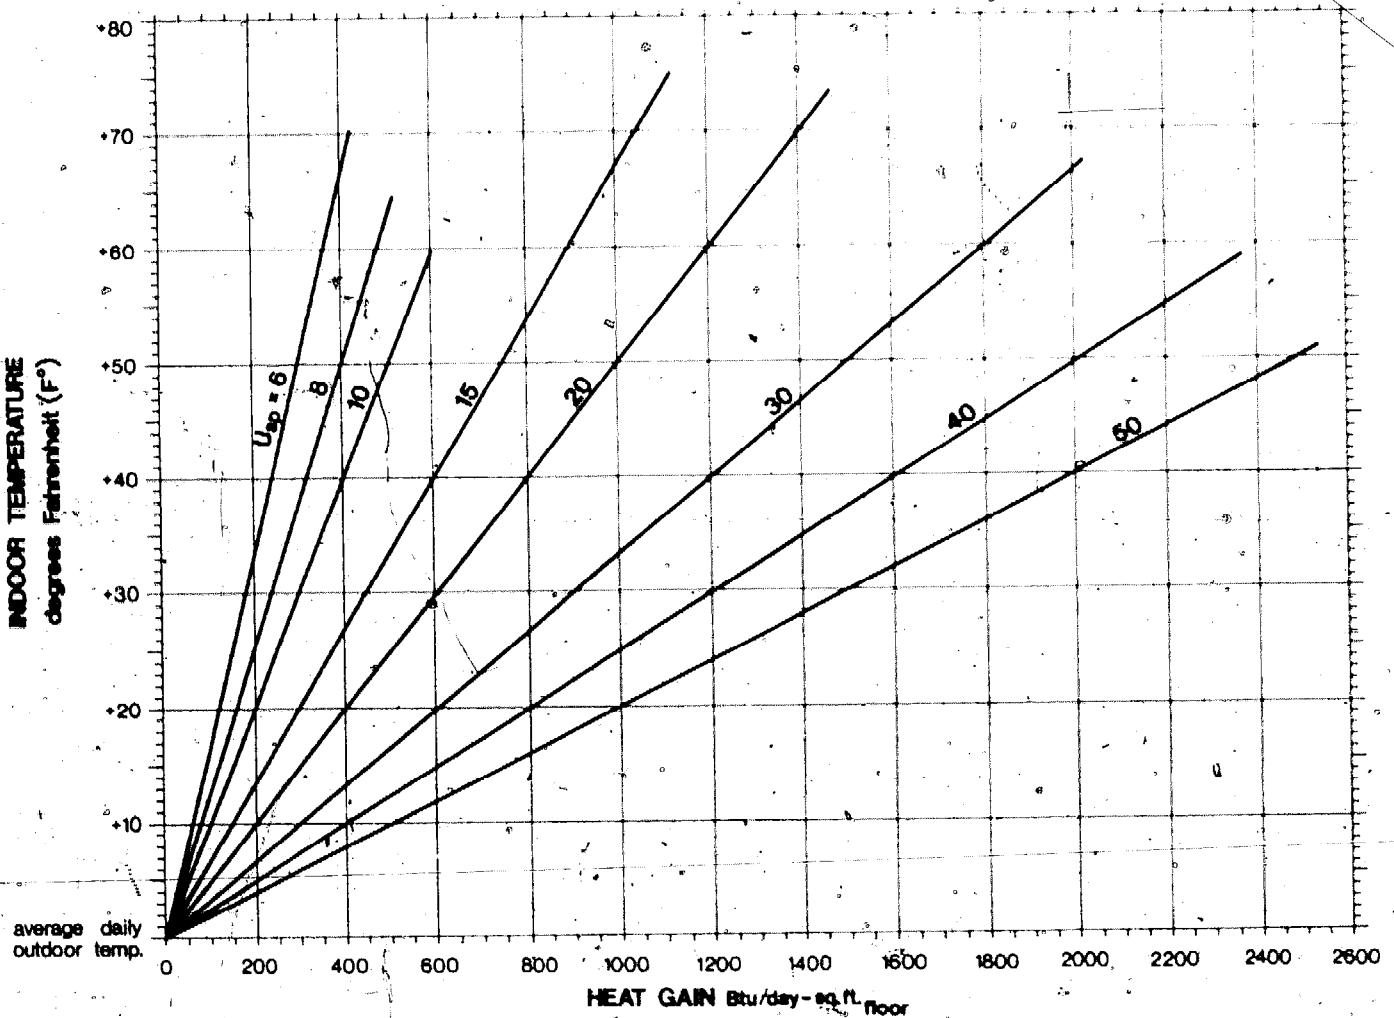


Fig. 1-3: Determining the average indoor temperature.

The Passive Solar Energy Book

Until now only the heat gain from passive systems (the sun) has been considered. However, heat from lights, people and equipment can be considerable. In certain building types, like theaters and educational facilities, this heat gain is very complex and will not be discussed here. In a residence, though, these sources of heat are intermittent and do not appreciably affect indoor temperatures over the day. To account for this heat gain, add 2° to 4°F to the average daily indoor temperature. Although the average temperature will be slightly higher over the day, the nighttime low temperature in the space will not be affected since there is very little activity in a residence during the late evening and early morning hours.

Because of the complicated nature of building design, there is no ideal average indoor temperature, but as the average temperature approaches 70°F, enough heat is admitted into a space to supply it with all its heating needs for that day. If the average indoor temperature is too low, it can be raised by reducing the rate of space heat loss (U_{sp}), increasing the area of south-facing glass or supplying heat to the space from an auxiliary heating system.

Step 4. Determining Daily Space Temperature Fluctuations

Having a good idea of how a system will perform on a sunny winter day, the air temperature fluctuations in the space over that same day can now be determined. A space may have different heating requirements at various times of the day, depending upon occupant use. An office, for example, should be kept at about 70°F during working hours, but at night, when the space is not in use, it can be kept at a much lower temperature. It is, therefore, important to know at what time, and by how much, the indoor air temperature will swing above and below the daily average. In this way a system can be designed to meet the thermal requirements of a space.

The effect of thermal mass on indoor temperature fluctuations is explained at length for Direct Gain Systems in MASONRY HEAT STORAGE(11) and INTERIOR WATER WALL(12), for Thermal Storage Wall Systems in WALL DETAILS(14), for spaces adjacent to an attached greenhouse in GREENHOUSE CONNECTION(16), and for attached or freestanding greenhouses in GREENHOUSE DETAILS(20). But since indoor temperature fluctuations are not always symmetrical about the daily average (an equal number of degrees above and below the average), a series of graphs plotting hourly temperatures for a variety of systems (figs. 1-4, 5, 6, 7 and 8) is included in this appendix. To determine hourly indoor temperatures for a design-day, first

select the graph that corresponds to your system. Then, using the average indoor temperature that you calculated in Step 3 as a reference point, plot the number of degrees the indoor air temperature is above or below the average for each hour.

Direct Gain System

- *Masonry Heat Storage*—Since the relationship between sunlight and thermal mass greatly influences indoor air temperatures, two cases, each representing a different relationship, are presented in figure 1-4. Choose the case that most clearly rep-



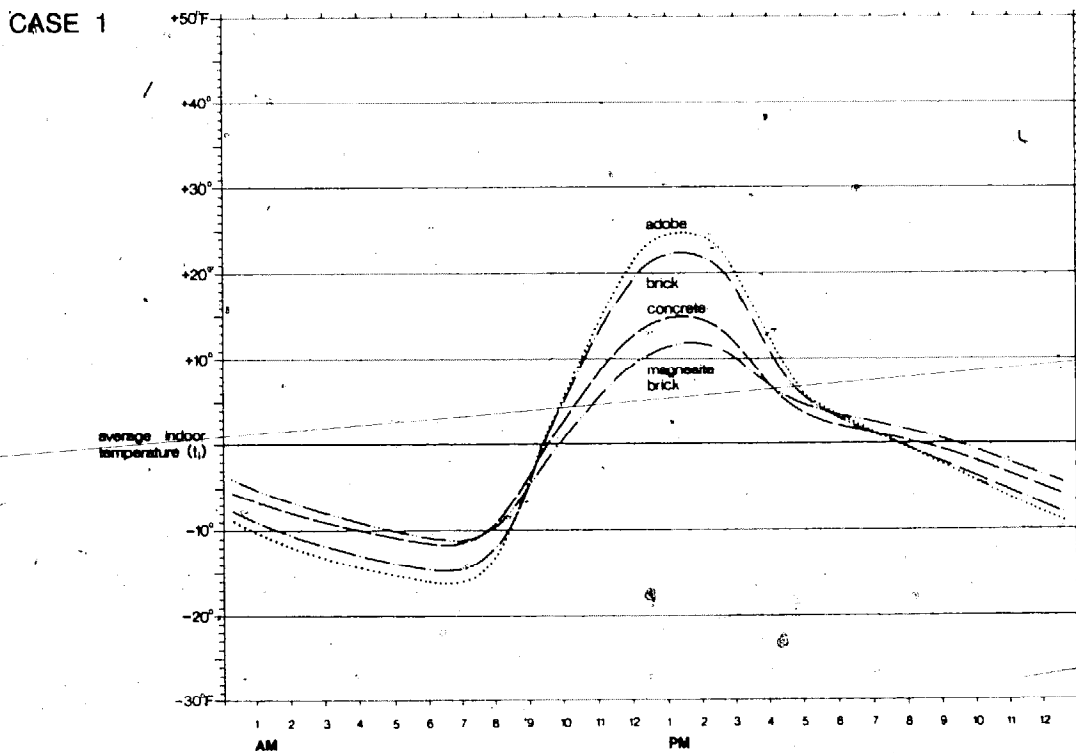



Fig. 1-4: Hourly indoor temperatures for direct gain systems with masonry heat storage (here and on next page).

The Passive Solar Energy Book

resents the way sunlight interacts with masonry located in the space. A graph corresponding to each case gives hourly indoor temperatures above and below the daily average (t_i) for four masonry materials. If a space falls between the two cases, then interpolate between the graphs plotted for each case. Also, it is probable that a space may not be constructed of just one material. Therefore, when more than one material is used, for example, concrete walls and a brick floor, take the hourly temperature somewhere between the values given for each material.

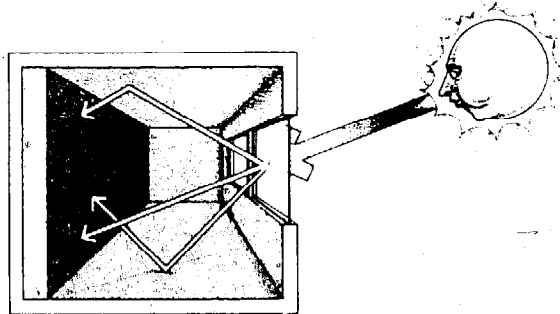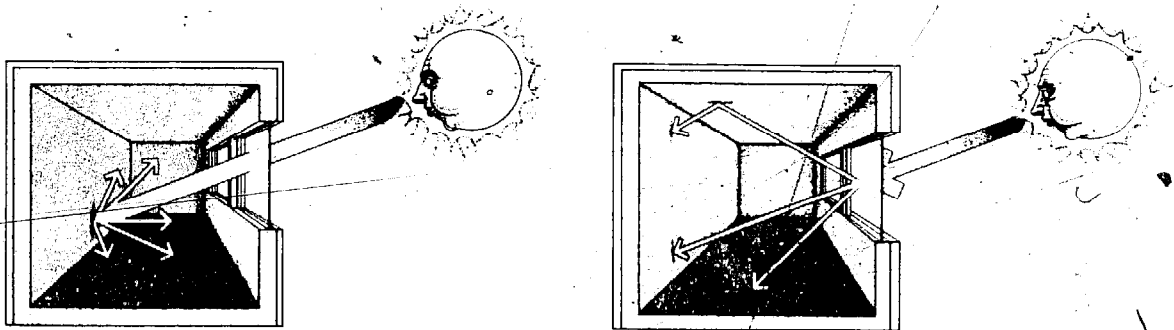

CASE 2

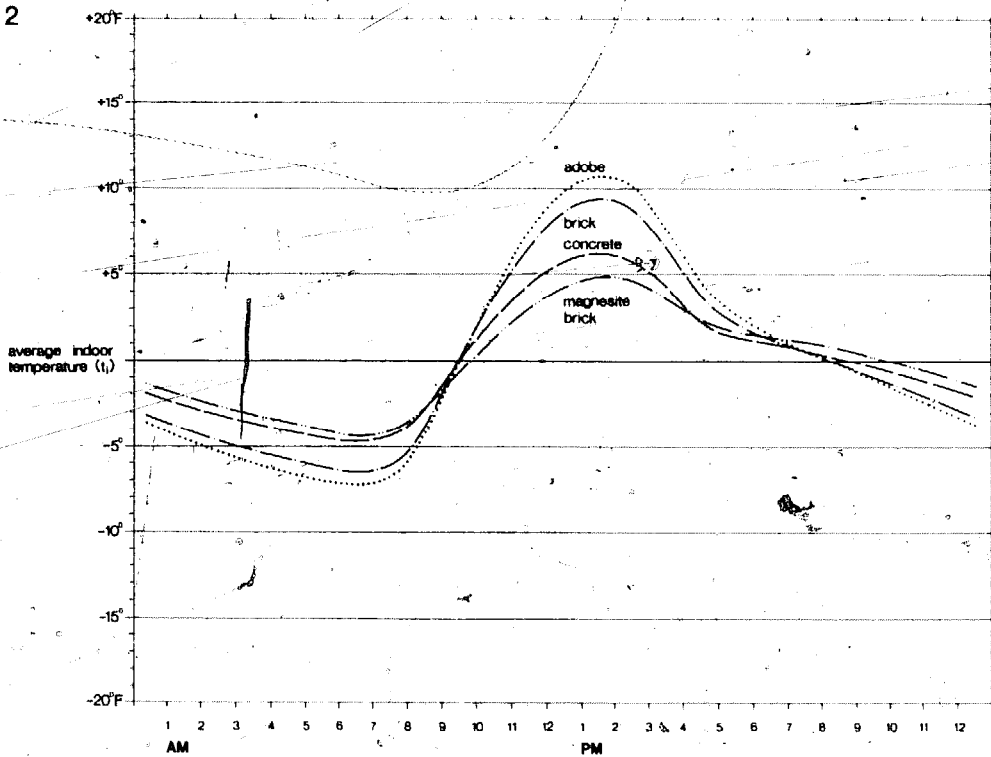

• *Interior Water Wall*—In the case of an interior water wall, the volume of water in direct sunlight is the major determinant of space temperature fluctuations over the day. Figure 1-5 plots indoor temperatures for various quantities of water per square foot of south-facing glass. To compute this value, simply take the volume of water (cu ft) in the space and divide it by the area of south-facing glass (sq ft). One important note: The surface of the water wall is assumed to be a dark color. If the wall is painted a light color, then air temperature fluctuations in the space will be higher than those given.


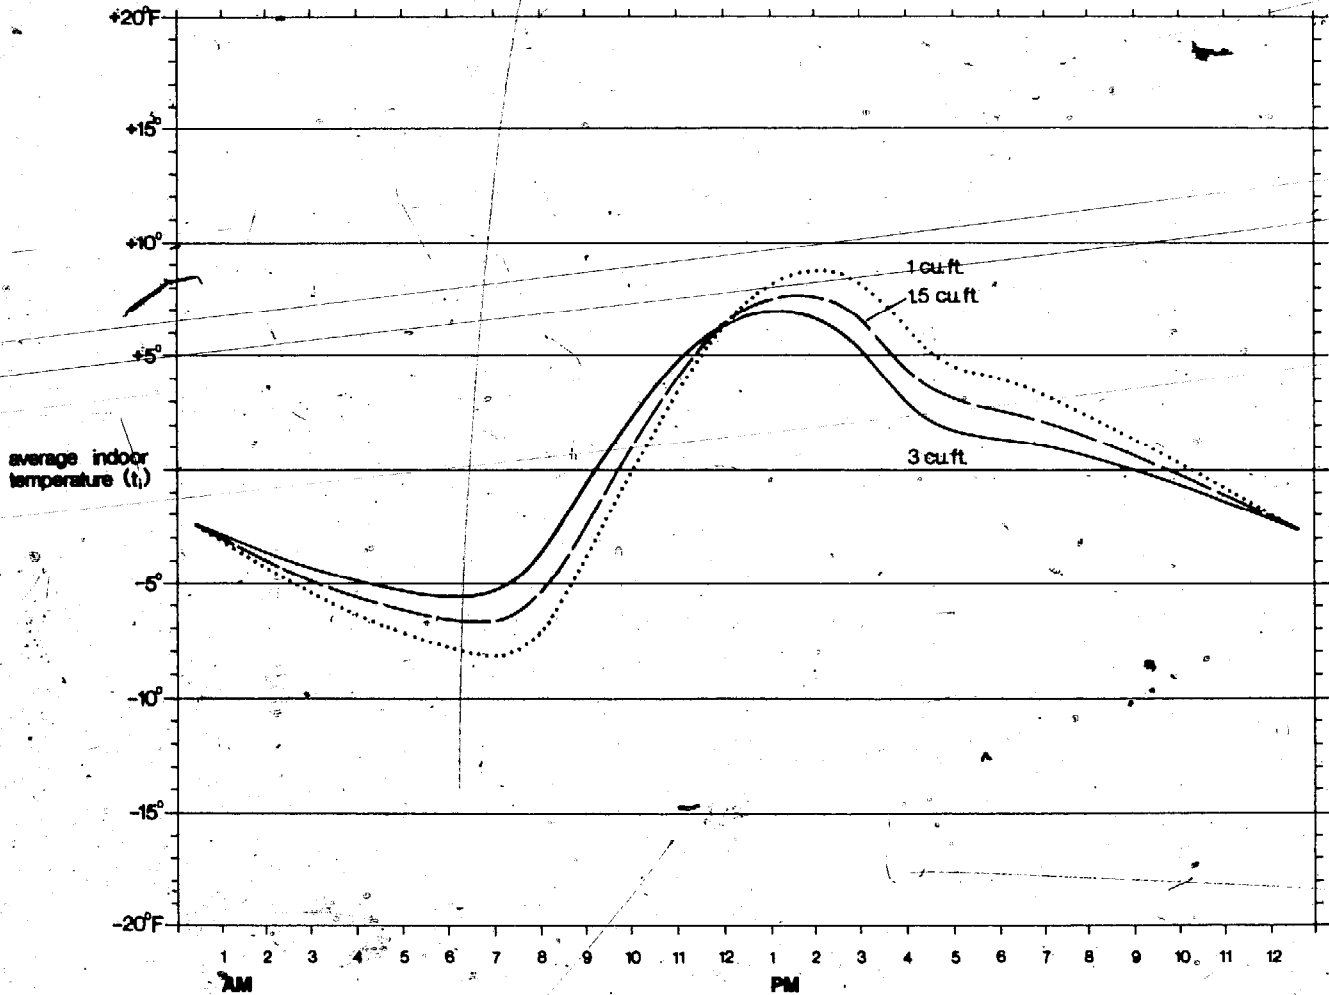


Fig. 1-5: Hourly indoor temperatures for direct gain systems with various volumes of water storage per square foot of south-facing glass.

The Passive Solar Energy Book

Thermal Storage Wall System and Spaces Adjacent to an Attached Greenhouse


The material used to construct a thermal storage wall and the thickness of the wall are the major influences on indoor air temperature fluctuations. Figure 1-6 graphs indoor air temperatures for various thicknesses of four commonly used wall materials: concrete, brick, adobe and water. Daytime temperatures can be increased above those indicated on the graphs if warm air from the greenhouse or face of a masonry thermal wall is allowed to circulate into the space. However, nighttime temperatures in the space will remain the same. Notice that maximum and minimum space temperatures are reached at different times of the day for different thicknesses of wall.

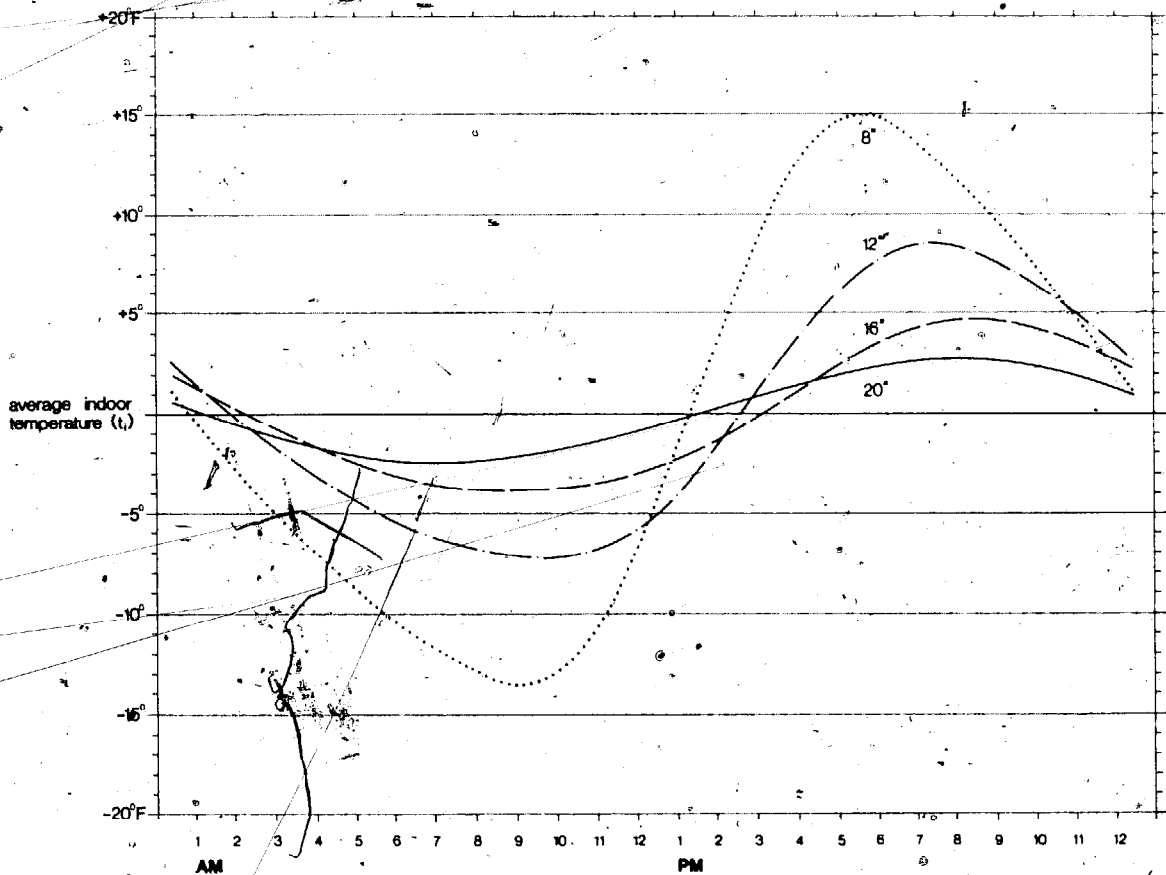


CONCRETE WALL

Fig. 1-6: Hourly indoor temperatures for thermal storage walls of various thicknesses (here and next two pages).


Note: Temperature fluctuations will be less if additional mass is located in the space, i.e., a masonry wall and floor.

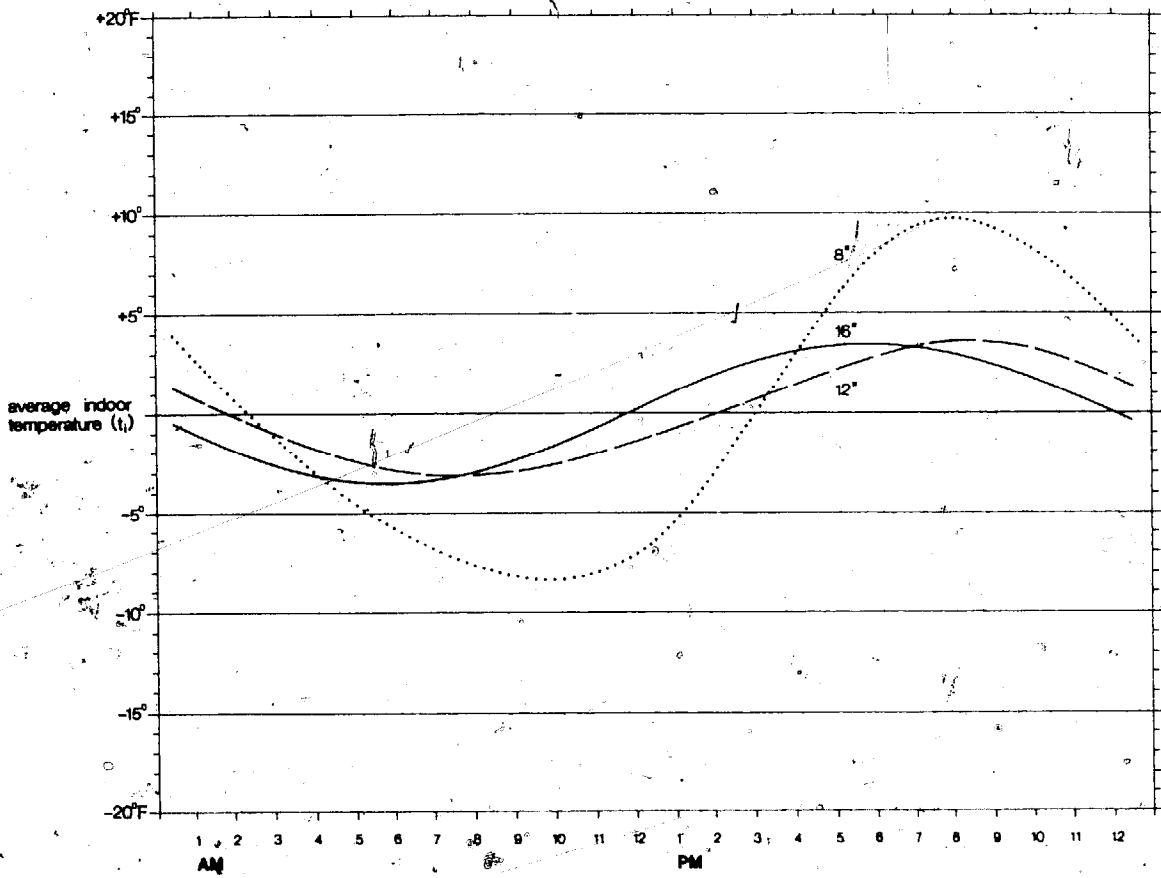


ADOBE WALL

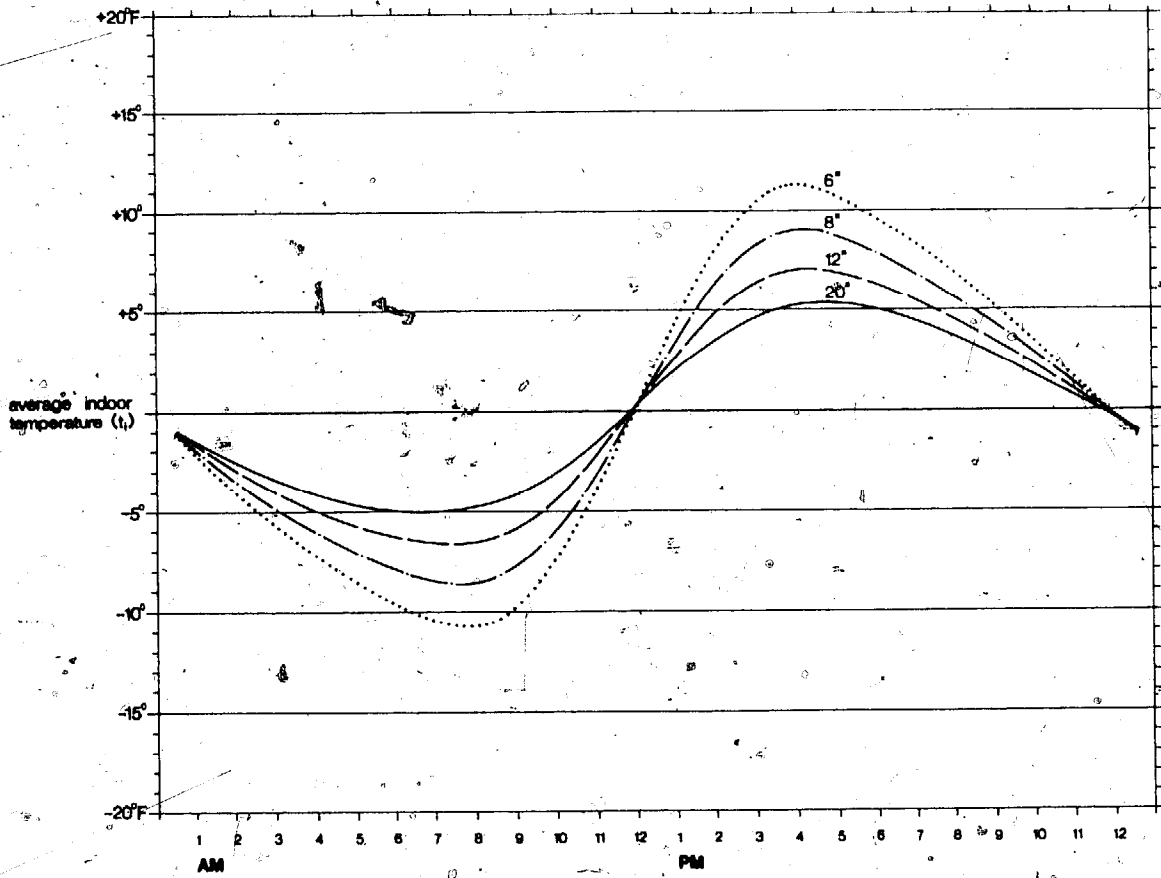

WATER WALL

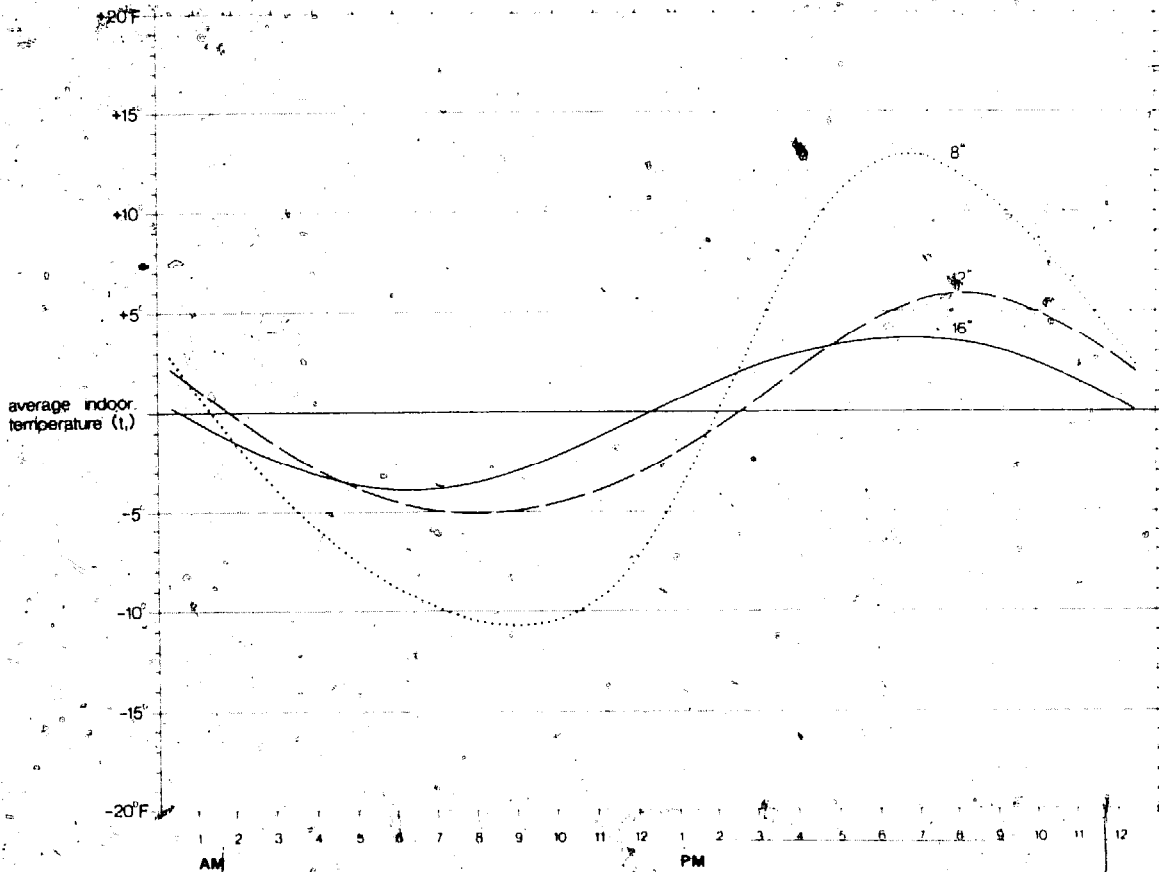

BRICK WALL

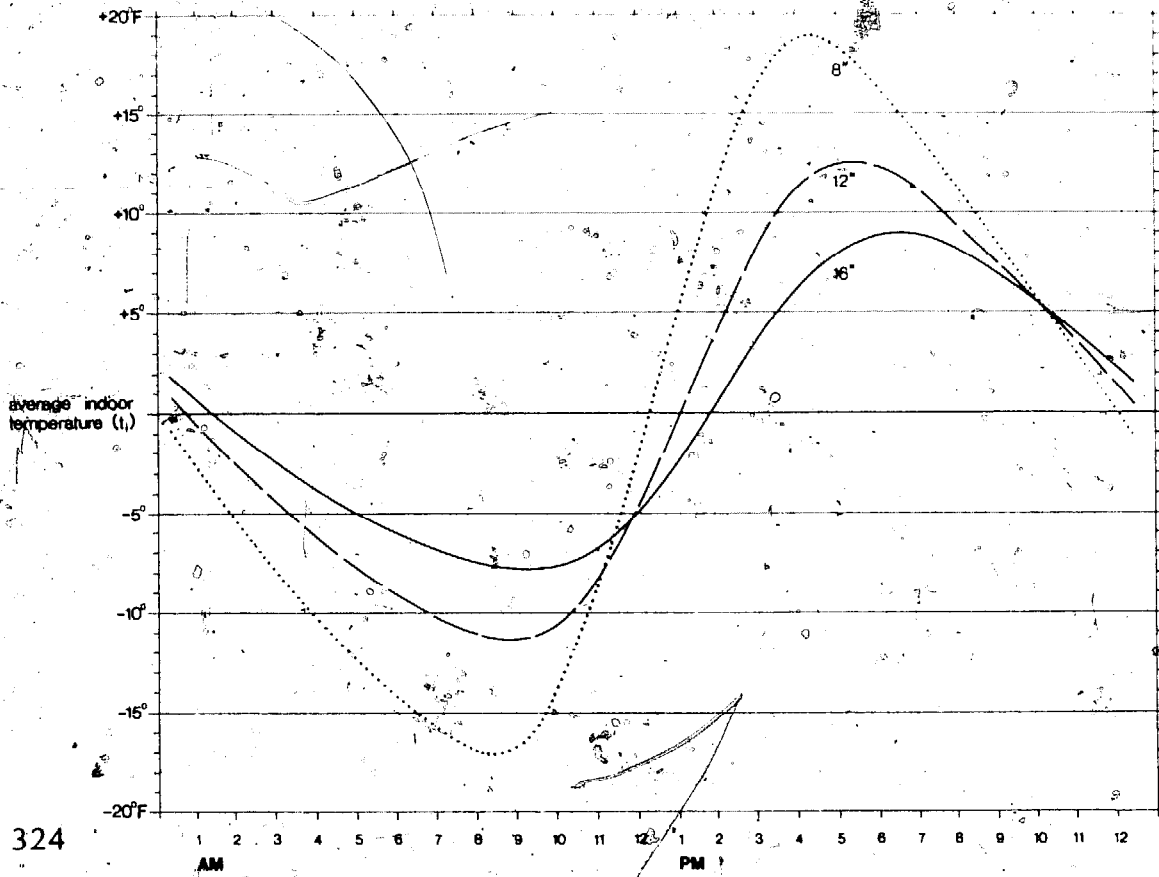

324

MAGNESITE BRICK WALL

Roof Pond System

Space temperature fluctuations for a Roof Pond System are proportional to the depth of the pond. As the depth increases, the fluctuation decreases. Figure 1-7 plots hourly indoor temperatures for various depths of roof ponds.

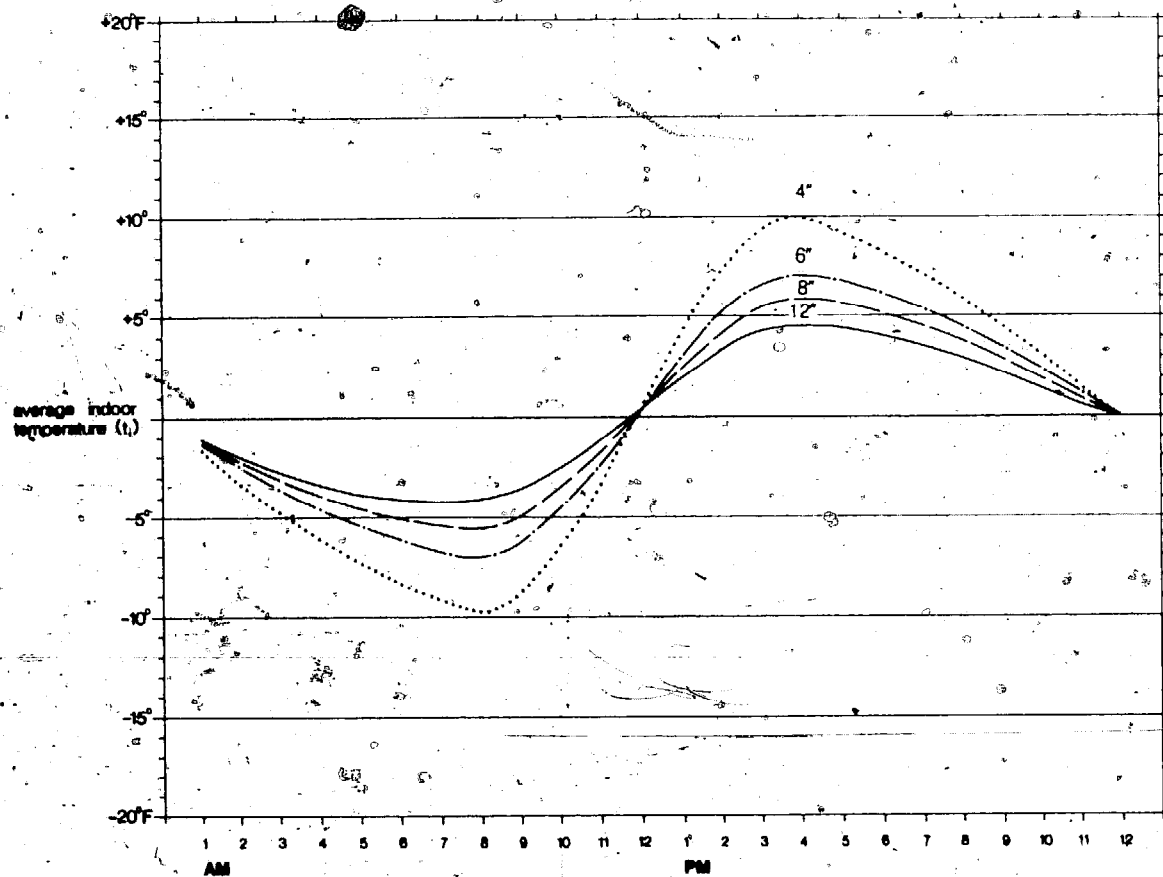


Fig. 1-7: Hourly indoor temperatures for roof ponds of various depths.

Note: Temperature fluctuations will be less if additional mass is located in the space, i.e., a masonry floor.

Greenhouse (attached or freestanding)

• **Solid Masonry Walls and Floor**—In a greenhouse constructed of solid masonry walls and/or floor, many factors influence indoor temperature fluctuations. The rate of greenhouse heat loss, the area of south-facing glass and the type of masonry material all contribute to the extent of greenhouse temperature fluctuations. All this implies that it is virtually impossible to generate a simple graph to predict indoor

The Passive Solar Energy Book

hourly temperatures. In this case, the daily range of indoor fluctuations for various greenhouse conditions can only be estimated—GREENHOUSE DETAILS(20).

- *Water Storage Wall*—Since a greenhouse is essentially a Direct Gain System, the quantity of water in the greenhouse (in direct sunlight) largely determines the indoor temperature fluctuations. Figure 1-8 graphs hourly indoor temperatures for various quantities of water (cu ft) per square foot of south-facing greenhouse glass. The

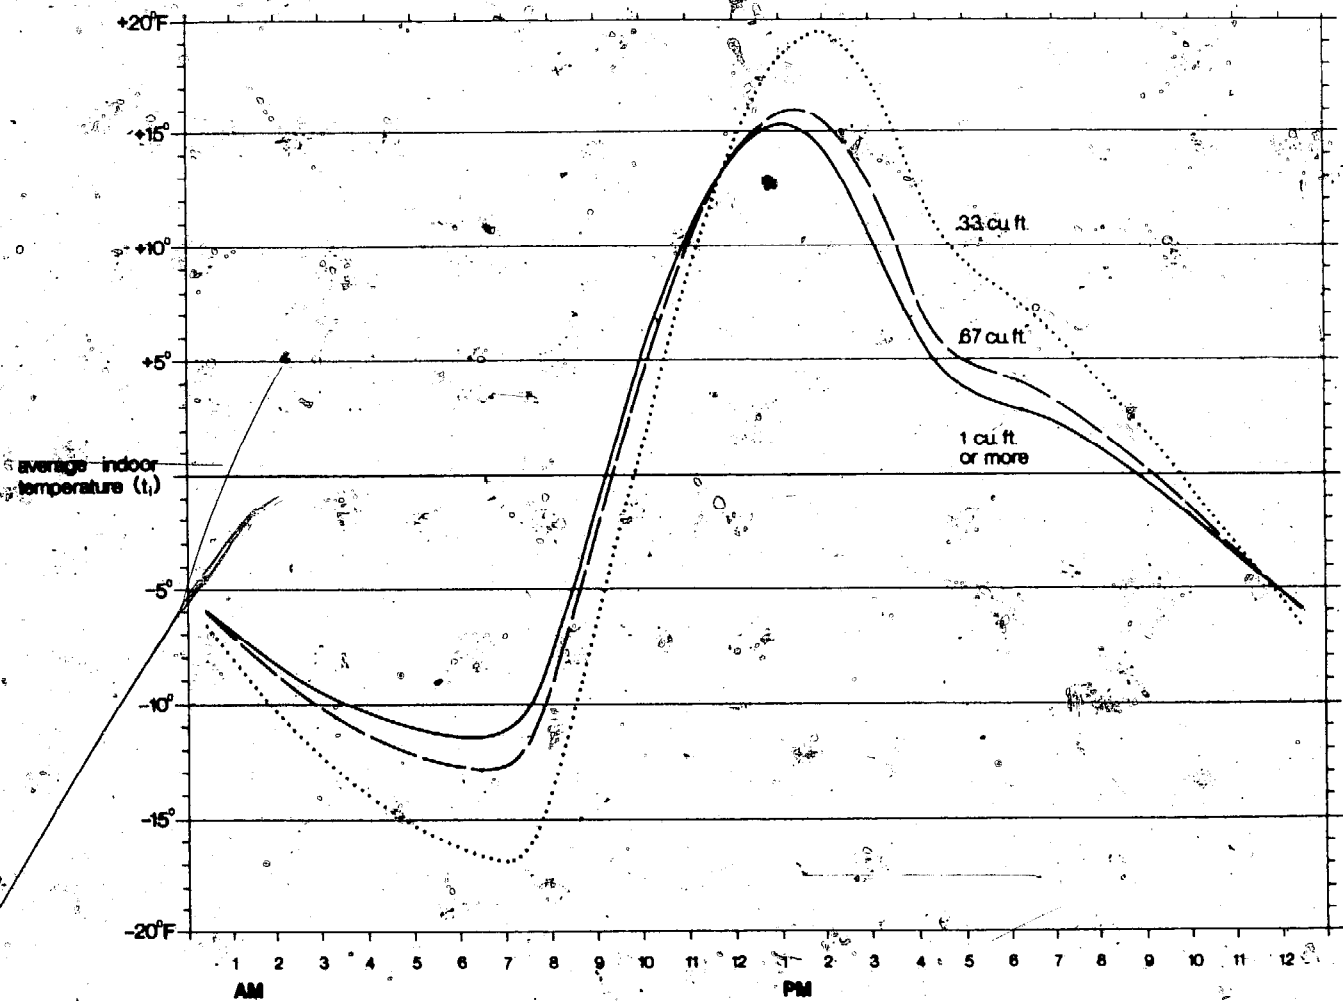


Fig. 1-8: Hourly greenhouse temperatures for various volumes of water storage per square foot of south-facing glass.

exposed surface of the water wall is assumed to be a dark color and in direct sunlight most of the day.

One final word about indoor temperature fluctuations. Figures 1-4 through 8¹ plot hourly temperatures for a space with no additional thermal mass other than that indicated for the system. If additional mass is located in a space, then fluctuations will be less than those graphed. For instance, a space constructed of lightweight materials (wood frame) with an 8-inch Thermal Water Wall System will have a daily temperature fluctuation of approximately 12°F (from fig. 1-6). If the entire space were constructed of masonry materials (walls and floor), then the daily fluctuation might be only 5° or 6°F. As a general rule, additional thermal mass distributed in a space will reduce indoor temperature fluctuations from those indicated on the graphs.

Step 5. Calculating Auxiliary Space Heating Requirements

The auxiliary energy required to heat a space is the amount needed, in addition to that provided by the solar system, to keep the space at a desired temperature (usually 70°F). The auxiliary energy requirement (Q_{aux}) is estimated on an annual basis for the entire building. It can be calculated by the equation:

$$Q_{aux} = Q_{r \text{ year}} - Q_{c \text{ year}}$$

where: $Q_{r \text{ year}}$ = annual space heating requirements in Btu's

$Q_{c \text{ year}}$ = annual solar heating contribution in Btu's

Annual Space Heating Requirements ($Q_{r \text{ year}}$)

To determine the annual space heating requirements in Btu's, multiply the overall space U value by the floor area of the space and the number of heating degree-days* for the year:

$$Q_{r \text{ year}} = U_{sd} \times A_{\text{floor}} \times DD_{\text{year}}$$

*Experience has shown that the heating requirements of a space kept at approximately 70°F is directly proportional to the number of degrees the average daily outside temperature falls below 65°F. The degree-day is based on this fact. Thus, the number of degree-days per day is the number of degrees the average outdoor temperature is below 65°F or, to put it another way, the number of degree-days for a given day equals 65°F minus the daily average outdoor temperature. The number of degree-days for a longer period of time is then the sum of the degree-days for each day in that period.

The Passive Solar Energy Book

where: U_{sp} = rate of space heat loss in Btu/day-sq ft-°F

A_{floor} = floor area of the space in square feet

DD_{year} = degree-days per year

Degree-days for major cities in United States and Canada are given in Appendix 5.

Annual Solar Heating Contribution ($Q_{c, year}$) for Thermal Storage Walls, Roof Ponds and Direct Gain Systems*

Three computations are necessary to determine the annual solar heating contribution for passive systems:

- Calculating the space Load Collector Ratio
- Determining the fraction of the total yearly space heating requirement supplied by solar energy
- Computing the annual solar heating contribution in Btu's.

● *a. Load Collector Ratio (LCR)*

The LCR is calculated by the formula:

$$LCR = \frac{U_{sp} \times A_{floor}}{\text{solar collection area (sq ft)}}$$

where: U_{sp} = rate of space heat loss in Btu/day-sq ft-°F
(exclusive of the south glazing)

A_{floor} = floor area of the space in sq ft

solar collection area = the actual solar collection aperture

- *b. Fraction of the Total Yearly Space Heating Requirement Supplied by Solar Energy (SHF)*—Table 1-3 lists by city the estimated fraction of the total yearly space heating requirement supplied by solar energy (SHF) for properly sized water and masonry thermal storage walls, roof ponds and direct gain systems, with and without night insulation ($R=10$). Locate the city and system type of interest in the table. If the LCR calculated above is exactly one of the values listed in the table, then read the corresponding SHF. If the LCR does not exactly match one of the values listed, then interpolate between the two closest values.

*Adapted from J. D. Balcomb and R. D. McFarland, "A Simple Empirical Method for Estimating the Performance of a Passive Solar Heated Building of the Thermal Storage Wall Type." *Proceedings of the Second National Passive Solar Conference*, Philadelphia, March 16-18, 1978.

• *c. Annual Solar Heating Contribution ($Q_{c \text{ year}}$) in Btu's*—To compute the annual solar heating contribution in Btu's, multiply $Q_{r \text{ year}}$ by the fraction of the total yearly space heating requirement supplied by solar energy determined in the previous computation:

$$Q_{c \text{ year}} = Q_{r \text{ year}} \times \text{SHF}$$

Table 1-3 Fraction of the Total Yearly Space Heating Requirement Supplied by Solar Energy

		DD = degree-days WW = water wall, roof pond or direct gain WWNI = water wall, roof pond or direct gain with night insulation TW = masonry thermal storage wall (Trombe) TWNI = masonry thermal storage wall (Trombe) with night insulation									
Page, Ariz.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9	
6,632 DD 37°N	WW	196	88	54	37	27	19	13	7		
	WWNI	312	145	91	65	49	38	29	22	15	
	TW	195	94	56	37	25	17	11	6		
	TWNI	304	141	89	63	46	35	26	18	12	
Phoenix, Ariz. 1,765 DD 33°N	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9	
	WW	626	294	188	135	102	78	60	44	29	
	WWNI	863	407	261	189	145	114	90	69	49	
	TW	577	287	179	123	88	64	47	33	21	
	TWNI	819	386	247	176	132	101	76	56	38	
Tucson, Ariz. 1,800 DD 32°N	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9	
	WW	631	291	184	132	100	77	59	43	29	
	WWNI	871	403	256	185	142	112	89	68	49	
	TW	578	284	176	121	87	63	46	33	21	
	TWNI	825	383	243	173	130	99	75	56	38	
Little Rock, Ark. 3,219 DD 35°N	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9	
	WW	239	108	66	46	33	24	17	11		
	WWNI	365	172	107	76	57	44	35	26	18	
	TW	232	112	67	44	30	21	14	9		
	TWNI	356	165	103	73	54	40	30	22	14	

The Passive Solar Energy Book

Davis, Calif.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
2,502 DD	WW	409	187	115	79	57	42	30	21	11
	WWNI	585	272	170	120	89	68	52	39	26
	TW	376	183	111	74	51	36	25	16	9
39°N	TWNI	556	259	161	112	82	61	45	32	21
El Centro, Calif.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
1,458 DD	WW	1028	482	301	214	161	125	97	72	50
	WWNI	1375	649	407	290	221	175	139	107	77
	TW	916	458	284	194	140	103	75	54	36
33°N	TWNI	1294	608	382	270	202	154	117	87	60
Fresno, Calif.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
2,492 DD	WW	405	186	113	77	55	40	29	19	10
	WWNI	577	271	168	117	87	66	50	37	25
	TW	370	181	109	72	49	34	24	15	8
37°N	TWNI	550	257	159	110	79	59	43	31	20
Inyokern, Calif.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
3,528 DD	WW	453	209	129	90	66	50	37	26	16
	WWNI	641	300	188	132	100	77	60	46	32
	TW	419	204	124	84	59	42	30	20	12
36°N	TWNI	613	284	177	124	92	69	52	38	25
Los Angeles, Calif.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
2,061 DD	WW	763	362	225	158	118	91	70	52	35
	WWNI	1032	498	310	219	165	131	103	80	57
	TW	687	344	213	145	103	75	55	39	26
34°N	TWNI	979	464	291	205	153	116	88	65	45
Riverside, Calif.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
1,803 DD	WW	767	356	224	160	121	94	72	53	36
	WWNI	1039	488	308	221	169	134	106	82	58
	TW	692	344	214	146	105	77	56	40	26
34°N	TWNI	984	459	290	207	155	118	90	67	46
Santa Maria, Calif.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
2,967 DD	WW	544	272	176	126	96	74	56	41	27
	WWNI	752	376	247	179	137	108	86	66	45
	TW	514	264	167	115	83	61	44	31	20
35°N	TWNI	720	358	231	166	126	96	73	54	36

Appendix 1

Granby, Colo.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	196	90	56	39	28	20	14	8	
5,524 DD	WWNI	313	146	94	67	51	40	31	23	15
	TW	197	96	58	38	26	18	12	7	
40°N	TWNI	303	143	91	65	48	36	27	19	13
Grand Junction, Colo.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	199	92	56	39	28	20	13		
5,641 DD	WWNI	317	150	95	67	51	39	30	22	15
	TW	201	97	58	38	26	17	11	6	
39°N	TWNI	310	145	91	64	48	36	26	19	12
Washington, D. C.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	179	79	47	32	22	15	9		
4,224 DD	WWNI	292	135	83	58	44	33	25	18	12
	TW	180	85	50	32	21	13	8		
39°N	TWNI	285	131	81	57	41	31	22	16	10
Apalachicola, Fla.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	700	322	204	145	110	85	65	48	32
1,308 DD	WWNI	956	444	281	203	155	123	97	75	53
	TW	635	313	194	133	95	70	51	36	24
30°N	TWNI	906	240	266	189	142	108	82	61	42
Gainesville, Fla.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	731	333	212	152	116	90	69	51	35
1,239 DD	WWNI	1000	457	292	211	162	129	102	79	56
	TW	662	326	202	139	100	73	54	39	25
30°N	TWNI	943	435	276	197	148	113	86	64	44
Tallahassee, Fla.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	621	285	179	128	97	75	57	42	28
1,485 DD	WWNI	857	397	249	180	138	109	87	67	48
	TW	563	279	172	117	84	61	45	32	21
30°N	TWNI	809	376	237	169	127	97	73	54	37
Tampa, Fla.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	1147	573	374	272	210	166	129	98	69
683 DD	WWNI	1520	760	500	365	283	227	182	141	102
	TW	1059	548	351	245	179	134	100	73	49
28°N	TWNI	1443	717	467	339	258	199	152	114	80

The Passive Solar Energy Book

Atlanta, Ga.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	301	136	83	58	43	31	23	15	8
2,961 DD	WWNI	448	207	129	91	69	54	42	32	22
	TW	286	138	83	55	38	27	18	12	7
34°N	TWNI	431	198	123	87	64	48	36	26	17
Boise, Idaho	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	185	83	48	31	20	12	6		
5,809 DD	WWNI	299	139	86	59	43	31	23	16	10
	TW	182	86	50	31	20	12	6		
44°N	TWNI	290	135	83	56	40	29	21	14	8
Lemont, Ill.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	120	51	29	18	11				
6,155 DD	WWNI	219	100	61	42	31	24	18	13	8
	TW	129	59	33	20	12	7			
42°N	TWNI	216	99	61	42	30	22	16	11	7
Indianapolis, Ind.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	136	58	33	21	14	7			
5,699 DD	WWNI	239	109	67	46	34	26	19	14	9
	TW	142	65	37	23	14	8			
40°N	TWNI	235	107	66	45	33	24	17	12	7
Ames, Iowa	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	117	50	29	18	11				
6,588 DD	WWNI	215	99	61	42	31	23	18	12	8
	TW	127	58	33	20	12	6			
42°N	TWNI	213	98	60	41	30	22	16	11	7
Dodge City, Kans.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	214	99	61	43	31	23	16	10	
4,986 DD	WWNI	335	160	101	72	54	42	33	25	17
	TW	214	104	63	41	28	20	13	8	
38°N	TWNI	327	154	97	69	51	38	29	21	14
Manhattan, Kans.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	165	74	44	30	21	14	8		
5,182 DD	WWNI	274	128	80	56	42	32	25	18	12
	TW	169	80	47	30	20	13	8		
39°N	TWNI	269	125	78	54	40	30	22	15	10

Appendix 1

Lexington, Ky.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
4,683 DD	WW	143	63	36	24	16	10			
	WWNI	246	114	70	49	36	28	21	15	10
	TW	148	70	40	25	16	10	5		
38°N	TWNI	242	112	69	48	35	26	19	13	8
Lake Charles, La.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
1,459 DD	WW	522	239	152	109	82	63	48	35	23
	WWNI	730	338	214	155	119	94	74	57	40
	TW	481	237	146	100	71	52	38	26	17
30°N	TWNI	695	322	204	146	109	83	63	46	32
Shreveport, La.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
2,184 DD	WW	361	166	104	74	65	42	31	22	14
	WWNI	524	245	154	111	85	67	53	40	28
	TW	340	167	103	69	49	35	25	17	10
32°N	TWNI	500	234	148	105	79	60	45	33	22
Caribou, Maine	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
9,769 DD	WW	83	34	17	8					
	WWNI	172	78	48	33	24	17	13	8	
	TW	97	43	23	12	5				
47°N	TWNI	172	79	48	33	23	17	12	8	4
Portland, Maine	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
7,511 DD	WW	125	54	31	20	13	7			
	WWNI	223	103	64	45	33	25	19	14	8
	TW	133	62	35	22	14	8			
44°N	TWNI	221	102	63	44	32	23	17	12	7
Boston, Mass.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
5,634 DD	WW	137	60	35	23	15	9			
	WWNI	241	110	68	48	36	27	21	15	9
	TW	145	67	39	24	15	9	5		
42°N	TWNI	238	108	67	47	34	25	18	13	8
East Lansing, Mich.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
6,909 DD	WW	111	46	25	15	8				
	WWNI	208	94	57	39	29	22	16	11	7
	TW	120	54	30	18	10	4			
43°N	TWNI	206	93	57	39	28	20	15	10	6

The Passive Solar Energy Book

Sault St. Marie, Mich.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	100	40	21	11					
9,048 DD	WWNI	193	87	53	36	26	19	13	9	5
	TW	110	49	26	15					
46°N	TWNI	192	87	53	36	25	18	13	8	4
St. Cloud, Minn.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	96	39	21	11					
8,879 DD	WWNI	189	85	52	36	26	19	14	9	5
	TW	108	48	26	15	7				
46°N	TWNI	189	86	52	36	25	18	13	8	5
Columbia, Mo.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	175	77	46	31	21	14	8		
5,046 DD	WWNI	287	133	82	57	43	33	25	18	12
	TW	177	83	49	31	20	13	8		
39°N	TWNI	281	129	80	55	41	30	22	15	10
Glasgow, Mont.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	168	75	44	29	19	12	6		
8,996 DD	WWNI	277	130	81	56	41	31	23	17	10
	TW	171	80	47	30	19	12	7		
48°N	TWNI	272	126	78	54	39	29	21	14	9
Great Falls, Mont.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	143	63	37	23	14	8			
7,750 DD	WWNI	246	115	71	49	36	27	20	14	8
	TW	149	69	40	25	15	9			
47°N	TWNI	243	112	69	48	34	25	18	12	7
Lincoln, Nebr.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	175	77	45	30	21	14	8		
5,864 DD	WWNI	288	133	82	57	42	33	25	18	12
	TW	176	83	48	31	20	13	8		
41°N	TWNI	280	129	79	55	40	30	22	16	10
Ely, Nev.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	172	80	50	35	25	18	12	6	
7,733 DD	WWNI	282	134	85	61	47	36	28	21	14
	TW	178	86	52	34	23	16	10	6	
39°N	TWNI	277	131	83	59	44	33	25	18	11

Appendix 1

Las Vegas, Nev.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	448	209	130	92	68	52	39	28	17
2,709 DD	WWNI	632	300	188	134	102	80	63	48	33
	TW	414	205	126	85	60	43	31	21	13
36°N	TWNI	603	284	179	126	94	71	53	39	26
Reno, Nev.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	192	88	54	37	26	18	12	6	
6,332 DD	WWNI	307	145	91	65	49	37	28	21	13
	TW	192	93	55	36	24	16	10	5	
39°N	TWNI	298	141	89	62	46	34	25	18	11
Seabrook, N. J.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	163	72	43	29	20	13	8		
4,812 DD	WWNI	271	126	78	55	41	31	24	17	11
	TW	167	78	46	29	19	12	7		
39°N	TWNI	267	123	76	53	39	29	21	15	9
Albuquerque, N. Mex.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	278	133	83	59	44	33	24	16	9
4,348 DD	WWNI	414	201	128	92	70	55	43	33	23
	TW	271	135	83	56	39	28	19	13	7
35°N	TWNI	402	193	123	87	65	49	37	27	18
Los Alamos, N. Mex.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	179	84	52	36	26	18	12	7	
6,604 DD	WWNI	288	139	89	64	48	37	29	21	14
	TW	183	89	54	36	24	16	11	6	
36°N	TWNI	283	136	86	61	45	34	25	18	12
Ithaca, N. Y.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	93	36	18	9					
6,914 DD	WWNI	189	83	50	34	24	18	13	9	5
	TW	106	46	24	13	6				
42°N	TWNI	188	83	50	34	24	17	12	8	4
New York City, N. Y.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	147	64	38	25	17	11	5		
4,871 DD	WWNI	250	117	72	51	38	29	22	16	10
	TW	152	71	42	26	17	11	6		
41°N	TWNI	247	114	71	49	36	27	20	14	9

The Passive Solar Energy Book

Sayville, L.I. N. Y.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
4,811 DD	WW	165	74	45	30	21	14	9		
	WWNI	272	129	80	57	43	33	25	18	12
	TW	169	81	48	31	20	13	8	4	
41°N	TWNI	268	125	78	55	40	30	22	16	10
Schenectady, N. Y.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
6,650 DD	WW	84	34	18	9					
	WWNI	174	79	48	33	24	18	13	9	5
	TW	98	43	23	13	6				
43°N	TWNI	175	79	49	33	24	17	12	8	5
Greensboro, N. C.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
3,805 DD	WW	237	107	66	46	33	24	17	11	
	WWNI	367	170	107	75	57	44	35	26	18
	TW	231	112	67	44	30	21	14	9	
36°N	TWNI	354	165	103	72	54	40	30	22	14
Hatteras, N. C.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
2,612 DD	WW	412	189	118	82	61	46	34	24	15
	WWNI	588	274	173	123	93	73	57	43	30
	TW	381	187	115	77	54	39	28	19	11
35°N	TWNI	560	261	164	115	86	65	49	36	24
Raleigh, N. C.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
3,393 DD	WW	256	117	71	50	37	27	19	12	7
	WWNI	391	182	114	80	61	48	37	28	19
	TW	249	120	72	48	33	23	16	10	5
36°N	TWNI	378	175	109	77	57	43	32	23	15
Bismarck, N. D.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
8,851 DD	WW	111	46	25	14	6				
	WWNI	208	94	57	39	26	21	15	10	6
	TW	120	54	30	17	9				
47°N	TWNI	207	94	57	39	27	20	14	9	5
Cleveland, Ohio	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
6,351 DD	WW	103	41	22	12					
	WWNI	202	89	53	36	26	20	14	10	6
	TW	114	50	27	15	8				
41°N	TWNI	200	89	53	36	26	19	13	9	5

Appendix 1

Columbus, Ohio	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	120	51	29	18	11				
5,211 DD	WWNI	218	100	61	42	31	23	17	12	7
	TW	128	59	33	20	12	6			
40°N	TWNI	216	99	61	42	30	22	16	11	6
Put-in-Bay, Ohio	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	102	39	20	9					
5,796 DD	WWNI	199	88	52	35	25	18	13	8	
	TW	112	48	26	14	6				
42°N	TWNI	199	87	52	35	25	18	12	8	4
Oklahoma City, Okla.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	250	115	70	49	36	26	19	12	6
3,725 DD	WWNI	382	179	112	80	60	47	37	28	19
	TW	243	118	71	47	32	23	15	10	5
35°N	TWNI	370	172	108	76	57	43	32	23	15
Astoria, Oreg.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	207	98	59	39	26	17	9		
5,186 DD	WWNI	322	158	99	69	50	37	27	19	11
	TW	205	99	59	38	25	16	9		
46°N	TWNI	315	152	95	65	47	34	24	16	9
Corvallis, Oreg.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	224	96	57	37	24	16	9		
4,726 DD	WWNI	352	158	97	67	48	36	26	18	11
	TW	217	100	58	36	24	15	9		
45°N	TWNI	341	153	93	63	45	33	23	16	9
Medford, Oreg.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	188	83	49	31	20	12			
5,008 DD	WWNI	306	139	86	60	43	32	23	16	9
	TW	186	87	50	31	20	12	6		
42°N	TWNI	296	136	83	57	40	29	21	14	8
State College, Pa.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	117	50	28	18	11				
5,934 DD	WWNI	214	98	61	42	31	23	17	12	7
	TW	126	58	33	20	12	6			
41°N	TWNI	213	97	60	41	30	22	16	11	6

The Passive Solar Energy Book

Newport, R. I.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	150	66	40	27	19	12	7		
5,804 DD	WWNI	256	118	74	52	39	30	23	17	11
	TW	156	74	43	27	18	11	7		
41°N	TWNI	251	116	72	51	37	28	20	14	9
Charleston, S. C.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	442	204	127	90	67	52	39	28	18
2,033 DD	WWNI	624	295	184	132	100	79	63	48	34
	TW	407	202	124	84	59	43	31	21	13
33°N	TWNI	594	279	176	124	93	71	53	39	27
Rapid City, S. Dak.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	149	67	40	26	18	11	6		
7,345 DD	WWNI	253	118	74	52	39	30	22	16	10
	TW	155	73	43	27	17	11	6		
44°N	TWNI	249	116	72	50	37	27	20	14	9
Nashville, Tenn.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	227	99	59	40	28	20	13	8	
3,578 DD	WWNI	355	161	98	68	51	39	30	23	15
	TW	219	103	61	39	26	18	11	7	
36°N	TWNI	343	155	95	66	48	36	27	19	12
Oak Ridge, Tenn.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	204	90	54	36	26	18	12	6	
3,817 DD	WWNI	325	149	92	64	48	37	29	21	14
	TW	201	95	56	36	24	16	6		
36°N	TWNI	315	145	89	62	46	34	25	18	11
Brownsville, Tex.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	1052	526	348	254	194	151	117	88	60
600 DD	WWNI	1399	700	465	342	265	209	165	127	90
	TW	976	506	324	226	165	123	91	66	44
26°N	TWNI	1330	664	435	315	238	183	140	104	71
El Paso, Tex.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	431	205	129	92	69	52	39	28	18
2,700 DD	WWNI	608	295	187	134	103	80	63	48	34
	TW	402	202	125	85	60	44	31	22	13
32°N	TWNI	582	279	178	126	94	72	54	40	27

Appendix 1

Fort Worth, Tex.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	364	171	108	76	57	43	32	23	14
2,405 DD	WWNI	526	251	159	115	87	69	54	41	29
	TW	344	171	106	71	50	36	26	18	10
33°N	TWNI	503	239	152	108	81	61	46	34	23
Midland, Tex.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	385	184	115	82	61	47	35	25	16
2,591 DD	WWNI	548	267	169	121	93	73	57	44	31
	TW	362	182	113	76	54	39	28	19	12
32°N	TWNI	527	253	161	115	86	65	49	36	24
San Antonio, Tex.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	547	253	159	114	86	66	50	37	24
1,546 DD	WWNI	762	355	224	162	124	98	78	60	42
	TW	501	248	154	104	75	54	40	28	18
30°N	TWNI	722	337	213	152	114	87	66	49	33
Flaming Gorge, Utah	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	170	79	48	33	23	16	10	5	
6,929 DD	WWNI	277	132	84	60	45	35	27	20	13
	TW	173	84	50	33	22	15	9	5	
41°N	TWNI	272	129	82	58	43	32	24	17	11
Salt Lake City, Utah	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	192	86	52	35	24	16	10		
6,052 DD	WWNI	308	143	90	63	46	35	27	19	12
	TW	190	91	54	34	23	15	9	4	
41°N	TWNI	299	140	87	60	44	32	24	17	10
Burlington, Vt.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	80	30	15						
8,269 DD	WWNI	171	75	46	31	23	17	12	8	4
	TW	94	41	21	11					
44°N	TWNI	172	77	46	31	22	16	11	7	4
Pullman, Wash.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	178	78	44	27	17	9			
5,542 DD	WWNI	291	134	82	56	40	29	21	14	8
	TW	175	81	46	28	18	10			
47°N	TWNI	282	130	79	53	37	27	19	13	7

The Passive Solar Energy Book

Richland, Wash.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	179	77	43	25	15	7			
5,941 DD	WWNI	293	133	81	54	38	27	19	13	7
	TW	176	80	45	27	16	9			
47°N	TWNI	285	130	78	52	36	26	18	12	7
Seattle, Wash.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	219	93	52	32	20	11			
4,424 DD	WWNI	346	154	93	62	44	31	22	15	9
	TW	211	95	54	33	20	12	6		
48°N	TWNI	333	149	89	59	41	29	20	13	8
Spokane, Wash.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	149	63	34	20	10				
6,655 DD	WWNI	255	116	70	47	33	23	17	11	6
	TW	151	68	38	22	13	6			
48°N	TWNI	251	114	68	45	32	22	16	10	5
Madison, Wis.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	108	44	24	14	7				
7,863 DD	WWNI	206	92	56	38	28	21	16	11	6
	TW	119	53	29	17	10				
43°N	TWNI	204	92	56	38	27	20	14	10	6
Lander, Wyo.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	163	76	47	32	22	15	9		
7,870 DD	WWNI	267	129	82	58	44	34	26	19	12
	TW	168	81	49	32	21	14	9	4	
43°N	TWNI	264	126	80	56	41	31	23	16	10
Laramie, Wyo.	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	157	72	44	31	22	15	10		
7,381 DD	WWNI	263	124	79	56	43	33	26	19	13
	TW	164	79	47	31	21	14	9	4	
41°N	TWNI	259	122	77	55	41	30	23	16	10
Edmonton, Alberta	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
	WW	93	34							
10,268 DD	WWNI	184	83	48	31	20	13	8	4	
	TW	102	42	20						
54°N	TWNI	184	83	48	31	20	14	9	5	

Appendix 1

Ottawa, Ontario	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9	
	WW	91	35	17	7						
	8,735 DD	WWNI	185	81	49	33	24	17	12	8	4
		TW	103	45	23	13					
45°N	TWNI	184	82	49	33	24	17	12	8	4	
	Toronto, Ontario	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
		WW	103	42	23	14	6				
		6,827 DD	WWNI	198	89	55	38	27	21	15	10
		TW	114	51	28	16	9				
44°N	TWNI	197	89	55	37	27	19	14	9	5	
	Winnipeg, Manitoba	SHF	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9
		WW	74	27							
		10,679 DD	WWNI	162	73	44	29	20	14	9	5
		TW	88	37	18	7					
50°N	TWNI	164	74	44	29	20	14	9	5		

Step 6. Determining Cost Effectiveness*

The important economic consideration when designing a passive solar heated building is the trade-off between the cost of extra thermal mass and movable insulation (less the installed cost of the conventional construction it replaces) and the future cost of the fuel saved by the system over its lifetime. Operating and maintenance cost must also be included; however, for most passive systems this cost is negligible. The cost of solar heat can be estimated by the following formula:

$$\text{cost of solar heat} = \frac{\left(\frac{\text{solar system cost} \times \text{capital recovery factor}}{\text{annual solar heating contribution (} Q_c \text{ year)}} \right) + \text{annual operating and maintenance cost}}$$

*Adapted from Los Alamos Scientific Laboratory, *Pacific Regional Solar Heating Handbook*. ERDA, San Francisco, California, 1976.

The Passive Solar Energy Book

The *capital recovery factor* is determined from bankers' tables or formulas. It is defined as the value of capital to the individual. It may be the interest rate that your money would earn if you invested it, or the annual cost of a loan made to finance the extra cost of the passive system. For example, the capital recovery factor of a 10% 30-year loan is 0.106.

To illustrate the use of the formula, if we assume, for example, that


- the passive solar heating system costs \$5,000 above installed conventional construction costs,
- the capital recovery factor is 0.106 for a 30-year loan at 10% interest,
- the operating and maintenance cost for the system is \$25 a year, and
- the annual solar heating contribution is 100 million Btu's,

from the formula, the cost of solar heat is then:

$$\begin{aligned}\text{cost of solar heat} &= \frac{(\$5,000 \times 0.106) + \$25}{100 \text{ million Btu's}} \\ &= \$5.55 \text{ per million Btu's.}\end{aligned}$$

This figure does not take into account considerations that would make the cost less expensive, such as tax incentives, deduction of interest payments and business depreciation, or considerations that can make it more expensive, such as property tax evaluation increases and fuel cost deductions (business expense).

Another method for calculating the cost effectiveness of a system is the nomograph in figure 1-9. This method allows for the increase in future annual fuel costs to be included in the procedure. By plotting the cost of the system, the annual projected increase in energy costs, the annual solar heating contribution and the cost of conventional fuel, the nomograph computes the break-even time on the system's initial cost.

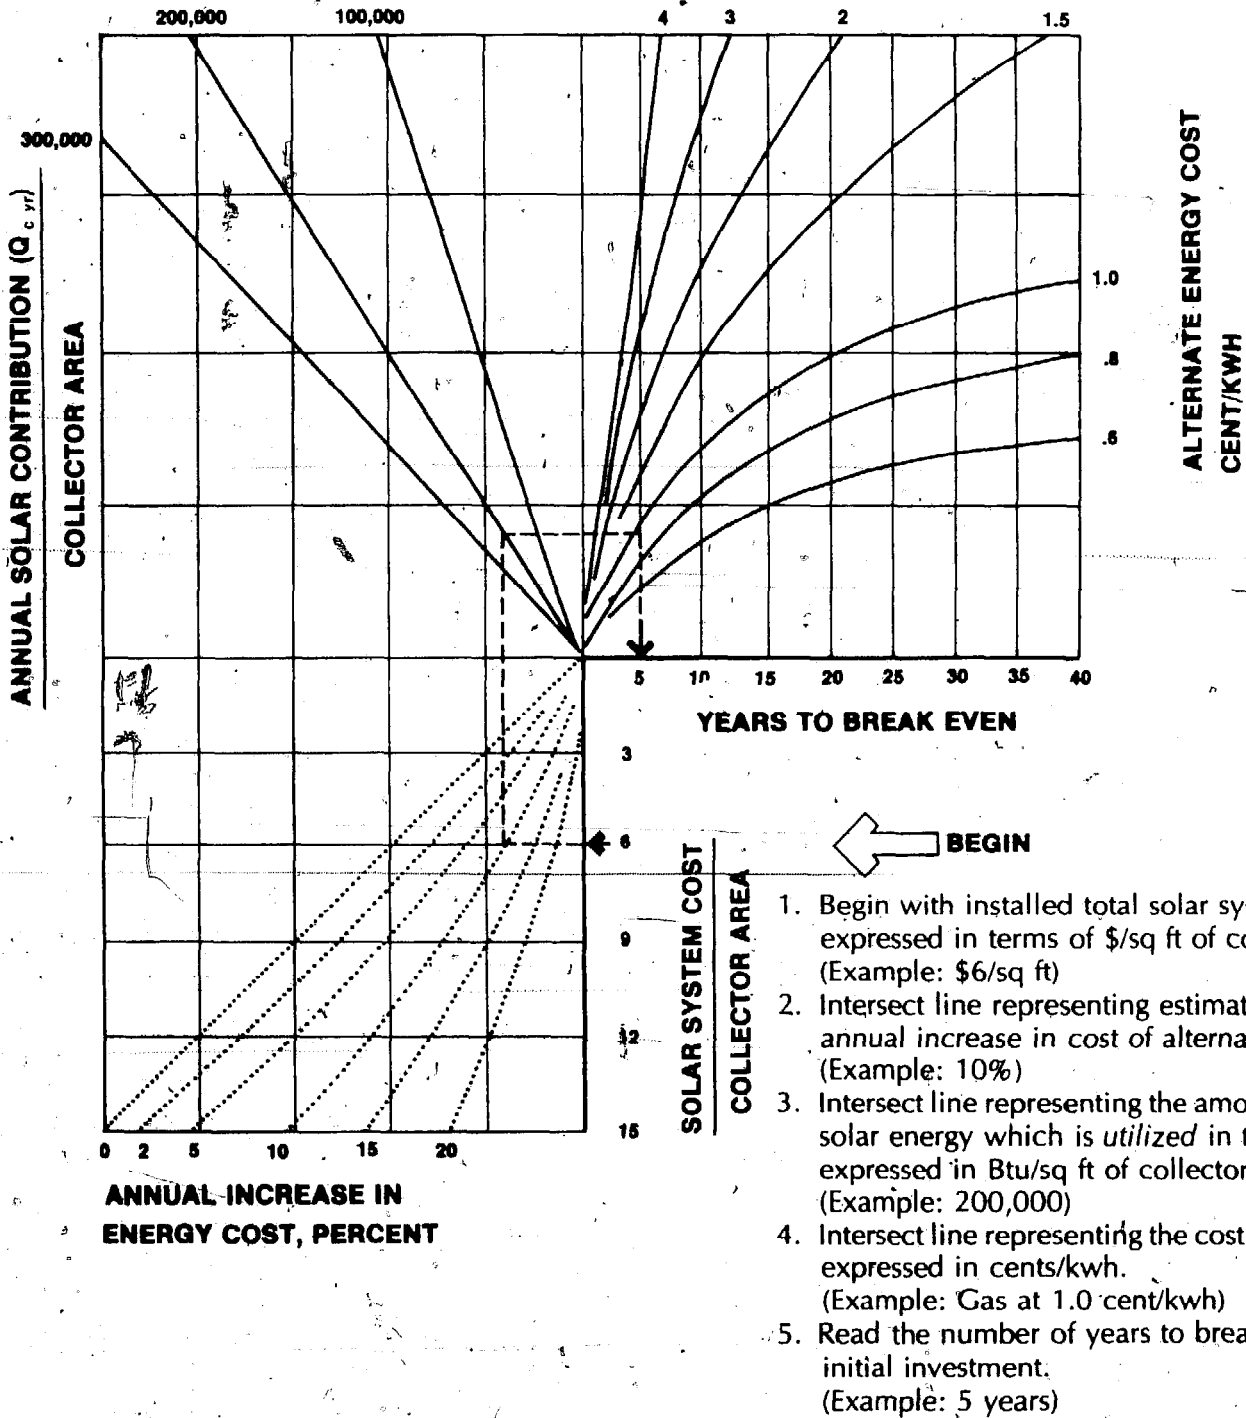

Based on 8% interest, 1% maintenance/year.

Fig. 1-9: Solar system cost nomograph.

Source: Adapted from GSA, "Energy Conservation Design Guidelines for New Office Buildings," as quoted by P.D. Maycock in "Solar Energy: The Outlook for Widespread Commercialization of Solar Heating and Cooling," ERDA:

Table 1-4 Capital Recovery Factors

Years	Interest Rate						
	5½%	6%	7%	8%	10%	12%	15%
1	1.055 00	1.060 00	1.070 00	1.080 00	1.100 00	1.120 00	1.150 00
2	0.541 62	0.545 44	0.553 09	0.560 77	0.576 19	0.591 70	0.615 12
3	0.370 65	0.374 11	0.381 05	0.388 03	0.402 11	0.416 35	0.437 98
4	0.285 29	0.288 59	0.295 23	0.301 92	0.315 47	0.329 23	0.350 27
5	0.234 18	0.237 40	0.243 89	0.250 46	0.263 80	0.277 41	0.298 32
6	0.200 18	0.203 36	0.209 80	0.216 32	0.229 61	0.243 23	0.264 24
7	0.175 96	0.179 14	0.185 55	0.192 07	0.205 41	0.219 12	0.240 36
8	0.157 86	0.161 04	0.167 47	0.174 01	0.187 44	0.201 30	0.222 85
9	0.143 84	0.147 02	0.153 49	0.160 08	0.173 64	0.187 68	0.209 57
10	0.132 67	0.135 87	0.142 38	0.149 03	0.162 75	0.176 98	0.199 25
11	0.123 57	0.126 79	0.133 36	0.140 08	0.153 96	0.168 42	0.191 07
12	0.116 03	0.119 28	0.125 90	0.132 70	0.146 76	0.161 44	0.184 48
13	0.109 68	0.112 96	0.119 65	0.126 52	0.140 78	0.155 68	0.179 11
14	0.104 28	0.107 58	0.114 34	0.121 30	0.135 75	0.150 87	0.174 69
15	0.099 63	0.102 96	0.109 79	0.116 83	0.131 47	0.146 82	0.171 02
16	0.095 58	0.098 95	0.105 86	0.112 98	0.127 82	0.143 39	0.167 95
17	0.092 04	0.095 44	0.102 43	0.109 63	0.124 66	0.140 46	0.165 37
18	0.088 92	0.092 36	0.099 41	0.106 70	0.121 93	0.137 94	0.163 19
19	0.086 15	0.089 62	0.096 75	0.104 13	0.119 55	0.135 76	0.161 34
20	0.083 68	0.087 18	0.094 39	0.101 85	0.117 46	0.133 88	0.159 76
21	0.081 46	0.085 00	0.092 29	0.099 83	0.115 62	0.132 24	0.158 42
22	0.079 47	0.083 05	0.090 41	0.098 03	0.114 01	0.130 81	0.157 27
23	0.077 67	0.081 28	0.088 71	0.096 42	0.112 57	0.129 56	0.156 28
24	0.076 04	0.079 68	0.087 19	0.094 98	0.111 30	0.128 46	0.155 43
25	0.074 55	0.078 23	0.085 81	0.093 68	0.110 17	0.127 50	0.154 70
26	0.073 19	0.076 90	0.084 56	0.092 51	0.109 16	0.126 65	0.154 07
27	0.071 95	0.075 70	0.083 43	0.091 45	0.108 26	0.125 90	0.153 53
28	0.070 81	0.074 59	0.082 39	0.090 49	0.107 45	0.125 24	0.153 06
29	0.069 77	0.073 58	0.081 45	0.089 62	0.106 73	0.124 66	0.152 65
30	0.068 81	0.072 65	0.080 59	0.088 83	0.106 08	0.124 14	0.152 30
31	0.067 92	0.071 79	0.079 80	0.088 11	0.105 50	0.123 69	0.152 00
32	0.067 10	0.071 00	0.079 07	0.087 45	0.104 97	0.123 28	0.151 73
33	0.066 33	0.070 27	0.078 41	0.086 85	0.104 50	0.122 92	0.151 50
34	0.065 63	0.069 60	0.077 80	0.086 30	0.104 07	0.122 60	0.151 31
35	0.064 97	0.068 97	0.077 23	0.085 80	0.103 69	0.122 32	0.151 13

2

Appendix

Percentage of Solar Radiation Absorbed by Various Surfaces

(Figures are expressed as the percentage of the intensity of solar radiation striking the surface.)

Reflective surfaces	0.20
For white, smooth surfaces	0.25 to 0.40
For grey to dark grey	0.40 to 0.50
For green, red and brown	0.50 to 0.70
For dark brown to blue	0.70 to 0.80
For dark blue to black	0.80 to 0.90

3 Appendix

Average Daily Solar Radiation

1. Average Daily Radiation on a Horizontal Surface for Various Locations in North America (in Btu/day-sq ft)

	January	February	March	April	May
Albuquerque, N. Mex. Lat. 35°03'N	1150.9	1453.9	1925.4	2343.5	2560.9
Annette Is., Alaska Lat. 55°02'N	236.2	428.4	883.4	1357.2	1634.7
Apalachicola, Fla. Lat. 29°45'N	1107	1378.2	1654.2	2040.9	2268.6
Astoria, Oreg. Lat. 46°12'N	338.4	607	1008.5	1401.5	1838.7
Atlanta, Ga. Lat. 33°39'N	848	1080.1	1426.9	1807	2618.1
Barrow, Alaska Lat. 71°20'N	13.3	143.2	713.3	1491.5	1883
Bethel, Alaska Lat. 60°47'N	142.4	404.8	1052.4	1662.3	1711.8
Bismarck, N. Dak. Lat. 46°47'N	587.4	934.3	1328.4	1668.2	2056.1
Blue Hill, Mass. Lat. 42°13'N	555.3	797	1143.9	1438	1776.4
Boise, Idaho Lat. 43°34'N	518.8	884.9	1280.4	1814.4	2189.3
Boston, Mass. Lat. 42°22'N	505.5	738	1067.1	1355	1769

Source: *Intermediate Property Standards for Solar Heating and Domestic Hot Water*, National Bureau of Standards, Washington, D.C.

Appendix 3

June	July	August	September	October	November	December
2757.5	2561.2	2387.8	2120.3	1639.8	1274.2	1051.6
1638.7	1632.1	1269.4	962	454.6	220.3	152
2195.9	1978.6	1912.9	1703.3	1544.6	1243.2	982.3
1753.5	2007.7	1721	1322.5	780.4	413.6	295.2
2002.6	2002.9	1898.1	1519.2	1290.8	997.8	751.6
2055.3	1602.2	953.5	428.4	152.4	22.9	
1698.1	1401.8	938.7	755	430.6	164.9	83
2173.8	2305.5	1929.1	1441.3	1018.1	600.4	464.2
1943.9	1881.5	1622.1	1314	941	592.2	482.3
2376.7	2500.3	2140.4	1717.7	1128.4	678.6	456.8
1864	1860.5	1570.1	1267.5	896.7	535.8	442.8

The Passive Solar Energy Book

	January	February	March	April	May
Brownsville, Tex. Lat. 25°55'N	1105.9	1262.7	1505.9	1714	2092.2
Caribou, Maine Lat. 46°52'N	497	861.6	1360.1	1495.9	1779.7
Charleston, S. C. Lat. 32°54'N	946.1	1152.8	1352.4	1918.8	2063.4
Cleveland, Ohio Lat. 41°24'N	466.8	681.9	1207	1443.9	1928.4
Columbia, Mo. Lat. 38°58'N	651.3	941.3	1315.8	1631.3	1999.6
Columbus, Ohio Lat. 40°00'N	486.3	746.5	1112.5	1480.8	1839.1
Davis, Calif. Lat. 38°33'N	599.2	945	1504	1959	2368.6
Dodge City, Kans. Lat. 37°46'N	953.1	1186.3	1565.7	1975.6	2126.5
East Lansing, Mich. Lat. 42°44'N	425.8	739.1	1086	1249.8	1732.8
East Wareham, Mass. Lat. 41°46'N	504.4	762.4	1132.1	1392.6	1704.8
Edmonton, Alberta Lat. 53°35'N	331.7	652.4	1165.3	1541.7	1900.4
El Paso, Tex. Lat. 31°48'N	1247.6	1612.9	2048.7	2447.2	2673
Ely, Nev. Lat. 39°17'N	871.6	1255	1749.8	2103.3	2322.1
Fairbanks, Alaska Lat. 64°49'N	66	283.4	860.5	1481.2	1806.2

Appendix 3

June	July	August	September	October	November	December
2288.5	2345	2124	1774.9	1536.5	1104.8	982.3
1779.7	1898.1	1675.6	1254.6	793	415.5	398.9
2113.3	1649.4	1933.6	1557.2	1332.1	1073.8	952
2102.6	2094.4	1840.6	1410.3	997	526.6	427.3
2129.1	2148.7	1953.1	1689.6	1202.6	839.5	590.4
2111	2041.3	1572.7	1189.3	919.5	479	430.2
2619.2	2565.6	2287.8	1856.8	1288.5	795.6	550.5
2459.8	2400.7	2210.7	1841.7	1421	1065.3	873.8
1914	1884.5	1627.7	1303.3	891.5	473.1	379.7
1958.3	1873.8	1607.4	1363.8	996.7	636.2	521
1914.4	1964.9	1528	1113.3	704.4	413.6	245
2731	2391.1	2350.5	2077.5	1704.8	1324.7	1051.6
2649	2417	2307.7	1935	1473	1078.6	814.8
1970.8	1702.9	1247.6	699.6	323.6	104.1	20.3

The Passive Solar Energy Book

	January	February	March	April	May
Fort Worth, Tex. Lat. 32°50'N	936.2	1198.5	1597.8	1829.1	2105.1
Fresno, Calif. Lat. 36°46'N	712.9	1116.6	1652.8	2049.4	2409.2
Gainesville, Fla. Lat. 29°39'N	1036.9	1324.7	1635	1956.4	1934.7
Glasgow, Mont. Lat. 48°13'N	572.7	965.7	1437.6	1741.3	2127.3
Grand Junction, Colo. Lat. 39°07'N	848	1210.7	1622.9	2002.2	2300.3
Grand Lake, Colo. Lat. 40°15'N	735	1135.4	1579.3	1876.7	1974.9
Great Falls, Mont. Lat. 47°29'N	524	869.4	1369.7	1621.4	1970.8
Greensboro, N. C. Lat. 36°05'N	743.9	1031.7	1323.2	1755.3	1988.5
Griffin, Ga. Lat. 33°15'N	889.6	1135.8	1450.9	1923.6	2163.1
Hatteras, N. C. Lat. 35°13'N	891.9	1184.1	1590.4	2128	2376.4
Indianapolis, Ind. Lat. 39°44'N	526.2	797.4	1184.1	1481.2	1828
Inyokern, Calif. Lat. 35°39'N	1148.7	1554.2	2136.9	2594.8	2925.4
Ithaca, N. Y. Lat. 42°27'N	434.3	755	1074.9	1322.9	1779.3
Lake Charles, La. Lat. 30°13'N	899.2	1145.7	1487.4	1801.8	2080.4

Appendix 3

June	July	August	September	October	November	December
2437.6	2293.3	2216.6	1880.8	1476	1147.6	913.6
2641.7	2512.2	2300.7	1897.8	1415.5	906.6	616.6
1960.9	1895.6	1873.8	1615.4	1312.2	1169.7	919.5
2261.6	2414.7	1984.5	1531	997	574.9	428.4
2645.4	2517.7	2157.2	1957.5	1394.8	969.7	793.4
2369.7	2103.3	1708.5	1715.8	1212.2	775.6	660.5
2179.3	2383	1986.3	1536.5	984.9	575.3	420.7
2111.4	2033.9	1810.3	1517.3	1202.6	908.1	690.8
2176	2064.9	1961.2	1605.9	1352.4	1073.8	781.5
2438	2334.3	2085.6	1758.3	1337.6	1053.5	798.1
2042	2039.5	1832.1	1513.3	1094.4	662.4	491.1
3108.8	2908.8	2759.4	2409.2	1819.2	3170.1	1094.4
2025.8	2031.3	1736.9	1320.3	918.4	466.4	370.8
2213.3	1968.6	1910.3	1678.2	1505.5	1122.1	875.6

The Passive Solar Energy Book

	January	February	March	April	May
Lander, Wyo. Lat. 42°48'N	786.3	1146.1	1638	1988.5	2114
Las Vegas, Nev. Lat. 36°05'N	1035.8	1438	1926.5	2322.8	2629.5
Lemont, Ill. Lat. 41°40'N	590	879	1255.7	1481.5	1866
Lexington, Ky. Lat. 38°02'N	—	—	—	1834.7	2171.2
Lincoln, Nebr. Lat. 40°51'N	712.5	955.7	1299.6	1587.8	1856.1
Little Rock, Ark. Lat. 34°44'N	704.4	974.2	1335.8	1669.4	1960.1
Los Angeles, Calif. (WBAS) Lat. 33°56'N	930.6	1284.1	1729.5	1948	2196.7
Los Angeles, Calif. (WBO) Lat. 34°03'N	911.8	1223.6	1640.9	1866.8	2061.2
Madison, Wis. Lat. 43°08'N	564.6	812.2	1232.1	1455.3	1745.4
Matanuska, Alaska Lat. 61°30'N	119.2	345	—	1327.6	1628.4
Medford, Oreg. Lat. 42°23'N	435.4	804.4	1259.8	1807.4	2216.2
Miami, Fla. Lat. 25°47'N	1292.2	1554.6	1828.8	2020.6	2068.6
Midland, Tex. Lat. 31°56'N	1066.4	1345.7	1784.8	2036.1	2301.1
Nashville, Tenn. Lat. 36°07'N	589.7	907	1246.8	1662.3	1997

Appendix 3

June	July	August	September	October	November	December
2492.2	2438.4	2120.6	1712.9	1301.8	837.3	694.8
2799.2	2524	2342	2062	1602.6	1190	964.2
2041.7	1990.8	1836.9	1469.4	1015.5	639	531
	2246.5	2064.9	1775.6	1315.8	—	681.5
2040.6	2011.4	1902.6	1543.5	1215.8	773.4	643.2
2091.5	2081.2	1938.7	1640.6	1282.6	913.6	701.1
2272.3	2413.6	2155.3	1898.1	1372.7	1082.3	901.1
2259	2428.4	2198.9	1891.5	1362.3	1053.1	877.8
2031.7	2046.5	1740.2	1443.9	993	555.7	495.9
1727.6	1526.9	1169	737.3	373.8	142.8	56.4
2440.5	2607.4	2261.6	1672.3	1043.5	558.7	346.5
1991.5	1992.6	1890.8	1646.8	1436.5	1321	1183.4
2317.7	2301.8	2193	1921.8	1470.8	1244.3	1023.2
2149.4	2079.7	1862.7	1600.7	1223.6	823.2	614.4

The Passive Solar Energy Book

	January	February	March	April	May
Newport, R. I. Lat. 41°29'N	565.7	856.4	1231.7	1484.8	1849
New York, N. Y. Lat. 40°46'N	539.5	790.8	1180.4	1426.2	1738.4
Oak Ridge, Tenn. Lat. 36°01'N	604	895.9	1241.7	1689.6	1942.8
Oklahoma City, Okla. Lat. 35°24'N	938	1192.6	1534.3	1849.4	2005.1
Ottawa, Ontario Lat. 45°20'N	539.1	852.4	1250.5	1506.6	1857.2
Phoenix, Ariz. Lat. 33°26'N	1126.6	1514.7	1967.1	2388.2	2709.6
Portland, Maine Lat. 43°39'N	565.7	874.5	1329.5	1528.4	1923.2
Rapid City, S. Dak. Lat. 44°09'N	687.8	1032.5	1503.7	1807	2028
Riverside, Calif. Lat. 33°57'N	999.6	1335	1750.5	1943.2	2282.3
St. Cloud, Minn. Lat. 45°35'N	632.8	976.7	1383	1598.1	1859.4
Salt Lake City, Utah Lat. 40°46'N	622.1	986	1301.1	1813.3	—
San Antonio, Tex. Lat. 29°32'N	1045	1299.2	1560.1	1664.6	2024.7
Santa Maria, Calif. Lat. 34°54'N	983.8	1296.3	1805.9	2067.9	2375.6
Sault Ste. Marie, Mich. Lat. 46°28'N	488.6	843.9	1336.5	1559.4	1962.3

Appendix 3

June	July	August	September	October	November	December
2019.2	1942.8	1687.1	1411.4	1035.4	656.1	527.7
1994.1	1938.7	1605.9	1349.4	977.8	598.1	476
2066.4	1972.3	1795.6	1559.8	1194.8	796.3	610
2355	2273.8	2211	1819.2	1409.6	1085.6	897.4
2084.5	2045.4	1752.4	1326.6	826.9	458.7	408.5
2781.5	2450.5	2299.6	2131.3	1688.9	1290	1040.9
2017.3	2095.6	1799.2	1428.8	1035	591.5	507.7
2193.7	2235.8	2019.9	1628	1179.3	763.1	590.4
2492.6	2443.5	2263.8	1955.3	1509.6	1169	979.7
2003.3	2087.8	1828.4	1369.4	890.4	545.4	463.1
—	—	—	1689.3	1250.2	—	552.8
814.8	2364.2	2185.2	1844.6	1487.4	1104.4	954.6
2599.6	2540.6	2293.3	1965.7	1566.4	1169	943.9
2064.2	2149.4	1767.9	1207	809.2	392.2	359.8

The Passive Solar Energy Book

	January	February	March	April	May
Sayville, N. Y. Lat. 40°30'N	602.9	936.2	1259.4	1560.5	1857.2
Schenectady, N. Y. Lat. 42°50'N	488.2	753.5	1026.6	1272.3	1553.1
Seabrook, N. J. Lat. 39°30'N	591.9	854.2	1195.6	1518.8	1800.7
Seattle, Wash. Lat. 47°27'N	282.6	520.6	992.2	1507	1881.5
Seattle, Wash. Lat. 47°36'N	252	471.6	917.3	1375.6	1664.9
Spokane, Wash. Lat. 47°40'N	446.1	837.6	1200	1864.6	2104.4
State College, Pa. Lat. 40°48'N	501.8	749.1	1106.6	1399.2	1754.6
Stillwater, Okla. Lat. 36°09'N	763.8	1081.5	1463.8	1702.6	1879.3
Tampa, Fla. Lat. 27°55'N	1223.6	1461.2	1771.9	2016.2	2228
Toronto, Ontario Lat. 43°41'N	451.3	674.5	1088.9	1388.2	1785.2
Tucson, Ariz. Lat. 32°07'N	1171.9	1453.8	—	2434.7	—
Upton, N. Y. Lat. 40°52'N	583	872.7	1280.4	1609.9	1891.5
Washington, D. C. (WBCO) Lat. 38°51'N	632.4	901.5	1255	1600.4	1846.8
Winnipeg, Man. Lat. 49°54'N	488.2	835.4	1354.2	1641.3	1904.4

Appendix 3


June	July	August	September	October	November	December
2123.2	2040.9	1734.7	1446.8	1087.4	697.8	533.9
1687.8	1662.3	1494.8	1124.7	820.6	436.2	356.8
1964.6	1949.8	1715	1445.7	1071.9	721.8	522.5
1909.9	2110.7	1688.5	1211.8	702.2	386.3	239.5
1724	1805.1	1617	1129.1	638	325.5	218.1
2226.5	2479.7	2076	1511	844.6	486.3	279
2027.6	1968.2	1690	1336.1	1017	580.1	443.9
2235.8	2224.3	2039.1	1724.3	1314	991.5	783
2146.5	1991.9	1845.4	1687.8	1493.3	1328.4	1119.5
1941.7	1968.6	1622.5	1284.1	835	458.3	352.8
2601.4	2292.2	2179.7	2122.5	1640.9	1322.1	1132.1
2159	2044.6	1789.6	1472.7	1102.6	686.7	551.3
2080.8	1929.9	1712.2	1446.1	1083.4	763.5	594.1
1962	2123.6	1761.2	1190.4	767.5	444.6	345

2. Horizontal to Vertical Conversion

Average solar radiation values generally available in tables and maps are measured on a horizontal surface; however, the values required for passive solar calculations are the actual solar energy transmitted through vertical south-facing glass. The following formula can be used to convert horizontal incident solar energy to the amount of energy transmitted through two sheets of vertical south-facing glass:

$$\text{solar energy transmitted through south double glass} = F \times \text{solar energy incident on a horizontal surface}$$

where: F = conversion factor from the following graph:

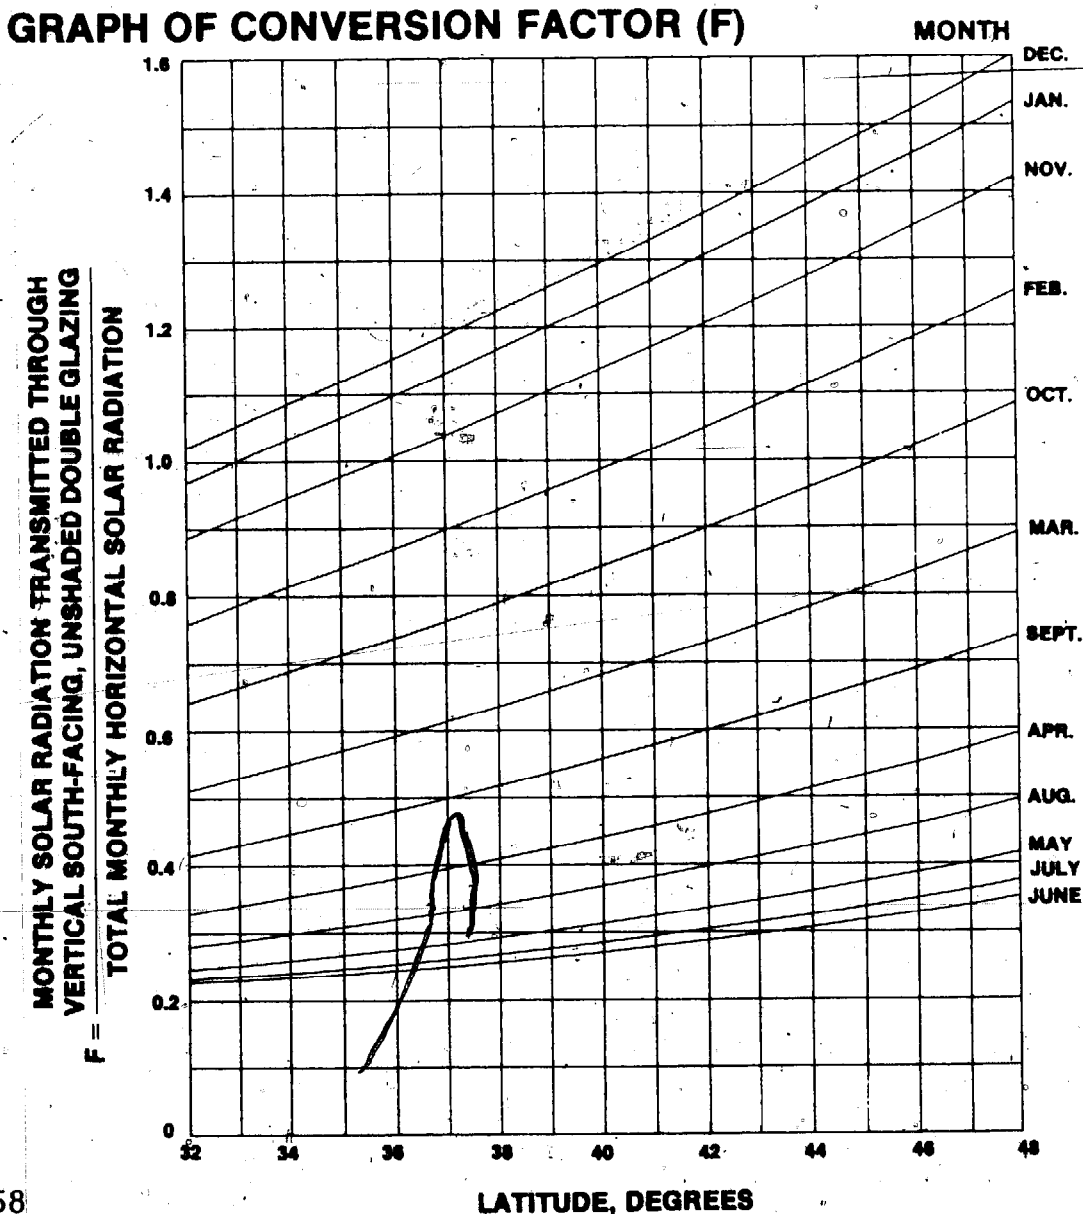

The conversion factor (F) is the ratio of the monthly solar radiation transmitted through vertical south-facing double glazing to the monthly total horizontal solar radiation. For vertical single glazing use 1.213 (F) and for vertical triple glazing use 0.825 (F).

For glazing other than vertical or at orientations different than true south, a correction to the value calculated must be made. It is recommended that the clear-day radiation tables in Appendix 6 be used. To establish a Correction Factor (CF), use the following formula:

$$CF = \frac{\text{clear-day transmitted radiation for tilt and orientation of glazing}}{\text{clear-day transmitted radiation for vertical, south glazing}}$$

Next, multiply the average solar radiation value transmitted through vertical glazing by the Correction Factor.

SOURCE: Adapted from J. D. Balcomb and R. D. McFarland, "A Simple Empirical Method for Estimating the Performance of a Passive Solar Heated Building of the Thermal Storage Wall Type," *Proceedings of the Second National Passive Solar Conference*, Philadelphia, March 16-18, 1978 (Washington D.C.: U.S. Energy Research and Development Administration, 1978).

4

Appendix

Average Daily Temperatures (°F) in North America

	January	February	March	April	May
Albuquerque, N. Mex. Lat. 35°03'N • El. 5314 ft	37.3	43.3	50.1	59.6	69.4
Annette Is., Alaska Lat. 55°02'N • El. 110 ft	35.8	37.5	39.7	44.4	51.0
Apalachicola, Fla. Lat. 29°45'N • El. 35 ft	57.3	59.0	62.9	69.5	76.4
Astoria, Oreg. Lat. 46°12'N • El. 8 ft	41.3	44.7	46.9	51.3	55.0
Atlanta, Ga. Lat. 33°39'N • El. 976 ft	47.2	49.6	55.9	65.0	73.2
Barrow, Alaska Lat. 71°20'N • El. 22 ft	-13.2	-15.9	-12.7	2.1	20.5
Bethel, Alaska Lat. 60°47'N • El. 125 ft	9.2	11.6	14.2	29.4	42.7
Bismarck, N. Dak. Lat. 46°47'N • El. 1660 ft	12.4	15.9	29.7	46.6	58.6
Blue Hill, Mass. Lat. 42°13'N • El. 629 ft	28.3	28.3	36.9	46.9	58.5
Boise, Idaho Lat. 43°34'N • El. 2844 ft	29.5	36.5	45.0	53.5	62.1
Boston, Mass. Lat. 42°22'N • El. 29 ft	31.4	31.4	39.9	49.5	60.4

SOURCE: *Intermediate Property Standards for Solar Heating and Domestic Hot Water*, National Bureau of Standards, Washington, D.C.

Appendix 4

14

June	July	August	September	October	November	December
79.1	82.8	80.6	73.6	62.1	47.8	39.4
56.2	58.6	59.8	54.8	48.2	41.9	37.4
81.8	83.1	83.1	80.6	73.2	63.7	58.55
59.3	62.6	63.6	62.2	55.7	48.5	43.9
80.9	82.4	81.6	77.4	66.5	54.8	47.7
35.4	41.6	40.0	31.7	18.6	2.6	- 8.6
55.5	56.9	54.8	47.4	33.7	19.0	9.4
67.9	76.1	73.5	61.6	49.6	31.4	18.4
67.2	72.3	70.6	64.2	54.1	43.3	31.5
69.3	79.6	77.2	66.7	56.3	42.3	33.1
69.8	74.5	73.8	66.8	57.4	46.6	34.9

The Passive Solar Energy Book

	January	February	March	April	May
Brownsville, Tex. Lat. 25°55'N • El. 20 ft	63.3	66.7	70.7	76.2	81.4
Caribou, Maine Lat. 46°52'N • El. 628 ft	11.5	12.8	24.4	37.3	51.8
Charleston, S. C. Lat. 32°54'N • El. 46 ft	53.6	55.2	60.6	67.8	74.8
Cleveland, Ohio Lat. 41°24'N • El. 805 ft	30.8	30.9	39.4	50.2	62.4
Columbia, Mo. Lat. 38°58'N • El. 785 ft	32.5	36.5	45.9	57.7	66.7
Columbus, Ohio Lat. 40°00'N • El. 833 ft	32.1	33.7	42.7	53.5	64.4
Davis, Calif. Lat. 38°33'N • El. 51 ft	47.6	52.1	56.8	63.1	69.6
Dodge City, Kans. Lat. 37°46'N • El. 2592 ft	33.8	38.7	46.5	57.7	66.7
East Lansing, Mich. Lat. 42°44'N • El. 856 ft	26.0	26.4	35.7	48.4	59.8
East Wareham, Mass. Lat. 41°46'N • El. 18 ft	32.2	31.6	39.0	48.3	58.9
Edmonton, Alberta Lat. 53°35'N • El. 2219 ft	10.4	14	26.3	42.9	55.4
El Paso, Tex. Lat. 31°48'N • El. 3916 ft	47.1	53.1	58.7	67.3	75.7
Ely, Nev. Lat. 39°17'N • El. 6262 ft	27.3	32.1	39.5	48.3	57.0
Fairbanks, Alaska Lat. 64°49'N • El. 436 ft	- 7.0	0.3	13.0	32.2	50.5

Appendix 4

June	July	August	September	October	November	December
85.1	86.5	86.9	84.1	78.9	70.7	65.2
61.6	67.2	65.0	56.2	44.7	31.3	16.8
80.9	82.9	82.3	79.1	69.8	59.8	54.0
72.7	77.0	75.1	68.5	57.4	44.0	32.8
75.9	81.1	79.4	71.9	61.4	46.1	35.8
74.2	78	75.9	70.1	58	44.5	34.0
75.7	81	79.4	76.7	67.8	57	48.7
77.2	83.8	82.4	73.7	61.7	46.5	36.8
70.3	74.5	72.4	65.0	53.5	40.0	29.0
67.5	74.1	72.8	65.9	56	46	34.8
61.3	66.6	63.2	54.2	44.1	26.7	14.0
84.2	84.9	83.4	78.5	69.0	56.0	48.5
65.4	74.5	72.3	63.7	52.1	39.9	31.1
62.4	63.8	58.3	47.1	29.6	5.5	6.6

The Passive Solar Energy Book

	January	February	March	April	May
Fort Worth, Tex. Lat. 32°50'N • El. 544 ft	48.1	52.3	59.8	68.8	75.9
Fresno, Calif. Lat. 36°46'N • El. 331 ft	47.3	53.9	59.1	65.6	73.5
Gainesville, Fla. Lat. 29°39'N • El. 165 ft	62.1	63.1	67.5	72.8	79.4
Glasgow, Mont. Lat. 48°13'N • El. 2277 ft	13.3	17.3	31.1	47.8	59.3
Grand Junction, Colo. Lat. 39°07'N • El. 4849 ft	26.9	35.0	44.6	55.8	66.3
Grand Lake, Colo. Lat. 40°15'N • El. 8389 ft	18.5	23.1	28.5	39.1	48.7
Great Falls, Mont. Lat. 47°29'N • El. 3664 ft	25.4	27.6	35.6	47.7	57.5
Greensboro, N. C. Lat. 36°05'N • El. 891 ft	42.0	44.2	51.7	60.8	69.9
Griffin, Ga. Lat. 33°15'N • El. 980 ft	48.9	51.0	59.1	66.7	74.6
Hatteras, N. C. Lat. 35°13'N • El. 7 ft	49.9	49.5	54.7	61.5	69.9
Indianapolis, Ind. Lat. 39°44'N • El. 793 ft	31.3	33.9	43.0	54.1	64.9
Inyokern, Calif. Lat. 35°39'N • El. 2440 ft	47.3	53.9	59.1	65.6	73.5
Ithaca, N. Y. Lat. 42°27'N • El. 950 ft	27.2	26.5	36	48.4	59.6
Lake Charles, La. Lat. 30°13'N • El. 12 ft	55.3	58.7	63.5	70.9	77.4

Appendix 4

June	July	August	September	October	November	December
84.0	87.7	88.6	81.3	71.5	58.8	50.8
80.7	87.5	84.9	78.6	68.7	57.3	48.9
83.4	83.8	84.1	82	75.7	67.2	62.4
67.3	76	73.2	61.2	49.2	31.0	18.6
75.7	82.5	79.6	71.4	58.3	42.0	31.4
56.6	62.8	61.5	55.5	45.2	30.3	22.6
64.3	73.8	71.3	60.6	51.4	38.0	29.1
78.0	80.2	78.9	73.9	62.7	51.5	43.2
81.2	83.0	82.2	78.4	68	57.3	49.4
77.2	80.0	79.8	76.7	67.9	59.1	51.3
74.8	79.6	77.4	70.6	59.3	44.2	33.4
80.7	87.5	84.9	78.6	68.7	57.3	48.9
68.9	73.9	71.9	64.2	53.6	41.5	29.6
83.4	84.8	85.0	81.5	73.8	62.6	56.9

The Passive Solar Energy Book

	January	February	March	April	May
Lander, Wyo. Lat. 42°48'N • El. 5370 ft	20.2	26.3	34.7	45.5	56.0
Las Vegas, Nev. Lat. 36°05'N • El. 2162 ft	47.5	53.9	60.3	69.5	78.3
Lemont, Ill. Lat. 41°40'N • El. 595 ft	28.9	30.3	39.5	49.7	59.2
Lexington, Ky. Lat. 38°02'N • El. 979 ft	36.5	38.8	47.4	57.8	67.5
Lincoln, Nebr. Lat. 40°51'N • El. 1189 ft	27.8	32.1	42.4	55.8	65.8
Little Rock, Ark. Lat. 34°44'N • El. 265 ft	44.6	48.5	56.0	65.8	73.1
Los Angeles, Calif. (WBAS) Lat. 33°56'N • El. 99 ft	56.2	56.9	59.2	61.4	64.2
Los Angeles, Calif. (WBO) Lat. 34°03'N • El. 99 ft	57.9	59.2	61.8	64.3	67.6
Madison, Wis. Lat. 43°08'N • El. 866 ft	21.8	24.6	35.3	49.0	61.0
Matanuska, Alaska Lat. 61°30'N • El. 180 ft	13.9	21.0	27.4	38.6	50.3
Medford, Oreg. Lat. 42°23'N • El. 1329 ft	39.4	45.4	50.8	56.3	63.1
Miami, Fla. Lat. 25°47'N • El. 9 ft	71.6	72.0	73.8	77.0	79.9
Midland, Tex. Lat. 31°56'N • El. 2854 ft	47.9	52.8	60.0	68.8	77.2
Nashville, Tenn. Lat. 36°07'N • El. 605 ft	42.6	45.1	52.9	63.0	71.4

Appendix 4

June	July	August	September	October	November	December
65.4	74.6	72.5	61.4	48.3	33.4	23.8
88.2	95.0	92.9	85.4	71.7	57.8	50.2
70.8	75.6	74.3	67.2	57.6	43.0	30.6
76.2	79.8	78.2	72.8	61.2	47.6	38.5
76.0	82.6	80.2	71.5	59.9	43.2	31.8
76.7	85.1	84.6	78.3	67.9	54.7	46.7
66.7	69.6	70.2	69.1	66.1	62.6	58.7
70.7	75.8	76.1	74.2	69.6	65.4	60.2
70.9	76.8	74.4	65.6	53.7	37.8	25.4
57.6	60.1	58.1	50.2	37.7	22.9	13.9
69.4	76.9	76.4	69.6	58.7	47.1	40.5
82.9	84.1	84.5	83.3	80.2	75.6	72.6
83.9	85.7	85.0	78.9	70.3	56.6	49.1
80.1	83.2	81.9	76.6	65.4	52.3	44.3

The Passive Solar Energy Book

	January	February	March	April	May
Newport, R. I. Lat. 41°29'N • El. 60 ft	29.5	32.0	39.6	48.2	58.6
New York, N. Y. Lat. 40°46'N • El. 52 ft	35.0	34.9	43.1	52.3	63.3
Oak Ridge, Tenn. Lat. 36°01'N • El. 905 ft	41.9	44.2	51.7	61.4	69.8
Oklahoma City, Okla. Lat. 35°24'N • El. 1304 ft	40.1	45.0	53.2	63.6	71.2
Ottawa, Ontario Lat. 45°20'N • El. 339 ft	14.6	15.6	27.7	43.3	57.5
Phoenix, Ariz. Lat. 33°26'N • El. 1112 ft	54.2	58.8	64.7	72.2	80.8
Portland, Maine Lat. 43°39'N • El. 63 ft	23.7	24.5	34.4	44.8	55.4
Rapid City, S. Dak. Lat. 44°09'N • El. 3218 ft	24.7	27.4	34.7	48.2	58.3
Riverside, Calif. Lat. 33°57'N • El. 1020 ft	55.3	57.0	60.6	65.0	69.4
St. Cloud, Minn. Lat. 45°35'N • El. 1034 ft	13.6	16.9	29.8	46.2	58.8
Salt Lake City, Utah Lat. 40°46'N • El. 4227 ft	29.4	36.2	44.4	53.9	63.1
San Antonio, Tex. Lat. 29°32'N • El. 794 ft	53.7	58.4	65.0	72.2	79.2
Santa Maria, Calif. Lat. 34°54'N • El. 238 ft	54.1	55.3	57.6	59.5	61.2
Sault Ste. Marie, Mich. Lat. 46°28'N • El. 724 ft	16.3	16.2	25.6	39.5	52.1

Appendix 4

June	July	August	September	October	November	December
67.0	73.2	72.3	66.7	56.2	46.5	34.4
72.2	76.9	75.3	69.5	59.3	48.3	37.7
77.8	80.2	78.8	74.5	62.7	50.4	42.5
80.6	85.5	85.4	77.4	66.5	52.2	43.1
67.5	71.9	69.8	61.5	48.9	35	19.6
89.2	94.6	92.5	87.4	75.8	63.6	56.7
65.1	71.1	69.7	61.9	51.8	40.3	28.0
67.3	76.3	75.0	64.7	52.9	38.7	29.2
74.0	81.0	81.0	78.5	71.0	63.1	57.2
68.5	74.4	71.9	62.5	50.2	32.1	18.3
71.7	81.3	79.0	68.7	57.0	42.5	34.0
85.0	87.4	87.8	82.6	74.7	63.3	56.5
63.5	65.3	65.7	65.9	64.1	60.8	56.1
61.6	67.3	66.0	57.9	46.8	33.4	21.9

The Passive Solar Energy Book

	January	February	March	April	May
Sayville, N. Y. Lat. 40°30'N • El. 20 ft	35	34.9	43.1	52.3	63.3
Schenectady, N. Y. Lat. 42°50'N • El. 217 ft	24.7	24.6	34.9	48.3	61.7
Seabrook, N. J. Lat. 39°30'N • El. 100 ft	39.5	37.6	43.9	54.7	64.9
Seattle, Wash. Lat. 47°27'N • El. 386 ft	42.1	45.0	48.9	54.1	59.8
Seattle, Wash. Lat. 47°36'N • El. 14 ft	38.9	42.9	46.9	51.9	58.1
Spokane, Wash. Lat. 47°40'N • El. 1968 ft	26.5	31.7	40.5	49.2	57.9
State College, Pa. Lat. 40°48'N • El. 1175 ft	31.3	31.4	39.8	51.3	63.4
Stillwater, Okla. Lat. 36°09'N • El. 910 ft	41.2	45.6	53.8	64.2	71.6
Tampa, Fla. Lat. 27°55'N • El. 11 ft	64.2	65.7	68.8	74.3	79.4
Toronto, Ontario Lat. 43°41'N • El. 379 ft	26.5	26.0	34.2	46.3	58
Tucson, Ariz. Lat. 32°07'N • El. 2556 ft	53.7	57.3	62.3	69.7	78.0
Upton, N. Y. Lat. 40°52'N • El. 75 ft	35.0	34.9	43.1	52.3	63.3
Washington, D. C. (WBCO) Lat. 38°51'N • El. 64 ft	38.4	39.6	48.1	57.5	67.7
Winnipeg, Man. Lat. 49°54'N • El. 786 ft	3.2	7.1	21.3	40.9	55.9

Appendix 4

June	July	August	September	October	November	December
72.2	76.9	75.3	69.5	59.3	48.3	37.7
70.8	76.9	73.7	64.6	53.1	40.1	28.0
74.1	79.8	77.7	69.7	61.2	48.5	39.3
64.4	68.4	67.9	63.3	56.3	48.4	44.4
62.8	67.2	66.7	61.6	54.0	45.7	41.5
64.6	73.4	71.7	62.7	51.5	37.4	30.5
71.8	75.8	73.4	66.1	55.6	43.2	32.6
81.1	85.9	85.9	77.5	67.6	52.6	43.0
83.0	84.0	84.4	82.9	77.2	69.6	65.5
68.4	73.8	71.8	64.3	52.6	40.9	30.2
87.0	90.1	87.4	84.0	73.9	62.5	56.1
72.2	76.9	75.3	69.5	59.3	48.3	37.7
76.2	79.9	77.9	72.2	60.9	50.2	40.2
65.3	71.9	69.4	58.6	45.6	25.2	10.1

5 Appendix

Degree-Days

1. Normal Degree-Days by Month for Cities in the United States

(In the tables, A indicates airport weather station; C indicates city office station.)

City	July	August	September	October	November
ALABAMA					
Anniston-A	0	0	17	118	438
Birmingham-A	0	0	13	123	396
Huntsville	0	0	12	127	426
Mobile-C	0	0	0	23	198
Montgomery-C	0	0	0	55	267
ALASKA					
Anchorage	239	291	510	899	1281
Annette Is.	262	217	357	561	729
Barrow	784	825	1032	1485	1929
Barter Is.	735	775	987	1482	1944
Bethel	326	381	591	1029	1440
Cold Bay	474	425	525	772	918
Cordova	363	360	510	750	1017
Fairbanks	149	296	612	1163	1857
Galena	171	311	624	1175	1818
Gambell	642	598	747	1042	1254
Juneau-C	1279	282	426	651	864
King Salmon	313	322	513	908	1290
Kotzebue	384	443	723	1225	1725
McGrath	206	357	630	1159	1785
Nome	477	493	690	1085	1446
Northway	186	350	675	1262	2016
St. Paul Is.-A	592	527	591	803	936

SOURCE: Values in this chart were gathered primarily from *Handbook of Air Conditioning, Heating, and Ventilating*, ed. Clifford Strock and Richard L. Koral (New York: Industrial Press, 1965), 2d edition.

Appendix 5

December	January	February	March	April	May	June	Total
614	614	485	381	128	25	0	2820
598	623	491	378	128	30	0	2780
663	694	557	434	138	19	0	3070
357	412	290	209	40	0	0	1529
458	483	360	265	66	0	0	1954
1587	1612	1299	1246	888	598	339	10789
896	942	809	384	672	496	321	7096
2237	2483	2321	2477	1956	1432	933	19994
2337	2536	2369	2477	1923	1373	924	19862
1792	1804	1565	1659	1146	775	372	12880
1122	1153	1036	1122	951	791	591	9880
1190	1240	1089	1082	858	685	471	9615
2297	2319	1907	1736	1083	546	193	14158
2235	2303	1887	1894	1224	670	226	14538
1655	1854	1767	1845	1425	1135	810	14474
1066	1101	983	949	738	533	315	8187
1606	1600	1333	1411	966	673	408	11343
2130	2220	1952	2065	1536	1097	651	16151
2241	2285	1809	1789	1170	676	283	14390
1776	1841	1660	1752	1320	970	576	14086
2474	2545	2083	1801	1176	626	312	15506
1107	1197	1154	1256	1047	924	705	10839

The Passive Solar Energy Book

City	July	August	September	October	November
Shemya Is.	577	475	501	784	876
Yakutat	381	378	498	722	939

ARIZONA

Flagstaff-A	49	78	243	586	876
Phoenix-C	0	0	0	13	182
Prescott-A	0	0	34	261	582
Tucson-A	0	0	0	24	222
Winslow-A	0	0	20	274	663
Yuma-A	0	0	0	0	105

ARKANSAS

Fort Smith-A	0	0	9	131	435
Little Rock-A	0	0	10	110	405
Texarkana-A	0	0	0	69	317

CALIFORNIA

Bakersfield-A	0	0	0	41	273
Beaumont-C	0	0	18	103	298
Bishop-A	0	0	55	253	564
Blue Canyon-A	36	41	105	369	633
Burbank-A	0	0	11	59	186
Eureka-C	267	248	264	335	411
Fresno-A	0	0	0	86	345
Long Beach	0	0	12	40	156
Los Angeles-A	31	22	56	87	200
Los Angeles-C	0	0	17	41	140
Mount Shasta-C	37	46	165	434	705
Oakland-A	84	77	76	157	336
Point Arguello	202	186	162	205	291
Red Bluff-A	0	0	0	59	319
Sacramento-C	0	0	17	75	321
Sandberg-C	0	0	26	211	465
San Diego-A	11	7	24	52	147
San Francisco-C	189	177	110	128	237
San Jose-C	7	11	26	97	270
Santa Catalina-A	21	11	24	77	168

Appendix 5

December	January	February	March	April	May	June	Total
1042	1045	958	1011	885	837	696	9687
1153	1194	1036	1060	855	673	465	9354
1135	1231	1014	949	687	465	212	7525
360	425	275	175	62	0	0	1492
843	921	717	626	368	164	17	4533
403	474	330	239	84	0	0	1776
946	1001	706	605	335	144	8	4702
259	318	167	88	14	0	0	951
698	775	571	418	127	24	0	3188
654	719	543	401	122	18	0	2982
527	600	441	324	84	0	0	2362
505	561	350	259	105	21	0	2115
487	574	473	437	286	146	18	2840
803	840	664	546	319	140	38	4222
822	893	809	815	597	397	202	5719
324	396	308	265	152	85	22	1808
508	552	465	493	432	375	282	4632
580	629	400	304	145	43	0	2532
288	375	297	267	168	90	18	1711
301	378	305	273	185	121	56	2015
253	328	244	212	129	68	19	1451
939	998	787	722	549	357	174	5913
508	552	400	360	282	212	119	3163
400	474	392	403	339	298	243	3595
564	617	423	336	177	51	0	2546
567	614	403	317	196	85	5	2600
701	781	678	629	435	261	56	4243
255	317	247	223	151	97	43	1574
406	462	336	317	279	248	180	3069
450	487	342	308	229	137	46	2410
311	375	328	344	264	205	121	2249

The Passive Solar Energy Book

City	July	August	September	October	November
Santa Maria-A	98	94	111	157	262

COLORADO

Alamosa-A	64	121	309	648	1065
Colorado Springs-A	8	21	124	422	777
Denver-C	0	5	103	385	711
Grand Junction-A	0	0	36	333	792
Pueblo-A	0	0	74	383	771

CONNECTICUT

Bridgeport-A	0	0	66	334	645
Hartford-A	0	14	101	384	699
New Haven-A	0	18	93	363	663

DELAWARE

Wilmington-A	0	0	47	282	585
--------------	---	---	----	-----	-----

DISTRICT OF COLUMBIA

Silver Hill Obs.	0	0	53	270	549
Washington-A	0	0	37	237	519
Washington-C	0	0	32	231	510

FLORIDA

Apalachicola-C	0	0	0	17	154
Daytona Beach-A	0	0	0	0	83
Fort Myers-A	0	0	0	0	25
Jacksonville-C	0	0	0	11	129
Key West-C	0	0	0	0	0
Lakeland-C	0	0	0	0	60
Melbourne-A	0	0	0	0	44
Miami-C	0	0	0	0	5
Miami Beach	0	0	0	0	0
Orlando-A	0	0	0	0	61
Pensacola-C	0	0	0	18	177
Tallahassee-A	0	0	0	31	209

Appendix 5

December	January	February	March	April	May	June	Total
391	453	370	341	276	229	152	2934
1414	1491	1176	1029	699	440	203	8659
1039	1122	930	874	555	307	75	6254
958	1042	854	797	492	266	60	5673
1132	1271	924	738	402	145	23	5796
1051	1104	865	775	456	203	27	5709
1014	1110	1008	871	561	249	38	5896
1082	1178	1050	871	528	201	31	6139
1026	1113	1005	865	567	261	52	6026
927	983	876	698	396	110	6	4910
865	918	798	632	347	107	0	4539
837	893	781	619	323	87	0	4333
831	884	770	606	314	80	0	4258
304	352	263	184	33	0	0	1307
205	245	187	137	11	0	0	868
101	124	95	60	0	0	0	405
276	303	226	154	14	0	0	1113
18	28	24	7	0	0	0	77
167	185	142	95	0	0	0	649
127	169	121	76	0	0	0	537
48	57	48	15	0	0	0	173
37	43	34	9	0	0	0	123
161	188	148	92	0	0	0	650
334	383	275	203	45	0	0	1435
366	385	287	203	38	0	0	1519

The Passive Solar Energy Book

City	July	August	September	October	November
Tampa-A	0	0	0	0	60
W. Palm Beach-A	0	0	0	0	7

GEORGIA

Albany-A	0	0	0	39	242
Athens-A	0	0	5	100	390
Atlanta-C	0	0	8	107	387
Augusta-A	0	0	0	59	282
Columbus-A	0	0	0	78	326
Macon-A	0	0	0	63	280
Rome-A	0	0	8	140	435
Savannah-A	0	0	0	38	225
Thomasville	0	0	0	25	198
Valdosta-A	0	0	0	32	203

IDAHO

Boise-A	0	0	135	389	762
Idaho Falls 46W	16	34	270	623	1056
Idaho Falls 42NW	16	40	282	648	1107
Lewiston-A	0	0	133	406	747
Pocatello-A	0	0	183	487	873
Salmon	22	55	292	592	996

ILLINOIS

Calro-C	0	0	28	161	492
Chicago-A	0	0	90	350	765
Joliet-A	0	16	114	390	798
Moline-A	0	8	96	363	786
Peoria-A	0	11	86	339	759
Rockford	6	9	114	400	837
Springfield-C	0	0	56	259	666

INDIANA

Evansville-A	0	0	59	215	570
Fort Wayne-A	0	17	107	377	759
Indianapolis-C	0	0	59	247	642

Appendix 5

December	January	February	March	April	May	June	Total
163	201	148	102	0	0	0	674
62	85	61	33	0	0	0	248
427	446	333	236	40	0	0	1763
614	629	515	404	128	15	0	2800
611	632	515	392	135	24	0	2811
494	521	412	308	62	0	0	2138
547	563	437	348	97	0	0	2396
481	497	391	275	62	0	0	2049
673	700	560	436	159	27	0	3138
412	424	330	238	43	0	0	1710
366	394	305	208	33	0	0	1529
366	386	290	210	38	0	0	1525
1054	1169	868	719	453	249	92	5890
1370	1538	1249	1085	651	391	192	8475
1432	1600	1291	1107	657	388	192	8760
961	1060	815	663	408	222	68	5483
1184	1333	1022	880	561	317	136	6976
1380	1513	1103	905	561	334	169	7922
784	856	683	523	182	47	0	3756
1147	1243	1053	868	507	229	58	6310
1190	1277	1084	893	519	233	64	6578
1181	1296	1075	862	453	199	45	6364
1128	1240	1028	828	435	192	41	6087
1221	1333	1137	961	516	236	60	6830
1017	1116	907	713	350	127	14	5225
871	939	770	589	251	90	6	4360
1122	1200	1036	874	516	226	53	6287
986	1051	893	725	375	140	16	5134

The Passive Solar Energy Book

City	July	August	September	October	November
South Bend-A	5	13	101	381	789
Terre Haute-A	0	5	77	295	681

IOWA

Burlington-A	0	0	83	336	765
Charles City-C	17	30	151	444	912
Davenport-C	0	7	79	320	756
Des Moines-C	0	6	89	346	777
Dubuque-A	8	28	149	444	882
Sioux City-A	8	17	128	405	885
Waterloo	12	19	138	428	909

KANSAS

Concordia-C	0	0	55	277	687
Dodge City-A	0	0	40	262	669
Goodland-A	0	0	95	413	825
Topeka-C	0	0	42	242	630
Wichita-A	0	0	32	219	597

KENTUCKY

Bowling Green-A	0	0	47	215	558
Covington	0	0	75	291	669
Lexington-A	0	0	56	259	636
Louisville-C	0	0	41	206	549

LOUISIANA

Alexandria	0	0	0	56	273
Baton Rouge-A	0	0	0	27	215
Burrwood	0	0	0	0	81
Lake Charles-A	0	0	0	22	218
New Orleans-C	0	0	0	5	141
Shreveport-A	0	0	0	53	305

MAINE

Caribou-A	85	133	354	710	1074
-----------	----	-----	-----	-----	------

Appendix 5

December	January	February	March	April	May	June	Total
1153	1252	1081	908	531	248	62	6524
1023	1107	913	725	371	145	24	5366
1150	1271	1036	822	425	179	34	6101
1352	1494	1240	1001	537	256	70	7504
1147	1262	1044	834	432	175	35	6091
1178	1308	1072	849	425	183	41	6274
1290	1414	1187	983	543	267	76	7271
1290	1423	1170	930	474	228	54	7012
1296	1460	1221	1023	531	229	54	7320
1029	1144	899	725	341	146	20	5323
980	1076	840	694	347	135	15	5058
1128	1215	974	884	534	241	58	6367
977	1088	851	669	295	112	13	4919
915	1023	778	619	280	101	7	4571
840	890	739	601	286	98	5	4279
983	1035	893	756	390	149	24	5265
933	1008	854	710	368	140	15	4979
849	911	762	605	270	86	0	4279
431	471	361	260	69	0	0	1921
373	424	293	215	48	0	0	1595
225	303	226	169	29	0	0	1033
353	416	284	210	40	0	0	1543
283	341	223	163	19	0	0	1175
490	550	386	272	61	0	0	2117
1562	1745	1546	1342	909	512	201	10173

The Passive Solar Energy Book

City	July	August	September	October	November
Eastport-C	141	136	261	521	798
Portland-A	15	56	199	515	825

MARYLAND

Baltimore-C	0	0	29	207	489
Frederick-A	0	0	47	276	588

MASSACHUSETTS

Blue Hill Obs	0	22	108	381	690
Boston-A	0	7	77	315	618
Nantucket-A	22	34	111	372	615
Pittsfield-A	25	63	213	543	843

MICHIGAN

Alpena-C	50	85	215	530	864
Detroit-A	0	8	96	381	747
Escanaba-C	62	95	247	555	933
Flint	16	40	159	465	843
Grand Rapids-C	0	20	105	394	756
Lansing-A	13	33	140	455	813
Marquette-C	69	87	236	543	933
Muskegon-A	26	48	152	462	795
Sault Ste. Marie-A	109	126	298	639	1005

MINNESOTA

Duluth-C	66	91	277	614	1092
International Falls-A	70	118	356	716	1230
Minneapolis-A	8	17	157	459	960
Rochester-A	24	38	182	499	975
Saint Cloud-A	32	53	225	570	1068
Saint Paul-A	12	21	154	459	951

MISSISSIPPI

Jackson-A	0	0	0	69	310
Meridian-A	0	0	0	90	338
Vicksburg-C	0	0	0	51	268

Appendix 5

December	January	February	March	April	May	June	Total
1206	1333	1201	1063	774	524	288	8246
1237	1373	1218	1039	693	394	117	7681
812	880	776	611	326	73	0	4203
930	1001	865	673	368	106	0	4854
1085	1178	1053	936	579	267	69	6368
998	1113	1002	849	534	236	42	5791
924	1020	949	880	642	394	139	6102
1246	1358	1212	1060	690	336	105	7694
1218	1358	1263	1156	762	437	135	8073
1101	1203	1072	927	558	251	60	6404
1321	1473	1327	1203	804	471	166	8657
1212	1330	1198	1066	639	319	90	7377
1107	1215	1086	939	546	248	58	6474
1175	1277	1142	986	591	287	70	6982
1299	1435	1291	1181	789	477	189	8529
1110	1243	1134	1011	642	350	116	7089
1398	1587	1442	1302	846	499	224	9475
1550	1696	1448	1252	801	487	200	9574
1733	1922	1618	1395	834	437	171	10600
1414	1562	1310	1057	570	259	80	7853
1426	1572	1316	1073	600	298	92	8095
1535	1690	1439	1181	663	331	106	8893
1401	1553	1305	1051	564	256	77	7804
503	535	405	299	81	0	0	2202
528	561	413	309	85	9	0	2333
456	507	374	273	71	0	0	2000

The Passive Solar Energy Book

City	July	August	September	October	November
MISSOURI					
Columbia-A	0	6	62	262	654
Kansas City-A	0	0	44	240	621
Saint Joseph-A	0	5	49	265	681
Saint Louis-C	0	0	38	202	570
Springfield-A	0	8	61	249	615
MONTANA					
Billings-A	8	20	194	497	876
Butte-A	115	174	450	744	1104
Glasgow-C	14	30	244	574	1086
Great Falls-A	24	50	273	524	894
Havre-C	20	38	270	564	1023
Helena-C	51	78	359	598	969
Kalispell-A	47	83	326	639	990
Miles City-A	6	11	187	525	966
Missoula-A	22	57	292	623	993
NEBRASKA					
Grand Island-A	0	6	84	369	822
Lincoln-C	0	7	79	310	741
Norfolk-A	0	17	122	422	903
North Platte-A	7	11	120	425	846
Omaha-A	0	5	88	331	783
Scottsbluff-A	0	0	137	456	867
Valentine-C	11	10	145	461	891
NEVADA					
Elko-A	6	28	229	546	915
Ely-A	22	44	228	561	894
Las Vegas-C	0	0	0	61	344
Reno-A	27	61	165	443	744
Tonopah	0	5	96	422	723
Winnemucca-A	0	17	180	508	822

Appendix 5

December	January	February	March	April	May	June	Total
989	1091	876	698	326	135	14	5113
970	1085	851	666	292	111	8	4888
1048	1175	930	716	326	127	14	5336
893	983	792	620	270	94	7	4469
908	1001	790	632	295	118	16	4693
1172	1305	1089	958	564	304	119	7106
1442	1575	1294	1172	804	561	325	9760
1510	1683	1408	1119	597	312	113	8690
1194	1311	1131	1008	621	359	166	7555
1383	1513	1291	1076	597	313	125	8213
1215	1438	1114	992	660	427	225	8126
1249	1386	1120	970	639	391	215	8055
1373	1516	1229	1048	570	285	106	7822
1283	1414	1100	939	609	365	176	7873
1178	1302	1044	849	423	195	39	6311
1113	1240	1000	794	377	172	32	5865
1280	1417	1159	933	501	251	60	7065
1172	1271	1016	887	489	243	59	6546
1166	1302	1058	831	389	175	32	6160
1178	1287	1030	933	567	305	81	6841
1212	1361	1100	970	543	288	83	7075
1181	1336	1025	896	612	378	183	7335
1181	1302	1033	921	639	418	200	7443
564	653	423	288	92	0	0	2425
986	1048	804	756	519	318	165	6036
995	1082	860	763	504	272	91	5813
1085	1153	854	794	546	299	111	6369

The Passive Solar Energy Book

City	July	August	September	October	November
NEW HAMPSHIRE					
Concord-A	11	57	192	527	849
Mt. Wash. Obs.	493	536	720	1057	1341
NEW JERSEY					
Atlantic City-C	0	0	29	230	507
Newark-A	0	0	47	301	603
Trenton-C	0	0	55	285	582
NEW MEXICO					
Albuquerque-A	0	0	10	218	630
Clayton-A	0	0	68	318	678
Raton-A	17	36	148	431	798
Roswell-A	0	0	8	156	501
NEW YORK					
Albany-C	0	6	98	388	708
Bear Mountain-C	0	25	119	409	753
Binghamton-A	16	63	192	518	834
Binghamton-C	0	36	141	428	735
Buffalo-A	16	30	122	433	753
New York-JFK Int'l-A	0	0	36	248	564
New York-C	0	0	39	263	561
Oswego-C	20	39	139	430	738
Rochester-A	9	34	133	440	759
Schenectady-C	0	19	137	456	792
Syracuse-A	0	29	117	396	714
NORTH CAROLINA					
Asheville-C	0	0	50	262	552
Charlotte-A	0	0	7	147	438
Greensboro-A	0	0	29	202	510
Hatteras-C	0	0	0	63	244
Raleigh-C	0	0	10	118	387
Wilmington-A	0	0	0	73	288
Winston-Salem-A	0	0	28	182	492

Appendix 5

December	January	February	March	April	May	June	Total
1271	1392	1226	1029	660	316	82	7612
1742	1820	1663	1652	1260	930	603	13817
831	905	829	729	468	189	24	4741
961	1039	932	760	450	148	11	5252
930	1004	904	735	429	133	11	5068
899	970	714	589	289	70	0	4389
927	995	795	729	420	184	24	5138
1104	1203	924	834	543	292	87	6417
750	787	566	443	185	28	0	3424
1113	1234	1103	905	531	202	31	6319
1110	1212	1098	921	561	244	59	6511
1228	1342	1215	1051	672	318	88	7537
1113	1218	1100	927	570	240	48	6556
1116	1225	1128	992	636	315	72	6838
933	1029	935	815	480	167	12	5219
908	995	904	753	456	153	18	5050
1132	1249	1134	995	654	355	90	6975
1141	1249	1148	992	615	289	54	6863
1212	1349	1207	1008	597	233	40	7050
1113	1225	1117	955	570	247	37	6520
769	794	678	572	285	105	5	4072
682	704	577	449	172	29	0	3205
772	806	672	528	241	50	0	3810
481	527	487	394	171	25	0	2392
651	691	577	440	172	29	0	3075
508	533	463	347	104	7	0	2323
756	797	666	519	232	49	0	3721

The Passive Solar Energy Book

City	July	August	September	October	November
NORTH DAKOTA					
Bismarck-A	29	37	227	598	1098
Devils Lake-C	47	61	276	654	1197
Fargo-A	25	41	215	586	1122
Williston-C	29	42	261	605	1101
OHIO					
Akron-Canton-A	0	17	83	378	738
Cincinnati-C	0	0	42	222	567
Cleveland-C	0	9	60	311	636
Columbus-C	0	0	59	299	654
Dayton-A	0	5	74	324	693
Mansfield	9	22	114	397	768
Sandusky-C	0	0	66	327	684
Toledo-A	0	12	102	387	756
Youngstown-A	0	19	83	355	732
OKLAHOMA					
Oklahoma City-C	0	0	12	149	459
Tulsa-A	0	0	18	452	462
OREGON					
Astoria-A	138	111	146	338	537
Baker-C	25	47	255	518	852
Burns-C	10	37	219	552	855
Eugene-A	33	34	144	381	591
Meacham-A	88	102	294	605	903
Medford-A	0	0	77	326	624
Pendleton-A	0	0	104	353	717
Portland-C	13	14	85	280	534
Roseburg-C	14	10	98	288	531
Salem-A	21	23	113	326	588
Sexton Summit	88	69	169	456	714
Troutdale-A	33	31	131	335	591

Appendix 5

December	January	February	March	April	May	June	Total
1535	1730	1464	1187	657	355	116	9033
1668	1866	1576	1314	750	394	137	9940
1615	1795	1518	1231	687	338	101	9274
1528	1705	1442	1194	663	360	138	9068
1082	1166	1033	884	537	235	50	6203
880	942	812	645	314	108	0	4532
995	1101	977	846	510	223	49	5717
983	1051	907	741	408	153	22	5277
1032	1094	941	781	435	179	39	5597
1110	1169	1042	924	543	245	60	6403
1039	1122	997	853	513	217	41	5859
1119	1197	1056	905	555	245	60	6394
1085	1163	1030	877	534	241	53	6172
747	843	630	472	169	38	0	3519
750	856	644	485	173	44	0	3584
691	772	613	611	459	357	222	4995
1138	1268	972	837	591	384	200	7087
1156	1274	946	809	552	349	159	6918
756	831	624	567	423	270	125	4779
1113	1243	1008	961	717	527	327	7888
822	862	627	552	381	207	69	4547
921	1066	795	614	386	197	51	5204
701	791	594	515	347	199	70	4143
694	744	563	508	366	223	83	4122
744	825	622	564	408	249	91	4574
877	905	801	797	621	450	270	6217
766	874	664	574	405	256	115	4775

The Passive Solar Energy Book

City	July	August	September	October	November
PENNSYLVANIA					
Allentown-A	0	9	89	366	690
Erie-C	0	17	76	352	672
Harrisburg-A	0	0	69	308	630
Park Place-C	14	57	173	484	807
Philadelphia-C	0	0	33	219	516
Pittsburgh-C	0	0	56	298	612
Reading-C	0	5	57	285	588
Scranton-C	0	18	115	389	693
Williamsport-A	0	16	101	377	699
RHODE ISLAND					
Block Island-A	6	21	88	330	591
Providence-A	0	26	107	381	672
Providence-C	0	7	68	330	624
SOUTH CAROLINA					
Charleston-C	0	0	0	34	214
Columbia-C	0	0	0	76	308
Florence-A	0	0	0	94	347
Greenville-A	0	0	10	131	411
Spartanburg-A	0	0	7	136	414
SOUTH DAKOTA					
Huron-A	10	16	149	472	975
Rapid City-A	32	24	193	500	891
Sioux Falls-A	16	21	155	472	984
TENNESSEE					
Bristol-A	0	0	58	239	576
Chattanooga-A	0	0	24	169	477
Knoxville-A	0	0	33	179	498
Memphis-C	0	0	13	98	392
Nashville-A	0	0	22	154	471
Oak Ridge	0	0	39	192	531

Appendix 5

December	January	February	March	April	May	June	Total
1051	1132	1019	840	495	164	25	5880
1020	1128	1039	911	573	273	55	6116
964	1051	921	750	423	128	14	5258
1200	1277	1142	998	648	290	85	7175
856	933	837	667	369	93	0	4523
924	992	879	735	402	137	13	5048
936	1017	902	725	411	123	11	5060
1057	1141	1028	859	516	196	35	6047
1057	1132	1005	828	477	181	25	5898
927	1026	955	865	603	335	96	5843
1035	1125	1019	874	570	258	58	6125
986	1076	972	809	507	197	31	5607
410	445	363	260	43	0	0	1769
524	538	443	318	77	0	0	2284
574	588	487	334	83	0	0	2507
648	673	552	442	161	32	0	3060
654	670	549	436	152	26	0	3044
1407	1597	1327	1032	558	279	80	7902
1218	1361	1151	1045	615	357	148	7535
1414	1575	1274	1023	558	276	80	7848
815	818	697	576	274	95	0	4148
710	725	588	467	179	45	0	3384
744	760	630	500	196	50	0	3590
639	716	574	423	131	20	0	3006
725	778	636	498	186	43	0	3513
772	778	669	552	228	56	0	3817

The Passive Solar Energy Book

City	July	August	September	October	November
TEXAS					
Abilene-A	0	0	5	98	350
Amarillo-A	0	0	37	240	594
Austin-A	0	0	0	30	214
Big Springs-A	0	0	0	75	316
Brownsville-A	0	0	0	0	59
Corpus Christi-A	0	0	0	0	113
Dallas-A	0	0	0	53	299
Del Rio-A	0	0	0	26	188
El Paso-A	0	0	0	70	390
Fort Worth-A	0	0	0	58	299
Galveston-C	0	0	0	0	131
Houston-C	0	0	0	0	162
Laredo-A	0	0	0	0	91
Lubbock-A	0	0	23	173	492
Midland	0	0	0	87	381
Palestine-C	0	0	0	45	260
Port Arthur-C	0	0	0	8	170
San Angelo-A	0	0	0	72	280
San Antonio-A	0	0	0	25	201
Victoria-A	0	0	0	0	131
Waco-A	0	0	0	44	251
Wichita Falls-A	0	0	5	115	404
UTAH					
Blanding	0	0	100	409	792
Milford-A	0	0	114	462	828
Salt Lake City-C	0	0	61	330	714
VERMONT					
Burlington-A	19	47	172	521	858
VIRGINIA					
Cape Henry-C	0	0	0	120	366
Lynchburg-A	0	0	49	236	531
Norfolk-C	0	0	5	118	354
Richmond-C	0	0	31	181	456

Appendix 5

December	January	February	March	April	May	June	Total
595	673	479	344	113	0	0	2657
859	921	711	586	298	99	0	4345
402	484	322	211	50	0	0	1713
577	639	454	314	105	0	0	2480
159	219	106	74	0	0	0	617
252	330	192	118	6	0	0	1011
518	607	432	288	75	0	0	2272
371	419	235	147	21	0	0	1407
626	670	445	330	110	0	0	2641
533	622	446	308	90	5	0	2361
271	356	247	176	30	0	0	1211
303	378	240	166	27	0	0	1276
215	270	134	71	0	0	0	781
756	812	613	481	201	36	0	3587
592	651	468	322	90	0	0	2591
440	531	368	265	71	0	0	1980
315	381	258	181	27	0	0	1340
502	556	378	257	62	0	0	2107
374	462	293	190	34	0	0	1579
277	352	209	141	14	0	0	1126
459	557	385	263	66	0	0	2025
657	756	538	394	140	16	0	3025
1079	1190	913	800	510	272	73	6138
1147	1277	955	800	516	269	77	6445
995	1119	857	701	414	208	64	5463
1308	1460	1313	1107	681	307	72	7865
648	698	636	512	267	60	0	3307
808	846	722	584	289	82	5	4153
636	679	602	464	220	41	0	3119
750	787	675	529	254	57	0	3720

The Passive Solar Energy Book

City	July	August	September	October	November
Roanoke-A	0	0	50	233	543
WASHINGTON					
Ellensburg-A	13	17	176	496	849
Kelso-A	85	84	186	409	636
Northhead	239	205	234	341	486
Olympia-A	91	83	207	434	645
Omak	0	46	194	533	921
Port Angeles-A	233	226	303	459	603
Seattle-C	49	45	134	329	540
Spokane-A	17	28	205	508	879
Stampede Pass	251	260	414	701	1002
Tacoma-C	66	62	177	375	579
Tattosh Island-C	295	288	315	406	528
Walla Walla-C	0	0	93	308	675
Yakima-A	0	7	150	446	807
WEST VIRGINIA					
Charleston-A	0	0	60	250	576
Elkins-A	9	31	122	412	726
Huntington-C	0	0	35	210	549
Parkersburg-C	0	0	56	272	600
Petersburg-C	0	5	72	308	654
WISCONSIN					
Green Bay-A	32	58	183	515	945
LaCrosse-A	11	20	152	447	921
Madison-C	10	30	137	419	864
Milwaukee-C	11	24	112	397	795
WYOMING					
Casper-A	13	24	231	577	951
Cheyenne-A	33	39	241	577	897
Lander-A	7	23	244	632	1050
Rock Springs-A	20	32	266	648	1038
Sheridan-A	27	41	239	578	957

Appendix 5

December	January	February	March	April	May	June	Total
806	840	722	588	289	81	0	4152
1116	1268	949	753	504	296	105	6542
784	856	652	605	453	316	173	5239
636	784	585	598	492	406	285	5211
794	868	700	660	498	338	183	5501
1212	1352	1061	781	453	222	59	6834
719	772	652	645	519	422	297	5850
679	753	602	558	396	246	107	4438
1113	1243	988	834	561	330	146	6852
1203	1280	1064	1063	837	636	438	9149
719	797	636	595	435	282	143	4866
648	713	610	629	525	437	330	5724
890	1023	748	564	338	171	38	4848
1066	1181	862	660	408	205	53	5845

834	887	750	632	310	110	8	4417
995	1017	910	797	477	224	53	5773
803	837	728	570	251	85	5	4073
896	949	826	672	347	119	13	4750
942	967	820	667	384	133	14	4966

1392	1516	1336	1132	696	347	107	8259
1380	1528	1280	1035	552	250	74	7650
1287	1417	1207	1011	573	266	79	7300
1184	1302	1117	961	606	335	100	6944

1225	1324	1095	1011	660	381	146	7638
1125	1225	1044	1029	717	462	173	7562
1383	1494	1179	1045	687	396	163	8303
1349	1457	1182	1110	735	443	193	8473
1271	1392	1170	1035	645	387	161	7903

The Passive Solar Energy Book

2. Normal Degree-Days by Month for Cities in Canada

City	July	August	September	October	November
ALBERTA					
Calgary	110	170	410	710	1110
Edmonton	90	180	440	750	1220
Grande Prairie	150	220	450	800	1300
Lethbridge	60	100	350	620	1030
McMurray	120	220	520	880	1500
Medicine Hat	20	50	300	600	1070
BRITISH COLUMBIA					
Atlin	350	360	560	870	1240
Bull Harbour	270	260	340	490	630
Crescent Valley	90	120	330	680	990
Estevan Point	270	240	310	460	580
Fort Nelson	120	220	460	920	1680
Kamloops	10	30	200	540	890
Penticton	20	20	200	520	820
Prince George	200	260	460	750	1110
Prince George City	170	220	430	740	1100
Prince Rupert	270	240	340	510	680
Vancouver	70	70	220	440	650
Vancouver City	70	70	200	430	650
Victoria (Pat. Bay)	130	130	260	470	660
Victoria City	160	150	230	410	600
MANITOBA					
Brandon	60	100	350	730	1290
Churchill	360	390	710	1110	1660
Dauphin	50	90	320	670	1250
The Pas	80	160	440	840	1480
Winnipeg	37	75	311	686	1255
NEW BRUNSWICK					
Bathurst	40	90	310	650	1010
Chatham	40	80	270	640	970
Fredericton	50	70	250	600	940

SOURCE: Reprinted with permission from *Handbook of Air Conditioning, Heating, and Ventilating*.

Appendix 5

December	January	February	March	April	May	June	Total
1430	1530	1350	1200	770	460	270	9520
1660	1780	1520	1290	760	410	220	10320
1750	1820	1600	1380	830	460	250	11010
1330	1450	1290	1120	690	400	210	8650
2070	2210	1820	1540	920	500	270	12570
1440	1590	1380	1130	620	320	130	8650

1590	1790	1540	1370	960	670	410	11710
770	820	710	690	580	470	340	6370
1220	1360	1080	940	610	400	220	8040
710	760	670	700	580	470	340	6090
2190	2200	1870	1460	890	460	220	12690
1170	1320	1050	780	450	210	80	6730
1050	1190	960	780	490	260	100	6410
1440	1570	1320	1110	740	480	280	9720
1450	1540	1290	1070	730	470	250	9460
860	910	810	790	650	500	350	6910
810	890	740	680	480	320	150	5520
810	880	720	650	470	300	140	5390
790	870	720	690	520	370	220	5830
730	800	660	620	470	350	230	5410

1810	2010	1730	1440	820	420	170	10930
2240	2590	2320	2150	1580	1130	670	16910
1740	1940	1670	1430	830	420	150	10560
1980	2200	1850	1620	1010	550	250	12460
1778	1993	1714	1441	810	411	147	10658

1480	1690	1520	1300	880	520	180	9670
1450	1620	1450	1250	850	490	180	9290
1410	1570	1410	1180	780	420	150	8830

The Passive Solar Energy Book

City	July	August	September	October	November
Grand Falls	100	120	330	660	1000
Moncton	50	80	260	590	910
Saint John	80	100	280	590	880
Saint John City	110	110	250	530	830

NEWFOUNDLAND

Cape Race	350	260	350	600	800
Corner Brook	90	140	320	640	890
Gander	130	160	320	660	920
Goose Bay	130	220	440	840	1220
St. John's (Torbay)	190	170	320	610	820

NORTHWEST TERRITORIES

Aklavik	280	460	800	1400	2040
Fort Norman	170	350	700	1220	1940
Frobisher	600	650	880	1280	1580
Resolute	780	860	1240	1810	2220
Yellowknife	160	250	580	1060	1740

NOVA SCOTIA

Halifax (Dartmouth)	80	90	230	510	790
Halifax City	55	58	190	469	745
Sydney	60	80	220	510	780
Yarmouth	110	120	230	480	720

ONTARIO

Fort William	90	140	370	740	1170
Hamilton	20	30	140	470	800
Kapuskasing	110	180	420	790	1280
Kenora	40	80	320	710	1270
Kingston City	30	40	160	500	820
Kitchener City	30	40	170	520	860
London	20	40	150	490	840
North Bay	70	120	320	670	1080
North Bay City	40	90	270	620	1000
Ottawa (Uplands)	30	60	200	580	970
Peterborough City	30	40	180	540	890
Sault Ste. Marie	120	160	340	650	1010

Appendix 5

December	January	February	March	April	May	June	Total
1540	1750	1570	1340	870	480	190	9950
1340	1520	1380	1190	830	480	200	8830
1300	1440	1310	1160	830	510	260	8740
1250	1400	1270	1100	780	500	250	8380
1080	1240	1170	1150	950	780	560	9290
1200	1410	1360	1240	900	640	350	9180
1230	1430	1320	1270	970	650	380	9440
1740	2020	1710	1530	1101	770	410	12140
1130	1270	1180	1170	920	700	460	8940
2530	2580	2310	2290	1690	1050	480	17910
2460	2550	2190	2040	1390	730	280	16020
2120	2560	2280	2230	1690	1250	800	17920
2660	2890	2730	2720	2170	1550	970	22600
2420	2570	2270	2020	1410	790	370	15640
1160	1280	1220	1090	800	530	250	8030
1109	1262	1180	1042	765	484	226	7585
1130	1310	1280	1160	850	570	270	8220
1040	1180	1100	1010	750	510	270	7520
1680	1830	1580	1380	890	540	230	10640
1150	1260	1190	1020	670	330	70	7150
1770	2030	1750	1550	1030	600	240	11750
1800	1980	1670	1420	860	430	160	10740
1250	1420	1290	1110	710	380	100	7810
1240	1350	1240	1080	680	330	80	7620
1200	1320	1210	1040	650	330	90	7380
1550	1710	1530	1350	840	470	170	9880
1510	1690	1490	1280	810	420	120	9340
1460	1640	1450	1220	730	330	70	8740
1320	1470	1330	1130	690	330	90	8040
1410	1590	1500	1310	820	470	210	9590

The Passive Solar Energy Book

City	July	August	September	October	November
Sioux Lookout	70	120	390	780	1310
Southampton	70	90	190	500	830
Sudbury	60	140	310	680	1100
Timmins	110	170	410	780	1270
Toronto (Malton)	30	40	180	540	840
Toronto City	8	29	154	465	777
Trenton	20	30	160	470	840
White River	160	230	440	820	1270
Windsor	10	10	120	410	780

PRINCE EDWARD ISLAND

Charlottetown	60	70	240	550	850
---------------	----	----	-----	-----	-----

QUEBEC

Bagotville	80	120	370	740	1160
Fort Chimo	380	450	700	1040	1440
Fort George	350	380	550	890	1270
Knob Lake	300	410	670	1080	1500
Megantic	80	140	330	660	1000
Mont Joli	70	120	310	660	1030
Montreal (Dorval)	10	40	190	550	910
Montreal City	10	40	180	530	890
Nitchequon	270	320	590	970	1430
Port Harrison	560	570	730	1050	1430
Quebec (An. Lorette)	40	90	290	650	1030
Quebec City	20	70	250	610	990
Sherbrooke City	20	70	240	590	920
Three Rivers City	20	60	250	610	980

SASKATCHEWAN

North Battleford	60	110	380	750	1350
Prince Albert	70	140	410	780	1350
Regina	70	110	370	750	1290
Saskatoon	60	110	380	760	1320

YUKON TERRITORY

Dawson	170	320	660	1170	1890
Whitehorse	280	350	570	940	1510

Appendix 5

December	January	February	March	April	May	June	Total
1850	2060	1750	1510	950	520	220	11530
1200	1350	1270	1140	760	450	170	8020
1500	1720	1450	1340	870	510	190	9870
1740	1990	1680	1530	1010	550	240	11480
1220	1360	1260	1090	700	370	100	7730
1126	1249	1147	1018	646	316	73	7008
1280	1400	1280	1080	670	330	70	7630
1770	1990	1740	1550	1010	590	280	11850
1130	1220	1100	950	580	270	70	6650

1210	1460	1370	1220	870	560	250	8710
------	------	------	------	-----	-----	-----	------

1730	1950	1710	1450	940	570	220	11040
2010	2410	2170	1920	1460	1010	610	15600
1880	2340	2090	1950	1330	920	530	14480
2010	2410	2040	1810	1300	910	450	14890
1480	1640	1490	1290	870	500	190	9670
1440	1650	1470	1310	910	550	230	9750
1390	1590	1430	1180	730	270	60	8350
1370	1540	1370	1150	700	300	50	8130
2050	2340	2010	1820	1310	910	490	14510
2050	2470	2290	2190	1610	1140	790	16880
1530	1690	1510	1300	850	430	130	9540
1470	1640	1460	1250	810	400	100	9070
1400	1560	1410	1190	750	370	90	8610
1490	1690	1490	1250	770	370	80	9060

1820	1990	1710	1440	800	400	190	11000
1870	2060	1750	1500	850	440	210	11430
1740	1940	1680	1420	790	420	190	10770
1790	1790	1710	1440	800	420	180	10960

2410	2510	2160	1830	1100	570	250	15040
1900	1850	1640	1350	1000	600	310	12300

6 APPENDIX

Clear-Day Solar Heat Gain through Vertical Double Glazing at Various Orientations (in Btu/sq ft)

(The heat gains listed in the following tables account only for the reflection losses from the surface of the glass. To account for absorption losses, reduce the values listed by 6%.)

28° North Latitude

	N	NE, NW	E, W	SE, SW	S	HORIZ
January	168	192	634	1172	1558	1454
February	206	310	816	1191	1350	1832
March	248	464	923	1074	912	2184
April	306	658	989	893	492	2428
May	402	809	1023	758	368	2576
June	464	861	1019	695	360	2610
July	416	808	1006	741	372	2494
August	324	656	961	862	482	2386
September	260	456	883	1029	884	2110
October	214	311	788	1143	1296	1796
November	170	194	625	1151	1526	1444
December	152	162	564	1151	1586	1306

32° North Latitude

	N	NE, NW	E, W	SE, SW	S	HORIZ
January	152	166	574	1146	1560	1288
February	192	278	772	1200	1424	1688
March	240	433	904	1116	1034	2084
April	302	636	997	955	600	2390
May	396	789	1040	823	422	2582
June	450	841	1038	758	390	2634
July	408	789	1024	803	420	2558
August	320	636	968	920	582	2352
September	250	426	864	1067	1000	2014
October	200	280	746	1151	1364	1654
November	154	168	567	1125	1528	1280
December	136	144	518	1128	1574	1136

SOURCE: Taken from computer studies by M. Steven Baker, University of Oregon, Eugene, Oregon, 1977.

36° North Latitude

	N	NE, NW	E, W	SE, SW	S	HORIZ
January	136	147	528	1123	1550	1120
February	178	247	722	1197	1474	1534
March	230	404	882	1153	1146	1974
April	298	615	1002	1016	720	2338
May	390	769	1054	888	500	2574
June	442	822	1056	823	446	2644
July	402	768	1037	867	492	2552
August	318	616	973	978	694	2304
September	242	399	842	1100	1102	1906
October	186	250	697	1147	1410	1506
November	140	150	522	1101	1516	1114
December	120	125	463	1083	1526	960

40° North Latitude

	N	NE, NW	E, W	SE, SW	S	HORIZ
	120	128	474	1079	1506	948
	164	215	666	1180	1502	1374
	220	376	858	1183	1244	1852
	294	593	1002	1075	838	2274
	384	747	1063	952	598	2552
	446	816	1083	894	528	2648
	398	749	1048	931	586	2534
	312	595	975	1034	806	2244
	230	370	816	1126	1190	1796
	170	218	642	1129	1436	1348
	122	130	466	1056	1472	942
	102	105	393	1007	1434	782

The Passive Solar Energy Book

44° North Latitude

	N	NE, NW	E, W	SE, SW	S	HORIZ
January	102	107	405	1004	1420	772
February	148	183	603	1148	1506	1208
March	208	347	829	1206	1324	1720
April	288	572	1000	1128	954	2196
May	386	738	1081	1021	710	2522
June	458	819	1116	968	628	2642
July	400	741	1067	999	694	2508
August	308	575	972	1085	916	2172
September	218	343	787	1144	1262	1660
October	154	187	582	1098	1438	1186
November	104	109	399	983	1388	768
December	82	83	307	895	1292	608

48° North Latitude

	N	NE, NW	E, W	SE, SW	S	HORIZ
	82	84	320	894	1284	598
	130	153	540	1106	1486	1040
	194	318	795	1218	1386	1578
	280	551	994	1177	1060	2106
	394	736	1105	1091	828	2482
	468	820	1144	1042	740	2626
	408	741	1092	1068	806	2474
	300	553	965	1131	1018	2088
	206	315	753	1151	1318	1522
	138	159	523	1056	1414	1022
	86	87	317	875	1252	596
	66	66	237	777	1130	446

Appendix 6

52° North Latitude

	N	NE, NW	E, W	SE, SW	S	HORIZ
January	64	64	240	767	1112	434
February	114	131	485	1057	1442	870
March	180	290	757	1220	1430	1428
April	270	528	984	1219	1156	2006
May	400	736	1127	1159	942	2434
June	472	817	1167	1113	856	2596
July	416	741	1114	1134	920	2430
August	290	532	956	1171	1108	1990
September	190	286	714	1148	1352	1374
October	120	136	466	1005	1368	856
November	66	66	237	749	1084	434
December	46	46	166	631	918	294


56° North Latitude

	N	NE, NW	E, W	SE, SW	S	HORIZ
	46	46	170	620	900	282
	96	109	420	982	1358	700
	166	261	714	1207	1452	1268
	260	506	970	1254	1240	1892
	406	735	1144	1221	1052	2374
	494	830	1199	1183	972	2562
	420	739	1130	1195	1026	2372
	280	511	943	1204	1188	1884
	176	258	670	1130	1364	1220
	102	113	403	930	1282	688
	48	48	168	603	876	284
	24	24	86	428	622	156

7

Appendix

Percentage of Enhancement of Solar Heat Gain with Specular Reflectors for Vertical South-Facing Glazing (reflectance 0.8)

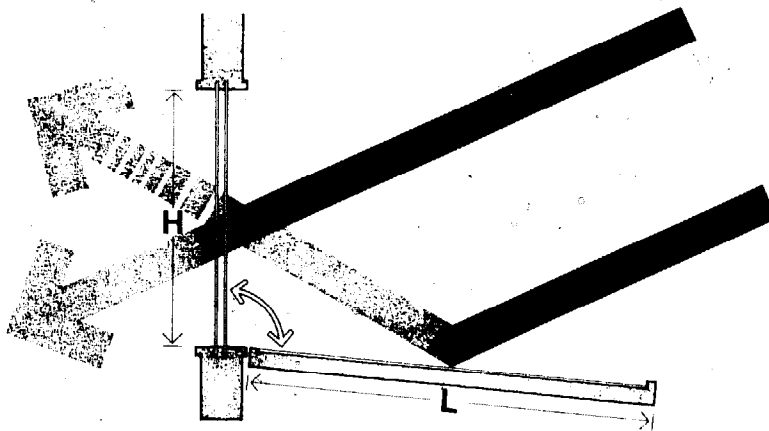

$$\frac{\text{reflector length (l)}}{\text{glazing height (h)}} = 1.0$$

Latitude	28°		32°		36°		40°		44°		48°		52°		56°	
	90°	95°	90°	95°	90°	95°	90°	95°	95°	100°	95°	100°	100°	105°	100°	105°
January	48	49	42	46	37	42	31	37	32	37	28	33	29	33	25	30
February	62	48	58	50	51	50	45	48	43	43	38	41	37	38	33	36
March	68	37	68	42	67	46	66	49	51	34	53	38	41	26	44	30
April	74	12	74	21	73	29	72	36	42	14	46	21	27	8	32	13
May	76	0	76	2	75	9	75	17	26	2	33	6	11	0	18	2
June	78	0	77	0	76	2	76	8	17	0	25	1	5	0	11	0
July	77	0	76	0	76	5	75	12	21	0	29	3	8	0	14	1
August	75	5	75	13	74	21	73	29	36	8	42	14	21	4	27	8
September	71	30	70	37	70	42	69	46	49	28	52	33	38	20	41	25
October	64	46	63	48	59	50	51	51	48	41	43	43	41	35	37	38
November	52	49	45	48	40	44	34	39	34	39	30	35	31	35	27	32
December	44	48	39	43	33	38	28	34	29	34	25	31	27	32	23	28

SOURCE: Taken from computer studies by M. Steven Baker; University of Oregon, Eugene, Oregon, 1977.

8

Appendix

Conversion Tables

1. Conversion Factors

To Convert From	To	Multiply By
Btu	Gram calories	251.9958
Btu	Kilogram calories	.00397
Btu	Cubic centimeters atmospheres	10405.6
Btu	Cubic foot atmospheres	.36747
Btu	Foot pounds	777.649
Btu	Horsepower hours	.0003927
Btu	Kilowatt hours	.00029287
Btu/square foot	Langleys	.271
Btu/hour/square foot/°F	Watts/CM ² /°C	5.6820 × 10 ⁴
Cubic foot atmospheres	Btu	2.721
Cubic feet of water	Gallons	7.4805
Cubic feet of water	Pounds	62.366
Foot pounds	Btu	.001285
Gallons of water	Cubic feet	0.13368
Gallons of water	Pounds	8.3453
Gram calories	Btu	.00397
Horsepower	Foot pounds/hour	1,980,000.
Horsepower	Foot pounds/minute	33,000.
Horsepower	Foot pounds/second	550.
Horsepower	Kilowatts	.7457
Horsepower	Watts	745.7
Horsepower hours	Btu	2546.14

Appendix 8

To Convert From	To	Multiply By
Horsepower years	Btu	22,304,186.4
Kilogram calories	Btu	3.97
Kilowatts	Horsepower	1.34102
Kilowatt hours	Btu	3414.43
Langleys	Btu/square foot	3.69
Lumens (at 5,550 Å)	Watts	0.0014706
Months (mean calendar)	Hours	730.1
Pints (U.S., liq)	Cubic centimeters	473.18
Pints	Cubic inches	28.875
Pounds of water	Cubic feet of water	0.01602
Pounds of water	Gallons (U.S., liq)	0.1198
Watts	Btu/hour	3.4144
Watts	Btu/minute	0.05691
Watts	Calories/minute	14.34
Watts	Horsepower	0.001341
Watts/square centimeter	Btu/square feet/hour	3,172.
Watt-hours	Btu	3.4144
Watt-hours	Calories	860.4
Watt-hours	Horsepower hours	0.001341

2. Fahrenheit-Centigrade Conversion Table

The numbers in the center column, in boldface type, refer to the temperature in either Fahrenheit or Centigrade degrees. If it is desired to convert from Fahrenheit to Centigrade degrees, consider the center column as a table of Fahrenheit temperatures and read the corresponding Centigrade temperature in the column at the left. If it is desired to convert from Centigrade to Fahrenheit degrees, consider the center column as a table of Centigrade values, and read the corresponding Fahrenheit temperature on the right.

SOURCE: Clifford Strock and Richard L. Koral, eds., *Handbook of Air Conditioning, Heating, and Ventilating*, 2d ed. (New York: Industrial Press, 1965).

For conversions not covered in the table, the following formulas are used:

$$F = 1.8 C + 32$$

$$C = (F - 32) \div 1.8$$

Deg C	Deg F	Deg C	Deg F
-46	-50	-58	8.9
-40	-40	-40	9.4
-34	-30	-22	10.0
-29	-20	-4	10.6
-23	-10	14	11.1
-17.8	0	32	11.7
-17.2	1	33.8	12.2
-16.7	2	35.6	12.8
-16.1	3	37.4	13.3
-15.6	4	39.2	13.9
-15.0	5	41.0	14.4
-14.4	6	42.8	15.0
-13.9	7	44.6	15.6
-13.3	8	46.4	16.1
-12.8	9	48.2	16.7
-12.2	10	50.0	17.2
-11.7	11	51.8	17.8
-11.1	12	53.6	18.3
-10.6	13	55.4	18.9
-10.0	14	57.2	19.4
-9.4	15	59.0	20.0
-8.9	16	60.8	20.6
-8.3	17	62.6	21.1
-7.8	18	64.4	21.7
-7.2	19	66.2	22.2
-6.7	20	68.0	22.8
-6.1	21	69.8	23.3
-5.6	22	71.6	23.9
-5.0	23	73.4	24.4
-4.4	24	75.2	25.0
-3.9	25	77.0	25.6
-3.3	26	78.8	26.1
-2.8	27	80.6	26.7
-2.2	28	82.4	27.2
-1.7	29	84.2	27.8
-1.1	30	86.0	28.3
-0.6	31	87.8	28.9
0	32	89.6	29.4
0.6	33	91.4	30.0
1.1	34	93.2	30.6
1.7	35	95.0	31.1
2.2	36	96.8	31.7
2.7	37	98.6	32.2
3.3	38	100.4	32.8
3.9	39	102.2	33.3
4.4	40	104.0	33.9
5.0	41	105.8	34.4
5.6	42	107.6	35.0
6.1	43	109.4	35.6
6.7	44	111.2	36.1
7.2	45	113.0	36.7
7.8	46	114.8	37.2
8.3	47	116.6	37.8
			48
			49
			50
			51
			52
			53
			54
			55
			56
			57
			58
			59
			60
			61
			62
			63
			64
			65
			66
			67
			68
			69
			70
			71
			72
			73
			74
			75
			76
			77
			78
			79
			80
			81
			82
			83
			84
			85
			86
			87
			88
			89
			90
			91
			92
			93
			94
			95
			96
			97
			98
			99
			100



Glossary*

absorptance—the ratio of the radiation absorbed by a surface and the total energy falling on that surface measured as a percentage.

active solar energy system—a system which requires the importation of energy from outside of the immediate environment: e.g., energy to operate fans and pumps.

adobe—a sun-dried, unburned brick of clay (earth) and straw used in construction. Within the United States, adobe is used primarily in the Southwest.

ambient temperature—surrounding temperature, as temperature around a house.

angle of incidence—the angle that the sun's rays make with a line perpendicular to a surface. The angle of incidence determines the percentage of direct sunshine intercepted by a surface. The sun's rays that are perpendicular to a surface are said to be "normal" to that surface. See table II-1 in chapter 2 for the percentage of possible sunshine intercepted by a surface for various angles of incidence.

auxiliary system—a supplementary heating unit to provide heat to a space when its primary unit cannot do so. This usually occurs during periods of cloudiness or intense cold, when a solar heating system cannot provide enough heat to meet the needs of the space.

azimuth—the angular distance between true south and the point on the horizon directly below the sun.

back-up system—see auxiliary system.

Beadwall™—a form of movable insulation developed by David Harrison of Zomeworks Corp., 1212 Edith Blvd. NE, Albuquerque, NM 87102. The system employs tiny polystyrene beads blown into the space between the two sheets of glass (or plastic) in a double-glazed window or skylight.

bearing angle—see azimuth.

berm—a man-made mound or small hill of earth.

*Compiled by Bob Young.

The Passive Solar Energy Book

black body—a theoretically perfect absorber of incident radiation with also the highest possible emittance.

Btu (British thermal unit)—a unit used to measure quantity of heat; technically, the quantity of heat required to raise the temperature of one pound of water 1°F. One Btu = 252 calories. One Btu is approximately equal to the amount of heat given off by burning one kitchen match.

calorie—a unit of heat (metric measure); the amount of energy equivalent to that needed to raise the temperature of one gram of water 1°C. One calorie is approximately equal to 4 Btu's.

caulking—making an airtight seal by filling in cracks around windows and doors.

clerestory—a window that is placed vertically (or near vertical) in a wall above one's line of vision to provide natural light into a building.

collector, flat plate—an assembly containing a panel of metal or other suitable material, usually a flat black color on its sun side, that absorbs sunlight and converts it into heat. This panel is usually in an insulated box, covered with glass or plastic on the sun side to retard heat loss. In the collector, this heat transfers to a circulating liquid or gas, such as air, water, oil or antifreeze, in which it is transferred to where it is used immediately or stored for later use.

collector, focusing—a collector that has a parabolic or other reflector which focuses sunlight onto a small area for collection. A reflector of this type greatly intensifies the heat at the point of collection allowing the storage system to obtain higher temperatures. This type of collector will only work with direct beam sunlight.

collector, solar—a device for capturing solar energy, ranging from ordinary windows to complex mechanical devices.

conductance (C)—the quantity of heat (Btu's) which will flow through one square foot of material in one hour, when there is a 1°F temperature difference between both surfaces. Conductance values are given for a specific thickness of material, not per inch of thickness. For homogeneous materials, such as concrete, dividing the conductivity (k) of the material by its thickness (X) gives the conductance (C).

conduction—the process by which heat energy is transferred through materials (solids, liquids or gases) by molecular excitation of adjacent molecules.

conductivity (k)—the quantity of heat (Btu's) that will flow through one square foot of material, one inch thick, in one hour, when there is a temperature difference of 1°F between its surfaces.

convection—the transfer of heat between a moving fluid medium (liquid or gas) and a surface, or the transfer of heat within a fluid by movements within the fluid.

dead air space (still air space)—a confined space of air. A dead air space tends to reduce both conduction and convection of heat. This fact is utilized in virtually all insulating materials and systems, such as double glazing, Beadwall, fiberglass batts, rigid foam panels, fur and hair, and loose-fill insulations like pumice, vermiculite, rock wool and goose down.

degree-day (DD) cooling—see degree-day for heating, except that the base temperature is established at 75°F, and cooling degree-days are measured above that base.

degree-day (DD) heating—an expression of a climatic heating requirement expressed by the difference in degree F below the average outdoor temperature for each day and an established indoor temperature base of 65°F. (The assumption behind selecting this base is that average construction will provide interior comfort when the exterior temperature is 65°F.) The total number of degree-days over the heating season indicates the relative severity of the winter in that area.

density (ρ)—the mass of a substance which is expressed in pounds per cubic foot.

diffuse radiation—radiation that has traveled an indirect path from the sun because it has been scattered by particles in the atmosphere, such as air molecules, dust and water vapor. Indirect sunlight comes from the entire skydome.

direct radiation—light that has traveled a straight path from the sun, as opposed to diffuse sky radiation.

efficiency—in solar applications, this measure pertains to the percentage of the solar energy incident on the face of the collector (glazing), that is used for space heating.

emissivity—the property of emitting heat radiation; possessed by all materials to a varying extent. "Emittance" is the numerical value of this property, expressed as a decimal fraction, for a particular material. Normal emittance is the value measured at 90 degrees to the plane of the sample and hemispher-

The Passive Solar Energy Book

ical emittance is the total amount emitted in all directions. We are generally interested in hemispherical, rather than normal, emittance. Emittance values range from 0.05 for brightly polished metals to 0.96 for flat black paint. Most nonmetals have high values of emittance.

equinox—either of the two times during a year when the sun crosses the celestial equator and when the length of day and night are approximately equal. These are the autumnal equinox on or about September 22 and the vernal equinox which is on or about March 22.

eutectic salts—salts used for storing heat. At a given temperature, salts melt, absorbing large amounts of heat which will be released as the salts freeze. Example: Glauber's salts. The melt-freeze temperatures vary with different salts and some occur at convenient temperatures for thermal storage such as in the range of 80° to 120°F.

glazing—a covering of transparent or translucent material (glass or plastic) used for admitting light. Glazing retards heat losses from reradiation and convection. Examples: windows, skylights, greenhouse and collector coverings.

glazing, double—a sandwich of two separated layers of glass or plastic enclosing air to create an insulating barrier.

greenhouse effect—refers to the characteristic tendency of some transparent materials such as glass to transmit radiation shorter than about 2.5 microns and block radiation of longer wavelengths.

heat capacity (volumetric)—the number of Btu's a cubic foot of material can store with a one degree increase in its temperature.

heat gain—an increase in the amount of heat contained in a space, resulting from direct solar radiation and the heat given off by people, lights, equipment, machinery and other sources.

heat loss—a decrease in the amount of heat contained in a space, resulting from heat flow through walls, windows, roof and other building envelope components.

infiltration—the uncontrolled movement of outdoor air into the interior of a building through cracks around windows and doors or in walls, roofs and floors. This may work by cold air leaking in during the winter, or the reverse in the summer.

Glossary

insolation—the total amount of solar radiation—direct, diffuse and reflected—striking a surface exposed to the sky. This incident solar radiation is measured in langleys per minute, or Btu's per square foot per hour or per day.

insulation—materials or systems used to prevent loss or gain of heat, usually employing very small dead air spaces to limit conduction and/or convection.

radiation—the direct transport of energy through space by means of electromagnetic waves.

radiation, infrared—electromagnetic radiation, whether from the sun or a warm body, that has wavelengths longer than the red end of the visible spectrum (greater than 0.75 microns). We experience infrared radiation as heat; 49% of the radiation emitted by the sun is in the infrared band.

reflectance—the ratio or percentage of the amount of light reflected by a surface to the amount incident. The remainder that is not reflected is either absorbed by the material or transmitted through it. Good light reflectors are not necessarily good heat reflectors.

resistance (R)—R is the reciprocal of conductivity or X/k . (X = thickness of the material in inches.)

retrofitting—installing solar water heating and/or solar heating or cooling systems in existing buildings not originally designed for the purpose.

R-factor—a unit of thermal resistance used for comparing insulating values of different materials; the reciprocal of the conductivity; the higher the R-factor of a material, the greater its insulating properties. See resistance (R).

skydome (sky vault)—the visible hemisphere of sky, above the horizon, in all directions.

skylight—a clear or translucent panel set into a roof to admit sunlight into a building.

Skytherm™ system—a form of movable insulation and a roof pond system developed by Harold Hay. The system involves motor-driven sliding insulation panels.

solar altitude—the angle of the sun above the horizon measured in a vertical plane.

The Passive Solar Energy Book

solar constant—the amount of radiation or heat energy that reaches the outside of the earth's atmosphere.

solar radiation—electromagnetic radiation emitted by the sun.

solar window—openings that are designed or placed primarily to admit solar energy into a space.

specific heat (Cp)—the number of Btu's required to raise the temperature of one pound of a substance 1°F in temperature.

thermal mass—the amount of potential heat storage capacity available in a given assembly or system. Drum walls, concrete floors and adobe walls are examples of thermal mass.

thermocirculation—the convective circulation of fluid which occurs when warm fluid rises and is displaced by denser, cooler fluid in the same system.

time lag—the period of time between the absorption of solar radiation by a material and its release into a space. Time lag is an important consideration in sizing a thermal storage wall or Trombe wall.

translucent—the quality of transmitting light but causing sufficient diffusion to eliminate perception of distinct images.

transmittance—the ratio of the radiant energy transmitted through a substance to the total radiant energy incident on its surface. In solar technology, it is always affected by the thickness and composition of the glass cover plates on a collector, and to a major extent by the angle of incidence between the sun's rays and a line normal to the surface.

U value (coefficient of heat transfer)—the number of Btu's that flow through one square foot of roof, wall or floor, in one hour, when there is a 1°F difference in temperature between the inside and outside air, under steady state conditions. The U value is the reciprocal of the resistance or R-factor.

vapor barrier—a component of construction which is impervious to the flow of moisture and air and is used to prevent condensation in walls and other locations of insulation.

Glossary

water wall—an interior wall of water-filled containers constituting a one-step heating system which combines collection and storage.

weather stripping—narrow or jamb-width sections of thin metal or other material to prevent infiltration of air and moisture around windows and doors.

Bibliography

Chapter II

- American Society of Heating, Refrigerating and Airconditioning Engineers. 1972. *ASHRAE handbook of fundamentals*. New York: ASHRAE.
- Baer, S. 1975. *Sunspots*. Albuquerque: Zomeworks Corp.
- Brinkworth, B. J. 1974. *Solar energy for man*. New York: John Wiley & Sons.
- Duffie, J. A., and Beckman, W. A. 1974. *Solar energy thermal processes*. New York: John Wiley & Sons.
- Mather, J. R. 1974. *Climatology: fundamentals and applications*. New York: McGraw-Hill Book Co.
- Olgay, V. V. 1963. *Design with climate*. Princeton: Princeton Univ. Press.
- Portola Institute. 1974. *Energy primer: solar, water, wind and biofuels*. Menlo Park, Calif.
- Scientific American Editors, ed. 1971. *Energy and power*. San Francisco: W. H. Freeman & Co.

Chapter III

- AIA Research Corp. 1976. *Solar dwelling design concepts*. U.S. Government Printing Office, Washington, DC 20402, stock no. 023-000-00334-1.
- AIA Research Corp. 1978. *A survey of passive solar buildings*. U.S. Government Printing Office, Washington, DC 20402, stock no. 023-000-00437-2.
- Anderson, B. Ed. by Riordan, M., and Goodman, L. 1976. *The solar home book: heating, cooling, and designing with the sun*. Harrisville, N.H.: Cheshire Books.
- Hay, H. R. et al. 1975. *Research evaluation of a system of natural air conditioning*. San Luis Obispo: California Polytechnic State University.

Bibliography

- Raber, B. F., and Hutchinson, F. W. 1947. *Panel heating and cooling analysis*. New York: John Wiley & Sons.
- Stromberg, R. P., and Woodall, S. O. 1977. *Passive solar buildings: a compilation of data and results*. National Technical Information Service, Springfield, VA 22161, order no. SAND 77-1204.
- U.S. Energy Research and Development Administration. 1977. *Proceedings of the Passive Solar Heating and Cooling Conference*. Albuquerque, 1976. Washington, D.C.

Chapter IV

- Alexander, C. et al. 1976. *A pattern language: towns, buildings, construction*. New York: Oxford Univ. Press.
- Baker, S.; McDaniel, D.; and Kaehn, E. 1977. "Time integrated calculation of the insolation collected by a reflector/collector system." Eugene: Solar Energy Center, University of Oregon.
- Callender, J. H. 1966. *Time-saver standards: a handbook of architectural design*. 4th ed. New York: McGraw-Hill Book Co.
- Calthorpe, P. 1977. *Preliminary comparison study of four solar space heating systems*. Farallones Institute, Occidental, Calif.
- Clark, G.; Loxsom, F.; and Niles, P. 1977. Roof pond cooling vs. active solar cooling in a subtropic marine climate. Presented at the Helioscience Institute International Conference, Palm Springs, Calif., May 1977.
- Duffie, J. A., and Beckman, W. A. 1974. *Solar energy thermal processes*. New York: John Wiley & Sons.
- General Services Administration. 1975. *Energy conservation design guidelines for new office buildings*. 2d ed. Washington, D.C.: GSA Business Service Center.
- Haggard, K. 1977. The architecture of a passive system of diurnal radiation heating and cooling. *Solar energy*, vol. 19, no. 4.

The Passive Solar Energy Book

- Haggard, K., and Niles, P. *Research evaluation of a system of natural air conditioning*. National Technical Information Service, Springfield, VA 22161, order no. PB 243498.
- Haggard, K.; Hay, H.; and Niles, P. 1976. Nocturnal cooling and solar heating with water ponds and moveable insulation. *ASHRAE Transactions*, vol. 82, pt. 1.
- Kegel, R. A. 1975. The energy intensity of building materials. *Heating, piping, air conditioning*, June 1975, pp. 37-40.
- Lawand, T. A. et al. 1977. A greenhouse for northern climates. *Solar age*, October 1977, pp. 10-13.
- Los Alamos Scientific Laboratory. 1976. *Pacific regional solar heating handbook*. 2d ed. U.S. Government Printing Office, Washington, DC 20402, stock no. 060-000-00024-7.
- McCullagh, J. C. 1978. *The solar greenhouse book*. Emmaus, Pa.: Rodale Press.
- MacKillop, A. 1972. Low energy housing. *Ecologist*, December 1972, pp. 4-10.
- Makhijani, A. B., and Lichtenberg, A. J. 1972. Energy and well-being. *Environment*, vol. 14, no. 5: 11-18.
- Mazria, E. 1978. A design and sizing procedure for direct gain, thermal storage wall, attached greenhouse and roof pond systems. *Proceedings of the Second National Passive Solar Conference*, Philadelphia, 1978. Washington, D.C.: U.S. Energy Research and Development Administration.
- Mazria, E.; Baker, M. S.; and Wessling, F. C. 1977. An analytical model for passive solar heated buildings. *Proceedings of the 1977 Annual Meeting of the American Section of the ISES*, vol. 1. Orlando, Fla., June 1977.
- Mazria, E. et al. 1977. *Noti solar greenhouse performance and analysis*. Center for Environmental Research, University of Oregon, Eugene, OR 97403.
- Olgay, V. V. 1963. *Design with climate*. Princeton: Princeton Univ. Press.

Bibliography

Olgay, V. V., and Olgay, A. 1957. *Solar control and shading devices*. Princeton: Princeton Univ. Press.

Raber, B. F., and Hutchinson, F. W. 1947. *Panel heating and cooling analysis*. New York: John Wiley & Sons.

Robinette, G. O. 1972. *Plants, people and environmental quality*. U.S. Government Printing Office, Washington, DC 20402, stock no. 2405-0479.

United Nations. 1971. *Climate and house design*, vol. 1. Department of Economic and Social Affairs, New York.

U.S. Energy Research and Development Administration. 1977. *Proceedings of the Passive Solar Heating and Cooling Conference*. Albuquerque, 1976. Washington, D.C.

Watson, D. 1977. *Designing and building a solar house*. Charlotte, Vt.: Garden Way Publishing.

Wells, M. B. 1977. *Underground designs*. Malcolm Wells, Box 1149, Brewster, MA 02631.

Yanda, B., and Fisher, R. 1976. *The food and heat producing solar greenhouse*. John Muir Publications, P.O. Box 613, Santa Fe, NM 87501.

Chapter V

Mazria, E., and Winitzky, D. 1976. *Solar guide and calculator*. Center for Environmental Research, University of Oregon, Eugene, OR 97403.

Reynolds, J. S. 1976. *Solar energy for Pacific Northwest buildings*. Center for Environmental Research, University of Oregon, Eugene, OR 97403.

Photograph Acknowledgments

- III-2 Maxamillian's restaurant, Albuquerque, New Mexico.
Edward Mazria, designer; Robert Strell, designer.
- III-4 Karen Terry house, Santa Fe, New Mexico.
David Wright, architect; Karen Terry, builder.
- III-8 Attached greenhouse, Bethlehem, Pennsylvania.
Charles Klein, architect.
- III-11 Bus shelter, Snowmass, Colorado.
- IV-1a Fitzgerald residence, Santa Fe, New Mexico.
David Wright, architect; Karen Terry, builder.
- IV-2a Lasar residence, New Milford, Connecticut.
Stephen Lasar, architect.
- IV-2c Lasar residence, New Milford, Connecticut.
Stephen Lasar, architect.
- IV-3a Fitzgerald residence, Santa Fe, New Mexico.
David Wright, architect; Karen Terry, builder.
- IV-3b Lasar residence, New Milford, Connecticut.
Stephen Lasar, architect.
- IV-5a Nichols residence, Santa Fe, New Mexico.
Wayne and Susan Nichols, builders.
- IV-6a Residence, Aspen Mesa, Colorado.
Peter Dobrovolny, architect.
- IV-7a Attached Greenhouse System, Occidental, California.
Peter Calthorpe, designer.
- Roof Pond System, Winters, California.
John Hammond, designer.
- Thermal Storage Wall System, France.
Jacques Michel, architect.

Photograph Acknowledgments

- IV-9a Lasar residence, New Milford, Connecticut.
Stephen Lasar, architect.
- IV-10a Strell residence, Albuquerque, New Mexico.
Robert Strell, designer; Edward Mazria, solar consultant.
- IV-10b Aspen Airport, Aspen, Colorado.
Copland, Finholm, Hagmann and Yaw, architects;
Stephen C. Baer and Ronald Shore, solar consultants.
- IV-10c Maxamillian's restaurant, Albuquerque, New Mexico.
Edward Mazria, designer; Robert Strell, designer.
- IV-11a Stephen C. Baer residence, Corrales, New Mexico.
Stephen C. Baer, designer.
- IV-12a Longview School, Davis, California.
John Hammond, solar consultant.
- IV-12b Residence, Davis, California.
John Hammond, solar consultant.
- IV-13a Lasar residence, New Milford, Connecticut.
Stephen Lasar, architect.
- Longview School, Davis, California.
John Hammond, solar consultant.
- IV-14b Wolf residence, Durango, Colorado.
Brian Kesner, architect.
- Marshall Hunt residence, Davis, California.
John Hammond, solar consultant.
- IV-15a Brown residence, Vermont.
Douglas Taff, Parallax, Hinesburg, Vermont.
- IV-15b Wessling attached greenhouse, Albuquerque, New Mexico.
Edward Mazria, designer; Francis Wessling, mechanical engineer.
- IV-15c Balcomb residence, Santa Fe, New Mexico.
William Lumpkins, architect; Wayne and Susan Nichols, builders.

The Passive Solar Energy Book

- IV-15d Holdridge farmhouse, Hinesburg, Vermont.
Douglas Taff, Parallax, Hinesburg, Vermont.
- IV-16a Lasar residence, New Milford, Connecticut.
Stephen Lasar, architect.
- IV-17a Experimental residence, Atascadero, California.
Kenneth Haggard, architect; Harold Hay, solar system
engineering.
- IV-17b Farallones Institute, Occidental, California.
Peter Calthorpe, designer.
- IV-18a Roof Pond System, Winters, California.
John Hammond, designer.
- IV-18b Experimental residence, Atascadero, California.
Kenneth Haggard, architect; Harold Hay, solar system
engineering.
- IV-19a Farallones Institute, Occidental, California.
Peter Calthorpe, designer.
- IV-19c Greenhouse, Seattle, Washington.
Ecotope Group, designer.
- Greenhouse, Seattle, Washington.
Tim McGee, designer.
- Greenhouse, Noti, Oregon.
Jim Bourquin, John Hermansson and Andrew Laidlaw, designers;
Edward Mazria and Steven Baker, solar consultants.
- IV-20a Greenhouse, Seattle, Washington.
Tim McGee, designer.
- IV-20c Greenhouse, Noti, Oregon.
Jim Bourquin, John Hermansson and Andrew Laidlaw, designers;
Edward Mazria and Steven Baker, solar consultants.
- IV-20d Farallones Institute, Occidental, California.
Peter Calthorpe, designer.

Photograph Acknowledgments

- IV-21a Wolf residence, Durango, Colorado.
Brian Kesner, architect.
- IV-23a Holdridge farmhouse, Hinesburg, Vermont.
Douglas Taff, Parallax, Hinesburg, Vermont.
- IV-24b Dickinson residence, Chico, California.
John Hammond, solar consultant.
- IV-25a Dickinson residence, Chico, California.
John Hammond, solar consultant.
- IV-25b Ike Williams Community Center, Trenton, New Jersey.
John P. Clark, Fred Travisano and Doug Kelbaugh, architects.
- IV-25c Hammond residence, Winters, California.
John Hammond, designer.
- IV-25d Wolf residence, Durango, Colorado.
Brian Kesner, architect.
Marshall Hunt residence, Davis, California.
John Hammond, solar consultant.
- IV-26a First Village, Santa Fe, New Mexico.
Wayne and Susan Nichols, builders.

Photograph Credits

Tom Gettings	II-2; III-2, 6, 8; IV-2a, 2c, 3b, 7a, 9a, 10a, 10c, 10d, 12a, 12b, 13a, 13b, 14a, 15a, 15d, 16a, 17b, 20b, 20e, 22a, 23a, 23b, 23c, 24a, 25b, 25d.
Robert Young	IV-1a, 3a, 7a, 10b, 13a, 15c, 25a, 26a.
Kenneth Haggard	III-9; IV-17a, 18b.
Jacques Michel	III-5, IV-7a.
Marc Schiff	III-3.
Robert Gray	III-1.
Robert Perron	III-6.
NASA	II-1.
Braće Research Institute	IV-9b.
Peter O. Whiteley, <i>Sunset</i> magazine	IV-23c.

Index

A

Absorption

- of heat by thermal mass, 28, 29
- of solar radiation, 15, 16–20
 - by thermal storage wall, 44–45
- of thermal radiation by glass, 24–25

- Active solar heating systems, 28
 - in attached greenhouse, 53, 179, 183–85

- Adobe. *See also* Masonry thermal mass
 - for direct gain systems, 34, 42

- Adobe fireplace, as back-up heating system, 43

- Air lock, as entry, 97

- Air loop rock storage system, 60–62

- Albedo, of the earth, 8–9

- Alexander, Christopher, on the uses of open space, 75–77

- Altitude. *See* Solar altitude

- Angle, of sun's rays, 13–14

- Angle of incidence, 14, 15, 18

- Anticorrosive, in water wall, 42

- Appliances, supplying of interior heat by, 35

- Architecture, new attitude toward, 1–2

- Atascadero residence, as example of indirect gain system, 56

- Atmosphere, solar radiation and, 8–12

- Automatic timers, for movable insulation, 236

- Azimuth. *See* Solar azimuth

B

- Back-up heating systems, 31
 - adobe fireplace as, 43
 - for freestanding greenhouse, 218
 - wood stove as, 40, 52

- Baer residence, as example of indirect gain system, 50–52

- Beadwall, 236

- Bearing angle. *See* Solar azimuth

- Berming, of earth, on north side, 86, 87–88

- Black body, 24

- Body heat, 64
 - supplementing heat systems with, 31, 35

- Brick. *See also* Masonry thermal mass
 - for direct gain systems, 34, 42

C

- Carbon dioxide, absorption of solar radiation by, 10

- Carpeting, 134, 143

- Caulking, of doors, 97

- Clerestories, 84, 125–31
 - in direct gain systems, 34–35, 38
 - angled, 42
 - vented for cooling, 37

- Climate
 - affecting sizing of thermal storage wall, 154
 - as design factor for architecture, 1–2

- Climate, cloudy
 - design allowances for, 228, 229
 - greenhouse wall angles for, 204
 - reflectors and, 243

The Passive Solar Energy Book

- Climate, cold
 direct gain system in, 38-41
 sizing greenhouse for, 173-77
 sizing solar windows for, 119
 sizing thermal storage walls for, 153, 155-57
- Climate, temperate
 sizing greenhouse for, 173-75
 sizing solar windows for, 119
 sizing thermal storage walls for, 153, 155-57
- Closets, location of, 90-91
- Clouds, absorption of solar radiation by, 10
- Cloudy day storage, 226-29
- Collectors, 15
 in active solar heating systems, 28
 in direct gain systems, 29
 flat plate, 59-62
 in indirect gain systems, 44-45, 50, 56
 supplemented with reflectors, 241-48
- Color
 affecting reflection of solar radiation, 24
 affecting reflection of thermal radiation, 24
 of clerestory ceiling, 129
 of masonry thermal mass, 134, 136-40, 142-43
 perception of, 15-16
 for summer cooling, 264
 of thermal storage wall, 166
 of water wall, 145, 149-51
- Combination solar heating systems, 220-24
 direct gain and thermal storage wall, 50-51, 52
- Comfort, of passive solar heating, 64-65
- Concrete. *See also* Masonry thermal mass
 as thermal mass in direct gain system, 31
- Concrete block. *See also* Masonry thermal mass
 for direct gain system, 40, 42
- Conduction, 20, 21
 heat loss by, 232
 in masonry thermal wall, 44, 161, 162
- Conductivity, 21. *See also* Conduction
 affecting of heat storage by, 27
- Convection, 21-23
 in attached greenhouse, 53
 in masonry thermal storage wall, 44-45, 50
 in roof ponds, 56
 in water thermal storage wall, 50, 147
- Convective flow, in convective loop, 60
- Convective loop, 59-62
- Cooling, with solar power, 26, 262-66
 in direct gain systems, 31, 37-38
 in indirect gain systems, 55-56
 with roof ponds, 189
- Corridors, location of, 90-91
- Corrosion, prevention of, in water walls, 42
- Cost
 of passive solar system, 62
 of transportation of building materials, 2

Curtains

- to control thermal storage wall, 51, 236
 - exterior, for shade, 255-57
- Cylindrical sun chart, 267-92

D

- Daily sun paths, 274
- Dampers, to prevent reverse thermocirculation, 50, 159, 166-68
- Davis house, as example of isolated gain system, 60-62
- Density, of construction materials
 - affecting heat capacity, 26
 - affecting thermal radiation, 24
- Depth, of room, determining of, 84
- Diffuse reflection, 15-16
- Diffusion, of solar radiation by atmosphere, 9-12
- Direct gain systems, 29-43, 118-51
 - assessing of, 107-9
 - clerestories in, 34-35
 - cooling with, 31
 - examples of, 31-43
 - masonry heat storage for, 134-43
 - skylights and clerestories for, 125-32
 - solar windows for, 119-23
 - thermal mass and heat storage in, 29-31
 - water wall for, 145-51
- Distribution. See Transportation
- Doors. See Entrance location
- Downdraft, caused by convection, 21
- Drums, 55-gallon, for water wall, 42, 51
- Dust, absorption of solar radiation by, 9, 10

E

- Earth, solar radiation affected by tilt and rotation of, 11-12
- Earth berming, on north side, 86, 87-88
- Electromagnetic radiation, 5-6. See also Solar radiation
- Emissivity, of a surface, 23-24
- Emittance, of a material, 24
- Energy. See also Heat; Thermal energy
 - output of the sun, 5-7
- Energy density, 13
- Entrance location, 94-99
- Equation of time, 288
- Evaporation, of roof ponds for cooling, 189

F

- Fan
 - in attached greenhouse, 53
 - for ventilation, 121
- Fence, as windbreak, 97
- Fiberglass tanks, for roof ponds, 197
- Fireplace, adobe, as back-up heating system, 43
- Flat plate collector, in isolated gain system, 59-62
- Floor, as thermal mass
 - in direct gain system, 40
 - insulation of, 259, 261
 - maintaining comfort of, 65
- Forced convection, 22-23
- Foyers, 94, 97
- Frequencies, of solar wavelengths, 7
- Fusion. See Thermonuclear fusion

The Passive Solar Energy Book

G

- Garage, location of, 90–91
- Glare, 125, 127
- Glass. *See also* Glazing
 - absorption of thermal radiation by, 24–25
 - as collector in passive systems, 28, 29
 - transmitting of solar radiation by, 17–19, 24–25
- Glazing. *See also* Glass
 - double, 101, 104, 122
 - for roof ponds, 191–92
 - greenhouse effect and, 25
 - insulated, 232–33
 - tilted for greenhouse, 204
 - transmission characteristics of, 17–19
- Gravitational contraction, of hydrogen, 5
- Greenhouse effect, 24–25
- Greenhouse, attached
 - assessing of, 111–12
 - common thermal wall in, 181–85
 - in indirect gain systems, 48, 52–55
 - retrofitting to wood frame building, 178–79
 - sizing of, 173–79
 - thermal mass in, 174, 177
- Greenhouse, freestanding, 201–18
 - active rock storage system for, 210, 213–16
 - back-up heating system for, 218
 - masonry thermal mass for, 209, 210–12
 - water wall for, 209, 213
- Guidelines. *See* Patterns

H

- Heat, 20
 - from interior lights, 31
 - loss of, 94, 97, 101
 - from people, 31
 - storage of, 25–27
 - transfer of, 20–25
- Heat capacity, 26
- Horizontal overhang, shading mask for, 305–6
- Hydrogen, in the sun, 5

I

- Indirect gain systems, 29, 43–58
 - assessing of, 109–14
 - attached greenhouses in, 48, 52–55
 - roof ponds in, 55–58
 - thermal storage wall in, 43–51, 53, 55–56
 - sizing of, 153–57
- Indoor spaces, location of, 90–92
- Infrared radiation, 7, 10
- Insulation, exterior, 259–61
- Insulation, movable, 231–39
 - hand operated, 236
 - motor driven, 236, 239
 - for roof pond, 56, 189, 194–95, 197–99
 - thermally sensitive, 236
 - for thermal storage wall, 51, 156
- Intensity, of solar radiation, 13–15
- Iron, in-glass, 18–19
- Isolated gain systems, 29, 59–62

K

- Kelbaugh house, as example of indirect gain system, 48–50

L

- Latitude, affecting sizing of thermal storage wall, 154
- Latitude variations, of sun's path, 277
- Laundry room, location of, 90-91
- Light
 - as part of sun's energy, 7
 - speed of, 7
- Lighting, interior
 - heat supplied by, 31, 35
 - from solar radiation, 84
- Location, of building, 72-77. *See also* Shape and orientation
- Louvers, 218, 236

M

- Magnetic variations, of sun's path, 277-78
- Masonry thermal mass
 - compared to water wall, 170-71
 - in direct gain systems, 29-30, 31, 34-35, 40, 42
 - specifications for, 134-43
 - in indirect gain systems, 44-50
 - thicknesses for, 159, 161-63, 166
- Materials, for building, 115-17
- Maxamillian's, as example of direct gain system, 34-38
- Mean radiant temperature, 64
- Microns, definition of, 7
- Monthly sun paths, 275

N

- Natural convection, 21. *See also* Convection
- Natural convective loop. *See* Convective loop

- North side, utilizing of, 86-89
- Noti greenhouse, 215

O

- Obstructions
 - to solar radiation, 73, 74
 - to south wall, 125, 127
 - to wind, 88, 97
- Olgyay, Victor, on building shapes, 80-82
- Outdoor spaces
 - north side, 86-88
 - south side, 75-77
- Overhangs, 250-57
 - adjustable, 253-54, 255-57
 - horizontal, 250-52
- Overheating
 - caused by allowances for cloudy days, 229
 - caused by improperly sized storage walls, 153, 159, 162
 - caused by oversized windows, 119, 120
- Ozone, absorption of solar radiation by, 10

P

- Patterns, for designing passive solar systems, 66-266
 - attached greenhouse systems, 172-85
 - choosing the system, 106-14
 - direct gain systems, 118-51
 - entrance location, 94-99
 - greenhouses, 200-266
 - location of building, 72-77
 - location of indoor spaces, 90-92
 - materials for, 115-17
 - north side, of building, 85-89

The Passive Solar Energy Book

Patterns (continued)

- roof pond systems, 186–99
- shape and orientation of building, 78–84
- thermal storage walls, 152–71
- use of, 66–71
- window location, 101–4

Photons, 6

Plastic, as glazing for greenhouse effect, 25

Pollution. See Thermal pollution

Polyethylene, for roof ponds, 197

Polyvinyl chloride, for roof ponds, 197

Ponds, roof. See Roof ponds

Prevailing winter winds, 86, 88, 94, 97

R

Radiation. See also Solar radiation;
Thermal radiation
of heat, 23–24

Reflection

- of solar radiation, 15
- of thermal radiation, 24–25

Reflectors, 51, 241–48

- comparing finishes of, 248
- for interior surfaces, 246, 248
- for roof ponds, 189, 191
- for skylights, 132, 241, 245–46
- tilt angle for, 241, 242–43
- for vertical glazing, 241

Retrofitting, of passive solar systems,
109, 110, 111, 113

Reverse thermocirculation, 50

Rocks, storing heat in, 60, 62

- for attached greenhouse,
183–85

- for freestanding greenhouse,
210, 213–16

Roof ponds, 55–58, 194–99

- assessing of, 112–14
- insulating panels for, 194–95,
197–99
- sizing of, 187–92
- temperature stratification in,
197
- waterproofing of, 196

Rotation, of earth, affecting of solar radiation by, 11–12

Rules of thumb. See Patterns

Rust inhibitor. See Anticorrosive

S

St. George's County Secondary
School, as example of direct gain
system, 31–33

Sash construction, 122–23

Sawtooth clerestories, 34, 38, 130

Schiff residence, as example of direct
gain system, 38–41

Seasonal sun paths, 275

Seasons

- cause of, 12
- solar radiation during, 102–3

Shading calculator, 301–4

- plotting shading masks with,
305–8

Shading devices, 250–57, 264

- adjustable overhangs, 253–54,
255–57

- for east and west windows, 255

- for interior, 254

- sizing of horizontal overhangs,
250–52

Shading masks, 305–8

- for horizontal overhang, 305–6
- for vertical fins, 306–8

Shape and orientation, of building,
78–84

- Shrubs
 for shade, 255
 as windbreak, 88, 97
 Shutters, 236, 239
 Siding, for exterior, 260
 Skydome, 272
 Skylids, 236
 Skylights, 84, 125, 132
 Skyline, how to plot, 290-92
 Sky vault. *See* Skydome
 Slate, as thermal mass floor, 40
 Solar altitude, 269, 270
 Solar azimuth, 269, 271
 Solar collectors. *See* Collectors
 Solar Constant, 7
 Solar greenhouse. *See* Greenhouse,
 attached; Greenhouse,
 freestanding
 Solar heating:
 active systems, 28, 53, 179,
 183-85
 passive systems, 28-65
 advantages of, 62-65
 direct gain, 29-43
 disadvantages of, 65
 indirect gain, 43-58
 isolated gain, 59-62
 selecting of, 106-14
 principle of heat storage in,
 25-27
 Solar intensity masks, 293
 Solar noon, 288
 Solar radiation, 5-7. *See also* Heat
 absorption of, 18-20
 affected by seasons, 102-3
 earth's atmosphere and, 8-12
 intensity of, on a surface, 13-15
 reflection of, 15
 transmission of, 16-17
 Solar radiation calculator, 293-300
 daily radiation totals for, 296
 hourly radiation totals for,
 295-96
 Solar windows
 for direct gain systems, 119-23
 sizing of, 119-22
 disadvantages of, 125
 location of, 101-4
 Space air temperature, 64. *See also*
 Temperature, fluctuations indoors
 Specific heat, 26
 Specular reflection, 15-16
 Square houses, for passive solar
 systems, 80, 81
 Steel deck, for roof pond, 56, 194,
 196
 Stone. *See* Masonry thermal mass
 Storage tank
 for attached greenhouse,
 183-85
 for freestanding greenhouse,
 210, 213-16
 in isolated gain system, 60, 62
 Stucco, for exterior, 260
 Sun. *See also* Solar radiation
 calculating position of, 273
 daily path of, 274
 declination of, 267
 energy output of, 5-7
 monthly paths of, 275
 movement of, across skydome,
 267-92
 origin of, 5
 position of, in relation to earth's
 orbit, 7
 Sun chart. *See* Cylindrical sun chart
 Sundial, determining building
 location with, 75
 Sun time, 73, 277, 288-90
 standard time converted to, 290

The Passive Solar Energy Book

Technology, effect of, on
architecture, 1-2

Temperature, 20. *See also* Mean
radiant temperature; Space air
temperature

controlling amount of heat
radiated, 23.

fluctuations indoors

in attached greenhouse, 183

in direct gain systems, 31, 35,
136-41, 149

in freestanding greenhouse,
207, 210, 213, 216

in indirect gain systems, 50,
51-52, 56, 163

stratification, in roof ponds, 197
of sun, 7

Terry house, as example of direct
gain system, 42-43

Thermal control. *See also*

Temperature, fluctuations indoors

of attached greenhouse, 111

of direct gain system, 108

of roof pond, 113

of thermal storage wall, 110, 168

Thermal energy, 20. *See also* Heat

Thermal mass, 28-29

in direct gain systems, 29-31,
34-35, 40, 42

in indirect gain systems, 43-51,
53, 55-56

Thermal pollution, 1-2

Thermal radiation, 23, 24, 25

in attached greenhouse, 53

by thermal storage wall, 45

Thermal storage walls, 43-44

masonry, 44-50

efficiency of, 45

sizing of, 153-57

surface color of, 166

thickness of, 161-63, 166

vents and dampers in, 166-68

water, 50-52

Thermocirculation, 44. *See also*

Convection

reverse, 50

Thermocirculation vents. *See*

Ventilation

Thermonuclear fusion, 5-6

Thermosiphoning hot water heater,
60

Thermostats, for movable insulation,
236

Tilt

of earth, affecting solar
radiation, 11-12

of reflectors, 241, 242-43

of south wall of greenhouse,
204

Time lag, 265

Timers, automatic, for movable
insulation, 236

Translucent glazing

for clerestories, 130

definition of, 17

used in direct gain system, 31,
34-35

Transmission

of solar radiation, 15, 16-17

of thermal radiation, 24-25

Transmissivity. *See* Transmission

Transparent, definition of, 17

Transportation, as cost factor in
construction, 2, 115, 117

Trees

shade from, 50, 73, 255

as windbreak, 88, 97

Trombe house, as example of
indirect gain system, 45-46

Trombe wall, 166-67
 True north, 277-78
 True south, 279

U

Ultra-violet radiation, 7, 10

V

Vegetation

for shade, 254-55, 263
 for windbreak, 263

Ventilation

of direct gain systems, 120, 121
 of freestanding greenhouse, 216
 for summer cooling, 262-66
 of thermal storage walls, 159,
 166-68

Vertical fins, shading mask for, 306-8

Vestibules, 94, 97

W

Water. See also Roof ponds; Water wall

convection in, 21-23
 as heat storage medium, 147

Waterproofing, below grade, 259,
 261

Water vapor, absorption of solar radiation by, 10

Water wall

compared to masonry wall,
 170-71

corrosion in, 42

in direct gain systems, 29, 30,
 42, 145-51

in indirect gain systems, 50-52,
 volume of, 145, 148, 162

Wavelengths, of solar radiation, 7,
 15-16

Weather, seasonal variation in, 12.
 See also Climate

Weather stripping, of doors, 97

Width, of building, how to
 determine, 84

Wind. See Prevailing winter winds

Windbreaks, 88, 97, 263

Windows. See Solar windows

Wing walls, as windbreak, 97

Wood stoves, as back-up heating
 system, 40, 52